

WING

XW570K

1. GENERAL WARNING

1.1 PLEASE READ BEFORE USING THIS MANUAL

- This manual is part of the product and should be kept near the instrument for easy and quick reference.
- The instrument shall not be used for purposes different from those described hereunder. It cannot be used as a safety device.
- Check the application limits before proceeding.
- Dixell Srl reserves the right to change the composition of its products, even without notice, ensuring the same and unchanged functionality.

1.2 SAFETY PRECAUTIONS

- Check the supply voltage is correct before connecting the instrument.
- Do not expose to water or moisture: use the controller only within the operating limits avoiding sudden temperature changes with high atmospheric humidity to prevent formation of condensation
- Warning: disconnect all electrical connections before any kind of maintenance.
- Fit the probe where it is not accessible by the End User. The instrument must not be opened.
- In case of failure or faulty operation send the instrument back to the distributor or to "Dixell s.r.l." (see address) with a detailed description of the fault.
- Consider the maximum current which can be applied to each relay (see Technical Data).
- Ensure that the wires for probes, loads and the power supply are separated and far enough from each other, without crossing or intertwining.
- In case of applications in industrial environments, the use of mains filters (our mod. FT1) in parallel with inductive loads could be useful.

2. GENERAL DESCRIPTION

Each model in the **XW500** series is fitted with a Real Time Clock which allows programming of up to eight daily defrost cycles, divided into holidays and workdays. A "Day and Night" function with two different set points is fitted for energy saving.

Model **XW570K** is microprocessor based controllers suitable for applications on medium or low temperature refrigerating units. It must be connected by means of a two-wire cable (\varnothing 1mm) at a distance of up to 30 meters to the keyboards **T850**. They are provided with six relay outputs to control compressor, defrost - which can be either electrical or hot gas - the evaporator fans, the lights, the alarm and an auxiliary output. They are also provided with three NTC probe inputs, one for temperature control, one to control the defrost end temperature of the evaporator and the third, optional, for the display. There are two digital inputs (free contact) for the door switch and configurable by parameter.

The standard TTL output allows the user to connect, by means of a TTL/RS485 external module, a **ModBUS-RTU** compatible monitoring system and to programme the parameter list with the "Hot Key". A **4÷20 mA** output to control evaporator or condenser fans and the direct serial output **RS485** are available as options.

3. CONTROLLING LOADS

3.1 THE COMPRESSOR

The regulation is performed according to the temperature measured by the thermostat probe with a positive differential from the set point: if the temperature increases and reaches set point plus differential the compressor is started and then turned off when the temperature reaches the set point value again.

In case of fault in the thermostat probe the start and stop of the compressor are timed through parameters "COn" and "COF".

3.2 FAST FREEZING

When defrost is not in progress, it can be activated the keypad by holding the \blacktriangle key pressed for about 3 seconds. The compressor operates in continuous mode for the time set through the "CCt" parameter. The cycle can be terminated before the end of the set time using the same activation key, \blacktriangle for about 3 seconds.

3.3 DEFROST

Three defrost modes are available through the "tdF" parameter: defrost with electrical heater, hot gas or thermostatic defrost. The defrost interval is control by means of parameter "EdF": (EdF = rtc) the defrost is made in real time depending on the hours set in the parameters **Ld1...Ld8** on workdays and in **Sd1...Sd8** in holidays; (EdF = in) the defrost is made every "ldF" time, (EdF=Sd) the interval "ldF" is calculate through Smart Defrost algorithm (only when the compressor is ON and the evaporator temperature is bigger than "SdF" parameter). At the end of defrost the drip time is controlled through the "FdT" parameter.

3.4 CONTROL OF EVAPORATOR FANS

The fan control mode is selected by means of the "FnC" parameter:

- C-n** = running with the compressor, OFF during the defrost;
- C-y** = running with the compressor, ON during the defrost;
- O-n** = continuous mode, OFF during the defrost;
- O-y** = continuous mode, ON during the defrost;

An additional parameter "FSI" provides the setting of temperature, detected by the evaporator probe, above which the fans are always OFF. This can be used to make sure circulation of air only if his temperature is lower than set in "FSI".

3.5 AUXILIARY OUTPUT

The auxiliary output is switch ON and OFF by means of the corresponding button on the keyboard.

4. KEYBOARD



set

To display and modify target set point; in programming mode it selects a parameter or confirm an operation.
By holding it pressed for 3s when max or min temperature is displayed it will be erased.
By pressing it when the current time is displayed, it allows the User to re-set the current time and three holidays.

To see the max. stored temperature; in programming mode it browses the parameter codes or increases the displayed value. By holding it pressed for 3s the fast freezing cycle is started.

To see the min stored temperature; in programming mode it browses the parameter codes or decreases the displayed value.
By holding it pressed for 3s the current time is displayed and it permits the User to enter Energy saving, Defrost and Clock parameter menu.

By holding it pressed for 3s the defrost is started.
By pressing it when the current time is displayed, it allows the User to set defrost times.

Switch ON and OFF the cold room light.

By holding it pressed for 3s Energy Saving function is started or stopped.
By holding it pressed for 6s, the Holiday function is started or stopped.
By pressing it when the current time is displayed, it allows the User to set Energy Saving times.

aux

Switch ON and OFF the auxiliary output.

Switch ON and OFF the instrument.

KEY COMBINATIONS

+

To lock and unlock the keyboard.

set

+

To enter the programming mode.

set

+

To exit the programming mode.

4.1 USE OF LEDS

Each LED function is described in the following table.

LED	MODE	Function
	ON	The compressor is running
	FLASHING	- Programming Phase (flashing with LED) - Anti-short cycle delay enabled
	ON	The fan is running
	FLASHING	Programming Phase (flashing with LED)
	ON	The defrost is enabled
	FLASHING	Drip time in progress
	ON	The Fast Freezing cycle is enabled
	ON	- ALARM signal - In "Pr2" indicates that the parameter is also present in "Pr1"

Function of the LEDs placed on the left top side of buttons:

BUTTON	MODE	FUNCTION
DOWN/CLOCK	ON	Time is displayed
DOWN/CLOCK	FLASHING	Programming time is enabled
DOWN/CLOCK	SLOW FLASHING	Holiday function is ON
SET	FLASHING	The Set point is displayed and it can be modified
DEFROST	ON	The Manual Defrost is activated
DEFROST	FLASHING	Defrost times programming is enabled
ENERGY SAVING	ON	The Energy Saving is enabled
ENERGY SAVING	FLASHING	Energy saving times programming is enabled
LIGHT	ON	The Light is ON
AUX	ON	The Auxiliary output is ON
ON/OFF	ON	The instrument is OFF

4.2 HOW TO SEE THE MIN TEMPERATURE



1. Press and release the \blacktriangledown key.
2. The "Lo" message will be displayed followed by the minimum temperature recorded.
3. By pressing the \blacktriangledown key or waiting for 5s the normal display will be restored.

4.3 HOW TO SEE THE MAX TEMPERATURE

1. Press and release the key.
2. The "Hi" message will be displayed followed by the maximum temperature recorded.
3. By pressing the key or waiting for 5s the normal display will be restored.

4.4 HOW TO RESET THE MAX AND MIN TEMPERATURE RECORDED

To reset the stored temperature, when max or min temperature is displayed :

1. Press SET key until "rST" label starts blinking.

N.B. After the installation RESET the temperature stored .

4.5 HOW TO SEE AND MODIFY THE SET POINT

1. Push and immediately release the **SET** key: the display will show the Set point value;
2. The SET LED start blinking;
3. To change the Set value push the Or arrows within 10s.
4. To memorise the new set point value push the **SET** key again or wait 10s.

4.6 TO START A MANUAL DEFROST

1. Push the **DEF** key for more than 2 seconds and a manual defrost will start.

4.7 TO ENTER IN PARAMETERS LIST "Pr1"

To enter the parameter list "Pr1" (user accessible parameters) operate as follows:

1. Enter the Programming mode by pressing the Set and DOWN key for few seconds (and start blinking).
2. The instrument will show the first parameter present in "Pr1"

4.8 TO ENTER IN PARAMETERS LIST "Pr2"

To access parameters in "Pr2":

1. Enter the "Pr1" level.
2. Select "Pr2" parameter and press the **SET** key.
3. The "PAS" flashing message is displayed, shortly followed by "0 -" with a flashing zero.
4. Use Or to input the security code in the flashing digit; confirm the figure by pressing **SET**. The security code is "321".
5. If the security code is correct the access to "Pr2" is enabled by pressing **SET** on the last digit.

Another possibility is the following: after switching ON the instrument the user can push Set and DOWN keys within 30 seconds.

NOTE: each parameter in "Pr2" can be removed or put into "Pr1" (user level) by pressing **SET** + . When a parameter is present in "Pr1" LED is on.

4.9 HOW TO CHANGE THE PARAMETER VALUE

1. Enter the Programming mode.
 2. Select the required parameter with Or .
 3. Press the **SET** key to display its value (and LED starts blinking).
 4. Use Or to change its value.
 5. Press **SET** to store the new value and move to the following parameter.
- To exit:** Press **SET** + **UP** or wait 15s without pressing a key.
- NOTE:** the new programming is stored even when the procedure is exited by waiting the time-out.

4.10 HOW TO LOCK THE KEYBOARD

1. Keep the and keys pressed together for more than 3 s the and keys.
2. The "POF" message will be displayed and the keyboard is locked. At this point it is only possible the viewing of the set point or the MAX o Min temperature stored and to switch ON and OFF the light, the auxiliary output and the instrument.

TO UNLOCK THE KEYBOARD

Keep the and keys pressed together for more than 3s.

4.11 ON/OFF FUNCTION

- By pushing the **ON/OFF** key, the instrument shows "OFF" for 5 sec. and the ON/OFF LED is switched ON.
 - During the OFF status, all the relays are switched OFF and the regulations are stopped; if a monitoring system is connected, it does not record the instrument data and alarms.
- N.B. During the OFF status the Light and AUX buttons are active.**

4.12 TO SEE THE PROBE VALUES

1. Enter in "Pr2" level.
2. Select "Prd" parameter with or .
3. Press the **SET** key to display "Pb1" label alternate with Pb1 value.
4. Use and keys to display the other probe values.
5. Press **SET** to move to the following parameter.

5. REAL TIME CLOCK FUNCTIONS

5.1 TO SEE THE CURRENT TIME AND DAY

1. Push the key for more than 3 seconds
2. LED switches ON and the following messages are displayed:
Hur (hour); **Min** (Minute); **dAY** (day = giorno)
3. To exit push key or wait 5 seconds

5.2 TO SET THE TIME AND THE WEEKLY HOLIDAYS

1. Push the key for more than 3 seconds
2. LED switches ON and the current time is displayed.
3. By pushing the SET key, the LED will start flashing and setting the current hour, minutes, day and the weekly holidays (up to 3) will be possible.
4. To exit, press **SET** + **UP** or wait 15s without pressing any key.

5.3 TO SET THE DEFROST TIMES

1. Push the key for more than 3 seconds
2. LED switches ON and the current time is displayed.
3. By pushing DEF key, the DEF led will start flashing and setting defrost time will be possible.
4. To exit, press **SET** + **UP** or wait 15s without pressing any key.

5.4 TO SET THE ENERGY SAVING TIMES

1. Push the key for more than 3 seconds
2. LED switches ON and the current time is displayed.
3. By pushing the ES key, the ES led will start flashing and setting Energy Saving time will be possible.
4. To exit, press **SET** + **UP** or wait 15s without pressing any key.

5.5 TO START HOLIDAY FUNCTION BY USING THE KEYBOARD

1. Push the ES key for more than 6 seconds until the label "Hd" is shown.
2. LED will start to blink slower than during time programming and the regulators will follow holiday times.
3. Push the ES key for more than 6 seconds to start normal functioning again.

6. PARAMETER LIST

REGULATION

- Hy Differential:** (0.1÷25.5°C; 1÷45°F): Intervention differential for set point, always positive. Compressor Cut IN is Set Point Plus Differential (Hy). Compressor Cut OUT is when the temperature reaches the set point.
- LS Minimum set point limit:** (-50,0°C÷SET; -58°F÷SET) Sets the minimum acceptable value for the set point.
- US Maximum set point limit:** (SET÷110°C; SET÷230°F) Set the maximum acceptable value for set point.
- OdS Outputs activation delay at start up:** (0÷255 min) This function is enabled at the initial start up of the instrument and inhibits any output activation for the period of time set in the parameter. (AUX and Light can work)
- AC Anti-short cycle delay:** (0÷30 min) interval between the compressor stop and the following restart.
- CCT Thermostat override:** (0min ÷23h 50min) allows to set the length of the continuous cycle. Can be used, for instance, when the room is filled with new products.
- Con Compressor ON time with faulty probe:** (0÷255 min) time during which the compressor is active in case of faulty thermostat probe. With Con=0 compressor is always OFF.
- COF Compressor OFF time with faulty probe:** (0÷255 min) time during which the compressor is off in case of faulty thermostat probe. With COF=0 compressor is always active.

DISPLAY

- CF Temperature measurement unit:** °C = Celsius; °F = Fahrenheit . When the measurement unit is changed the SET point and the values of the regulation parameters have to be modified
- rES Resolution (for °C):** (in = 1°C; de = 0,1°C) allows decimal point display.
de = 0,1°C
in = 1 °C
- Red Remote display :** select which probe is displayed by the remote display (**T850**)
P1 = Thermostat probe
P2 = Evaporator probe
P3 = auxiliary probe
1r2 = difference between P1 and P2 (P1-P2)

DEFROST

- tdF Defrost type:**
rE = electrical heater (Compressor OFF)
rT = thermostat defrost. During the defrost time "MdF", the heater switches On and OFF depending on the evaporator temperature and "dtE" value.
in = hot gas (Compressor and defrost relays ON)
- EdF Defrost mode:**
rtc = **Real Time Clock mode.** Defrost time follows **Ld1÷Ld8** parameters on workdays and **Sd1÷Sd8** on holidays.
in = **interval mode.** The defrost starts when the time "IdF" is expired.
Sd = **Smart Defrost mode.** The time IdF (interval between defrosts) is increased only when the compressor is running (even non consecutively) and only if the evaporator temperature is less than the value in "SdF" (set point for SMARTFROST).
- SdF Set point for SMARTFROST:** (-30÷30 °C/ -22÷86 °F) evaporator temperature which allows the IdF counting (interval between defrosts) in SMARTFROST mode.
- dtE Defrost termination temperature:** (-50,0÷110,0°C; -58÷230°F) (Enabled only when the evaporator probe is present) sets the temperature measured by the evaporator probe which causes the end of defrost.
- IdF Interval between defrosts:** (1÷120h) Determines the time interval between the beginning of two defrost cycles.
- MdF (Maximum) duration of defrost:** (0÷255 min) When **P2P** = n, no evaporator probe, it sets the defrost duration, when **P2P** = y, defrost end based on temperature, it sets the maximum length for defrost.
- dFd Display during defrost:**
rt = real temperature;
it = temperature reading at the defrost start;
Set = set point;
dEF = "dEF" label;

dEG = "dEG" label;

dAd Defrost display time out: (0÷255 min) Sets the maximum time between the end of defrost and the restarting of the real room temperature display.

Fdt Drain down time: (0÷60 min.) time interval between reaching defrost termination temperature and the restoring of the control's normal operation. This time allows the evaporator to eliminate water drops that might have formed due to defrost.

dPO First defrost after start-up:

y = Immediately;

n = after the 1dF time

dAF Defrost delay after fast freezing: (0min÷23h 50min) after a Fast Freezing cycle, the first defrost will be delayed for this time.

FANS

FnC Fan operating mode:

C-n = running with the compressor, OFF during the defrost;

C-y = running with the compressor, ON during the defrost;

O-n = continuous mode, OFF during the defrost;

O-y = continuous mode, ON during the defrost;

Fnd Fan delay after defrost: (0÷255 min) The time interval between the defrost end and evaporator fans start.

FSt Fan stop temperature: (-50÷110°C; -58÷230°F) setting of temperature, detected by evaporator probe, above which the fan is always OFF.

ALARMS

ALC Temperature alarm configuration

rE = High and Low alarms related to Set Point

Ab = High and low alarms related to the absolute temperature.

ALU High temperature alarm setting:

ALC= rE, 0 + 50°C or 90°F

ALC= Ab, ALL ÷ 110°C or 230°F

when this temperature is reached and after the ALd delay time the HA alarm is enabled.

ALL Low temperature alarm setting:

ALC = rE, 0 + 50 °C or 90°F

ALC = Ab, - 50°C or -58°F + ALU

when this temperature is reached and after the ALd delay time, the LA alarm is enabled..

AFH Temperature alarm and fan differential: (0,1÷25,5°C; 1÷45°F) Intervention differential for temperature alarm set point and fan regulation set point, always positive.

ALd Temperature alarm delay: (0÷255 min) time interval between the detection of an alarm condition and the corresponding alarm signalling.

dAO Delay of temperature alarm at start-up: (0min÷23h 50min) time interval between the detection of the temperature alarm condition after the instrument power on and the alarm signalling.

EdA Alarm delay at the end of defrost: (0÷255 min) Time interval between the detection of the temperature alarm condition at the end of defrost and the alarm signalling.

dot Delay of temperature alarm after closing the door : (0÷255 min) Time delay to signal the temperature alarm condition after closing the door.

doA Open door alarm delay:(0÷254min,nu) delay between the detection of the open door condition and its alarm signalling: the flashing message "dA" is displayed. If **doA=nu** the door alarm will be not signalled.

tbA Buzzer and alarm relay silencing: by pushing one of the keypad buttons.

n= Only the Buzzer is silenced;

y= Buzzer and relay are silenced.

nPS Pressure switch number: (0 ÷15) Number of activation of the pressure switch, during the "did" interval, before signalling the alarm event (I2F= PAL).

ANALOGUE OUTPUT 4÷20 mA (OPTIONAL)

AOS Analogue output start point: (-50÷110°C or -58÷230°F). Sets the temperature at which the analogue output begins.

APB Analogue output band width: (-50÷110°C or -58÷230°F) sets the width of the regulation band for the analogue output. If APb is **positive** then it is above the start point and the kind of action is direct (condenser application). If APb is **negative** then it is below the start point and the kind of action is inverse (evaporator application).

CAO Input type for the analogue output: four input types can be selected:

P1 = room probe temperature;

P2 = evaporator probe temperature;

P3 = temperature of the third probe;

1r2= temperature difference between the room probe and the evaporator probe

PROBE INPUTS

Ot Thermostat probe calibration: (-12,0÷12,0°C/ -21÷21°F) allows to adjust possible offset of the thermostat probe.

OE Evaporator probe calibration: (-12,0÷12,0°C/ -21÷21°F) allows to adjust possible offsets of the evaporator probe.

O3 Auxiliary probe calibration: (-12,0÷12,0°C/ -21÷21°F) allows to adjust possible offsets of the evaporator probe.

P2P Evaporator probe presence:

n= not present: the defrost stops only by time; y= present: the defrost stops by temperature and time.

P3P Auxiliary probe presence: n= not present; y= present.

HES Temperature increase during the Energy Saving cycle : (-30÷30°C / -54÷54°F) sets the increasing value of the set point during the Energy Saving cycle.

DIGITAL INPUTS

odc Compressor and fan status when open door:

no = normal;

Fan = Fan OFF;

CPPr = Compressor OFF;

F_C = Compressor and fan OFF.

I1P Door switch input polarity:

CL : the digital input is activated by closing the contact;

OP : the digital input is activated by opening the contact.

I2P Configurable digital input polarity:

CL : the digital input is activated by closing the contact;

OP : the digital input is activated by opening the contact

I2F Digital input operating mode: configure the digital input function:

EAL = generic alarm;

bAL = serious alarm mode;

PAL = Pressure switch;

dFr = Start defrost;

AUS = Relay AUX actuation;

Es = Energy Saving;

onF = remote On/OFF.

Hdf = Holiday function.

did Time interval/delay for digital input alarm:(0÷255 min.) Time interval to calculate the number of the pressure switch activation when I2F=PAL. If I2F=EAL or bAL (external alarms), "did" parameter defines the time delay between the detection and the successive signalling of the alarm.

TO SET CURRENT TIME AND WEEKLY HOLIDAYS (3SEC. afterward

Hur Current hour (0 ÷ 23 h)

Min Current minute (0 ÷ 59min)

dAY Current day (Sun ÷ SAT)

Hd1 First weekly holiday (Sun ÷ nu) Set the first day of the week which follows the holiday times.

Hd2 Second weekly holiday (Sun ÷ nu) Set the second day of the week which follows the holiday times.

Hd3 Third weekly holiday (Sun ÷ nu) Set the third day of the week which follows the holiday times.

N.B. Hd1,Hd2,Hd3 can be set also as "nu" value (Not Used).

TO SET ENERGY SAVING TIMES (3SEC. afterward

ILE Energy Saving cycle start during workdays: (0 ÷ 23h 50 min.) During the Energy Saving cycle the set point is increased by the value in HES so that the operation set point is SET + HES.

dLE Energy Saving cycle length during workdays: (0 ÷ 24h 00 min.) Sets the duration of the Energy Saving cycle on workdays.

ISE Energy Saving cycle start on holidays. (0 ÷ 23h 50 min.)

dSE Energy Saving cycle length on holidays (0 ÷ 24h 00 min.)

HES Temperature increase during the Energy Saving cycle (-30÷30°C / -54÷54°F) sets the increasing value of the set point during the Energy Saving cycle.

TO SET DEFOST TIMES (3SEC. afterward

Ld1÷Ld8 Workday defrost start (0 ÷ 23h 50 min.) These parameters set the beginning of the eight programmable defrost cycles during workdays. Ex. When **Ld2** = 12.4 the second defrost starts at 12.40 during workdays.

Sd1÷Sd8 Holiday defrost start (0 ÷ 23h 50 min.) These parameters set the beginning of the eight programmable defrost cycles on holidays. Ex. When **Sd2** = 3.4 the second defrost starts at 3.40 on holidays.

N.B. : **To disable a defrost cycle set it to "nu"(not used).**

Ex. If **Ld6=nu** ; the sixth defrost cycle is disabled

OTHER

Adr RS485 serial address (1÷247): Identifies the instrument address when connected to a ModBUS compatible monitoring system.

Rel Release software: (read only) Software version of the microprocessor.

Ptb Parameter table: (read only) it shows the original code of the Dixell parameter map.

Prd Probes display: (read only) display the temperature values of the evaporator probe Pb2 and the auxiliary probe Pb3.

Pr2 Access to the protected parameter list (read only).

7. DIGITAL INPUTS

The Wing series can support up to 2 free contact digital inputs. One is always configured as door switch, the second is programmable in seven different configurations by the "I2F" parameter.

7.1 DOOR SWITCH INPUT

It signals the door status and the corresponding relay output status through the "odc" parameter:

no = normal (any change);

Fan = Fan OFF;

CPPr = Compressor OFF;

F_C = Compressor and fan OFF.

Since the door is opened, after the delay time set through parameter "dOA", the alarm output is enabled and the display shows the message "dA". The alarm stops as soon as the external digital input is disabled again. During this time and then for the delay "dot" after closing the door, the high and low temperature alarms are disabled.

7.2 CONFIGURABLE INPUT - GENERIC ALARM (EAL)

As soon as the digital input is activated the unit will wait for "did" time delay before signalling the "EAL" alarm message. The outputs status don't change. The alarm stops just after the digital input is de-activated.

7.3 CONFIGURABLE INPUT - SERIOUS ALARM MODE (BAL)

When the digital input is activated, the unit will wait for "did" delay before signalling the "BAL" alarm message. The relay outputs are switched OFF. The alarm will stop as soon as the digital input is de-activated.

7.4 CONFIGURABLE INPUT - PRESSURE SWITCH (PAL)

If during the interval time set by "did" parameter, the pressure switch has reached the number of activation of the "nPS" parameter, the "PAL" pressure alarm message will be displayed. The compressor and the regulation are stopped. When the digital input is ON the compressor is always OFF.

7.5 CONFIGURABLE INPUT - START DEFOST (DFR)

It executes a defrost if there are the right conditions. After the defrost is finished, the normal regulation will restart only if the digital input is disabled otherwise the instrument will wait until the "Mdf" safety time is expired.

7.6 CONFIGURABLE INPUT - RELAY AUX ACTUATION (AUS)

This function allows to turn ON and OFF the auxiliary relay by using the digital input as external switch.

7.7 CONFIGURABLE INPUT - ENERGY SAVING (ES)

The Energy Saving function allows to change the set point value as the result of the SET+ HES (parameter) sum. This function is enabled until the digital input is activated.

7.8 CONFIGURABLE INPUT - REMOTE ON/OFF (ONF)

This function allows to switch ON and OFF the instrument.

7.9 CONFIGURABLE INPUT - HOLIDAY FUNCTION (HDF)

In Holiday function Energy saving and defrost cycles follow holiday times. (Sd1...Sd8)

7.10 DIGITAL INPUTS POLARITY

The digital inputs polarity depends on "I1P" and "I2P" parameters.

CL : the digital input is activated by closing the contact.

OP : the digital input is activated by opening the contact

8. ANALOGUE OUTPUT 4÷20 mA (OPTIONAL)

The analogue output is obtained through a 4÷20mA signal proportional to the input selected in parameter "CAO". Through the analogue output the speed of fans can be regulated according to the input variable.

The following input types can be selected through the "CAO" parameter:



- "CAO" = P1 room temperature
- "CAO" = P2 evaporator temperature
- "CAO" = P3 third probe temperature
- "CAO" = 1r2 room temperature - evaporator temperature

To adjust the analogue output the following parameters are available:

"AOS" = Start point for analogue output

"APb" = Band width for analogue output can be either positive (direct action) and negative (inverse action).

Named T the input, the relationship input-output is given by the following charts

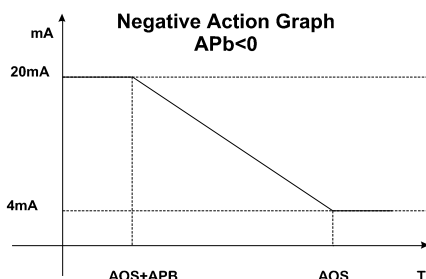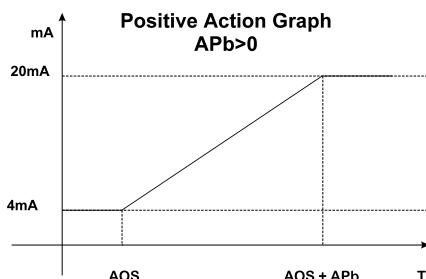


NOTE: When the defrost is in progress, the analogue output is set to the minimum value (4 mA). This condition lasts until the defrost terminates.


9. INSTALLATION AND MOUNTING

T850 keyboards shall be mounted on vertical panel, in a 150x31 mm hole, and fixed using two screws \varnothing 3 x 2mm. To obtain an IP65 protection grade use the front panel rubber gasket (mod. RG-L). Power modules **XW570K** shall be mounted in a panel with two or more screws and they must be connected to the keyboards by means of a two-wire cable (\varnothing 1mm). The temperature range allowed for correct operation is 0 - 60 °C. Avoid places subject to strong vibrations, corrosive gases, excessive dirt or humidity. The same recommendations apply to probes. Let the air circulate by the cooling holes.


9.1 T850 - CUT OUT

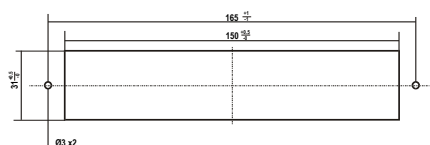

9.2 MOUNTING WITH KEYBOARD COVER OPENING DOWNWARD

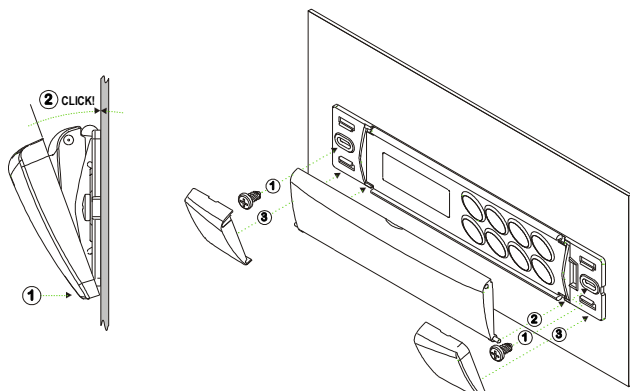

9.3 MOUNTING WITH KEYBOARD COVER OPENING UPWARD

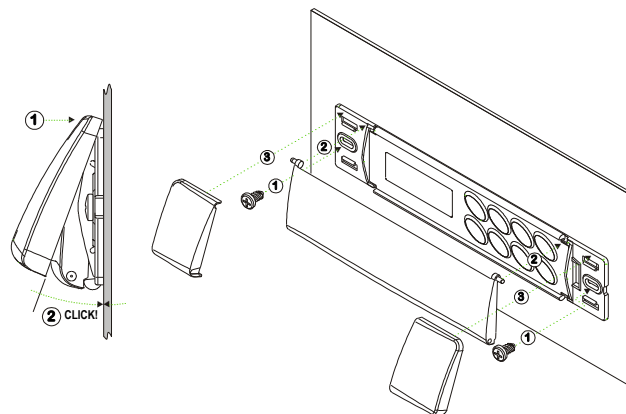

10. ELECTRICAL CONNECTIONS

XW570K are provided with screw terminal block to connect cables with a cross section up to 2,5 mm² for the RS485(optional) and the keyboard. Connecting other inputs, power supply and relays, **XW570K** are provided with Faston connection (6,3mm). Heat-resistant cables have to be used. Before connecting cables make sure the power supply complies with the instrument's requirements. Separate the probe cables from the power supply cables, from the outputs and the power connections. Do not exceed the maximum current allowed on each relay, in case of heavier loads use a suitable external relay.

N.B. Maximum current allowed for all the loads is 20A.

10.1 PROBE CONNECTIONS

The probes shall be mounted with the bulb upwards to prevent damages due to casual liquid infiltration. It is recommended to place the thermostat probe away from air streams to correctly measure the average room temperature. Place the defrost termination probe among the evaporator fins in the coldest place, where most ice is formed, far from heaters or from the warmest place during defrost, to prevent premature defrost termination.

11. TTL/RS485 SERIAL LINE

The TTL connector allows, by means of the external module TTL/RS485 (**XJ485**), to connect the unit to a network line **ModBUS-RTU** compatible as the Dixell monitoring system XJ500 (Version 3.0).

The same TTL connector is used to upload and download the parameter list of the "HOT KEY". The instruments can be ordered with the serial output RS485(Optional).

12. USE OF THE PROGRAMMING "HOT KEY"

The Wing units can **UPLOAD** or **DOWNLOAD** the parameter list from its own E2 internal memory to the "Hot Key" and vice-versa.

12.1 DOWNLOAD (FROM THE "HOT KEY" TO THE INSTRUMENT)

- Turn OFF the instrument by means of the ON/OFF key, remove the TTL serial cable if present, insert the "Hot Key" and then turn the Wing ON.
- Automatically the parameter list of the "Hot Key" is downloaded into the Wing memory, the "DoL" message is blinking. After 10 seconds the instrument will restart working with the new parameters.
- Turn OFF the instrument remove the "Hot Key", plug in the TTL serial cable, then turn it ON again.

At the end of the data transfer phase the instrument displays the following messages:

"end" for right programming.

The instrument starts regularly with the new programming.

"err" for failed programming.

In this case turn the unit off and then on if you want to restart the download again or remove the "Hot key" to abort the operation.

12.2 UPLOAD (FROM THE INSTRUMENT TO THE "HOT KEY")

- Turn OFF the instrument by means of the ON/OFF key and remove the TTL serial cable if present; then turn it ON again.
- When the Wing unit is ON, insert the "Hot key" and push c_2 key; the "uPL" message appears.
- Push "SET" key to start the UPLOAD; the "uPL" message is blinking.
- Turn OFF the instrument remove the "Hot Key", plug in the TTL serial cable, then turn it ON again.

At the end of the data transfer phase the instrument displays the following messages:

"end" for right programming.

"err" for failed programming.

In this case push "SET" key if you want to restart the programming again or remove the not programmed "Hot key".

13. ALARM SIGNALS

Message	Cause	Outputs
"P1"	Thermostat probe failure	Alarm output ON; Compressor output according to "CON" and "COF"
"P2"	Evaporator probe failure	Alarm output ON; Other outputs unchanged
"P3"	Auxiliary probe failure	Alarm output ON; Other outputs unchanged
"HA"	Maximum temperature alarm	Alarm output ON; Other outputs unchanged
"LA"	Minimum temperature alarm	Alarm output ON; Other outputs unchanged
"EE"	Data or memory failure	Alarm output ON; Other outputs unchanged
"dA"	Door switch alarm	Alarm output ON; Other outputs unchanged
"EAL"	External alarm	Alarm output ON; Other outputs unchanged
"BAL"	Serious external alarm	Alarm output ON; Other outputs OFF
"PAL"	Pressure switch alarm	Alarm output ON; Other outputs OFF
"rtc"	Real time clock alarm	Alarm output ON; Other outputs unchanged; Defrosts according to par. "IdF"

The alarm message is displayed until the alarm condition is recovery.

All the alarm messages are showed alternating with the room temperature except for the "P1" which is flashing. To reset the "EE" alarm and restart the normal functioning press any key, the "rSt" message is displayed for about 3s.

13.1 SILENCING BUZZER / ALARM RELAY OUTPUT

If "tbA = y", once the alarm signal is detected the buzzer and the relay are silenced by pressing any key.
If "tbA = n", only the buzzer is silenced while the alarm relay is on until the alarm condition recovers.
Buzzer is mounted in the **T850** keyboards and it is an option.

13.2 "EE" ALARM

The Dixell instruments are provided with an internal check for the data integrity. Alarm "EE" flashes when a failure in the memory data occurs. In such cases the alarm output is enabled.

13.3 ALARM RECOVERY

Probe alarms : "P1" (probe1 faulty), "P2" and "P3"; they automatically stop 10s after the probe restarts normal operation. Check connections before replacing the probe.
Temperature alarms "HA" and "LA" automatically stop as soon as the thermostat temperature returns to normal values or when the defrost starts.
Door switch alarm "da" stop as soon as the door is closed.
External alarms "EAL", "BAL" stop as soon as the external digital input is disabled "PAL" alarm is recovered by switching OFF the instrument.

14. TECHNICAL DATA**T850 keyboards**

Housing: self extinguishing ABS.
Case: facia 38x185 mm; depth 23mm

Mounting :

panel mounting in a 150x31 mm panel cut-out with two screws. \varnothing 3 x 2mm.
Distance between the holes 165mm

Protection: IP20.

Frontal protection: IP65 with frontal gasket mod RG-L. (optional)

Connections: Screw terminal block $\leq 2,5$ mm² heat-resistant wiring and 6,3mm

Power supply: from power module

Display: 3 digits, red LED, 14,2 mm high.

Optional output: buzzer

Power modules XW570K**Case:**

"OS": open board 132x 94 mm; height: 40mm.

"OA": open board with aluminium protection 176x 123mm; height: 52mm.

"GS": case 155x114; height 70mm. Self extinguishing ABS. IP55

"PS": case 147x110; height 47mm. Self extinguishing ABS. IP55. UL approved

Connections: Screw terminal block $\leq 2,5$ mm² heat-resistant wiring and 6,3mm Faston

Power supply: 230Vac or. 110Vac \pm 10%

Power absorption: 10VA max.

Inputs: 3 NTC probes

Digital inputs: 2 free voltage

Relay outputs: Total current on loads MAX. 20A

compressor: relay SPST 20(8) A, 250Vac

light: relay SPST 16(3) A, 250Vac (or **optional** relay SPST 16(3) A, special for fluorescent lights)

fans: relay SPST 8(3) A, 250Vac

defrost: relay SPST 8(3) A, 250Vac

alarm: SPST relay 8(3) A, 250Vac

auxiliary: SPST relay 16(3) A, 250Vac

Other output :

Analogue output 4÷20 mA (optional)

Serial output : TTL standard. RS485 optional

Communication protocol: ModBUS - RTU

Data storing: on the non-volatile memory (EEPROM).

Internal clock back-up: 24 hours

Kind of action: 1B.

Pollution grade: normal

Software class: A.

Operating temperature: 0÷60 °C.

Storage temperature: -25÷60 °C.


Relative humidity: 20÷85% (no condensing)

Measuring and regulation range:

NTC probe: -40÷110°C (-58÷230°F)

Resolution: 0,1 °C or 1°C or 1 °F (selectable).

Accuracy (ambient temp. 25°C): $\pm 0,5$ °C ± 1 digit

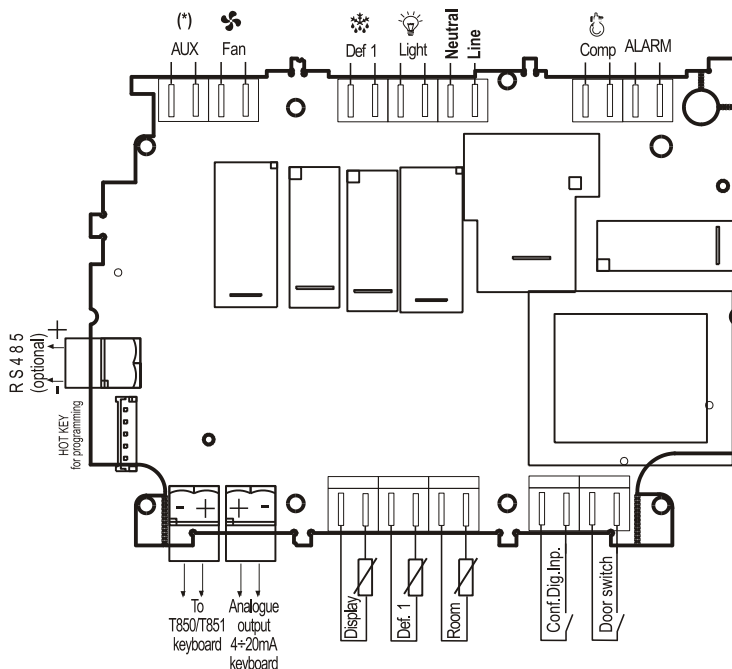15. CONNECTIONS**15.1 XW570K****T850 Keyboard****To XW570K**

Connector number	Description	Connector number	Description
HOT KEY	Hot key for programming	9 - 10	Door switch
RS485 (Optional)	RS485 direct output	11 - 12	Alarm relay
An.Out (Optional)	4÷20 mA analogue output	13 - 14	Compressor relay
KEY (+)	+ :connection for keyboard	15	Phase
KEY (-)	- : connection for keyboard	16	Neutral
1 - 2	Display probe	17 - 18	Light relay
3 - 4	Defrost probe	19 - 20	Defrost relay
5 - 6	Room probe	21 - 22	Fan relay
7 - 8	Configurable digital input	18 -19	Auxiliary relay

16. DEFAULT SETTING VALUES

Label	Name	Range	Default	Level
	REGULATION			XW570
Set	Set point	LS÷US	-5/23	Pr1
Hy	Differential	0,1÷25,5 °C / 1÷45°F	2/4	Pr1
LS	Minimum set point	-50,0°C÷SET / -58°F÷SET	-30/-22	Pr2
US	Maximum set point	SET + 110°C / SET + 230°F	20/68	Pr2
OdS	Outputs activation delay at start up	0÷255 min.	1	Pr2
AC	Anti-short cycle delay	0÷30 min.	1	Pr1
CCt	Compressor ON time during fast freezing	0 ÷ 23h 50 min.	0	Pr2
CO _n	Compressor ON time with faulty probe	0÷255 min.	15	Pr2
CO _F	Compressor OFF time with faulty probe	0÷255 min.	30	Pr2
	DISPLAY			
CF	Temperature measurement unit	°C ÷ °F	°C/°F	Pr2
rES	Resolution (integer/decimal point)	in ÷ de	de	Pr1
Red	Remote display	P1 ÷ 1r2	p1	Pr2
	DEFROST			
tdF	Defrost type	rE, rT, in	rE	Pr1
EdF	Defrost mode	rE, In, Sd	In	Pr2
SdF	Set point for SMART DEFROST	-30 ÷ +30°C / -22÷+86°F	0	Pr2
dtE	Defrost termination temperature (1°Evaporator)	-50,0÷110°C / -58÷230°F	8/46	Pr1
ldF	Interval between defrost cycles	1÷120h	6	Pr1
MdF	(Maximum) length for 1° defrost	0÷255 min.	30	Pr1
dFd	Displaying during defrost	rt, it, SET, dEF, dEG	it	Pr2
dAd	MAX display delay after defrost	0÷255 min.	30	Pr2
Fdt	Draining time	0÷60 min.	0	Pr2
dPO	First defrost after start up	n ÷ y	n	Pr2
dAF	Defrost delay after fast freezing	0 ÷ 23h 50 min.	2	Pr2

Label	Name	Range	Default	Level
FANS				
FnC	Fans operating mode	C-n, C-y, O-n, O-y	O-n	Pr2
Fnd	Fans delay after defrost	0+255 min.	10	Pr2
FSt	Fans stop temperature	-50,0+110°C / -58+230°F	2/35	Pr2
ALARMS				
ALC	Temperature alarms configuration	rE+Ab	rE	Pr2
ALU	MAXIMUM temperature alarm	-50,0+110°C/-58+230°F	10/20	Pr1
ALL	minimum temperature alarm	-50,0+110°C / -58+230°F	10/20	Pr1
AFH	Temperature alarm and fan differential	0,1+25,5 °C/ 1+45°F	2/4	
ALd	Temperature alarm delay	0+255 min.	15	Pr2
dAO	Delay of temperature alarm at start up	0 ÷ 23h 50 min.	1,3	Pr2
EdA	Alarm delay at the end of defrost	0+255 min.	30	Pr2
dot	Delay of temperature alarm after closing the door	0+255 min.	15	Pr2
dOA	Open door alarm delay	0+254 min., nu	15	Pr2
tBA	Alarm relay silencing	y ÷ n	y	Pr2
nPS	Pressure switch activation number	0+15	0	Pr2
ANALOGUE OUTPUT 4÷20mA (Optional)				
AOS	Analogue output start point	-50,0+110°C / -58+230°F	0/32	Pr2
APb	Analogue output band width	-50,0+110°C / -58+230°F	0	Pr2
CAO	Input type for the analogue output	P1+1r2	P1	Pr2
ANALOGUE INPUTS				
Ot	Thermostat probe calibration	-12,0+12,0°C / -21+21°F	0	Pr1
OE	Evaporator probe calibration	-12,0+12,0°C / -21+21°F	0	Pr2
O3	Auxiliary probe calibration	-12,0+12,0°C / -21+21°F	0	Pr2
P2P	Evaporator probe presence	n ÷ y	y	Pr2
P3P	Auxiliary probe presence	n ÷ y	n	Pr2
HES	Temperature increase during the Energy Saving cycle	-30+30°C / -54+54°F	0	Pr2
DIGITAL INPUTS				
Odc	Open door control	no, Fan, CPr, F_C	Fan	Pr2
I1P	Door switch polarity	CL+OP	CL	Pr2
I2P	Configurable digital input polarity	CL+OP	CL	Pr2
i2F	Digital input configuration	EAL, bAL, PAL, dFr, AUS, ES, OnF	EAL	Pr2
dId	Digital input alarm delay	0+255 min.	5	Pr2
TIME AND WEEKLY HOLIDAYS				
			°C/°F	XW570
Hur	Current hour	0 ÷ 23	0	Pr2
Min	Current minute	0 ÷ 59	0	Pr2
dAY	Current day	Sun ÷ SAT	Sun	Pr2
Hd1	First weekly holiday	Sun ÷ SAT – nu	nu	Pr2
Hd2	Second weekly holiday	Sun ÷ SAT – nu	nu	Pr2
Hd3	Third weekly holiday	Sun ÷ SAT – nu	nu	Pr2
ENERGY SAVING TIMES				
ILE	Energy Saving cycle start during workdays	0 ÷ 23h 50 min.	0	Pr2
dLE	Energy Saving cycle length during workdays	0 ÷ 24h 00 min.	0	Pr2
ISE	Energy Saving cycle start on holidays	0 ÷ 23h 50 min.	0	Pr2
dSE	Energy Saving cycle length on holidays	0 ÷ 24h 00 min.	0	Pr2
HES	Temperature increase during the Energy Saving cycle	-30+30°C / -54+54°F	0	Pr2
DEFROST TIMES				
Ld1	1 st workdays defrost start	0 ÷ 23h 50 min. - nu	6.0	Pr2
Ld2	2 nd workdays defrost start	0 ÷ 23h 50 min. - nu	13.0	Pr2
Ld3	3 rd workdays defrost start	0 ÷ 23h 50 min. - nu	21.0	Pr2
Ld4	4 th workdays defrost start	0 ÷ 23h 50 min. - nu	nu	Pr2
Ld5	5 th workdays defrost start	0 ÷ 23h 50 min. - nu	nu	Pr2
Ld6	6 th workdays defrost start	0 ÷ 23h 50 min. - nu	nu	Pr2
Ld7	7 th workdays defrost start	0 ÷ 23h 50 min. - nu	nu	Pr2
Ld8	8 th workdays defrost start	0 ÷ 23h 50 min. - nu	nu	Pr2
Sd1	1 st holiday defrost start	0 ÷ 23h 50 min. - nu	6.0	Pr2
Sd2	2 nd holiday defrost start	0 ÷ 23h 50 min. - nu	13.0	Pr2
Sd3	3 rd holiday defrost start	0 ÷ 23h 50 min. - nu	21.0	Pr2
Sd4	4 th holiday defrost start	0 ÷ 23h 50 min. - nu	nu	Pr2
Sd5	5 th holiday defrost start	0 ÷ 23h 50 min. - nu	nu	Pr2
Sd6	6 th holiday defrost start	0 ÷ 23h 50 min. - nu	nu	Pr2
Sd7	7 th holiday defrost start	0 ÷ 23h 50 min. - nu	nu	Pr2
Sd8	8 th holiday defrost start	0 ÷ 23h 50 min. - nu	nu	Pr2
OTHER				
Adr	Serial address	0+247	1	Pr1
rEL	Software release	---	---	Pr2

Label	Name	Range	Default	Level
Ptb	Map code	---	---	Pr2
Prd	Probes display	Pb1+Pb3	---	Pr2
Pr2	Access parameter list	---	---	Pr2

Dixell™



Dixell S.r.l. - Z.I. Via dell'Industria, 27 - 32010 Pieve d'Alpago (BL) ITALY
 Tel. +39.0437.9833 r.a. - Fax +39.0437.989313 - EmersonClimate.com/Dixell - dixell@emerson.com