

AIR CONDITIONER

Wall mounted type

DESIGN & TECHNICAL MANUAL

INDOOR



ASYG18KLCA
ASYG24KLCA

OUTDOOR



AOYG18KLTA



AOYG24KLTA

FUJITSU GENERAL LIMITED

Notices:

- Product specifications and design are subject to change without notice for future improvement.
- For further details, please check with our authorized dealer.

CONTENTS

Part 1. INDOOR UNIT	1
1. Specifications	2
2. Dimensions	4
2-1. Models: ASYG18KLCA and ASYG24KLCA	4
3. Wiring diagrams	6
3-1. Models: ASYG18KLCA and ASYG24KLCA	6
4. Capacity table	7
4-1. Cooling capacity	7
4-2. Heating capacity	8
5. Fan performance	9
5-1. Air velocity distributions	9
5-2. Airflow	11
6. Operation noise (sound pressure)	13
6-1. Noise level curve	13
6-2. Sound level check point	14
7. Safety devices	15
8. Remote controller	16
8-1. Wireless remote controller	16
9. Function settings	18
9-1. Function settings by using remote controller	18
9-2. Custom code setting for wireless remote controller	22
10. Accessories	23
10-1. Models: ASYG18KLCA and ASYG24KLCA	23

CONTENTS (continued)

Part 2. OUTDOOR UNIT.....25

1. Specifications.....	26
2. Dimensions.....	27
2-1. Model: AOYG18KLTA.....	27
2-2. Model: AOYG24KLTA.....	28
3. Installation space	29
3-1. Models: AOYG18KLTA and AOYG24KLTA.....	29
4. Refrigerant circuit	32
4-1. Model: AOYG18KLTA.....	32
4-2. Model: AOYG24KLTA.....	33
5. Wiring diagrams	34
5-1. Model: AOYG18KLTA.....	34
5-2. Model: AOYG24KLTA.....	34
6. Capacity compensation rate for pipe length and height difference.....	35
6-1. Model: AOYG18KLTA.....	35
6-2. Model: AOYG24KLTA.....	36
7. Additional charge calculation	37
7-1. Model: AOYG18KLTA.....	37
7-2. Model: AOYG24KLTA.....	37
8. Airflow	38
8-1. Model: AOYG18KLTA.....	38
8-2. Model: AOYG24KLTA.....	38
9. Operation noise (sound pressure).....	39
9-1. Noise level curve.....	39
9-2. Sound level check point	40
10. Electrical characteristics	41
11. Safety devices	42
12. Accessories.....	43
12-1. Models: AOYG18KLTA and AOYG24KLTA.....	43

Part 1. INDOOR UNIT

WALL MOUNTED TYPE:

ASYG18KLCA

ASYG24KLCA

1. Specifications

Type				Wall mounted				
				Inverter heat pump				
Model name				ASYG18KLCA	ASYG24KLCA			
Power supply				230 V ~ 50 Hz				
Available voltage range				198—264 V				
Capacity	Cooling	Rated	kW	5.20	7.10			
			Btu/h	17,700	24,200			
		Min.—Max.	kW	0.9—5.5	0.9—7.7			
			Btu/h	3,000—18,700	3,000—26,200			
	Heating	Rated	kW	6.30	8.00			
			Btu/h	21,400	27,200			
		Min.—Max.	kW	0.6—7.6	0.9—9.0			
			Btu/h	2,000—25,900	3,000—30,700			
Input power	Cooling	Rated	kW	1.685	2.42			
				Min.—Max.	0.14—2.09	0.18—2.74		
		Heating		Rated	1.800	2.225		
					Min.—Max.	0.10—1.93	0.15—2.66	
	Fan	HIGH	W	32	57			
				MED	25	34		
				LOW	16	17		
				QUIET	10	10		
Current	Cooling	Rated	A	7.5	10.9			
	Heating			8.0	10.4			
EER	Cooling		kW/kW	3.09	2.93			
COP	Heating			3.50	3.60			
Sensible capacity	Cooling		kW	3.93	4.92			
Power factor	Cooling		%	98.0				
	Heating			98.0				
Moisture removal			L/h (pints/h)	1.9 (3.3)	3.1 (5.5)			
Maximum operating current *1		Cooling		A	9.5	13.5		
		Heating			13.5	17.5		
Fan	Airflow rate	Cooling	HIGH	m³/h	865	1,040		
			MED		780	880		
			LOW		665	685		
			QUIET		555	555		
			HIGH		995	1,040		
		Heating	MED		810			
			LOW		700	695		
			QUIET		590	585		
			Type × Q'ty		Crossflow fan × 1			
			Motor output		W	61		
Sound pressure level *2	Cooling	HIGH	dB (A)	47	51			
				MED	44	45		
				LOW	40	38		
				QUIET	35	33		
				HIGH	50	52		
	Heating	MED		45	45			
		LOW		41	41			
		QUIET		37	37			
		Heat exchanger type		Dimensions (H × W × D)		mm	Main: 384 × 630 × 20.0 Sub: 126 × 630 × 13.30	Main: 384 × 630 × 20.0 Sub1: 84 × 630 × 13.30 Sub2: 126 × 630 × 13.30
				Fin pitch			Man: 1.1, Sub: 1.4	Man: 1.1, Sub1: 1.4, Sub2: 1.4
Rows × Stages				Main: 2 × 24, Sub: 1 × 6	Main: 2 × 24, Sub1: 1 × 4, Sub2: 1 × 6			
Pipe type			Copper tube					
Fin type			Aluminum					
Enclosure	Material		Polystyrene					
	Color		White Approximate color of Munsell N 9.25/					
Dimensions (H × W × D)	Net		mm	293 × 790 × 249				
	Gross			320 × 840 × 375				
Weight	Net		kg	9.5	10.0			
	Gross			12.0	12.5			
Connection pipe	Size	Liquid	mm (in)	Ø 6.35 (Ø 1/4)	Ø 6.35 (Ø 1/4)			
		Gas		Ø 9.52 (Ø 3/8)	Ø 12.70 (Ø 1/2)			
		Method		Flare				
Drain hose	Material		PP+HDPE					
	Tip diameter		Ø 13.8 (I.D.), Ø 15.8 to Ø 16.7 (O.D.)					
Operation range	Cooling			18 to 32				
		%RH		80 or less				
	Heating			16 to 30				
Remote controller type				Wireless				

NOTES:


- Specifications are based on the following conditions:
 - Cooling: Indoor temperature of 27 °CDB/19 °CWB, and outdoor temperature of 35 °CDB/24 °CWB
 - Heating: Indoor temperature of 20 °CDB/15 °CWB, and outdoor temperature of 7 °CDB/6 °CWB
 - Pipe length: 5 m, Height difference: 0 m (Between outdoor unit and indoor unit)
- Protective function might work when using it outside the operation range.
- *1: Maximum current is maximum value when operated within the operation range.
- *2: Sound pressure level:
 - Measured values in manufacturer's anechoic chamber
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.

Specifications for ErP Lot10					
Model name			ASYG18KLCA		ASYG24KLCA
Energy efficiency class	Cooling		A ⁺⁺		
	Heating (Average)		A ⁺		
Pdesign	Cooling	kW	5.2 (35 °C)	7.1 (35 °C)	
	Heating (Average)		4.8 (-10 °C)	7.1 (-10 °C)	
SEER	Cooling	kWh/kWh	7.20	7.10	
SCOP	Heating (Average)		4.30	4.00	
Annual energy consumption	QCE	kWh/a	253	350	
	QHE (Average)		1,563	2,485	
Sound power level	Cooling	HIGH	dB (A)	60	64
	Heating			65	65

2. Dimensions

2-1. Models: ASYG18KLCA and ASYG24KLCA



Unit: mm

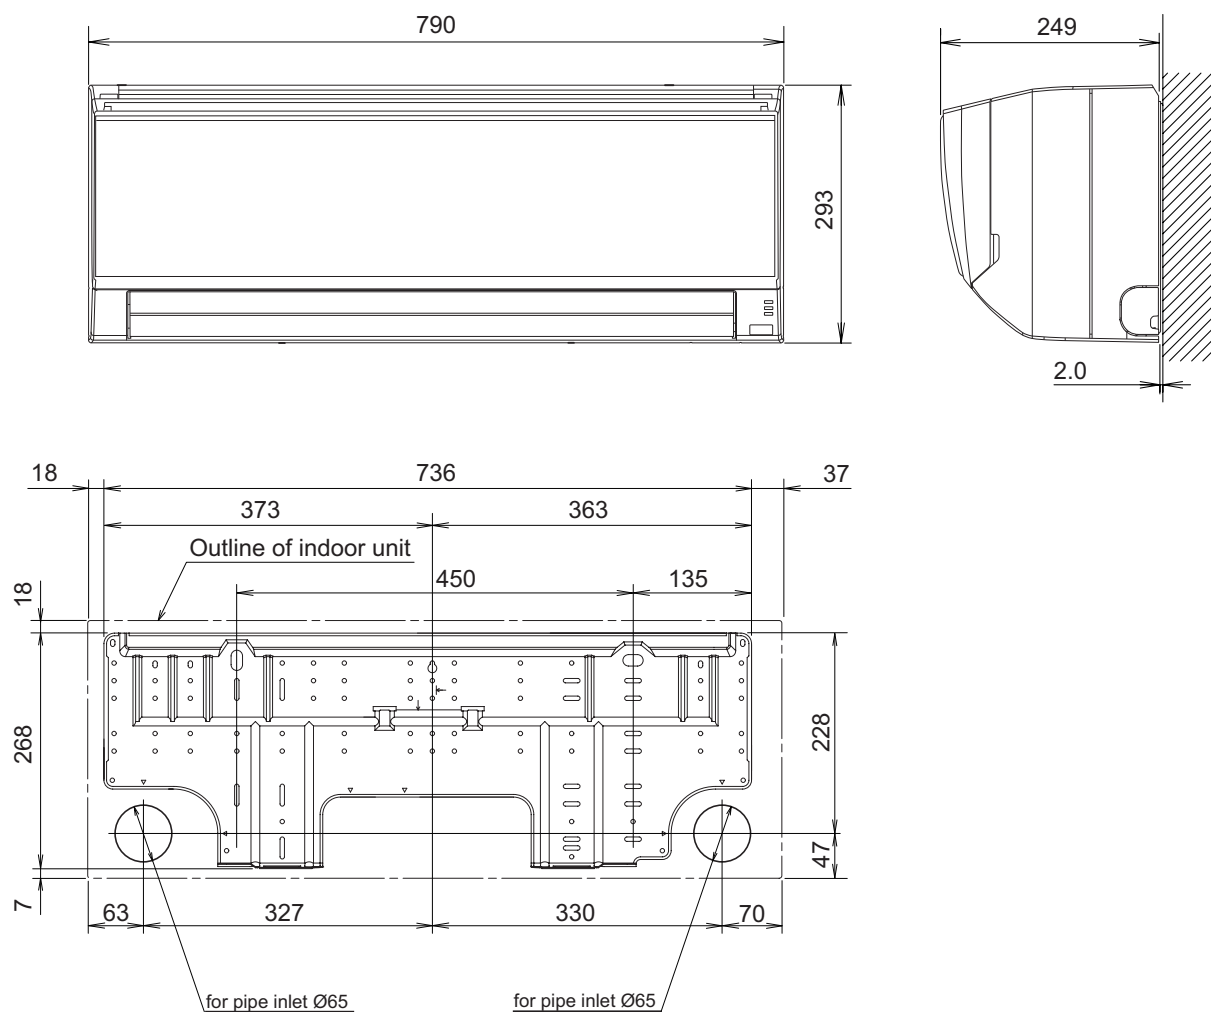

■ Installation space requirement


Provide sufficient installation space for product safety.

Unit: mm

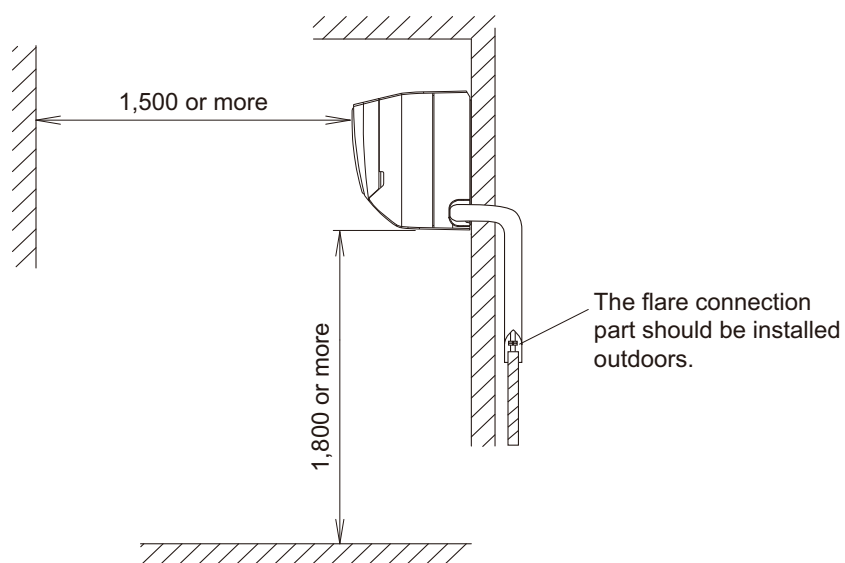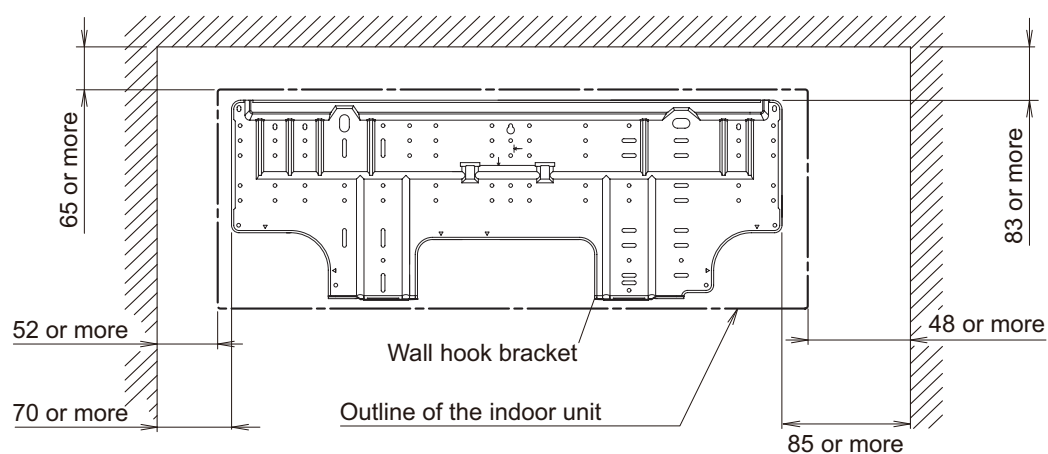

3. Wiring diagrams

3-1. Models: ASYG18KLCA and ASYG24KLCA

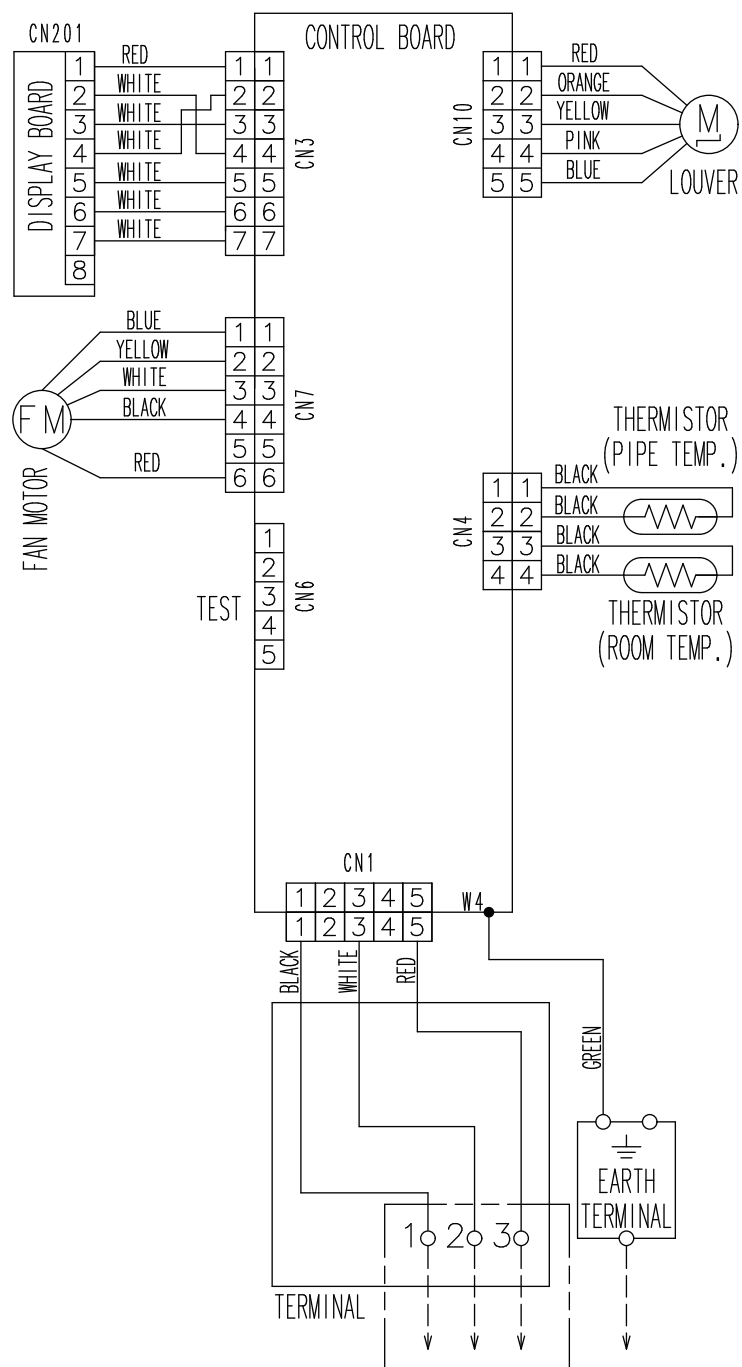

4. Capacity table

Capacity tables show each of following values calculated based on the outdoor temperature and the indoor temperature, under given Airflow Rate (AFR):

For cooling capacity: Total Capacity (TC), Sensible Heat Capacity (SHC), and Input Power (IP)

For heating capacity: Total Capacity (TC) and Input Power (IP)

4-1. Cooling capacity

■ Model: ASYG18KLCA

AFR			m³/h									865											
Outdoor temperature		Indoor temperature																					
	°CDB	18			21			23			25			27			29			32			
	°CWB	12			15			16			18			19			21			23			
	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kW			kW			kW			kW			kW			kW			kW			
	-10	3.20	2.79	1.99	3.51	3.05	2.01	3.61	3.15	2.03	3.84	3.35	2.05	3.96	3.45	2.07	4.22	3.68	2.09	4.50	3.92	2.11	
	-5	2.94	2.69	1.99	3.22	2.94	2.01	3.31	3.03	2.03	3.52	3.22	2.05	3.63	3.32	2.07	3.87	3.54	2.09	4.13	3.77	2.11	
	0	2.67	2.59	1.99	2.93	2.83	2.01	3.02	2.91	2.03	3.21	3.10	2.05	3.31	3.20	2.07	3.52	3.41	2.09	3.76	3.63	2.11	
	5	3.49	2.96	1.95	3.82	3.24	1.97	3.93	3.34	1.99	4.18	3.55	2.02	4.31	3.66	2.04	4.60	3.90	2.06	4.90	4.16	2.08	
	10	3.24	2.85	1.98	3.54	3.11	2.00	3.65	3.21	2.02	3.88	3.41	2.04	4.00	3.52	2.06	4.26	3.75	2.08	4.55	4.00	2.10	
	15	4.80	3.47	1.19	5.25	3.80	1.20	5.41	3.91	1.22	5.75	4.16	1.23	5.93	4.29	1.24	6.32	4.57	1.25	6.74	4.87	1.26	
	20	4.61	3.39	1.34	5.05	3.71	1.36	5.20	3.82	1.37	5.53	4.06	1.39	5.70	4.19	1.40	6.08	4.46	1.41	6.48	4.76	1.43	
	25	4.58	3.36	1.33	5.01	3.68	1.35	5.16	3.79	1.36	5.49	4.03	1.37	5.66	4.16	1.39	6.03	4.43	1.40	6.43	4.72	1.41	
	30	4.39	3.27	1.47	4.81	3.58	1.49	4.95	3.69	1.51	5.27	3.92	1.52	5.43	4.04	1.54	5.78	4.31	1.55	6.17	4.59	1.57	
	35	4.21	3.18	1.62	4.60	3.48	1.63	4.74	3.59	1.65	5.04	3.81	1.67	5.20	3.93	1.69	5.54	4.19	1.70	5.91	4.46	1.72	
	40	3.55	2.98	1.34	3.88	3.26	1.35	4.00	3.36	1.37	4.25	3.57	1.38	4.39	3.68	1.39	4.67	3.92	1.41	4.98	4.18	1.42	
46	2.47	2.47	0.98	2.70	2.70	0.99	2.78	2.78	1.00	2.96	2.96	1.01	3.05	3.05	1.02	3.25	3.25	1.03	3.46	3.46	1.04		

■ Model: ASYG24KLCA

AFR			m³/h									1,040														
Outdoor temperature		Indoor temperature																								
	°CDB	18			21			23			25			27			29			32						
	°CWB	12			15			16			18			19			21			23						
	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP				
		kW			kW			kW			kW			kW			kW			kW						
	-10	6.01	4.00	2.32	6.58	4.38	2.34	6.78	4.51	2.37	7.21	4.80	2.39	7.43	4.94	2.41	7.92	5.27	2.44	8.44	5.62	2.46				
	-5	5.57	3.82	2.48	6.10	4.18	2.50	6.29	4.30	2.53	6.69	4.58	2.55	6.89	4.72	2.58	7.34	5.03	2.61	7.83	5.36	2.63				
	0	5.14	3.64	2.64	5.62	3.98	2.66	5.79	4.10	2.69	6.16	4.36	2.72	6.35	4.49	2.75	6.77	4.79	2.77	7.21	5.11	2.80				
	5	5.96	4.02	2.31	6.53	4.40	2.34	6.73	4.54	2.36	7.15	4.83	2.38	7.37	4.97	2.41	7.86	5.30	2.43	8.38	5.65	2.46				
	10	5.63	3.95	2.46	6.16	4.32	2.48	6.35	4.45	2.51	6.75	4.73	2.53	6.96	4.88	2.56	7.42	5.20	2.59	7.91	5.54	2.61				
	15	6.65	4.40	1.61	7.27	4.81	1.62	7.50	4.96	1.64	7.97	5.27	1.66	8.22	5.43	1.67	8.76	5.79	1.69	9.33	6.17	1.71				
	20	6.45	4.29	1.81	7.06	4.69	1.83	7.28	4.83	1.85	7.74	5.14	1.87	7.98	5.30	1.89	8.50	5.65	1.90	9.06	6.02	1.92				
	25	6.31	4.23	1.92	6.91	4.62	1.94	7.12	4.76	1.96	7.57	5.07	1.98	7.81	5.22	2.00	8.32	5.57	2.02	8.87	5.93	2.04				
	30	6.03	4.10	2.12	6.60	4.49	2.14	6.80	4.63	2.17	7.23	4.92	2.19	7.45	5.07	2.21	7.94	5.40	2.23	8.47	5.76	2.25				
	35	5.74	3.98	2.32	6.28	4.36	2.35	6.48	4.49	2.37	6.89	4.77	2.40	7.10	4.92	2.42	7.57	5.24	2.44	8.07	5.59	2.47				
	40	5.33	3.85	2.09	5.84	4.21	2.11	6.02	4.34	2.14	6.40	4.61	2.16	6.59	4.75	2.18	7.03	5.07	2.20	7.49	5.40	2.22				
46	3.98	3.31	1.59	4.35	3.62	1.61	4.49	3.73	1.63	4.77	3.97	1.64	4.92	4.09	1.66	5.24	4.36	1.68	5.59	4.65	1.69					

4-2. Heating capacity

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

■ Model: ASYG18KLCA

AFR	m ³ /h	995
-----	-------------------	-----

			Indoor temperature									
			16		18		20		22		24	
			TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
Outdoor temperature	°CDB	°CWB	4.29	1.49	4.18	1.52	4.07	1.55	3.96	1.58	3.85	1.61
	-15	-16	4.97	1.60	4.84	1.63	4.71	1.65	4.58	1.70	4.45	1.73
	-10	-11	5.74	1.73	5.59	1.77	5.44	1.77	5.29	1.84	5.14	1.87
	-5	-7	6.67	1.88	6.49	1.92	6.32	1.93	6.14	2.00	5.97	2.04
	0	-2	7.41	2.01	7.21	2.05	7.02	2.09	6.83	2.13	6.63	2.17
	5	3	8.09	2.09	7.88	2.13	7.67	2.18	7.46	2.22	7.25	2.26
	7	6	8.47	2.17	8.25	2.21	8.03	2.24	7.81	2.31	7.59	2.35
	10	8	8.46	2.00	8.24	2.04	8.02	2.09	7.80	2.12	7.57	2.16
	15	10	7.85	1.56	7.64	1.59	7.44	1.63	7.23	1.66	7.03	1.69
	20	15	8.24	1.55	8.03	1.59	7.81	1.62	7.59	1.65	7.38	1.68
	24	18										

■ Model: ASYG24KLCA

AFR	m ³ /h	1,040
-----	-------------------	-------





			Indoor temperature									
			16		18		20		22		24	
			TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
			kW		kW		kW		kW		kW	
Outdoor temperature	°CDB	°CWB	6.90	2.74	6.72	2.79	6.54	2.85	6.36	2.90	6.18	2.96
	-15	-16	7.98	3.08	7.77	3.14	7.56	3.14	7.35	3.27	7.14	3.33
	-10	-11	8.79	3.25	8.56	3.31	8.33	3.40	8.10	3.45	7.87	3.51
	-5	-7	9.20	3.16	8.96	3.22	8.72	3.31	8.48	3.35	8.24	3.42
	0	-2	9.53	2.89	9.28	2.95	9.03	3.01	8.78	3.07	8.53	3.13
	5	3	9.50	2.55	9.25	2.60	9.00	2.66	8.75	2.71	8.50	2.76
	7	6	9.54	2.45	9.29	2.50	9.04	2.59	8.79	2.60	8.54	2.65
	10	8	9.60	2.24	9.35	2.29	9.10	2.38	8.84	2.38	8.59	2.43
	15	10	9.66	2.04	9.41	2.08	9.16	2.17	8.90	2.16	8.65	2.20
	20	15	9.71	1.87	9.46	1.91	9.20	1.95	8.95	1.99	8.70	2.03
	24	18										

5. Fan performance

5-1. Air velocity distributions

■ Model: ASYG18KLCA


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

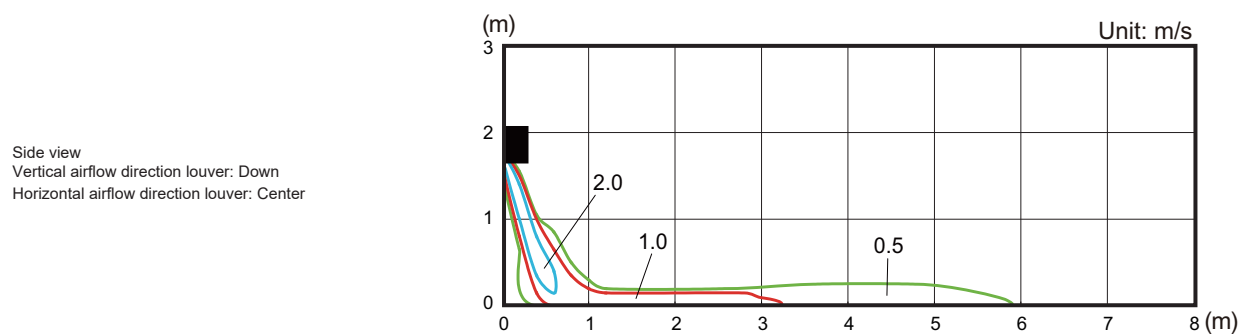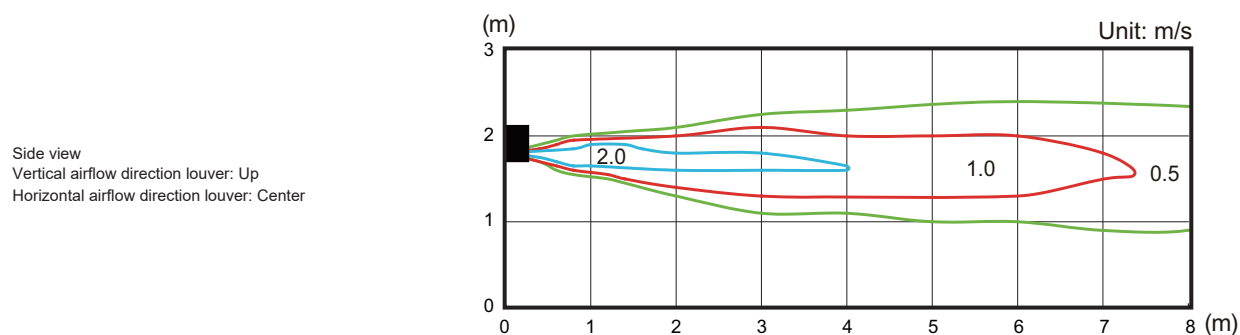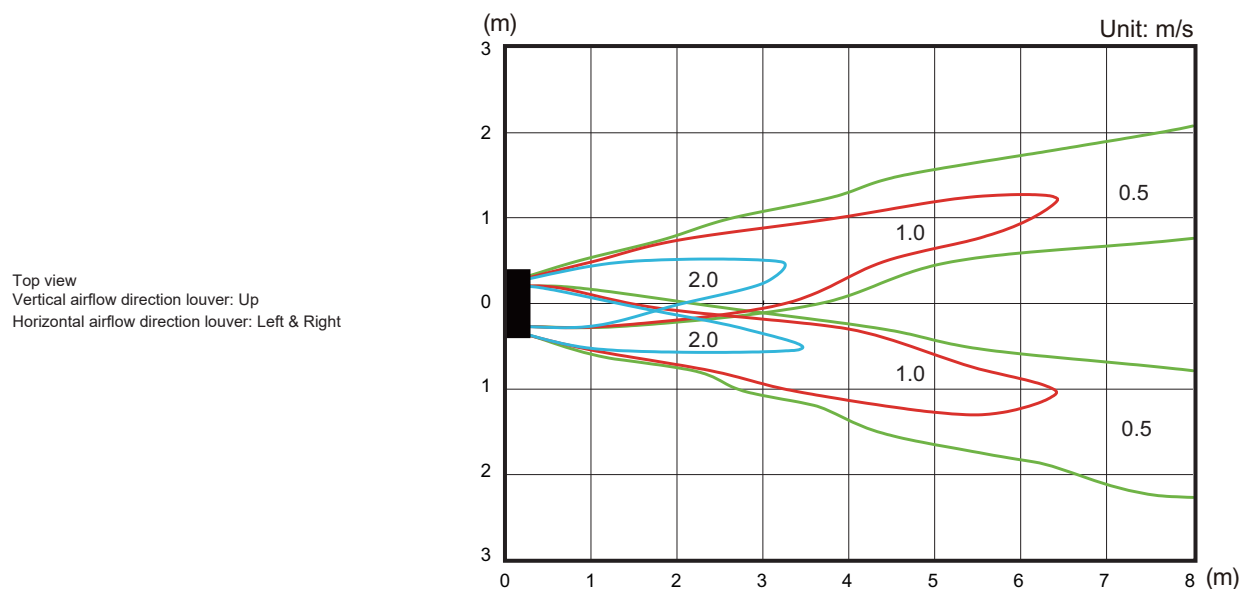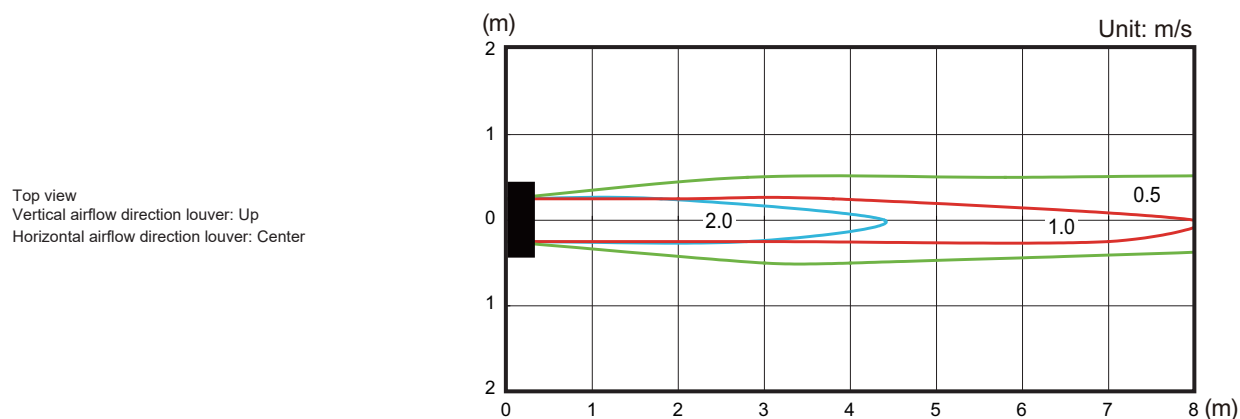


Model: ASYG24KLCA

Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------


Top view
Vertical airflow direction louver: Up
Horizontal airflow direction louver: Center

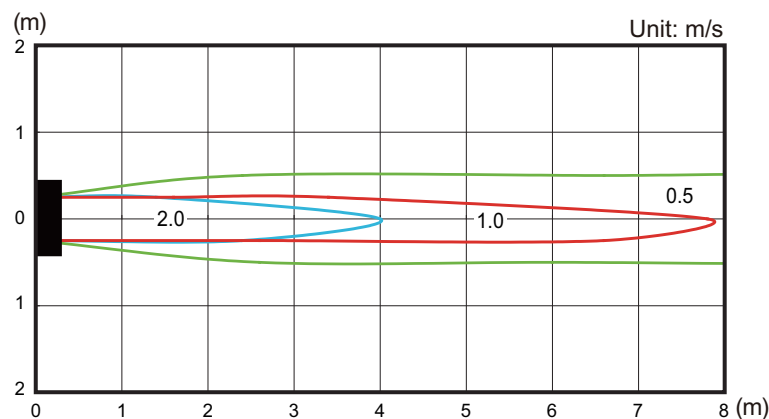


Top view
Vertical airflow direction louver: Up
Horizontal airflow direction louver: Left & Right

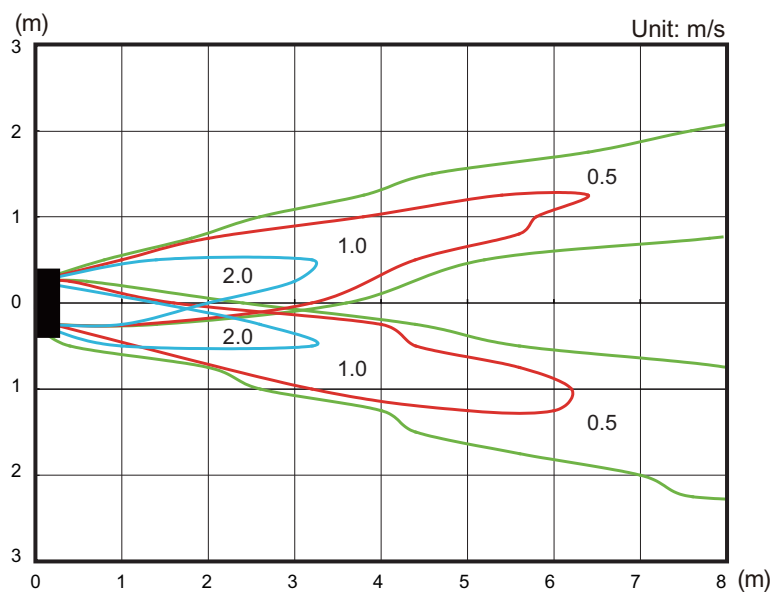

Side view
Vertical airflow direction louver: Up
Horizontal airflow direction louver: Center

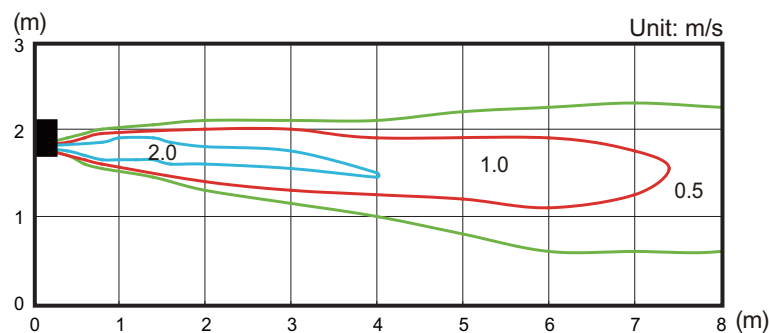

Side view
Vertical airflow direction louver: Down
Horizontal airflow direction louver: Center

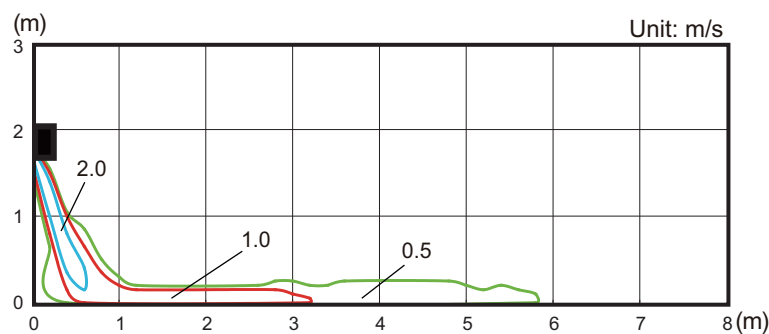

5-2. Airflow

■ Model: ASYG18KLCA

● Cooling

Fan speed	Airflow	
HIGH	m ³ /h	865
	l/s	240
	CFM	509
MED	m ³ /h	780
	l/s	217
	CFM	459
LOW	m ³ /h	665
	l/s	185
	CFM	391
QUIET	m ³ /h	555
	l/s	154
	CFM	327

● Heating

Fan speed	Airflow	
HIGH	m ³ /h	995
	l/s	276
	CFM	586
MED	m ³ /h	810
	l/s	225
	CFM	477
LOW	m ³ /h	700
	l/s	194
	CFM	412
QUIET	m ³ /h	590
	l/s	164
	CFM	347

■ Model: ASYG24KLCA

● Cooling

Fan speed	Airflow	
HIGH	m ³ /h	1,040
	l/s	288
	CFM	609
MED	m ³ /h	880
	l/s	244
	CFM	518
LOW	m ³ /h	685
	l/s	190
	CFM	403
QUIET	m ³ /h	555
	l/s	154
	CFM	327

● Heating


Fan speed	Airflow	
HIGH	m ³ /h	1,040
	l/s	288
	CFM	609
MED	m ³ /h	800
	l/s	222
	CFM	471
LOW	m ³ /h	680
	l/s	189
	CFM	400
QUIET	m ³ /h	580
	l/s	161
	CFM	341

6. Operation noise (sound pressure)


6-1. Noise level curve

■ Model: ASYG18KLCA

● Cooling

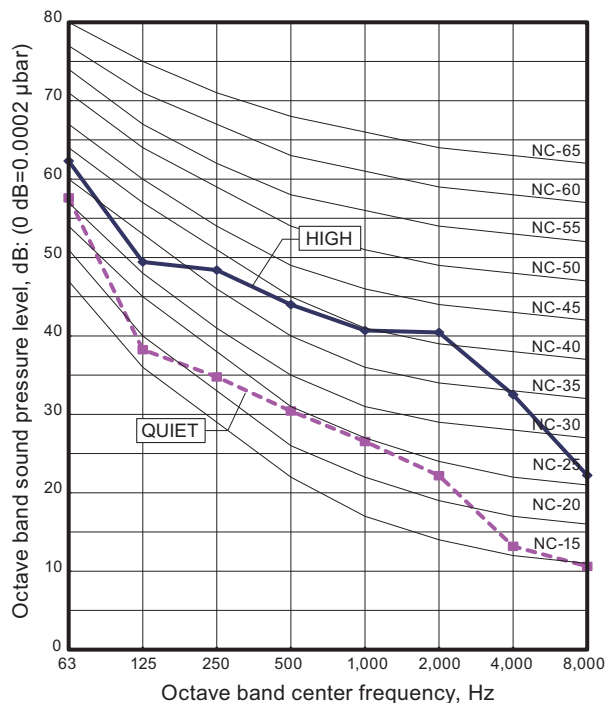


● Heating

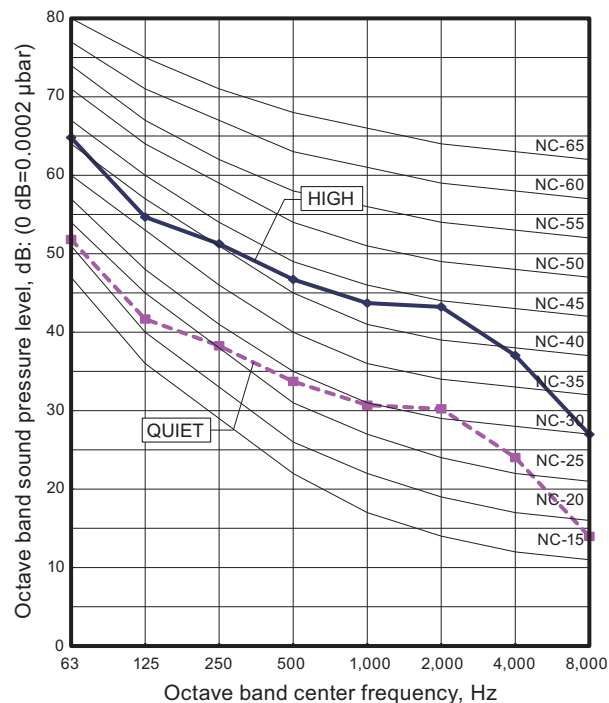


■ Model: ASYG24KLCA


● Cooling

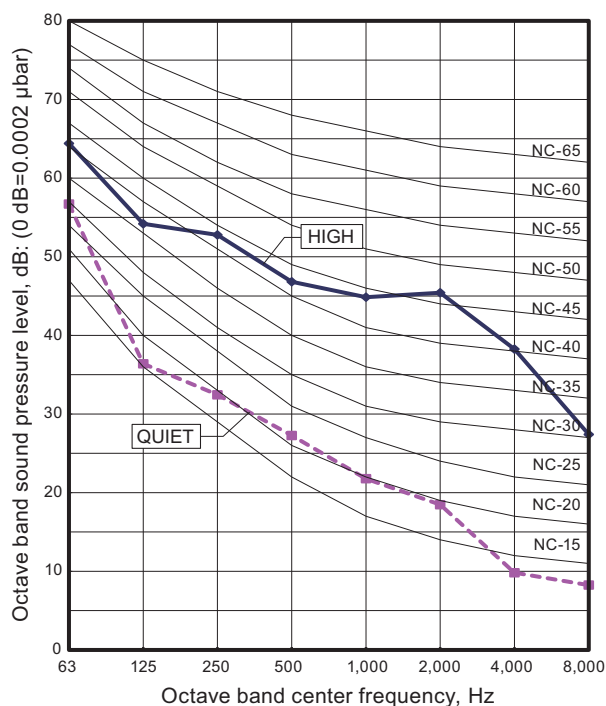

● Heating

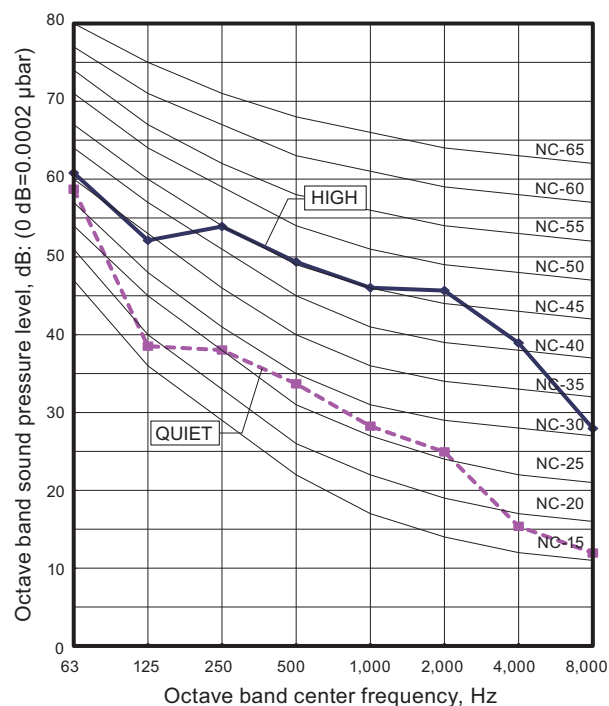

6-2. Sound level check point

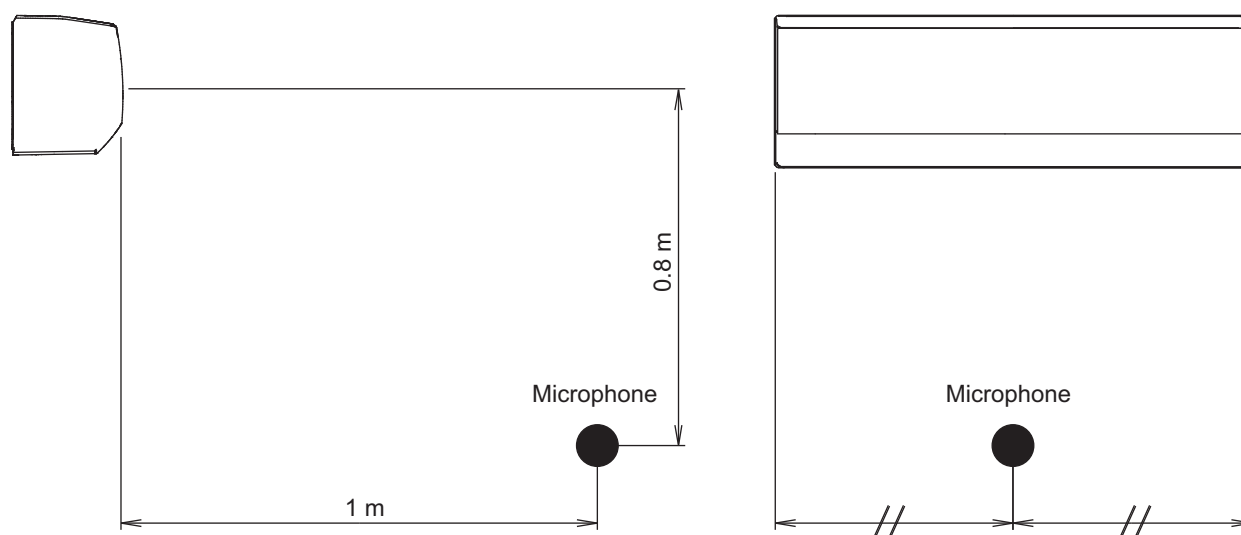

NOTE: Detailed shape of the actual indoor unit might be slightly different from the one illustrated above.

7. Safety devices


Type of protection	Protection form		Model	
			ASYG18KLCA	ASYG24KLCA
Circuit protection	Current fuse (PCB*)		250 V, 3.15 A	
Fan motor protection	Thermistor protection	Activate	150±15 °C Fan motor stop	
		Reset	120±15 °C Fan motor restart	

*PCB: Printed Circuit Board

8. Remote controller

8-1. Wireless remote controller

Overview

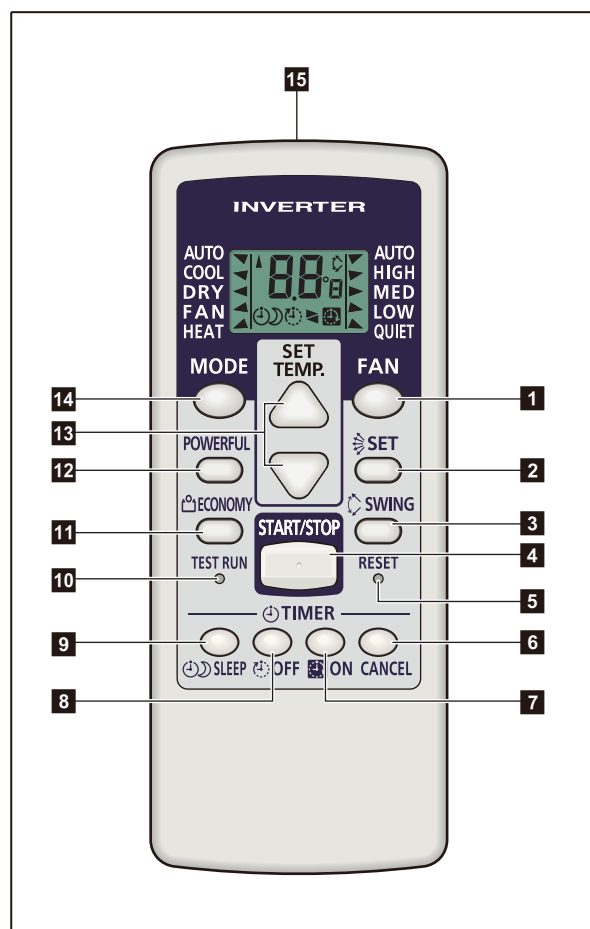

- 1 FAN button**
- 2 SET button**
- 3 SWING button**
- 4 START/STOP button**
- 5 RESET button**
- 6 TIMER CANCEL button**
- 7 ON TIMER button**
- 8 OFF TIMER button**
- 9 SLEEP TIMER button**
- 10 TEST RUN button**

- Used only when installing the air conditioner, and should not be used under normal conditions, as it will cause the indoor unit's thermostat malfunction.
- If this button is pressed during normal operation, the indoor unit will switch to test operation mode, and the operation indicator lamp and the timer indicator lamp on the indoor unit will begin to flash simultaneously.
- To stop the test operation mode, press the START/STOP button. Then, the air conditioner stops the operation.

- 11 ECONOMY button**
- 12 POWERFUL button**
- 13 SET TEMP. (temperature) (▲ / ▼) button**
- 14 MODE button**

- Switches operation mode (AUTO, COOL, DRY, FAN, and HEAT).
- Starts/ends the remote controller custom code (max. 4 types) change.


- 15 Signal transmitter**
- 16 Operating mode indicator**
- 17 Signal transmit indicator**
- 18 Temperature and time indicator**

- Displays set temperature.
- In timer setting, it displays the timer time. After finishing the timer setting, set temperature will reappear.

- 19 Swing indicator**
- 20 Fan speed indicator**
- 21 Timer mode indicator**

- Sleep timer
- OFF timer
- OFF-ON timer
- ON-OFF timer
- ON timer

Display panel

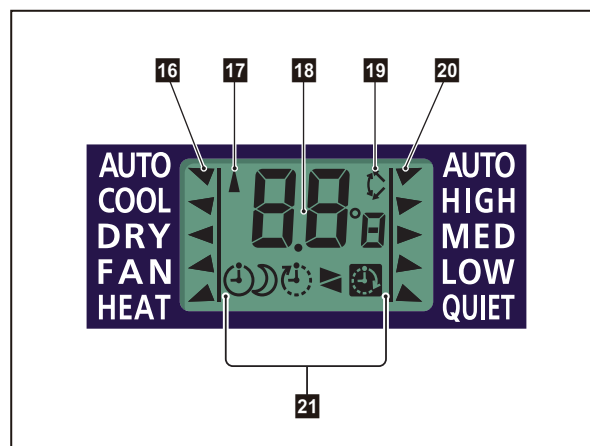


NOTE: Functions may differ by type of the indoor unit. For details, refer to the operation manual.

Specifications

Controller


Unit: mm

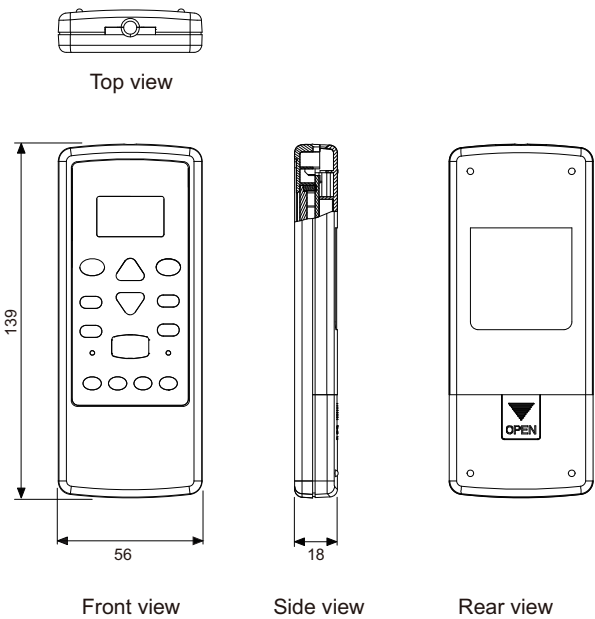

Size (H × W × D)	mm	139 × 56 × 18
Weight	g	70 (without batteries)

Holder

Unit: mm

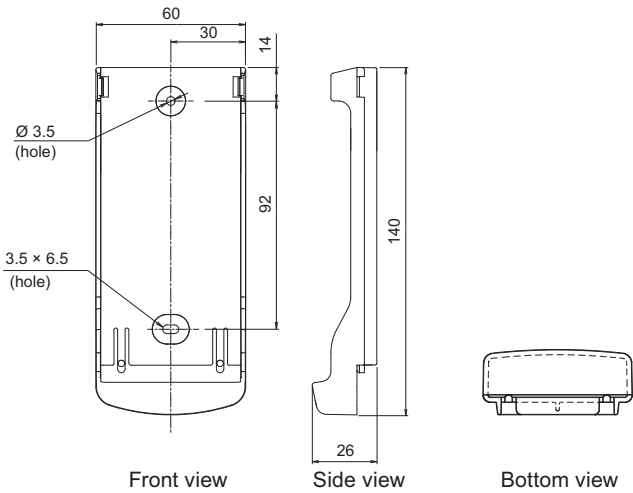

Size (H × W × D)	mm	140 × 60.4 × 26.2
Weight	g	25

9. Function settings

To adjust the functions of this product according to the installation environment, various types of function settings are available.

NOTE: Incorrect settings can cause a product malfunction.

9-1. Function settings by using remote controller

Some function settings can be changed on the remote controller. After confirming the setting procedure and the content of each function setting, select appropriate functions for your installation environment.

■ Setting procedure by using wireless remote controller

The function number and the associated setting value are displayed on the LCD of the remote controller. Follow the instructions written in the local setup procedure supplied with the remote controller, and select appropriate setting according to the installation environment.

Before connecting the power supply of the indoor unit, reconfirm following items:

- Piping air tight test and vacuuming have been performed firmly.
- There is no wiring mistake.

Then, connect the power supply of indoor unit.

Entering function setting mode:

While pressing the FAN button and SET TEMP. (▲) button simultaneously, press the RESET button to enter the function setting mode.


STEP 1: Setting the remote controller custom code

Use the following steps to select the custom code of the remote controller. (Note that the air conditioner cannot receive a custom code if the air conditioner has not been set for the custom code.)

The custom codes that are set through this process are applicable only to the signal in the function setting.

For details on how to set the custom codes through the normal process, refer to ["Custom code setting for wireless remote controller"](#) on page 22.

1. Press the SET TEMP. (▲) (▼) buttons to change the custom code between $\text{A} \rightarrow \text{b} \rightarrow \text{c} \rightarrow \text{d}$. Match the code on the display to the air conditioner custom code. (Initially set to A .) If the custom code does not need to be selected, press the MODE button, and proceed to **STEP 2**.
2. Press the MODE button to accept the custom code, and proceed to **STEP 2**.




***1:** Small A is displayed on the right of the custom code during the function setting.

NOTES:

- The air conditioner custom code is set to A prior to shipment. To change the custom code, contact your retailer.
- The remote controller resets to custom code A when the batteries on the remote controller are replaced. If you use a custom code other than code A , reset the custom code after replacing the batteries.
- If you do not know the air conditioner custom code setting, try each of the custom codes ($\text{A} \rightarrow \text{b} \rightarrow \text{c} \rightarrow \text{d}$) until you find the code that operates the air conditioner.

STEP 2: Selecting the function number and setting value

1. Press the SET TEMP. (▲) (▼) buttons to select the function number. To switch between the left and right digits, press the MODE button.
2. Press the FAN button to proceed the setting value. To return the function number selection, press the FAN button again.
3. Press the SET TEMP. (▲) (▼) buttons to select the setting value. To switch between the left and right digits, press the MODE button.
4. Press the SLEEP button, then after you hear the beep emitted from the indoor unit, the START/STOP button in the order to confirm the settings.
5. Press the RESET button to cancel the function setting mode.
6. After completing the function setting, be sure to disconnect the power supply and then reconnect it.

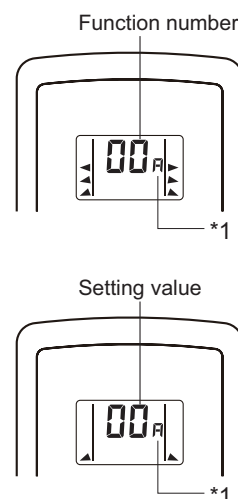

***1:** Small  is displayed on the right of the custom code during the function setting.

** CAUTION**

After disconnect the power supply, wait 30 seconds or more before reconnecting it. The function setting will not become active unless the power supply is disconnected and then reconnected.

■ Contents of function setting

Each function setting listed in this section is adjustable in accordance with the installation environment.

NOTE: Setting will not be changed if invalid numbers or setting values are selected.

● Function setting list

	Function no.	Functions
1)	11	Filter sign
2)	30/31	Room temperature control for indoor unit sensor
3)	40	Auto restart
4)	44	Remote controller custom code
5)	49	Indoor unit fan control for energy saving for cooling

1) Filter sign

Select appropriate intervals for displaying the filter sign on the indoor unit according to the estimated amount of dust in the air of the room.

If the indication is not required, select "No indication" (03).

Function number	Setting value	Setting description	Factory setting
11	00	Standard (400 hours)	
	01	Long interval (1,000 hours)	
	02	Short interval (200 hours)	
	03	No indication	◆

2) Room temperature control for indoor unit sensor

Depending on the installed environment, correction of the room temperature sensor may be required. Select the appropriate control setting according to the installed environment.

The temperature correction values show the difference from the Standard setting "00" (manufacturer's recommended value).

Function number	Setting value	Setting description	Factory setting
30 (For cooling)	31 (For heating)	00	Standard setting
		01	No correction 0.0 °C
		02	-0.5 °C
		03	-1.0 °C
		04	-1.5 °C
		05	-2.0 °C
		06	-2.5 °C
		07	-3.0 °C
		08	-3.5 °C
		09	-4.0 °C
		10	+0.5 °C
		11	+1.0 °C
		12	+1.5 °C
		13	+2.0 °C
		14	+2.5 °C
		15	+3.0 °C
		16	+3.5 °C
		17	+4.0 °C

3) Auto restart

Enables or disables automatic restart after a power interruption.

Function number	Setting value	Setting description	Factory setting
40	00	Enable	◆
	01	Disable	

NOTE: Auto restart is an emergency function such as for power outage etc. Do not attempt to use this function in normal operation. Be sure to operate the unit by remote controller or external device.

4) Remote controller custom code

(Only for wireless remote controller)

The indoor unit custom code can be changed. Select the appropriate custom code.

Function number	Setting value	Setting description	Factory setting
44	00	A	◆
	01	B	
	02	C	
	03	D	

5) Indoor unit fan control for energy saving for cooling

Enables or disables the power-saving function by controlling the indoor unit fan rotation when the outdoor unit is stopped during cooling operation.

Function number	Setting value	Setting description	Factory setting
49	00	Disable	
	01	Enable	◆

00: When the outdoor unit is stopped, the indoor unit fan operates continuously following the setting on the remote controller.


01: When the outdoor unit is stopped, the indoor unit fan operates intermittently at a very low speed.

9-2. Custom code setting for wireless remote controller

To interconnect the air conditioner and the wireless remote controller, assignment of the custom code for the wireless remote controller is required.

NOTE: Air conditioner cannot receive a custom code if the air conditioner has not been set for the custom code.

1. Press the MODE button for at least 5 seconds to display the current custom code. (Initially set to $\overline{A}$.)







2. Press the SET TEMP. ($\blacktriangle$ or $\blacktriangledown$) button to change the custom code between $\overline{A} \rightarrow \overline{b} \rightarrow \overline{c} \rightarrow \overline{d}$. Match the code on the display to the air conditioner custom code.
3. Press the MODE button again. The custom code will be changed.

NOTES:

- If no button is pressed within 30 seconds after the custom code is displayed, the system returns to the original clock indicator. In this case, start again from step 1.
- The air conditioner custom code is set to $\overline{A}$ prior to shipment. To change the custom code, contact your retailer.
- The remote controller resets to custom code $\overline{A}$ when the batteries in the remote controller are replaced. If you use a custom code other than code $\overline{A}$, reset the appropriate custom code after replacing the batteries. If you do not know the assigned code for the air conditioner, try each of the custom code ($\overline{A} \rightarrow \overline{b} \rightarrow \overline{c} \rightarrow \overline{d}$) until you find the code which operates the air conditioner.

10. Accessories

10-1. Models: ASYG18KLCA and ASYG24KLCA

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Operating manual		1	Battery		2
Operating manual (CD-ROM)		1	Remote controller holder		1
Installation manual		1	Cloth tape		1
Wall hook bracket		1	Tapping screw (large)		5
Remote controller		1	Tapping screw (small)		2

Part 2. OUTDOOR UNIT

SINGLE TYPE:

AOYG18KLTA

AOYG24KLTA


1. Specifications

Type				Inverter heat pump	
Model name				AOYG18KLTA	AOYG24KLTA
Power supply				230 V ~ 50 Hz	
Available voltage range				198—264 V	
Starting current			A	8.0	10.9
Fan	Airflow rate	Cooling	m³/h	1,830	2,885
		Heating		2,265	3,030
	Type × Q'ty		Propeller fan × 1		
	Motor output		W	23	49
Sound pressure level *1		Cooling	dB (A)	50	55
		Heating		56	57
Sound power level		Cooling	dB (A)	61	65
		Heating		66	67
Heat exchanger type		Dimensions (H × W × D)	mm	Main1: 504 × 881 × 18.19 Main2: 504 × 851 × 18.19	Main1: 588 × 881 × 18.19 Main2: 588 × 851 × 18.19
		Fin pitch		1.3	
		Rows × Stages		Main1: 1 × 24 Main2: 1 × 24	Main1: 1 × 28 Main2: 1 × 28
		Pipe type		Copper	
		Fin type	Type (Material)	Aluminum	
			Surface treatment	PC fin	
Compressor	Type × Q'ty	Twin rotary × 1			
	Motor output		W	900	1,060
Refrigerant		Type (Global warming potential)	R32 (675)		
		Charge	g	850	1,100
Refrigerant oil		Type	FW68S		RmM68AF
		Amount	cm³	350	400
Enclosure		Material	Steel sheet		
		Color	Beige Approximate color of Munsell 10YR 7.5/1.0		
Dimensions (H × W × D)	Net	mm	542 × 799 × 290		632 × 799 × 290
	Gross		602 × 940 × 375		692 × 940 × 375
Weight	Net	kg	33		38
	Gross		36		42
Connection pipe	Size	Liquid	mm (in)	Ø 6.35 (Ø 1/4)	
		Gas		Ø 9.52 (Ø 3/8) Ø 12.70 (Ø 1/2)	
	Method		Flare		
	Pre-charge length		m	15	
	Max. length			25	30
	Max. height difference			20	25
Operation range		Cooling	°C	-10 to 46	
		Heating		-15 to 24	
Drain pipe		Material	PP+HDPE		
		Size	mm	Ø 13.0 (I. D.), Ø 16.0 to Ø 16.8 (O. D.)	
NOTES:					
• Specifications are based on the following conditions:					
– Cooling: Indoor temperature of 27 °CDB/19 °CWB, and outdoor temperature of 35 °CDB/24 °CWB					
– Heating: Indoor temperature of 20 °CDB/15 °CWB, and outdoor temperature of 7 °CDB/6 °CWB					
– Pipe length: 5 m, Height difference: 0 m (Between outdoor unit and indoor unit)					
• Protective function might work when using it outside the operation range.					
• *1: Sound pressure level					
– Measured values in manufacturer's anechoic chamber					
– Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.					


2. Dimensions

2-1. Model: AOYG18KLTA


Unit: mm

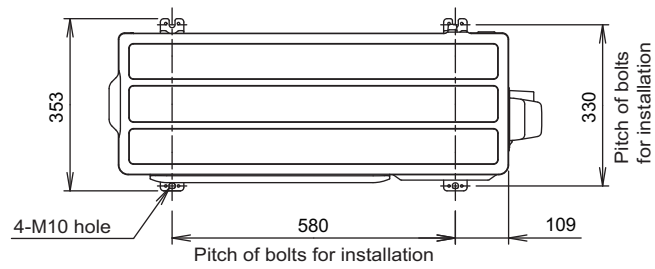


Top view

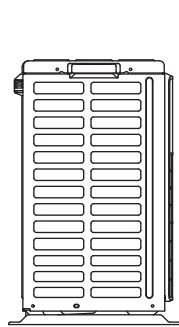


Side view

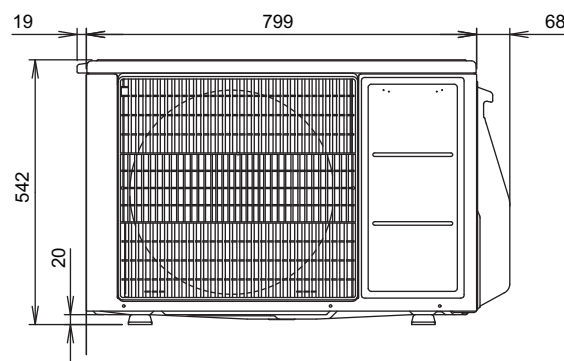


Front view

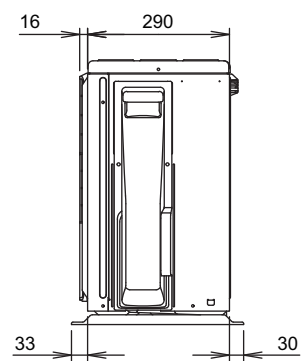

Side view

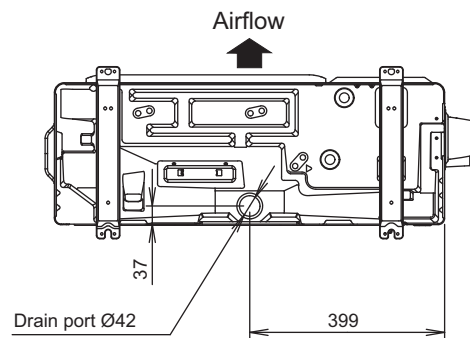


Bottom view

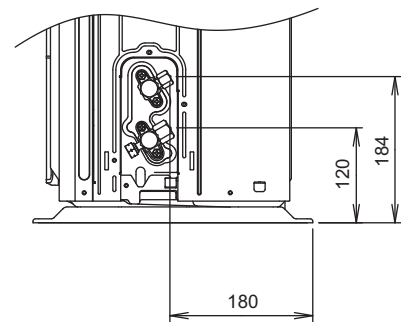


Side view (Valve part)

2-2. Model: AOYG24KLTA


Unit: mm

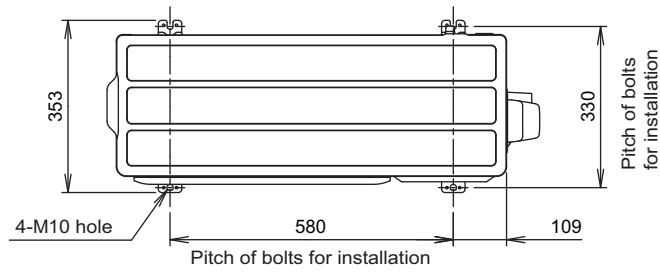


Top view

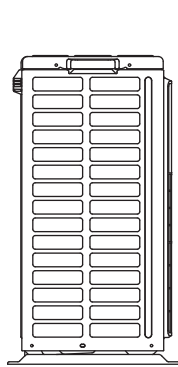


Side view

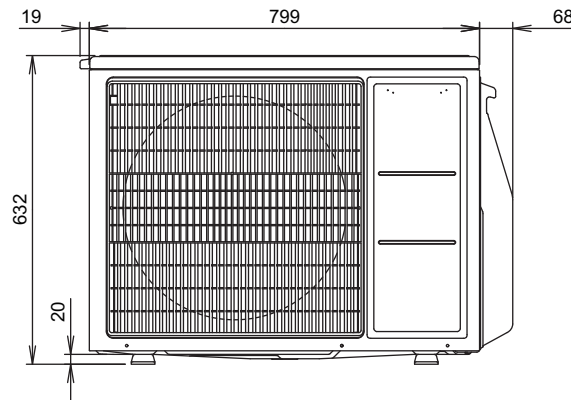


Front view

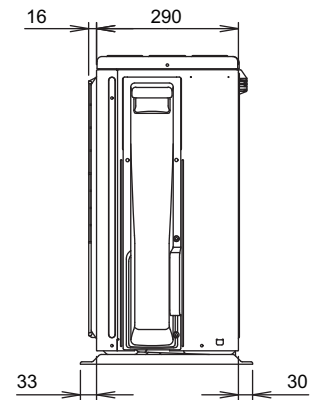

Side view

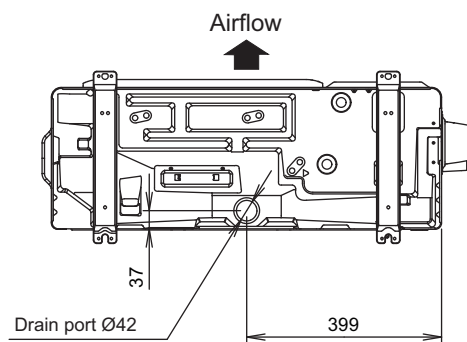

Bottom view

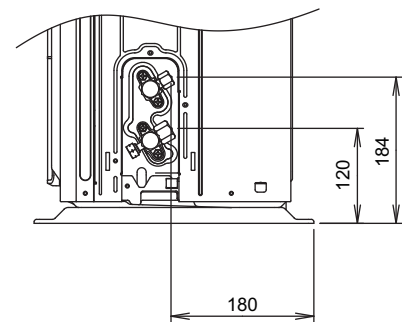

Side view (Valve part)

3. Installation space

3-1. Models: AOYG18KLTA and AOYG24KLTA

■ Space requirement

Provide sufficient installation space for product safety.

⚠ CAUTION

Keep the space shown in the installation examples.


If the installation is not performed accordingly, it could cause a short circuit and result in a lack of operating performance.

● Single outdoor unit installation


- When the upper space is open:

Unit: mm


Obstacles at rear only

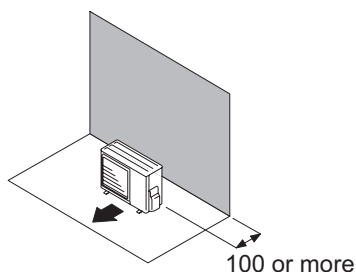


Obstacles at rear and sides

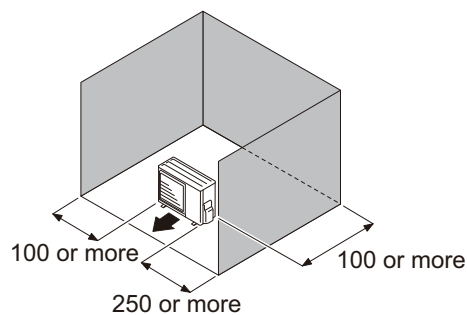

Obstacles at front

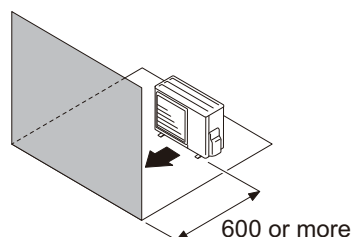


Obstacles at front and rear

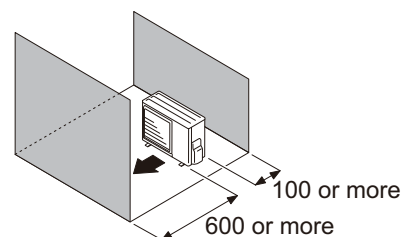


- When an obstruction in the upper space:

Unit: mm

Obstacles at rear and above

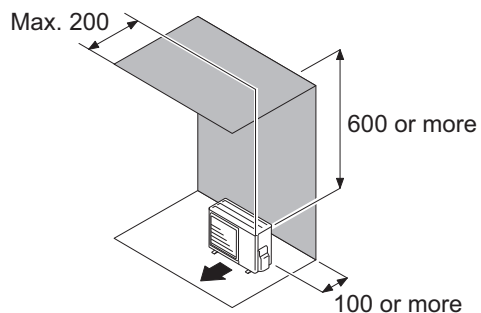


Obstacles at rear, sides, and above

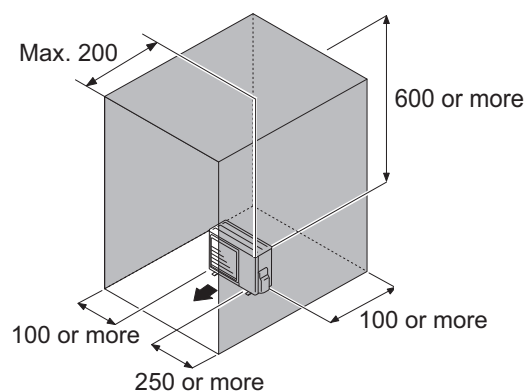

OUTDOOR UNIT
AOYG18, 24KLTA

- **When the upper space is open:**

Obstacles at rear only

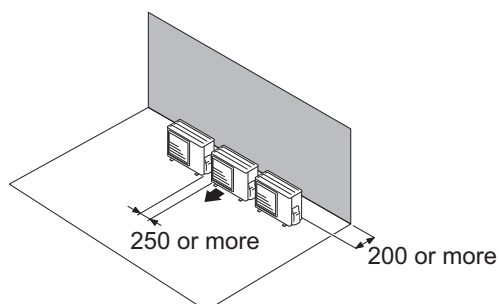


- Unit: mm



● Outdoor units installation in multi-row

Unit: mm

Single parallel unit arrangement

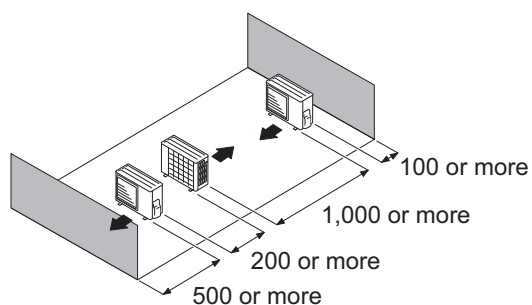

Multiple parallel unit arrangement

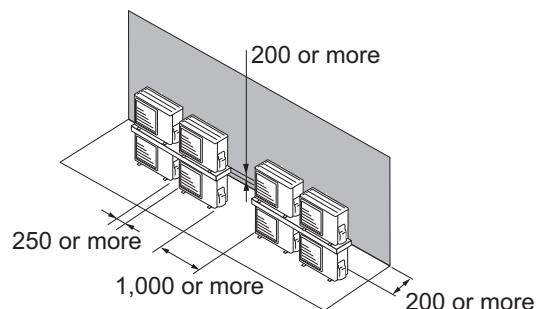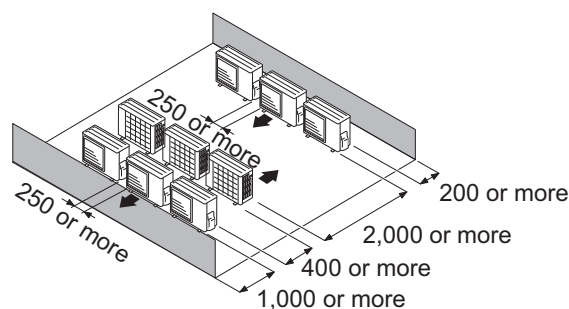


NOTES:

- If the space is larger than stated above, the condition will be the same as when there is no obstacle.
- When installing the outdoor unit, be sure to open the front and left side to obtain better operation efficiency.


⚠ CAUTION

- Do not install the outdoor unit in two-stage where the drain water could freeze. Otherwise the drainage from the upper unit may form ice and cause a malfunction of the lower unit.
- When the outdoor temperature is 0 °C or less, do not use the accessory drain pipe and drain cap. If the drain pipe and drain cap are used, the drain water in the pipe may freeze in extremely cold climate. (For reverse cycle model only.)
- In area with heavy snowfall, if the inlet and outlet of the outdoor unit is blocked with snow, it might become difficult to get warm, and it is likely to cause product malfunction. Construct a canopy and a pedestal, or place the unit on a high stand that is locally installed.



4. Refrigerant circuit

4-1. Model: AOYG18KLTA

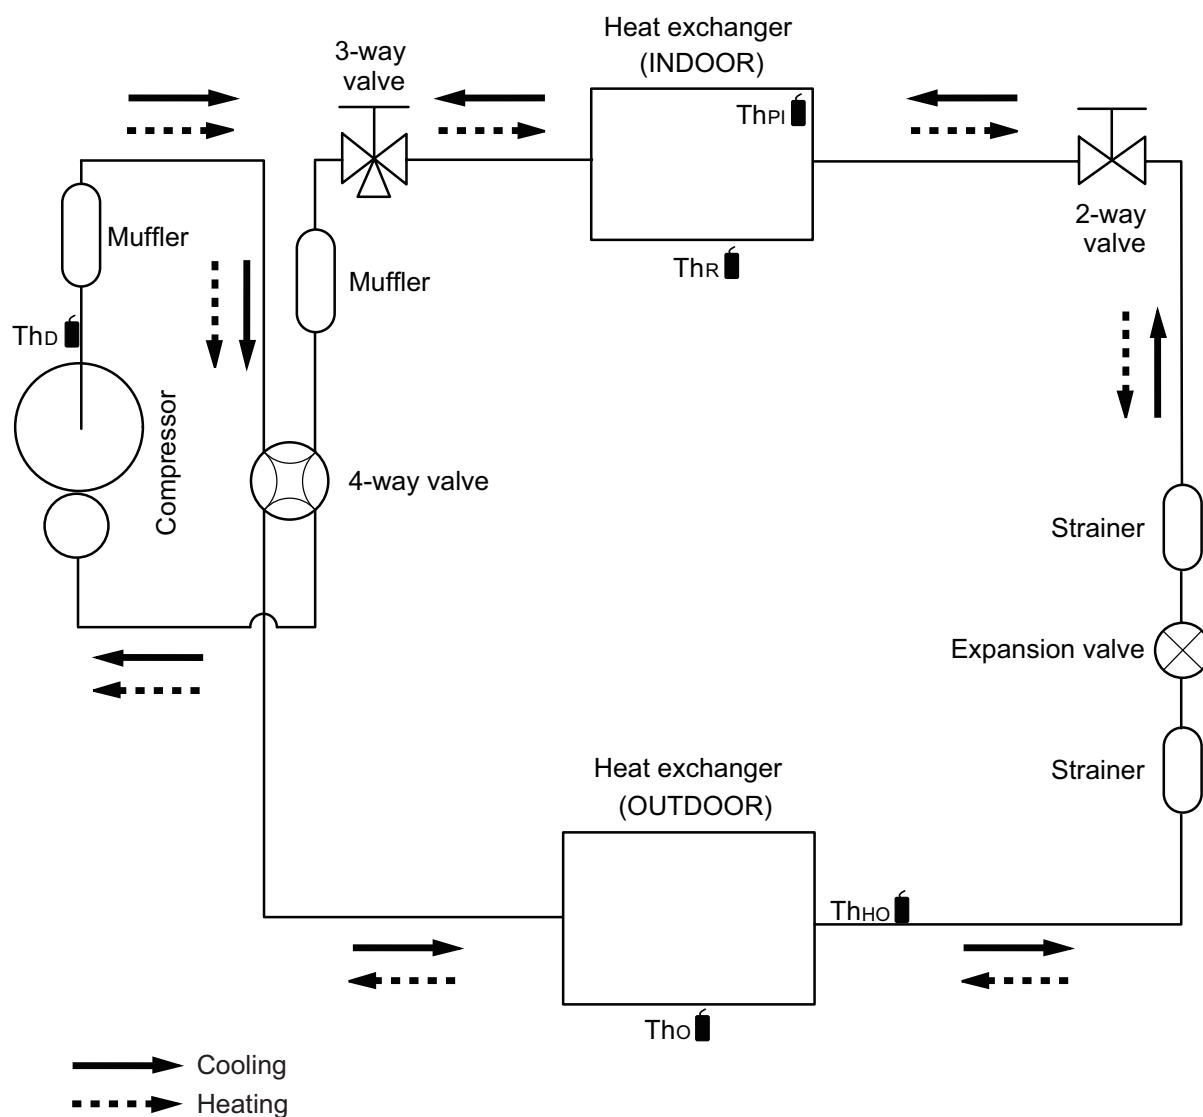

Th_D : Thermistor (Discharge temperature)


Th_O : Thermistor (Outdoor temperature)

Th_{HO} : Thermistor (Heat exchanger out temperature)

Th_R : Thermistor (Room temperature)


Th_{PI} : Thermistor (Pipe temperature)

4-2. Model: AOYG24KLTA

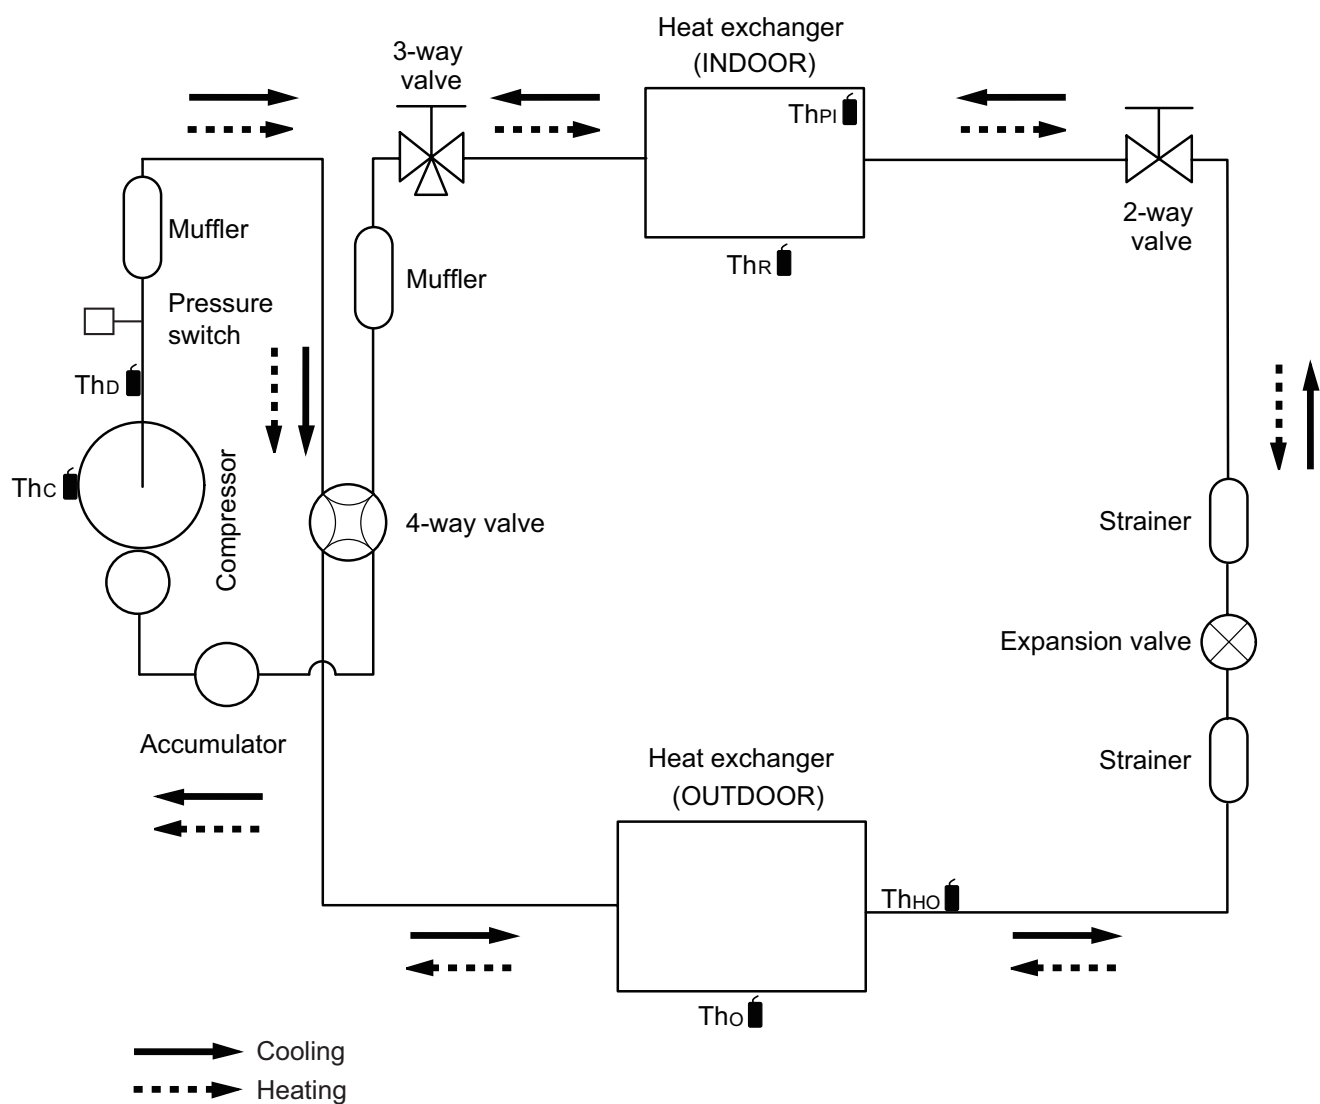

- Th_{CH} : Thermistor (Compressor temperature)
 Th_D : Thermistor (Discharge temperature)
 Th_O : Thermistor (Outdoor temperature)
 Th_{HO} : Thermistor (Heat exchanger out temperature)
 Th_R : Thermistor (Room temperature)
 Th_{PI} : Thermistor (Pipe temperature)

6. Capacity compensation rate for pipe length and height difference

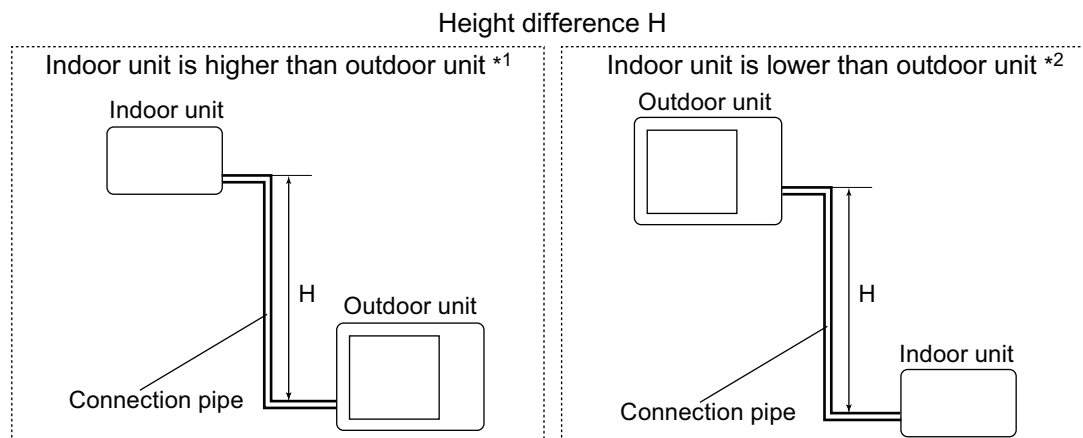

6-1. Model: AOYG18KLTA

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

COOLING			Pipe length (m)					
			5	7.5	10	15	20	25
Height difference H (m)	Indoor unit is higher than outdoor unit *1	20	—	—	—	—	0.872	0.848
		15	—	—	—	0.904	0.879	0.854
		10	—	—	0.951	0.919	0.893	0.868
		7.5	—	0.972	0.955	0.923	0.897	0.872
		5	0.992	0.975	0.959	0.925	0.901	0.876
	Indoor unit is lower than outdoor unit *2	0	1.000	0.983	0.967	0.933	0.908	0.883
		-5	1.000	0.983	0.967	0.933	0.908	0.883
		-7.5	—	0.983	0.967	0.933	0.908	0.883
		-10	—	—	0.967	0.933	0.908	0.883
		-15	—	—	—	0.933	0.908	0.883

HEATING			Pipe length (m)					
			5	7.5	10	15	20	25
Height difference H (m)	Indoor unit is higher than outdoor unit *1	20	—	—	—	—	0.863	0.857
		15	—	—	—	0.869	0.863	0.857
		10	—	—	0.934	0.869	0.863	0.857
		7.5	—	0.967	0.934	0.869	0.863	0.857
		5	1.000	0.967	0.934	0.869	0.863	0.857
	Indoor unit is lower than outdoor unit *2	0	1.000	0.967	0.934	0.869	0.863	0.857
		-5	0.995	0.962	0.930	0.864	0.859	0.853
		-7.5	—	0.960	0.928	0.862	0.856	0.850
		-10	—	—	0.926	0.860	0.854	0.848
		-15	—	—	—	0.852	0.846	0.840

6-2. Model: AOYG24KLTA

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

COOLING			Pipe length (m)						
			5	7.5	10	15	20	25	30
Height difference H (m)	Indoor unit is higher than outdoor unit *1	25	—	—	—	—	—	0.893	0.877
		20	—	—	—	—	0.917	0.900	0.885
		10	—	—	0.966	0.947	0.932	0.914	0.899
		7.5	—	0.979	0.970	0.951	0.936	0.918	0.903
		5	0.992	0.983	0.974	0.955	0.939	0.922	0.906
		0	1.000	0.991	0.981	0.963	0.946	0.930	0.914
	Indoor unit is lower than outdoor unit *2	-5	1.000	0.991	0.981	0.963	0.946	0.930	0.914
		-7.5	—	0.991	0.981	0.963	0.946	0.930	0.914
		-10	—	—	0.981	0.963	0.946	0.930	0.914
		-20	—	—	—	—	0.946	0.930	0.914
		-25	—	—	—	—	—	0.930	0.914

HEATING			Pipe length (m)						
			5	7.5	10	15	20	25	30
Height difference H (m)	Indoor unit is higher than outdoor unit *1	25	—	—	—	—	—	0.871	0.855
		20	—	—	—	—	0.887	0.871	0.855
		10	—	—	0.952	0.903	0.887	0.871	0.855
		7.5	—	0.976	0.952	0.903	0.887	0.871	0.855
		5	1.000	0.976	0.952	0.903	0.887	0.871	0.855
		0	1.000	0.976	0.952	0.903	0.887	0.871	0.855
	Indoor unit is lower than outdoor unit *2	-5	0.995	0.971	0.947	0.899	0.883	0.866	0.850
		-7.5	—	0.969	0.945	0.897	0.881	0.865	0.849
		-10	—	—	0.942	0.894	0.879	0.863	0.847
		-20	—	—	—	—	0.869	0.854	0.838
		-25	—	—	—	—	—	0.850	0.834

7. Additional charge calculation

7-1. Model: AOYG18KLTA

Refrigerant type		R32
Refrigerant amount	g	850

■ Refrigerant charge

Total pipe length	m	15 or less	20	25 (Max.)	20 g/m
Additional charge	g	0	100	200	

7-2. Model: AOYG24KLTA

Refrigerant type		R32
Refrigerant amount	g	1,100

■ Refrigerant charge

Total pipe length	m	15 or less	20	25	30 (Max.)	20 g/m
Additional charge	g	0	100	200	300	

8. Airflow

8-1. Model: AOYG18KLTA

● Cooling

m ³ /h	1,830
l/s	508
CFM	1,077

● Heating

m ³ /h	2,265
l/s	629
CFM	1,333

8-2. Model: AOYG24KLTA

● Cooling

m ³ /h	2,885
l/s	801
CFM	1,698

● Heating


m ³ /h	3,030
l/s	842
CFM	1,783

9. Operation noise (sound pressure)


9-1. Noise level curve

Model: AOYG18KLTA

● Cooling

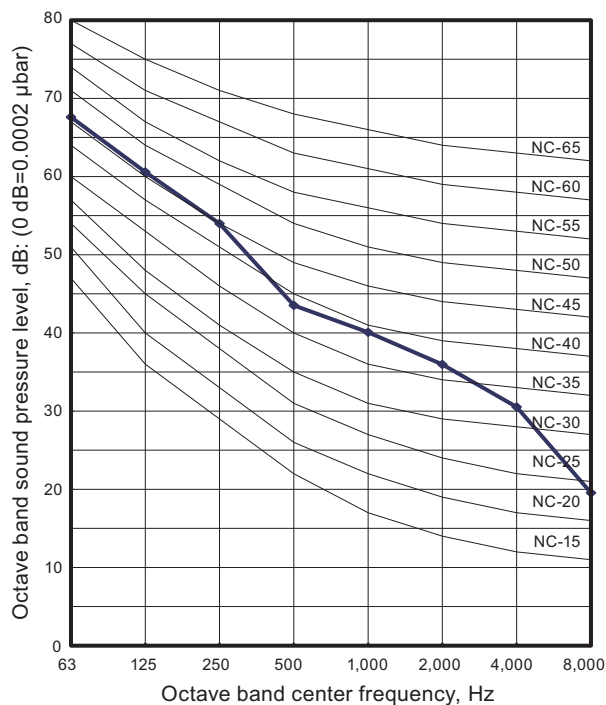


● Heating

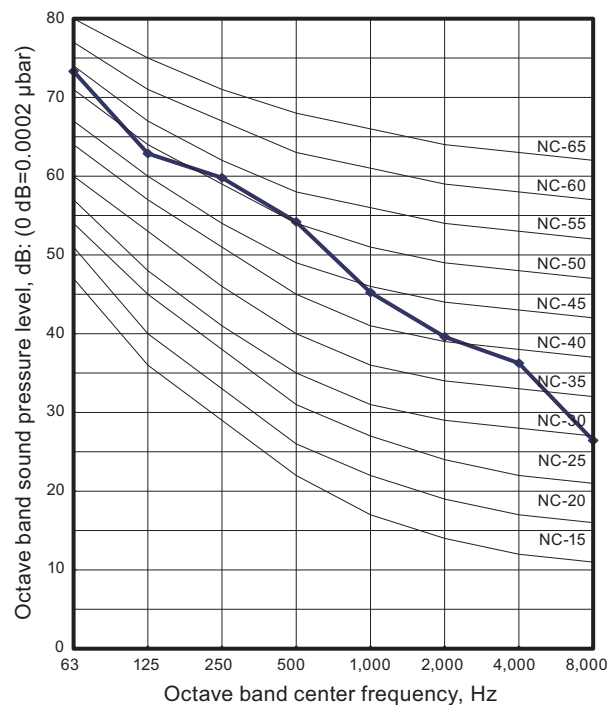


Model: AOYG24KLTA


● Cooling

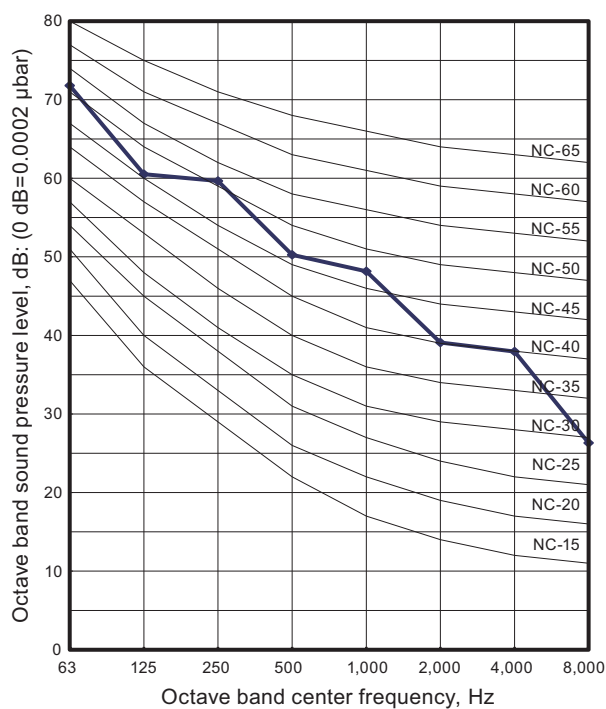

● Heating

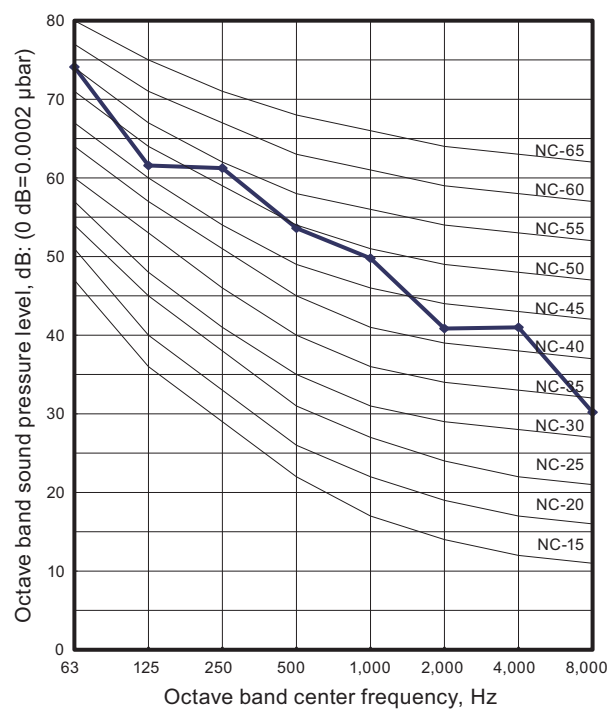

9-2. Sound level check point

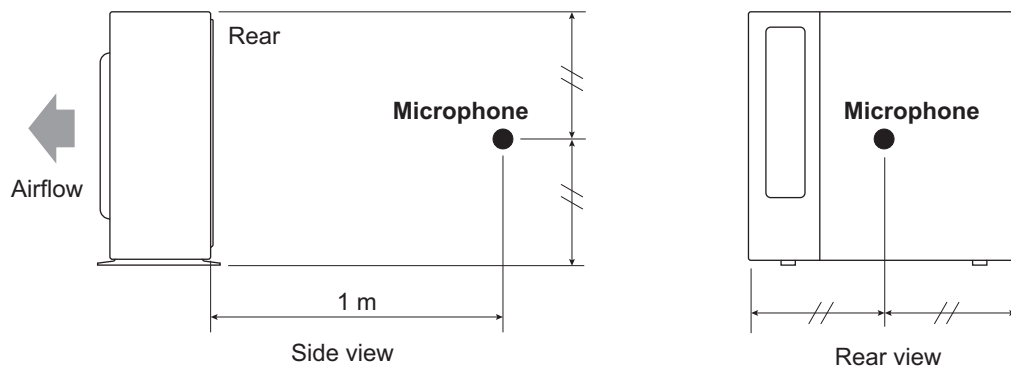

NOTE: Detailed shape of the actual outdoor unit might be slightly different from the one illustrated above.

10. Electrical characteristics

Model name				AOYG18KLTA		AOYG24KLTA	
Power supply	Voltage		V	230 ~			
	Frequency		Hz	50			
Max operating current *1			A	13.5		17.5	
Starting current			A	8.0		10.9	
Wiring spec. *2	Circuit breaker current		A	15		20	
	Power cable		mm ²	1.5			
	Connection cable *3	Cross-sectional area	mm ²	1.5			
		Limited wiring length	m	26		31	

*1: Maximum operating current is the total current of the indoor unit and the outdoor unit.

*2: Selected sample based on Japan Electrotechnical Standards and Codes Committee E0005. As the regulations of wire size and circuit breaker differ in each country or region, select appropriate devices complied to the regional standard.

*3: Limit voltage drop to less than 2%. If voltage drop is 2% or more, increase cable conductor size.

11. Safety devices

Type of protection	Protection form		Model	
			AOYG18KLTA	AOYG24KLTA
Circuit protection	Current fuse (Main PCB)		250 V, 20 A	250 V, 25 A
			250 V, 5 A	
			—	250 V, 3.15 A
Fan motor protection	Terminal protection program	Activate	100±15 °C Fan motor stop	125±10 °C Fan motor stop
		Reset	95±10 °C Fan motor restart	120±10 °C Fan motor restart
Compressor protection	Terminal protection program (Discharge temp.)	Activate	110 °C Compressor stop	115 °C Compressor stop
		Reset	After 7 minutes Compressor restart	After 3 minutes Compressor restart

12. Accessories

12-1. Models: AOYG18KLTA and AOYG24KLTA

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Installation manual		1	Drain pipe		1