

AIR CONDITIONER

2-unit multi-split type

DESIGN & TECHNICAL MANUAL

INDOOR



AUXG07-14KVLA

ARXG07-14KSLAP

ARXG07-14KLLAP

ARXH12-14KMTAP



ASHG07-14KMTB
ASHG07-14KMCC
ASHG07-14KMCE
ASHG07-14KMCF
ASHH07-14KMCG
ASHH07-14KMCH

ASHH07-14KMCG-B
ASHH07-14KMCH-B
ASHG07-14KETA
ASHG07-14KETF
ASHG07-14KETA-B
ASHG07-14KETE-B
ASHG07-14KETF-B

ASHG07-14KETE
ASHG07-14KGTE
ASHG07-14KGTF
ASHH07-14KG TG
ASHH07-14KGTH

ASHG07-14KG TB
ASHH05-12KNCA
ASHH05-12KNCH



OUTDOOR



AGHG09-14KVCA

AOHG14KBTA2

AOHG18KBTA2

FUJITSU GENERAL LIMITED

Notices:

- Product specifications and design are subject to change without notice for future improvement.
- For further details, please check with our authorized dealer.

Trademarks

FGLair™ is trademark of FUJITSU GENERAL LIMITED in the United States, other countries or both.

“AIRSTAGE Mobile” is a trademark of FUJITSU GENERAL LIMITED.

Android and Google Play are trademarks of Google LLC.

App Store is a service mark of Apple Inc., registered in the U.S. and other countries.

IOS is a trademark or registered trademark of Cisco in the U.S. and other countries and is used under license.

CONTENTS

Part 1. INDOOR UNIT	1
1. Model lineup	2
1-1. Connectable indoor units to each outdoor unit	5
1-2. Indoor unit connection patterns	6
2. Specifications	7
2-1. Compact cassette type	7
2-2. Mini duct type	8
2-3. Slim duct type	9
2-4. Medium static pressure duct type	10
2-5. Wall mounted type	11
2-6. Floor type	27
3. Wireless LAN control (for KMCF, KMCG, KMCG-B, KETF, KETF-B, KGTF, KGTG, and KNCA)	28
3-1. System requirement	28
4. Dimensions	29
4-1. Compact cassette type	29
4-2. Mini duct type	31
4-3. Slim duct type	33
4-4. Medium static pressure duct type	35
4-5. Wall mounted type	38
4-6. Floor type	53
5. Wiring diagrams	55
5-1. Compact cassette type	55
5-2. Mini duct type and Slim duct type	56
5-3. Medium static pressure duct type	57
5-4. Wall mounted type	58
5-5. Floor type	70
6. Air velocity and temperature distributions	71
6-1. Compact cassette type	71
6-2. Mini duct type	77
6-3. Slim duct type	85
6-4. Wall mounted type	93
6-5. Floor type	99
7. Fan performance	100
7-1. Mini duct type	100
7-2. Slim duct type	108
7-3. Medium static pressure duct type	116
8. Airflow	120
8-1. Compact cassette type	120
8-2. Mini duct type	121
8-3. Slim duct type	122

CONTENTS (continued)

8-4. Medium static pressure duct type	123
8-5. Wall mounted type	124
8-6. Floor type	135
9. Noise level curve	136
9-1. Compact cassette type	136
9-2. Mini duct type	138
9-3. Slim duct type	140
9-4. Medium static pressure duct type	142
9-5. Wall mounted type	143
9-6. Floor type	151
9-7. Sound level check point	153
10. Electrical characteristics	156
11. Safety devices	159
12. External input and output	162
12-1. Compact cassette type and Medium static pressure duct type	162
12-2. Mini duct type and Slim duct type	173
12-3. Wall mounted type (KGTB, KETA, and KETA-B)	179
12-4. Wall mounted type (KMTB and KMCC)	189
12-5. Wall mounted type (KMCE, KMCF, KMCG, KMCG-B, KMCH, KMCH-B, KETE, KETE-B, KETF, KETF-B, KGTE, KGTf, KGTG, and KGTH)	194
12-6. Floor type	207
13. Group connection	216
14. Remote controller	218
14-1. Wireless remote controller (AR-REW4E, AR-REM4E, AR-REB1E, and AR-REJ1E) ..	218
14-2. Wireless remote controller (AR-REW3E)	223
14-3. Wireless remote controller (AR-REM7E)	225
14-4. Wireless remote controller (AR-RMB1E and AR-RMB1E-B)	227
14-5. Wireless remote controller (UTY-LNTG: Optional part) and IR receiver kit with Wireless remote controller (UTY-LBTGM: Optional part)	229
14-6. Wireless remote controller (AR-RPF4E)	232
14-7. Wired remote controller (UTY-RNNGM: Optional part)	234
14-8. Wired Remote Controller (UTY-RVRG : Optional part)	238
14-9. Wired remote controller (UTY-RLRG: Optional part)	248
14-10. Wired remote controller (UTY-RVNGM: Optional part)	252
14-11. Wired remote controller (UTY-RNRGZ*: Optional part)	260
14-12. Wired remote controller (UTY-RCRGZ1: Optional part)	264
14-13. Simple remote controller (UTY-RSNGM: Optional part)	268
14-14. Simple remote controller (UTY-RSRG and UTY-RHRG: Optional parts)	272
15. Function settings	276
15-1. Compact cassette, Mini duct, Slim duct types indoor unit (setting by DIP switch)	276
15-2. Medium static pressure duct type	278
15-3. Indoor unit (setting by wireless remote controller)	279
15-4. Indoor unit (setting by wired remote controller)	299

CONTENTS (continued)

15-5.Indoor unit (setting by simple remote controller)	312
15-6.Function details.....	319
15-7.Wired remote controller (UTY-RNNGM)	329
15-8.Wired remote controller (UTY-RVNGM).....	331
15-9.Wired remote controller (UTY-RLRG)	332
15-10.Wired remote controller (UTY-RNRGZ*).....	332
15-11.Simple remote controller (UTY-RSNGM)	333
16. Accessories	334
16-1.Compact cassette type	334
16-2.Mini duct type.....	335
16-3.Slim duct type	336
16-4.Medium static pressure duct type	337
16-5.Wall mounted type	338
16-6.Floor type	345
17. Optional parts	346
17-1.Controllers	346
17-2.Cassette grille	352
17-3.Others	353
18. Indoor unit installation precautions	361
18-1.Places where prohibited for use	361
18-2.Points to remember when installing	361

CONTENTS (continued)

Part 2. OUTDOOR UNIT (2 UNITS TYPE)	365
1. Specifications	366
2. Dimensions	368
2-1. Model: AOHG14KBTA2	368
2-2. Model: AOHG18KBTA2	369
3. Installation space	370
3-1. Models: AOHG14KBTA2 and AOHG18KBTA2.....	370
4. Refrigerant circuit	373
4-1. Model: AOHG14KBTA2	373
4-2. Model: AOHG18KBTA2	374
5. Wiring diagram	375
5-1. Model: AOHG14KBTA2	375
5-2. Model: AOHG18KBTA2	376
6. Capacity table	377
6-1. Combinations	377
6-2. Cooling capacity.....	381
6-3. Heating capacity	403
7. Capacity compensation rate for pipe length and height difference.....	425
7-1. Model: AOHG14KBTA2	425
7-2. Model: AOHG18KBTA2	427
8. Additional charge calculation	429
8-1. Model: AOHG14KBTA2	429
8-2. Model: AOHG18KBTA2	429
9. Airflow	430
9-1. Model: AOHG14KBTA2	430
9-2. Model: AOHG18KBTA2	430
10. Operation noise (sound pressure).....	431
10-1.Noise level curve.....	431
10-2.Sound level check point	432
11. Electrical characteristics	433
12. Safety devices	434
13. Accessories	435
13-1.Models: AOHG14KBTA2 and AOHG18KBTA2.....	435
14. Outdoor unit installation precautions	436
14-1.Places where prohibited for use.....	436
14-2.Points to remember when installing	436

Part 1. INDOOR UNIT

COMPACT CASSETTE TYPE:

AUXG07-14KVLA

MINI DUCT TYPE:

ARXG07-14KSLAP

SLIM DUCT TYPE:

ARXG07-14KLLAP

MEDIUM STATIC PRESSURE DUCT TYPE:

ARXH12-14KMTAP

WALL MOUNTED TYPE:

ASHG07-14KMTB

ASHG07-14KETA

ASHG07-14KGTB

ASHH05-12KNCA

ASHG07-14KMCC

ASHG07-14KETE

ASHG07-14KGTE

ASHH05-12KNCH

ASHG07-14KMCE

ASHG07-14KETF

ASHG07-14KGTF

ASHG07-14KMCF

ASHG07-14KETA-B

ASHH07-14KG TG

ASHH07-14KMCG

ASHG07-14KETE-B

ASHH07-14KGTH

ASHH07-14KMCG-B

ASHG07-14KETF-B

ASHH07-14KMCH

ASHH07-14KMCH-B

FLOOR TYPE:

AGHG09-14KVCA

1. Model lineup

Indoor unit (other than wall-mounted type)		
 AUXG07KVLA AUXG09KVLA AUXG12KVLA AUXG14KVLA	 ARXG07KSLAP ARXG09KSLAP ARXG12KSLAP ARXG14KSLAP	 ARXG07KLLAP ARXG09KLLAP ARXG12KLLAP ARXG14KLLAP
 ARXH12KMTAP ARXH14KMTAP	 AGHG09KVCA AGHG12KVCA AGHG14KVCA	

Indoor unit (wall-mounted type)

			
ASHG07KMTB ASHG09KMTB ASHG12KMTB ASHG14KMTB ASHG07KMCC ASHG09KMCC ASHG12KMCC ASHG14KMCC ASHG07KMCE ASHG09KMCE ASHG12KMCE ASHG14KMCE ASHG07KMCF ASHG09KMCF ASHG12KMCF ASHG14KMCF ASHH07KMCG ASHH09KMCG ASHH12KMCG ASHH14KMCG ASHH07KMCH ASHH09KMCH ASHH12KMCH ASHH14KMCH	ASHH07KMCG-B ASHH09KMCG-B ASHH12KMCG-B ASHH14KMCG-B ASHH07KMCH-B ASHH09KMCH-B ASHH12KMCH-B ASHH14KMCH-B	ASHG07KETA ASHG09KETA ASHG12KETA ASHG14KETA ASHG07KETE ASHG09KETE ASHG12KETE ASHG14KETE ASHG07KETF ASHG09KETF ASHG12KETF ASHG14KETF	ASHG07KETA-B ASHG09KETA-B ASHG12KETA-B ASHG14KETA-B ASHG07KETE-B ASHG09KETE-B ASHG12KETE-B ASHG14KETE-B ASHG07KETF-B ASHG09KETF-B ASHG12KETF-B ASHG14KETF-B
			
ASHG07KGTB ASHG09KGTB ASHG12KGTB ASHG14KGTB	ASHG07KGTE ASHG09KGTE ASHG12KGTE ASHG14KGTE ASHG07KGTF ASHG09KGTF ASHG12KGTF ASHG14KGTF ASHH07KG TG ASHH09KG TG ASHH12KG TG ASHH14KG TG ASHH07KG TH ASHH09KG TH ASHH12KG TH ASHH14KG TH	ASHH05KNCA* ASHH07KNCA* ASHH09KNCA* ASHH12KNCA* ASHH05KNCH* ASHH07KNCH* ASHH09KNCH* ASHH12KNCH*	

*: The products are connectable to the outdoor unit with the serial number T100000/E100000 or later. (Example: T100123, Connectable; T012345, Not connectable)

Outdoor unit

AOHG14KBTA2



AOHG18KBTA2

1-1. Connectable indoor units to each outdoor unit

●: Connectable / -: Not connectable

Outdoor unit	Compact cassette				Mini duct			
	AUXG07-14KVLA				ARXG07-14KSLAP			
Btu class	07	09	12	14	07	09	12	14
kW class	2.0	2.5	3.5	4.0	2.0	2.5	3.5	4.0
AOHG14KBTA2	●	●	●	—	●	●	●	—
AOHG18KBTA2	●	●	●	●	●	●	●	●

Outdoor unit	Slim duct				Medium static pressure duct		
	ARXG07-14KLLAP				ARXH12-14KMTAP		
Btu class	07	09	12	14	12	14	
kW class	2.0	2.5	3.5	4.0	3.5	4.0	
AOHG14KBTA2	●	●	●	—	●	—	
AOHG18KBTA2	●	●	●	●	●	●	

Outdoor unit	Wall mounted							
	KM				KE			
ASHG07-14KMTB					ASHG07-14KETA			
ASHG07-14KMCC					ASHG07-14KETA-B			
ASHG07-14KMCE					ASHG07-14KETE			
ASHG07-14KMF					ASHG07-14KETE-B			
ASHH07-14KMCG					ASHG07-14KETF			
ASHH07-14KMCG-B					ASHG07-14KETF-B			
ASHH07-14KMCH								
ASHH07-14KMCH-B								
Btu class	07	09	12	14	07	09	12	14
kW class	2.0	2.5	3.5	4.0	2.0	2.5	3.5	4.0
AOHG14KBTA2	●	●	●	—	●	●	●	—
AOHG18KBTA2	●	●	●	●	●	●	●	●

Outdoor unit	Wall mounted							
	KG				KN			
ASHG07-14KGTB					ASHH05-12KNCA			
ASHG07-14KGTE					ASHH05-12KNCH			
ASHG07-14KGTF								
ASHH07-14KG TG								
ASHH07-14KGTH								
Btu class	07	09	12	14	05	07	09	12
kW class	2.0	2.5	3.5	4.0	1.5	2.0	2.5	3.5
AOHG14KBTA2	●	●	●	—	●	●	●	●
AOHG18KBTA2	●	●	●	●	●	●	●	●

Outdoor unit	Floor			
	AGHG09-14KVCA			
Btu class	09	12	14	
kW class	2.5	3.5	4.0	
AOHG14KBTA2	●	●	—	
AOHG18KBTA2	●	●	●	

1-2. Indoor unit connection patterns

■ 2 units

AOHG14KBTA2			
Combination no.	Unit 1	Unit 2	Total
1	5	5	10
2	5	7	12
3	5	9	14
4	5	12	17
5	7	7	14
6	7	9	16
7	7	12	19
8	9	9	18
9	9	12	21

AOHG18KBTA2			
Combination no.	Unit 1	Unit 2	Total
1	5	5	10
2	5	7	12
3	5	9	14
4	5	12	17
5	5	14	19
6	7	7	14
7	7	9	16
8	7	12	19
9	7	14	21
10	9	9	18
11	9	12	21
12	9	14	23
13	12	12	24
14	12	14	26

Numbers in column Unit 1, 2, and Total indicate the indoor unit capacities as follows:

5: 5,000 Btu/h, 7: 7,000 Btu/h, 9: 9,000 Btu/h, 12: 12,000 Btu/h, 14: 14,000 Btu/h

2. Specifications

2-1. Compact cassette type

Model name			AUXG07KVLA	AUXG09KVLA	AUXG12KVLA	AUXG14KVLA							
Power supply			1Ø 230 V~ 50 Hz										
Available voltage range			198–264 V										
Capacity	kW class		2.0	2.5	3.5	4.0							
Input power	W		18		23	28							
Running current	A		0.15		0.19	0.22							
Fan	Airflow rate	Cooling	HIGH	m³/h	540	610							
			MED		490	530							
			LOW		440	470							
			QUIET		390	410							
		Heating	HIGH		540	610							
			MED		490	530							
			LOW		440	470							
			QUIET		390	410							
Type x Qty			Turbo fan x 1										
Motor output			W										
Sound pressure level*	Cooling	HIGH		dB (A)	33	37							
			MED		31	34							
			LOW		29	31							
			QUIET		27	28							
		Heating	HIGH		34	37							
			MED		32	34							
			LOW		29	31							
			QUIET		27	29							
	Sound power level		Cooling	dB (A)	46	49							
			Heating		47	49							
Heat exchanger type	Dimensions (H × W × D)			mm	Main 1: 210 × 1,310 × 13.3 Main 2: 210 × 1,250 × 13.3								
	Fin pitch			mm	Main 1: 1.2 Main 2: 1.2								
	Rows × Stages				Main 1: 1 × 10 Main 2: 1 × 10								
	Pipe type				Copper tube								
	Fin type				Aluminum								
Dimensions (H × W × D)	Net		mm	245 × 570 × 570									
	Gross			265 × 730 × 625									
Weight	Net		kg	15									
	Gross			19									
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4) Ø9.52 (Ø3/8)									
		Gas		Flare									
	Method												
Operation range	Cooling		°C	18 to 32									
			%RH	80 or less									
	Heating		°C	16 to 30									
Drain hose			Material	Polyvinyl chloride									
			Tip diameter	mm	VP25 (Ø25 [I.D.], Ø32 [O.D.])								
Cassette grille (Grid type: Option)	Model name			UTG-UFGF-W									
	Material			Polystyrene									
	Color			White									
				Approximate color of Munsell 9PB 9.1/0.2									
	Dimensions (H × W × D)	Net	mm	49 × 620 × 620									
		Gross		120 × 765 × 755									
	Weight	Net	kg	2.3									
		Gross		4.5									
NOTES:													
<ul style="list-style-type: none"> • The protective function might work when using it outside the operation range. • *: Sound pressure level: <ul style="list-style-type: none"> – These are the measured values in the manufacturer's anechoic chamber. – Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here. 													

2-2. Mini duct type

Model name			ARXG07KSLAP	ARXG09KSLAP	ARXG12KSLAP	ARXG14KSLAP			
Power supply			1Ø 230 V~ 50 Hz						
Available voltage range			198–264 V						
Capacity		kW class	2.0	2.5	3.5	4.0			
Input power	Fan	HIGH	33	40	47	72			
		MED	23	23	26	44			
		LOW	20	20	22	30			
		QUIET	18	18	18	18			
		A	0.29	0.33	0.38	0.58			
Fan	Airflow rate	Cooling	550	600	650	800			
			440	450	490	640			
			390	400	430	530			
			360	360	360	360			
		Heating	550	600	650	800			
		440	450	490	640				
		390	400	430	530				
		360	360	360	360				
	Type × Qty			Sirocco fan × 2					
	Motor output		W	75					
Recommended static pressure			Pa	0 to 30		0 to 50			
Sound pressure level*	Cooling	HIGH	29	31		35			
		MED	26	27		30			
		LOW	24	25		27			
		QUIET	23	23		23			
	Heating	HIGH	29	31		35			
		MED	26	27		30			
		LOW	24	25		27			
		QUIET	23						
Sound power level	Cooling	dB (A)	52	54	55	60			
	Heating		53	56	57	62			
Heat exchanger type	Dimensions (H × W × D)		mm	336 × 490 × 26.6					
	Fin pitch		mm	1.3					
	Rows × Stages			2 × 16					
	Pipe type			Copper tube					
Enclosure	Fin type			Aluminum					
	Material			Steel sheet					
	Color			—					
Dimensions (H × W × D)	Net	mm	198 × 700 × 450						
	Gross		250 × 930 × 580						
Weight	Net	kg	15.5						
	Gross		19.0						
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)					
		Gas		Ø9.52 (Ø3/8)					
	Method			Flare					
Operation range	Cooling	°C	18 to 32						
		%RH	80 or less						
	Heating	°C	16 to 30						
Drain hose	Material		Hard Polyvinyl chloride						
	Tip diameter	mm	Ø25 (I.D.), Ø32 (O.D.)						

NOTES:

- Values mentioned in the table are based on the following conditions:
 - Static pressure: 07-12 models: 10 Pa, 14 model: 15 Pa
 - The protective function might work when using it outside the operation range.
 - *: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.

2-3. Slim duct type

Model name				ARXG07KLLAP	ARXG09KLLAP	ARXG12KLLAP	ARXG14KLLAP				
Power supply				1Ø 230 V~ 50 Hz							
Available voltage range				198–264 V							
Capacity		kW class	2.0	2.5	3.5	4.0					
Input power		W	33	49	58	76					
Running current		A	0.33	0.30	0.35	0.51					
Fan	Airflow rate	Cooling	HIGH	550	600	650	800				
			MED	490	550	600	700				
			LOW	470	500	550	600				
			QUIET	440	450	480	480				
		Heating	HIGH	550	600	650	800				
			MED	490	550	600	700				
			LOW	470	500	550	600				
			QUIET	440	450	480	480				
Type × Qty				Sirocco fan × 2							
Motor output		W	80	81							
Recommended static pressure				Pa							
Sound pressure level*	Cooling	HIGH		28	29	32					
			MED	26	27	28	30				
			LOW	25	26	27	28				
			QUIET	24	25	26					
		Heating	HIGH	28	29	32					
			MED	26	28	30					
			LOW	25	27	28					
			QUIET		24		25				
Sound power level		Cooling	dB (A)	57	58	60					
		Heating		57	58	60					
Dimensions (H × W × D)		mm	294 × 500 × 26.6		294 × 500 × 39.9						
Heat exchanger type		Fin pitch	mm	1.3							
		Rows × Stages		2 × 14	3 × 14						
		Pipe type		Copper tube							
		Fin type		Aluminum							
Enclosure	Material			Steel sheet							
	Color			—							
Dimensions (H × W × D)	Net		mm	198 × 700 × 620							
	Gross			276 × 968 × 772							
Weight	Net		kg	16	17						
	Gross			21	22						
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)							
		Gas		Ø9.52 (Ø3/8)							
Method				Flare							
Operation range	Cooling		°C	18 to 32							
	Heating		%RH	80 or less							
Drain hose	Material		°C	16 to 30							
	Tip diameter		mm	Ø25 (I.D.), Ø32 (O.D.)							

NOTES:

- Values mentioned in the table are based on the following conditions:
 - Static pressure: 25 Pa
 - The protective function might work when using it outside the operation range.
 - *: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.

2-4. Medium static pressure duct type

Model name				ARXH12KMTAP	ARXH14KMTAP			
Power supply				230 V~ 50 Hz				
Available voltage range				198—264 V				
Capacity				3.5	4.0			
Input power				46	70			
Running current				0.34	0.49			
Fan	Airflow rate	Cooling	HIGH	650	800			
			MED	520	640			
			LOW	460	560			
			QUIET	390	480			
		Heating	HIGH	650	800			
			MED	520	640			
			LOW	460	560			
			QUIET	390	480			
Type × Qty				Sirocco fan × 1				
Motor output				150				
Static pressure range				Pa				
Sound pressure level*1	Cooling	HIGH	29	32				
			27	29				
			25	27				
			23	25				
		Heating	HIGH	29	32			
			MED	27	29			
			LOW	25	27			
			QUIET	23	25			
Sound power level				dB (A)	58			
Heat exchanger				mm	58			
Dimensions (H × W × D)				336 × 490 × 39.9				
Fin pitch				1.4				
Rows × Stages				3 × 16				
Pipe type				Copper tube				
Fin type				Aluminum				
Enclosure				Steel sheet				
Material				—				
Color								
Dimensions (H × W × D)				mm	240 × 700 × 700			
Net				334 × 926 × 863				
Gross								
Weight				kg	24			
Net				29				
Gross								
Connection pipe	Size	Liquid	mm (in)					
		Gas	Ø6.35 (Ø1/4) Ø9.52 (Ø3/8)					
	Method			Flare				
Drain port				Polyvinyl chloride				
Material				Ø26 (I.D.), Ø32 (O.D.)				
Tip diameter								
Drain hose				Polyvinyl chloride				
Material				Ø25 (I.D.), Ø32 (O.D.)				
Tip diameter				18 to 32				
Operation range				°C	80 or less			
Cooling				%RH	16 to 30			
Heating				°C				
Remote controller (Option)				Wireless, Wired, Mobile app*2 [FGLair™, AIRSTAGE Mobile]				

NOTES:

- Values mentioned in the table are based on the following conditions:
 - Static pressure: 40 Pa
 - The protective function might work when using it outside the operation range.
 - *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
 - *2: Available on Google Play™ store or on App Store®. Optional WLAN Adapter is also required. For details, refer to the setting manual.

2-5. Wall mounted type

Model name				ASHG07KMTB	ASHG09KMTB	ASHG12KMTB	ASHG14KMTB			
Power supply				1Ø 230 V~ 50 Hz						
Available voltage range				198–264 V						
Capacity		kW class		2.0	2.5	3.5	4.0			
Input power		W		23	27		33			
Running current		A		0.20	0.24		0.30			
Fan	Airflow rate	Cooling	HIGH	m³/h	650	700	770			
			MED		540	560	600			
			LOW		430		450			
			QUIET		270		280			
		Heating	HIGH		720	750	800			
			MED		580	610	660			
			LOW		460	470	520			
			QUIET		330		340			
Type × Qty				Crossflow fan × 1						
Motor output				W		30	49			
Sound pressure level*1	Cooling	HIGH		dB (A)	38	40	43			
			MED		33	34	36			
			LOW		29		30			
			QUIET		21					
		Heating	HIGH		41	42	44			
			MED		35	36	39			
			LOW		31		33			
			QUIET		22		24			
	Sound power level		Cooling	dB (A)	54	55	57			
			Heating		56	57	59			
Heat exchanger type	Dimensions (H × W × D)		mm	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0		Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0 Sub: 84 × 670 × 13.3				
	Fin pitch		mm	Main 1: 1.2 Main 2: 1.1		Main 1: 1.2 Main 2: 1.1 Sub: 1.4				
	Rows × Stages			Main 1: 2 × 10 Main 2: 2 × 7		Main 1: 2 × 10 Main 2: 2 × 7 Sub: 1 × 4				
	Pipe type			Copper tube						
	Fin type			Aluminum						
Enclosure	Material			Polystyrene						
	Color			White + Pearl white (painted) Approximate color of Munsell N 9.25/						
Dimensions (H × W × D)	Net		mm	270 × 834 × 215						
	Gross			277 × 914 × 332						
Weight	Net		kg	10.0						
	Gross			12.5		13.0				
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)						
		Gas		Ø9.52 (Ø3/8)						
Method				Flare						
Drain hose	Material		Polypropylene + High-density polyethylene							
	Tip diameter		mm	Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)						
Operation range	Cooling		°C	18 to 32						
	Heating		%RH	80 or less						
Remote controller type				Wireless (Option: Wired, Mobile app*2 [FGLair™])						

NOTES:

- The protective function might work when using it outside the operation range.
- *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: Available on Google Play™ store or on App Store®. Optional WLAN Adapter is also required. For details, refer to the setting manual.

Model name			ASHG07KMCC	ASHG09KMCC	ASHG12KMCC	ASHG14KMCC					
Power supply			100~230V~50Hz								
Available voltage range			198~264V								
Capacity			2.0	2.5	3.5	4.0					
Input power			W	23	27	33					
Running current			A	0.20	0.24	0.30					
Fan	Airflow rate	Cooling	HIGH	m³/h	650	700					
			MED		540	560					
			LOW		430	450					
			QUIET		320	310					
		Heating	HIGH		720	780					
			MED		580	640					
			LOW		460	520					
			QUIET		330	340					
Type × Qty			Crossflow fan × 1								
Motor output			W	27							
Sound pressure level*1	Cooling	HIGH	38	dB (A)	40	43					
			33		34	36					
			29		35	30					
			21		21	21					
		Heating	41		42	44					
			35		36	39					
			31		38	33					
			22		22	24					
	Sound power level		Cooling	54	55	57					
			Heating	56	57	59					
Heat exchanger type	Dimensions (H × W × D)			mm	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20						
	Fin pitch				Main 1: 1.2 Main 2: 1.1						
	Rows × Stages				Main 1: 2 × 10 Main 2: 2 × 7						
	Pipe type				Copper tube						
	Fin type				Aluminum						
	Material				Polystyrene						
	Color				White + Pearl white (painted) Approximate color of Munsell N 9.25/						
	Dimensions (H × W × D)				Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20						
	Net				Main 1: 1.2 Main 2: 1.1						
	Gross				Sub: 84 × 670 × 13.3						
Weight	Net			kg	Main 1: 2 × 10 Main 2: 2 × 7						
	Gross				Main 1: 1.2 Main 2: 1.1						
	Connection pipe	Size	Liquid		Sub: 1.4						
			Gas		Main 1: 2 × 10 Main 2: 2 × 7						
Method			Flare								
Drain hose			Polypropylene + High-density polyethylene								
Tip diameter			Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)								
Operation range	Cooling			18 to 32 °C							
	%RH			80 or less							
	Heating			16 to 30 °C							
Remote controller type			Wireless (Option: Wired, Mobile app*2 [FGLair™])								

NOTES:

- The protective function might work when using it outside the operation range.
- *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: Available on Google Play™ store or on App Store®. Optional WLAN Adapter is also required. For details, refer to the setting manual.

Model name			ASHG07KMCE	ASHG09KMCE	ASHG12KMCE	ASHG14KMCE		
Power supply			100~230 V~ 50 Hz					
Available voltage range			198~264 V					
Capacity			2.0	2.5	3.5	4.0		
Input power			W	23	27	33		
Running current			A	0.20	0.24	0.30		
Fan	Airflow rate	Cooling	HIGH	m³/h	650	700		
			MED		540	560		
			LOW		430	450		
			QUIET		320	310		
		Heating	HIGH		720	780		
			MED		580	640		
			LOW		460	520		
			QUIET		330	340		
Type × Qty			Crossflow fan × 1					
Motor output			W	27				
Sound pressure level*1	Cooling	HIGH	38	dB (A)	40	43		
			33		34	36		
			29		35	30		
			QUIET		21			
		Heating	HIGH		41	44		
			MED		35	39		
			LOW		31	33		
			QUIET		22	24		
	Sound power level		Cooling	dB (A)	54	55		
			Heating		56	59		
Heat exchanger type	Dimensions (H × W × D)			mm	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20			
	Fin pitch				Main 1: 1.2 Main 2: 1.1			
	Rows × Stages				Main 1: 2 × 10 Main 2: 2 × 7			
	Pipe type				Copper tube			
	Fin type				Aluminum			
	Material				Polystyrene			
	Color				White + Pearl white (painted) Approximate color of Munsell N 9.25/			
	Dimensions (H × W × D)				Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20			
	Net				Main 1: 1.2 Main 2: 1.1			
	Gross				Sub: 84 × 670 × 13.3			
Weight	Net			kg	Main 1: 2 × 10 Main 2: 2 × 7			
	Gross				Main 1: 1.2 Main 2: 1.1			
	Connection pipe	Size	Liquid		Sub: 1.4			
			Gas		Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20			
Drain hose	Method			mm (in)	Ø6.35 (Ø1/4) Ø9.52 (Ø3/8)			
	Material				Flare			
	Tip diameter				Polypropylene + High-density polyethylene			
	Tip diameter				Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)			
Operation range	Cooling			°C	18 to 32			
	%RH				80 or less			
	Heating				16 to 30			
Remote controller type			Wireless (Option: Wired, Mobile app*2 [FGLair™])					

NOTES:

- The protective function might work when using it outside the operation range.
- *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: Available on Google Play™ store or on App Store®. Optional WLAN Adapter is also required. For details, refer to the setting manual.

Model name			ASHG07KMCF	ASHG09KMCF	ASHG12KMCF	ASHG14KMCF					
Power supply			100~230V~50Hz								
Available voltage range			198~264V								
Capacity			2.0	2.5	3.5	4.0					
Input power			W	23	27	33					
Running current			A	0.20	0.24	0.30					
Fan	Airflow rate	Cooling	HIGH	m³/h	650	700					
			MED		540	560					
			LOW		430	450					
			QUIET		320	310					
		Heating	HIGH		720	780					
			MED		580	640					
			LOW		460	520					
			QUIET		330	340					
Type x Qty			Crossflow fan x 1								
Motor output			W	27							
Sound pressure level*1	Cooling	HIGH	38	dB (A)	40	43					
			33		34	36					
			29		35	30					
			QUIET		21						
		Heating	HIGH		41	44					
			MED		35	39					
			LOW		31	33					
			QUIET		22	24					
	Sound power level		Cooling	dB (A)	54	55					
			Heating		56	59					
Heat exchanger type	Dimensions (H x W x D)			mm	Main 1: 210 x 670 x 26.6 Main 2: 112 x 670 x 20						
	Fin pitch				Main 1: 1.2 Main 2: 1.1						
	Rows x Stages				Main 1: 2 x 10 Main 2: 2 x 7						
	Pipe type			Copper tube							
	Fin type			Aluminum							
	Material			Polystyrene							
	Color			White + Pearl white (painted) Approximate color of Munsell N 9.25							
	Dimensions (H x W x D)		Net	mm	270 x 834 x 215						
			Gross		277 x 914 x 332						
Weight	Net		kg	10.0							
	Gross			12.5		13.0					
	Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)						
			Gas		Ø9.52 (Ø3/8)						
Method			Flare								
Drain hose			Polypropylene + High-density polyethylene								
Operation range			Material	Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)							
			Tip diameter	mm	18 to 32						
			Cooling		80 or less						
			%RH	°C	16 to 30						
			Heating								
Remote controller type			Wireless (Option: Wired, Mobile app*2 [AIRSTAGE Mobile])								

NOTES:

- The protective function might work when using it outside the operation range.
- *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: Available on Google Play™ store or on App Store®.

Model name				ASHH07KMCG ASHH07KMCG-B	ASHH09KMCG ASHH09KMCG-B	ASHH12KMCG ASHH12KMCG-B	ASHH14KMCG ASHH14KMCG-B				
Power supply				1Ø 230 V~ 50 Hz							
Available voltage range				198–264 V							
Capacity			kW class	2.0	2.5	3.5	4.0				
Input power			W	23	27	33					
Running current			A	0.20	0.24	0.30					
Fan	Airflow rate	Cooling	HIGH	650	700	770					
			MED	540	560	600					
			LOW	430		450					
			QUIET	320		310					
		Heating	HIGH	720	750	780	820				
			MED	580	610	640	660				
			LOW	460	470	520					
			QUIET	330		340					
Type × Qty				Crossflow fan × 1							
Motor output				27							
Sound pressure level*1		Cooling	HIGH	38	40	43					
			MED	33	34	35	36				
			LOW	29		30					
			QUIET	21							
		Heating	HIGH	41	42	44					
			MED	35	36	38	39				
			LOW	31		33					
			QUIET	22		24					
Sound power level		Cooling	dB (A)	54	55	57					
		Heating		56	57	58	59				
Heat exchanger type		Dimensions (H × W × D)		mm	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0		Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0 Sub: 84 × 670 × 13.3				
		Fin pitch			Main 1: 1.2 Main 2: 1.1		Main 1: 1.2 Main 2: 1.1 Sub: 1.4				
		Rows × Stages			Main 1: 2 × 10 Main 2: 2 × 7		Main 1: 2 × 10 Main 2: 2 × 7 Sub: 1 × 4				
		Pipe type			Copper tube						
		Fin type			Aluminum						
		Material			Polystyrene						
		Color			KMCG: White + Pearl white (painted) Approximate color of Munsell N 9.25/						
					KMCG-B: Soft black Approximate color of Munsell N3/						
		Net	mm	270 × 834 × 215							
		Gross		KMCG: 277 × 914 × 332 KMCG-B: 284 × 925 × 341							
Weight		Net	kg	10.0							
		Gross		KMCG: 12.5 KMCG-B: 13.5		KMCG: 13.0 KMCG-B: 13.5					
		Size	mm (in)	Ø6.35 (Ø1/4) Ø9.52 (Ø3/8)		Flare					
		Liquid									
Connection pipe		Gas									
		Method									
		Material	Polypropylene + High-density polyethylene								
Drain hose		Tip diameter	mm	Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)							
		Cooling		18 to 32							
		Heating	%RH	80 or less							
Operation range				16 to 30							
Remote controller type				Wireless (Option: Wired, Mobile app*2 [AIRSTAGE Mobile])							

NOTES:

- The protective function might work when using it outside the operation range.
- *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: Available on Google Play™ store or on App Store®.

Model name				ASHH07KMCH ASHH07KMCH-B	ASHH09KMCH ASHH09KMCH-B	ASHH12KMCH ASHH12KMCH-B	ASHH14KMCH ASHH14KMCH-B				
Power supply				1Ø 230 V~ 50 Hz							
Available voltage range				198–264 V							
Capacity			kW class	2.0	2.5	3.5	4.0				
Input power			W	23	27	33					
Running current			A	0.20	0.24	0.30					
Fan	Airflow rate	Cooling	HIGH	650	700	770					
			MED	540	560	600					
			LOW	430		450					
			QUIET	320		310					
		Heating	HIGH	720	750	780	820				
			MED	580	610	640	660				
			LOW	460	470	520					
			QUIET	330		340					
Type × Qty				Crossflow fan × 1							
Motor output				27							
Sound pressure level*1		Cooling	HIGH	38	40	43					
			MED	33	34	35	36				
			LOW	29		30					
			QUIET	21							
		Heating	HIGH	41	42	44					
			MED	35	36	38	39				
			LOW	31		33					
			QUIET	22		24					
Sound power level		Cooling	dB (A)	54	55	57					
		Heating		56	57	58	59				
Heat exchanger type		Dimensions (H × W × D)		mm	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0		Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0 Sub: 84 × 670 × 13.3				
		Fin pitch			Main 1: 1.2 Main 2: 1.1		Main 1: 1.2 Main 2: 1.1 Sub: 1.4				
		Rows × Stages			Main 1: 2 × 10 Main 2: 2 × 7		Main 1: 2 × 10 Main 2: 2 × 7 Sub: 1 × 4				
		Pipe type			Copper tube Aluminum						
Enclosure		Material				Polystyrene KMCH: White					
		Color				Approximate color of Munsell N 9.25/ KMCH-B: Soft black					
Dimensions (H × W × D)		Net	mm				Approximate color of Munsell N3/				
		Gross					KMCH: 270 × 834 × 222 KMCH-B: 270 × 834 × 215				
Weight		Net	kg				KMCH: 277 × 914 × 332 KMCH-B: 284 × 925 × 341				
		Gross					10.0				
Connection pipe		Size	Liquid	mm (in)							
			Gas		Ø6.35 (Ø1/4) Ø9.52 (Ø3/8)						
Drain hose		Method				Flare					
		Material				Polypropylene + High-density polyethylene					
Operation range		Tip diameter	mm	Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)							
		Cooling	°C	18 to 32							
			%RH	80 or less							
Remote controller type		Heating	°C	16 to 30							
					Wireless (Option: Wired, Mobile app*2 [AIRSTAGE Mobile])						

NOTES:

- The protective function might work when using it outside the operation range.
- *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: Available on Google Play™ store or on App Store®. Optional WLAN Adapter is also required. For details, refer to the setting manual.

Model name				ASHG07KETA ASHG07KETA-B	ASHG09KETA ASHG09KETA-B	ASHG12KETA ASHG12KETA-B	ASHG14KETA ASHG14KETA-B		
Power supply				1Ø 230 V~ 50 Hz					
Available voltage range				198~264 V					
Capacity		kW class	2.0	2.5	3.5	4.0			
Input power		W	23	27	33				
Running current		A	0.20	0.24	0.30				
Fan	Airflow rate	Cooling	HIGH	m³/h	650	700	770		
			MED		540	560	600		
			LOW		430		450		
			QUIET		270		280		
		Heating	HIGH		720	750	800		
			MED		580	610	660		
			LOW		460	470	520		
			QUIET		330		340		
Type × Qty				Crossflow fan × 1					
Motor output				W					
Sound pressure level* ¹	Cooling	HIGH	38	dB (A)	40		43		
			33		34	35	36		
			29			30			
					21				
		Heating	41		42		44		
			35		36	38	39		
			31			33			
					22		24		
Sound power level		Cooling	54		55		57		
		Heating	56		57	58	59		
Heat exchanger type	Dimensions (H × W × D)		mm	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0		Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0 Sub: 84 × 670 × 13.3			
	Fin pitch		mm	Main 1: 1.2 Main 2: 1.1		Main 1: 1.2 Main 2: 1.1 Sub: 1.4			
	Rows × Stages			Main 1: 2 × 10 Main 2: 2 × 7		Main 1: 2 × 10 Main 2: 2 × 7 Sub: 1 × 4			
	Pipe type			Copper tube					
	Fin type			Aluminum					
Enclosure	Material			Polystyrene					
	Color			KETA: White + Pearl white (painted) Approximate color of Munsell N 9.25/ KETA-B: Dark Gray + Silver (painted) Approximate color of Munsell 0.5P 3.5/0.2					
	Dimensions (H × W × D)		mm	295 × 950 × 230 284 × 1,027 × 357					
Weight	Net		kg	11.0		11.5			
	Gross			14.5		15.0			
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)					
		Gas		Ø9.52 (Ø3/8)					
	Method			Flare					
Drain hose	Material			Polypropylene + High-density polyethylene					
	Tip diameter		mm	Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)					
Operation range	Cooling		°C	18 to 32					
			%RH	80 or less					
Heating				°C					
Remote controller type				Wireless (Option: Wired, Mobile app* ² [FGLair™])					

NOTES:

- The protective function might work when using it outside the operation range.
- *¹: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *²: Available on Google Play™ store or on App Store®. Optional WLAN Adapter is also required. For details, refer to the setting manual.

Model name				ASHG07KETE ASHG07KETE-B	ASHG09KETE ASHG09KETE-B	ASHG12KETE ASHG12KETE-B	ASHG14KETE ASHG14KETE-B		
Power supply				1Ø 230 V~ 50 Hz					
Available voltage range				198~264 V					
Capacity		kW class	2.0	2.5	3.5	4.0			
Input power		W	23	27	33				
Running current		A	0.20	0.24	0.30				
Fan	Airflow rate	Cooling	HIGH	m³/h	650	700	770		
			MED		540	560	600		
			LOW		430		450		
			QUIET		270		280		
		Heating	HIGH		720	750	800		
			MED		580	610	660		
			LOW		460	470	520		
			QUIET		330		340		
Type × Qty				Crossflow fan × 1					
Motor output				W					
Sound pressure level* ¹	Cooling	HIGH	38	dB (A)	40		43		
			33		34	35	36		
			29			30			
					21				
		LOW	41		42		44		
			35		36	38	39		
			31			33			
					22		24		
	Heating	Cooling	54	dB (A)	55		57		
		Heating	56		57	58	59		
Heat exchanger type	Dimensions (H × W × D)				Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0 Sub: 84 × 670 × 13.3			
	Fin pitch				Main 1: 1.2 Main 2: 1.1	Main 1: 1.2 Main 2: 1.1 Sub: 1.4			
	Rows × Stages				Main 1: 2 × 10 Main 2: 2 × 7	Main 1: 2 × 10 Main 2: 2 × 7 Sub: 1 × 4			
	Pipe type				Copper tube				
	Fin type				Aluminum				
	Enclosure	Material			Polystyrene				
		Color			KETE: White + Pearl white (painted) Approximate color of Munsell N 9.25/ KETE-B: Dark Gray + Silver (painted) Approximate color of Munsell 0.5P 3.5/0.2				
Dimensions (H × W × D)	Net		mm	295 × 950 × 230					
	Gross			284 × 1,027 × 357					
	Weight		kg	11.0		11.5			
	Net			14.5		15.0			
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)					
		Gas		Ø9.52 (Ø3/8)					
	Method			Flare					
	Drain hose			Polypropylene + High-density polyethylene					
Operation range	Tip diameter		mm	Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)					
	Cooling		°C	18 to 32					
	Heating		%RH	80 or less					
			°C	16 to 30					
Remote controller type				Wireless (Option: Wired, Mobile app* ² [FGLair™])					

NOTES:

- The protective function might work when using it outside the operation range.
- *¹: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *²: Available on Google Play™ store or on App Store®. Optional WLAN Adapter is also required. For details, refer to the setting manual.

Model name				ASHG07KETF ASHG07KETF-B	ASHG09KETF ASHG09KETF-B	ASHG12KETF ASHG12KETF-B	ASHG14KETF ASHG14KETF-B			
Power supply				1Ø 230 V~ 50 Hz						
Available voltage range				198–264 V						
Capacity		kW class	2.0	2.5	3.5	4.0				
Input power		W	23	27	33					
Running current		A	0.20	0.24	0.30					
Fan	Airflow rate	Cooling	HIGH	m³/h	650	700	770			
			MED		540	560	600			
			LOW		430		450			
			QUIET		270		280			
		Heating	HIGH		720	750	800			
			MED		580	610	660			
			LOW		460	470	520			
			QUIET		330		340			
Type × Qty				Crossflow fan × 1						
Motor output				W						
Sound pressure level* ¹	Cooling	HIGH	38	dB (A)	40		43			
			33		34	35	36			
			29			30				
					21					
		Heating	41		42	42	44			
			35		36	38	39			
			31			33				
					22		24			
	Sound power level		Cooling	dB (A)	54	55	57			
			Heating		56	57	59			
Heat exchanger type	Dimensions (H × W × D)			mm	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0		Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0 Sub: 84 × 670 × 13.3			
	Fin pitch			mm	Main 1: 1.2 Main 2: 1.1		Main 1: 1.2 Main 2: 1.1 Sub: 1.4			
	Rows × Stages				Main 1: 2 × 10 Main 2: 2 × 7		Main 1: 2 × 10 Main 2: 2 × 7 Sub: 1 × 4			
	Pipe type				Copper tube					
	Fin type				Aluminum					
	Enclosure	Material			Polystyrene					
		Color			KETF: White + Pearl white (painted) Approximate color of Munsell N 9.25/ KETF-B: Dark Gray + Silver (painted) Approximate color of Munsell 0.5P 3.5/0.2					
Dimensions (H × W × D)	Net		mm	295 × 950 × 230						
	Gross			284 × 1,027 × 357						
Weight	Net		kg	11.0		11.5				
	Gross			14.5		15.0				
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)						
		Gas		Ø9.52 (Ø3/8)						
	Method			Flare						
Drain hose	Material			Polypropylene + High-density polyethylene						
	Tip diameter			Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)						
Operation range	Cooling		°C	18 to 32						
			%RH	80 or less						
	Heating		°C	16 to 30						
Remote controller type				Wireless (Option: Wired, Mobile app* ² [AIRSTAGE Mobile])						

NOTES:

- The protective function might work when using it outside the operation range.
- *¹: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *²: Available on Google Play™ store or on App Store®.

Model name				ASHG07KGTB	ASHG09KGTB	ASHG12KGTB	ASHG14KGTB			
Power supply				100~230 V~ 50 Hz						
Available voltage range				198~264 V						
Capacity		kW class		2.0	2.5	3.5	4.0			
Input power		W		23	27	33				
Running current		A		0.20	0.24	0.29				
Fan	Airflow rate	Cooling	HIGH	m³/h	650	700	770			
			MED		540	560	600			
			LOW		430		450			
			QUIET		270		280			
		Heating	HIGH		720	750	770			
			MED		580	610	640			
			LOW		460	470	520			
			QUIET		330		340			
Type x Qty				Crossflow fan × 1						
Motor output				W						
Sound pressure level*1	Cooling	HIGH	dB (A)	30		49				
				38	40	43				
				33	34	35	36			
				29		30				
		MED		21						
				41	42	44				
				35	36	38	39			
				31		33				
	Heating	LOW		22		24				
				44						
				35	36	38	39			
				31		33				
		QUIET		22		24				
Sound power level		dB (A)		54	55	56	57			
Heating		56		56	57	58	59			
Heat exchanger type	Dimensions (H × W × D)			mm		Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0 Sub: 84 × 670 × 13.3			
	Fin pitch			mm		Main 1: 1.2 Main 2: 1.1	Main 1: 1.2 Main 2: 1.1 Sub: 1.4			
	Rows × Stages					Main 1: 2 × 10 Main 2: 2 × 7	Main 1: 2 × 10 Main 2: 2 × 7 Sub: 1 × 4			
	Pipe type									
	Fin type									
Enclosure	Material									
	Color									
Dimensions (H × W × D)	Net	mm					270 × 834 × 215			
	Gross						277 × 914 × 332			
Weight	Net	kg					10.0			
	Gross						12.5 13.0			
Connection pipe	Size	Liquid	mm (in)							
		Gas								
	Method									
Drain hose		Material		Polypropylene + High-density polyethylene						
Tip diameter		mm		Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)						
Operation range	Cooling		°C	18 to 32						
	Heating		%RH	80 or less						
			°C	16 to 30						
Remote controller type				Wireless (Option: Wired, Mobile app*2 [FGLair™])						

NOTES:

- The protective function might work when using it outside the operation range.
- *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: Available on Google Play™ store or on App Store®. Optional WLAN Adapter is also required. For details, refer to the setting manual.

Model name			ASHG07KGTE	ASHG09KGTE	ASHG12KGTE	ASHG14KGTE	
Power supply			1Ø 230 V~ 50 Hz				
Available voltage range			198—264 V				
Capacity	kW class	2.0	2.5	3.5	4.0		
Input power	W	23	27	33			
Running current	A	0.20	0.24	0.29			
Fan	Airflow rate	HIGH	m³/h	650	700	770	
		MED		540	560	600	
		LOW		430	450		
		QUIET		270	280		
		HIGH		720	770	800	
	Heating	MED		580	610	660	
		LOW		460	470	520	
		QUIET		330		340	
Type × Qty			Crossflow fan × 1				
Motor output			W	30	49		
Sound pressure level*1	Cooling	HIGH	dB (A)	38	40	43	
		MED		33	35	36	
		LOW		29	30	30	
		QUIET		21			
		HIGH		41	42	44	
	Heating	MED		35	36	39	
		LOW		31		33	
		QUIET		22		24	
Sound power level			dB (A)	54	55	56	
Heating				56	57	59	
Heat exchanger type	Dimensions (H × W × D)			mm	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0 Sub: 84 × 670 × 13.3	
	Fin pitch			mm	Main 1: 1.2 Main 2: 1.1	Main 1: 1.2 Main 2: 1.1 Sub: 1.4	
	Rows × Stages				Main 1: 2 × 10 Main 2: 2 × 7	Main 1: 2 × 10 Main 2: 2 × 7 Sub: 1 × 4	
	Pipe type				Copper tube		
	Fin type				Aluminum		
	Enclosure	Material			Polystyrene		
		Color			White + Pearl white (painted) Approximate color of Munsell N 9.25/		
Dimensions (H × W × D)		Net	mm	270 × 834 × 215			
		Gross		277 × 914 × 332			
Weight		Net	kg	10.0			
		Gross		12.5		13.0	
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)			
		Gas		Ø9.52 (Ø3/8)			
	Method			Flare			
Drain hose				Polypropylene + High-density polyethylene			
Tip diameter			mm	Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)			
Operation range				18 to 32			
			%RH	80 or less			
Heating			°C	16 to 30			
Remote controller type				Wireless (Option: Wired, Mobile app*2 [FGLair™])			

NOTES:

- The protective function might work when using it outside the operation range.
- *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: Available on Google Play™ store or on App Store®. Optional WLAN Adapter is also required. For details, refer to the setting manual.

Model name			ASHG07KGTF	ASHG09KGTF	ASHG12KGTF	ASHG14KGTF						
Power supply			1Ø 230 V~ 50 Hz									
Available voltage range			198—264 V									
Capacity	kW class	2.0	2.5	3.5	4.0							
Input power	W	23	27	33								
Running current	A	0.20	0.24	0.29								
Fan	Airflow rate	HIGH	m³/h	650	700	770						
		MED		540	560	600						
		LOW		430	450							
		QUIET		270	280							
		HIGH		720	770	800						
	Heating	MED		580	610	660						
		LOW		460	470	520						
		QUIET		330		340						
Type × Qty			Crossflow fan × 1									
Motor output			W	30	49							
Sound pressure level*1	Cooling	HIGH	dB (A)	38	40	43						
		MED		33	34	36						
		LOW		29	30							
		QUIET		21								
		HIGH		41	42	44						
	Heating	MED		35	36	39						
		LOW		31	33							
		QUIET		22		24						
Sound power level		Cooling	dB (A)	54	55	56						
		Heating		56	57	58						
Heat exchanger type	Dimensions (H × W × D)			mm		Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0 Sub: 84 × 670 × 13.3						
	Fin pitch			mm		Main 1: 1.2 Main 2: 1.1 Sub: 1.4						
	Rows × Stages			Main 1: 2 × 10 Main 2: 2 × 7		Main 1: 2 × 10 Main 2: 2 × 7 Sub: 1 × 4						
	Pipe type			Copper tube								
	Fin type			Aluminum								
	Enclosure	Material			Polystyrene							
		Color			White + Pearl white (painted) Approximate color of Munsell N 9.25/							
Dimensions (H × W × D)		Net	mm	270 × 834 × 215								
		Gross		277 × 914 × 332								
Weight	Net		kg	10.0								
	Gross			12.5	13.0							
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)								
		Gas		Ø9.52 (Ø3/8)								
Method			Flare									
Drain hose			Polypropylene + High-density polyethylene									
Tip diameter			Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)									
Operation range	Cooling		18 to 32									
	Heating		80 or less									
Wireless (Option: Wired, Mobile app*2 [AIRSTAGE Mobile])												

NOTES:

- The protective function might work when using it outside the operation range.
- *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: Available on Google Play™ store or on App Store®.

Model name			ASHH07KG TG	ASHH09KG TG	ASHH12KG TG	ASHH14KG TG	
Power supply			1Ø 230 V~ 50 Hz				
Available voltage range			198—264 V				
Capacity	kW class	2.0	2.5	3.5	4.0		
Input power	W	23	27	33			
Running current	A	0.20	0.24	0.29			
Fan	Airflow rate	HIGH	m³/h	650	700	770	
		MED		540	560	600	
		LOW		430	450		
		QUIET		270	280		
		HIGH		720	770	800	
	Heating	MED		580	610	660	
		LOW		460	470	520	
		QUIET		330		340	
Type × Qty			Crossflow fan × 1				
Motor output			W	30	49		
Sound pressure level*1	Cooling	HIGH	dB (A)	38	40	43	
		MED		33	34	36	
		LOW		29	30		
		QUIET		21			
		HIGH		41	42	44	
	Heating	MED		35	36	39	
		LOW		31	33		
		QUIET		22		24	
Sound power level			dB (A)	54	55	56	
Heating				56	57	59	
Heat exchanger type	Dimensions (H × W × D)			mm	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0 Sub: 84 × 670 × 13.3	
	Fin pitch			mm	Main 1: 1.2 Main 2: 1.1	Main 1: 1.2 Main 2: 1.1 Sub: 1.4	
	Rows × Stages				Main 1: 2 × 10 Main 2: 2 × 7	Main 1: 2 × 10 Main 2: 2 × 7 Sub: 1 × 4	
	Pipe type				Copper tube		
	Fin type				Aluminum		
	Enclosure	Material			Polystyrene		
		Color			White + Pearl white (painted) Approximate color of Munsell N 9.25/		
Dimensions (H × W × D)		Net	mm	270 × 834 × 215			
		Gross		277 × 914 × 332			
Weight	Net	kg	10.0				
	Gross		12.5			13.0	
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)			
		Gas		Ø9.52 (Ø3/8)			
Method				Flare			
Drain hose				Polypropylene + High-density polyethylene			
Tip diameter			mm	Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)			
Operation range	Cooling			18 to 32			
	%RH			80 or less			
	Heating		°C	16 to 30			
Remote controller type				Wireless (Option: Wired, Mobile app*2 [AIRSTAGE Mobile])			

NOTES:

- The protective function might work when using it outside the operation range.
- *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: Available on Google Play™ store or on App Store®.

Model name				ASHH07KGTH	ASHH09KGTH	ASHH12KGTH	ASHH14KGTH		
Power supply				100~230 V~ 50 Hz					
Available voltage range				198~264 V					
Capacity		kW class		2.0	2.5	3.5	4.0		
Input power		W		23	27	33			
Running current		A		0.20	0.24	0.29			
Fan	Airflow rate	Cooling	HIGH	650	700	770			
			MED	540	560	600			
			LOW		430	450			
			QUIET		270	280			
		Heating	HIGH	720	750	770	800		
			MED	580	610	640	660		
			LOW	460	470	520			
			QUIET		330		340		
	Type x Qty			Crossflow fan × 1					
	Motor output	W		30		49			
Sound pressure level*1		Cooling	HIGH	38	40	43			
			MED	33	34	35	36		
			LOW	29		30			
			QUIET		21				
		Heating	HIGH	41	42	44			
			MED	35	36	38	39		
			LOW	31		33			
			QUIET		22		24		
	Sound power level	Cooling		54	55	56	57		
		Heating		56	57	58	59		
Heat exchanger type	Dimensions (H × W × D)		mm	Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0		Main 1: 210 × 670 × 26.6 Main 2: 112 × 670 × 20.0 Sub: 84 × 670 × 13.3			
	Fin pitch		mm	Main 1: 1.2 Main 2: 1.1		Main 1: 1.2 Main 2: 1.1 Sub: 1.4			
	Rows × Stages			Main 1: 2 × 10 Main 2: 2 × 7		Main 1: 2 × 10 Main 2: 2 × 7 Sub: 1 × 4			
	Pipe type			Copper tube					
	Fin type			Aluminum					
Enclosure	Material			Polystyrene					
	Color			White + Pearl white (painted) Approximate color of Munsell N 9.25					
Dimensions (H × W × D)	Net	mm		270 × 834 × 215					
	Gross			277 × 914 × 332					
Weight	Net	kg		10.0					
	Gross			12.5		13.0			
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)					
		Gas		Ø9.52 (Ø3/8)					
	Method			Flare					
Drain hose	Material			Polypropylene + High-density polyethylene					
	Tip diameter		mm	Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)					
Operation range	Cooling		°C	18 to 32					
			%RH	80 or less					
	Heating	°C		16 to 30					
Remote controller type				Wireless (Option: Wired, Mobile app*2 [AIRSTAGE Mobile])					

NOTES:

- The protective function might work when using it outside the operation range.
- *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: Available on Google Play™ store or on App Store®.Optional WLAN Adapter is also required. For details, refer to the setting manual.

Model name			ASHH05KNCA	ASHH07KNCA	ASHH09KNCA	ASHH12KNCA			
Power supply			1Ø 230 V~ 50 Hz						
Available voltage range			198—264 V						
Capacity			1.5	2.0	2.5	3.5			
Input power			W	12	13	21			
Running current			A	0.11	0.12	0.19			
Fan	Airflow rate	Cooling	kW class	500	530	640			
				450	460	500			
				390		440			
					250				
		Heating	m³/h	500	530	640			
				450	460	500			
				420		440			
					280				
Type × Qty			Crossflow fan × 1						
Motor output			W	27					
Sound pressure level*1	Cooling	HIGH	dB (A)	34	36	41			
		MED		33		35			
		LOW		29		32			
		QUIET			21				
		Heating	dB (A)	34	36	41			
				32	33	34			
				30		31			
					22				
Sound power level		Cooling	dB (A)	50	51	56			
		Heating		50	51	57			
Heat exchanger type	Dimensions (H × W × D)		mm	Main 1: 210 × 600 × 26.6 Main 2: 112 × 600 × 20.0					
	Fin pitch		mm	Main 1: 1.2 Main 2: 1.1					
	Rows × Stages			Main 1: 2 × 10 Main 2: 2 × 7					
	Pipe type			Copper tube					
	Fin type			Aluminum					
	Material			Polystyrene					
Enclosure	Color			White + Pearl white (painted) Approximate color of Munsell N 9.25/					
	Dimensions (H × W × D)			270 × 784 × 222 279 × 864 × 334					
Weight	Net		kg	9.0					
	Gross			12.0					
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)					
		Gas		Ø9.52 (Ø3/8)					
Method			Flare						
Drain hose	Material		Polypropylene + High-density polyethylene						
	Tip diameter		mm	Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)					
Operation range	Cooling		°C	18 to 32					
	Heating		%RH	80 or less					
Remote controller type			°C	16 to 30					
				Wireless (Option: Mobile app*2 [AIRSTAGE Mobile])					

NOTES:

- The protective function might work when using it outside the operation range.
- *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: Available on Google Play™ store or on App Store®.

Model name			ASHH05KNCH	ASHH07KNCH	ASHH09KNCH	ASHH12KNCH					
Power supply			1Ø 230 V~ 50 Hz								
Available voltage range			198—264 V								
Capacity			1.5	2.0	2.5	3.5					
Input power			W	12	13	21					
Running current			A	0.11	0.12	0.19					
Fan	Airflow rate	Cooling	m³/h	500	530	640					
				450	460	500					
				390		440					
					250						
		Heating		500	530	640					
				450	460	500					
				420		440					
					280						
Type × Qty			Crossflow fan × 1								
Motor output			W	27							
Sound pressure level*1	Cooling	HIGH	dB (A)	34	36	41					
		MED		33		35					
		LOW		29		32					
		QUIET			21						
		Heating		34	36	41					
				32	33	34					
				30		31					
					22						
Sound power level		Cooling	dB (A)	50	51	56					
		Heating		50	51	57					
Heat exchanger type	Dimensions (H × W × D)		mm	Main 1: 210 × 600 × 26.6 Main 2: 112 × 600 × 20.0							
	Fin pitch		mm	Main 1: 1.2 Main 2: 1.1							
	Rows × Stages			Main 1: 2 × 10 Main 2: 2 × 7							
	Pipe type			Copper tube							
	Fin type			Aluminum							
	Material			Polystyrene							
Enclosure	Color			White + Pearl white (painted) Approximate color of Munsell N 9.25/							
	Dimensions (H × W × D)			270 × 784 × 222 279 × 864 × 334							
Weight	Net		kg	9.0							
	Gross			12.0							
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)							
		Gas		Ø9.52 (Ø3/8)							
Method			Flare								
Drain hose	Material		Polypropylene + High-density polyethylene								
	Tip diameter		mm	Ø13.8 (I.D.), Ø15.0 to Ø16.8 (O.D.)							
Operation range	Cooling		°C	18 to 32							
	Heating		%RH	80 or less							
Remote controller type			16 to 30								
NOTES:			Wireless (Option: Mobile app*2 [AIRSTAGE Mobile])								
<ul style="list-style-type: none"> • The protective function might work when using it outside the operation range. • *1: Sound pressure level: <ul style="list-style-type: none"> – These are the measured values in the manufacturer's anechoic chamber. – Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here. • *2: Available on Google Play™ store or on App Store®. Optional WLAN Adapter is also required. For details, refer to the setting manual. 											

2-6. Floor type

Model name				AGHG09KVCA	AGHG12KVCA	AGHG14KVCA	
Power supply				230 V~ 50 Hz			
Available voltage range				198~264 V			
Capacity		kW class		2.5	3.5	4.0	
Input power		W		16	20	23	
Running current		A		0.15	0.18	0.20	
Fan	Airflow rate	Cooling	HIGH	530	600	650	
			MED	440	490	520	
			LOW	360	380	400	
			QUIET	270			
		Heating	HIGH	530	600	650	
			MED	460	510	540	
			LOW	380	410	430	
			QUIET	270			
Type x Qty				Crossflow fan x 2			
Motor output		W		16 x 2			
Sound pressure level*1	Cooling	HIGH	39	42	44		
			34	36	38		
			28	30	31		
			22				
		Heating	39	42	44		
			35	38	39		
			30	32	33		
			22				
Sound power level	Cooling	dB (A)	52	55	56		
	Heating	dB (A)	52	55	56		
Heat exchanger type	Dimensions (H × W × D)		mm	378 × 550 × 26.6			
	Fin pitch			1.2			
	Rows × Stages			2 × 18			
	Pipe type			Copper tube			
Enclosure	Fin type			Aluminum			
	Material			Polystyrene			
	Color			White			
Dimensions (H × W × D)				Approximate color of Munsell N 9.25/			
Weight	Net	mm		600 × 740 × 200			
	Gross			700 × 820 × 310			
Connection pipe	Net	kg		14			
	Gross			18			
	Size	Liquid	mm (in)	Ø6.35 (Ø1/4")			
		Gas		Ø9.52 (Ø3/8")			
Method				Flare			
Drain hose				Polypropylene + Linear low-density polyethylene			
Tip diameter		mm		Ø13.8 (I.D.), Ø15.8 to Ø16.7 (O.D.)			
Operation range	Cooling		°C	18 to 32			
	%RH			80 or less			
	Heating	°C		30 or less			
Remote controller type				Wireless (Option: Wired, Mobile app*2 [FGLair™])			

NOTES:

- The protective function might work when using it outside the operation range.
- *1: Sound pressure level:
 - These are the measured values in the manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: Available on Google Play™ store or on App Store®. Optional WLAN Adapter is also required. For details, refer to the setting manual.

3. Wireless LAN control (for KMCF, KMCG, KMCG-B, KETF, KETF-B, KGTF, KGTG, and KNCA)

By installing mobile app on a smart device, several functions can be controlled from outside the house.

3-1. System requirement

Before using this function, prepare the following items:

- **Wireless router:**

Wireless LAN standard	IEEE802.11b/g/n
Frequency bands*	<ul style="list-style-type: none"> • U.S.A., Canada: 2.4 GHz (1ch—11ch) • Other countries: 2.4 GHz (1ch—13ch)
Network security standard	<ul style="list-style-type: none"> • Open • WEP • WPA (PSK) • WPA2 Personal (PSK) • WPS for same-LAN registration

*: Usable only in the country or region where you purchased the product.

To check whether your wireless router complies with the network security standards listed above, refer to the operation manual.

- **Smartphone:**

App-compliant operating system	iOS	Check the latest version of supported OS at Google Play store or App Store.
	Android™	

- **AIRSTAGE Mobile (mobile application):**

Mobile app is available on Google Play store or on App Store.

After installation of mobile app, user registration is required. For user registration and setup information, refer to Setting Manual attached with the product.

For the latest version of the wireless LAN control manuals, refer to the following web site.





<https://www.fujitsu-general.com/global/support/>

4. Dimensions

4-1. Compact cassette type

■ Models: AUXG07-14KVLA


Unit: mm

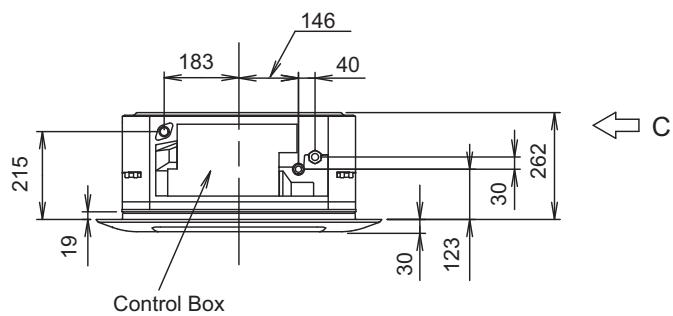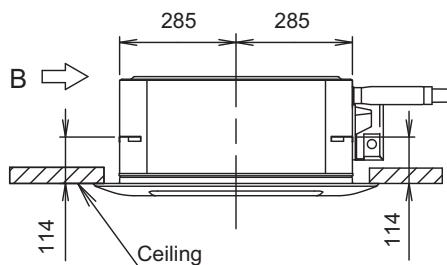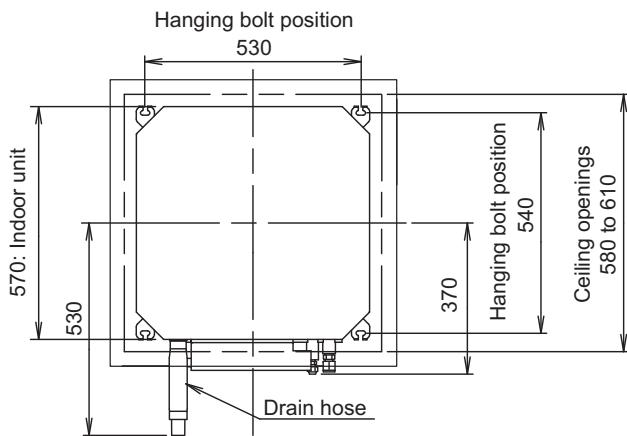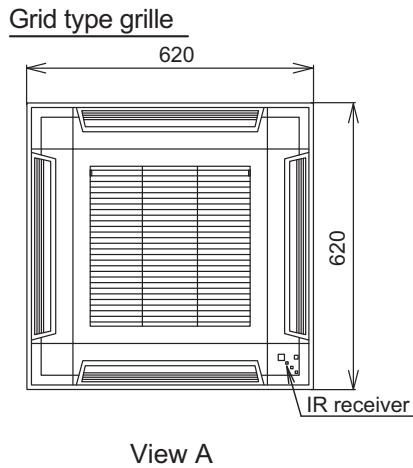

● Installation space requirement

Provide enough clearance for product safety.

Unit: mm

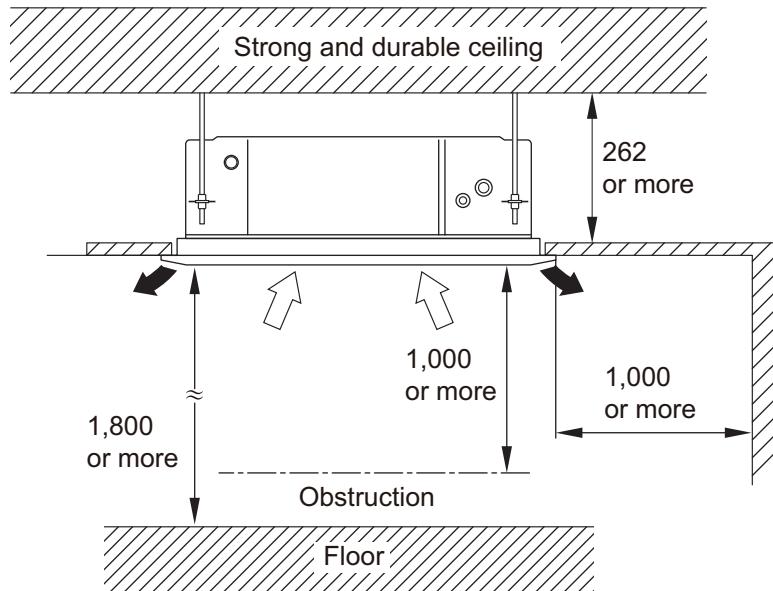


Maximum height from floor to ceiling (Unit: mm)

	07 and 09 models	12 or larger models
Standard	2,700	
High ceiling	—	3,000

● 3-way direction setting

Unit: mm

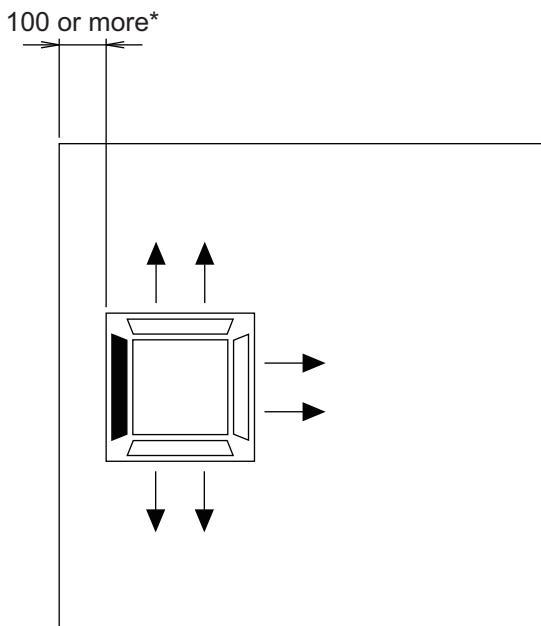







NOTES:

- To set "3-direction", optional Air Outlet Shutter Plate (UTR-YDZB) must be installed, and the "outlet-direction" need to be switched to "3-way" by remote controller.
- *When installing the indoor unit, be careful about the maintenance space.
- In 3-way outlet mode, changing of ceiling height setting by function setting 20 is prohibited. (Ceiling height setting [function setting 20] is allowed to be changed only in 4-way outlet mode.)

4-2. Mini duct type

■ Models: ARXG07-14KSLAP


Unit: mm

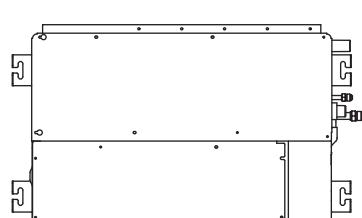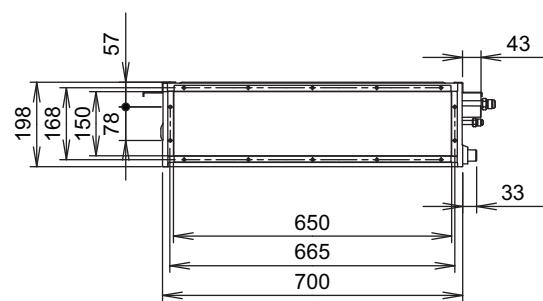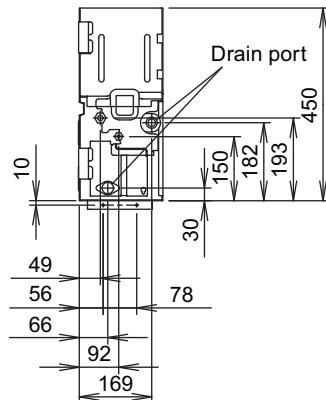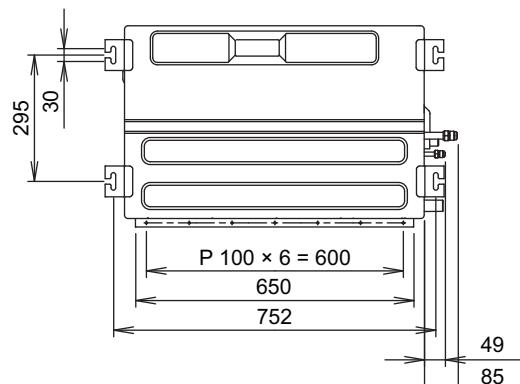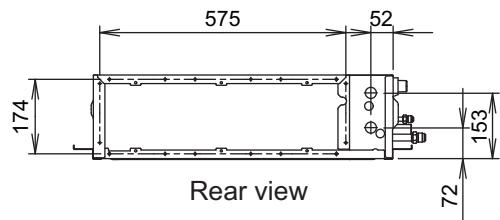

● Installation space requirement


Provide sufficient installation space for product safety.

Unit: mm

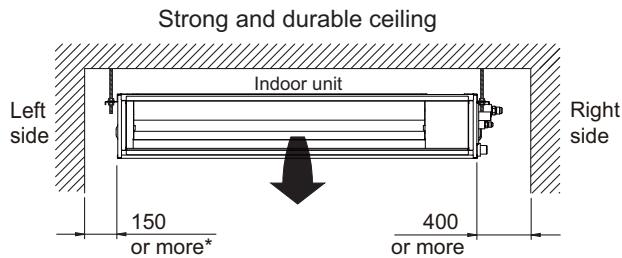


*: 400 or more when drain from drain pipe

- When intaking air from back:

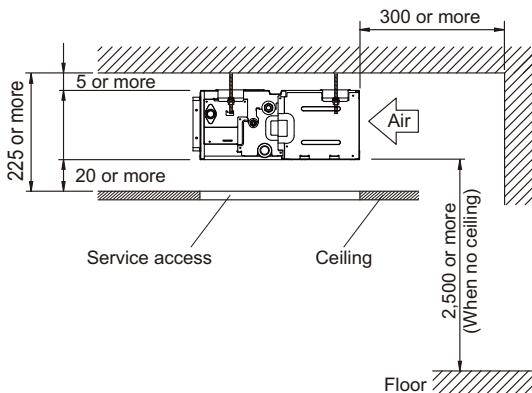

- When intaking air from bottom:

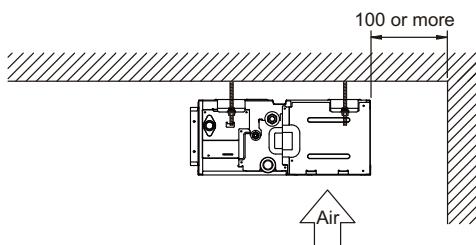


● Maintenance space requirement

Provide enough clearance for efficient maintenance.

NOTE: Do not place wiring or illumination in the maintenance space, as they impede maintenance work.

Unit: mm

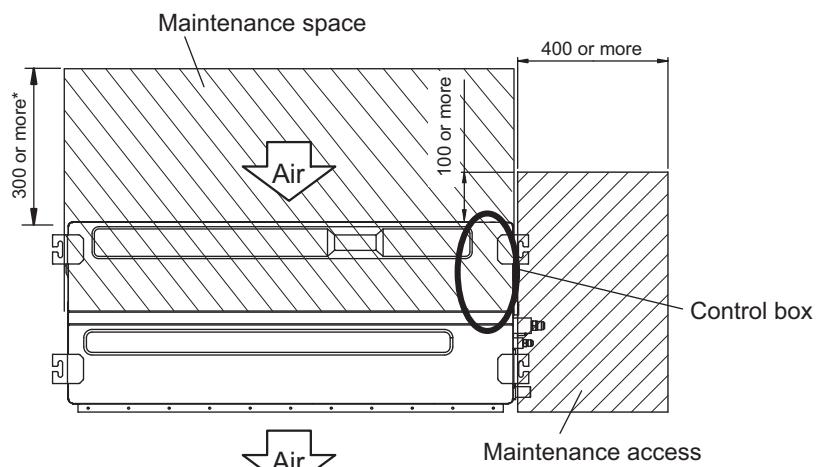


*: More than 100 when intaking air from bottom

Top view

4-3. Slim duct type

■ Models: ARXG07-14KLLAP


Unit: mm

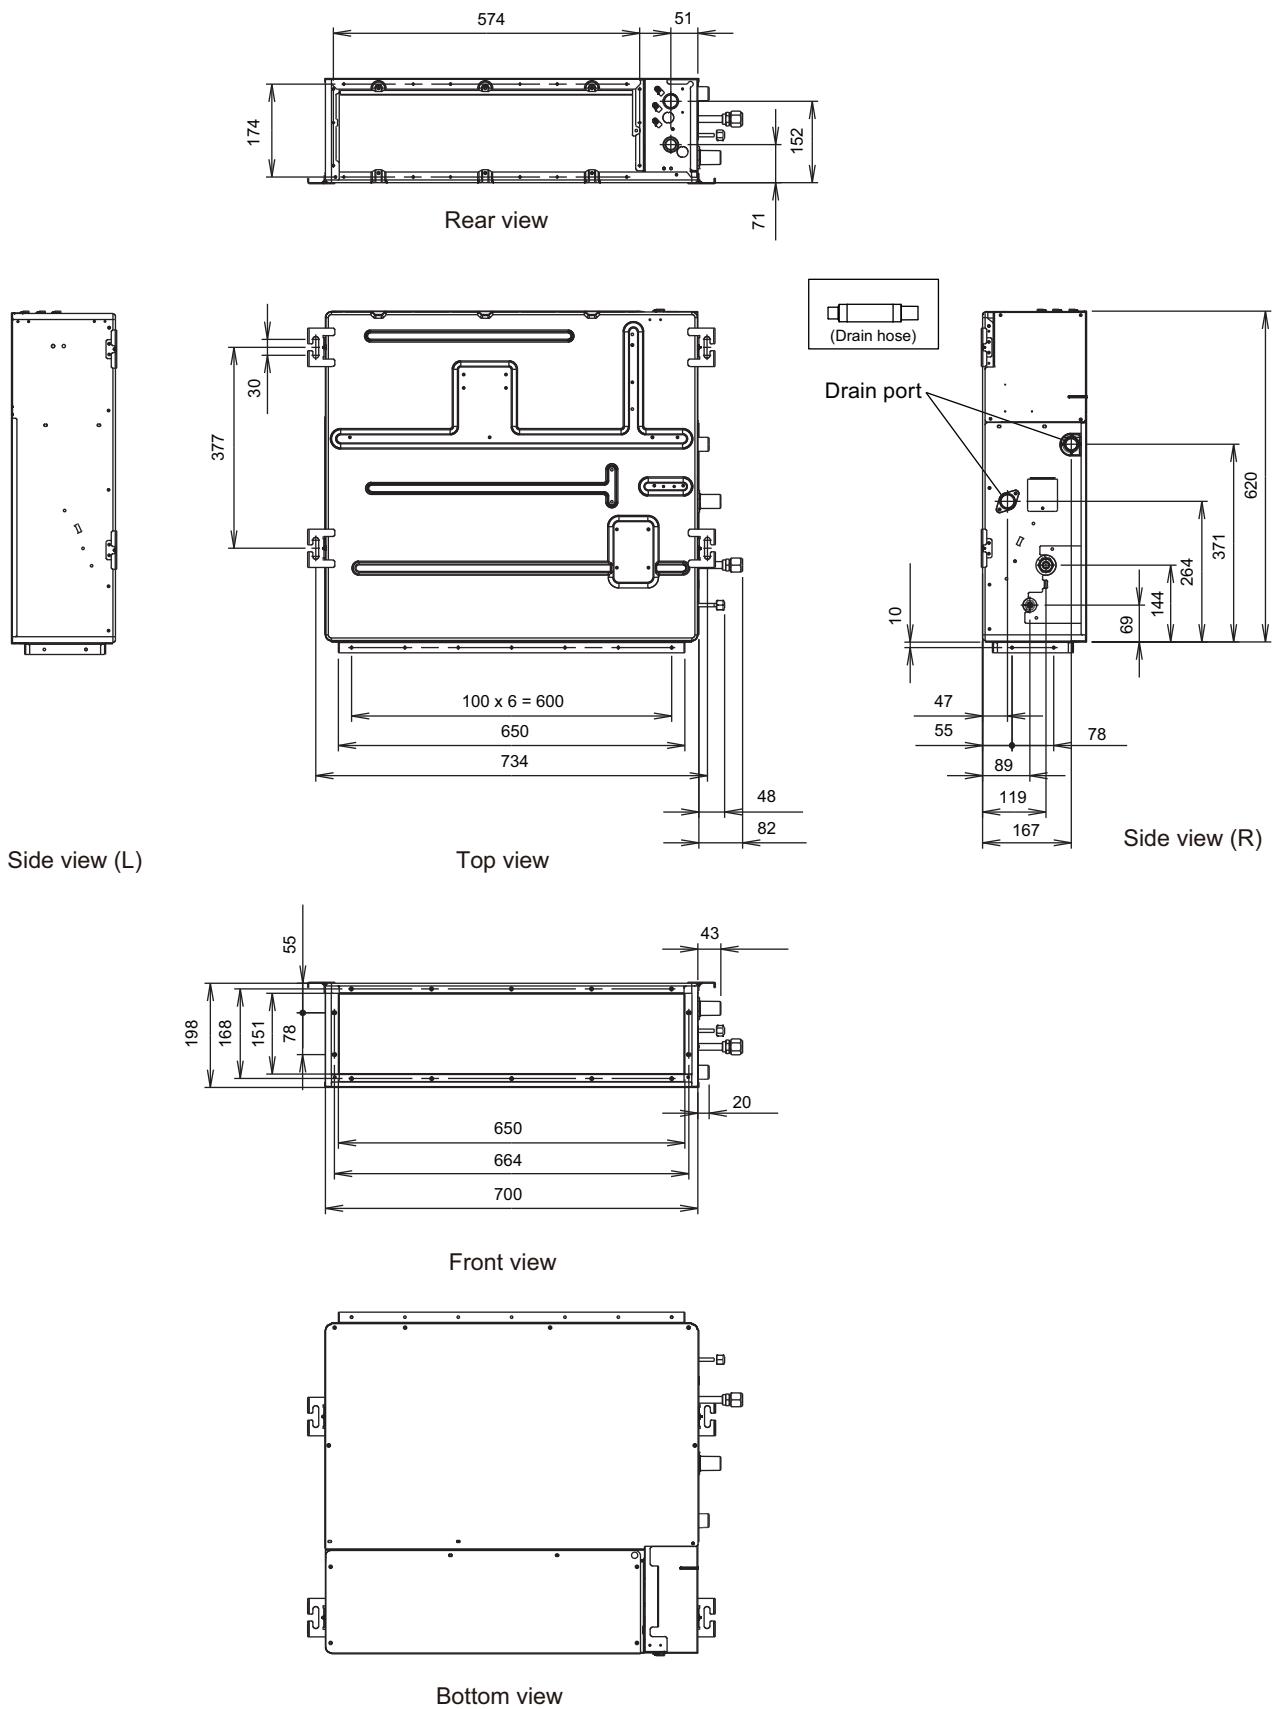

● Installation space requirement

Provide sufficient installation space for product safety.


In ceiling-concealed installations:

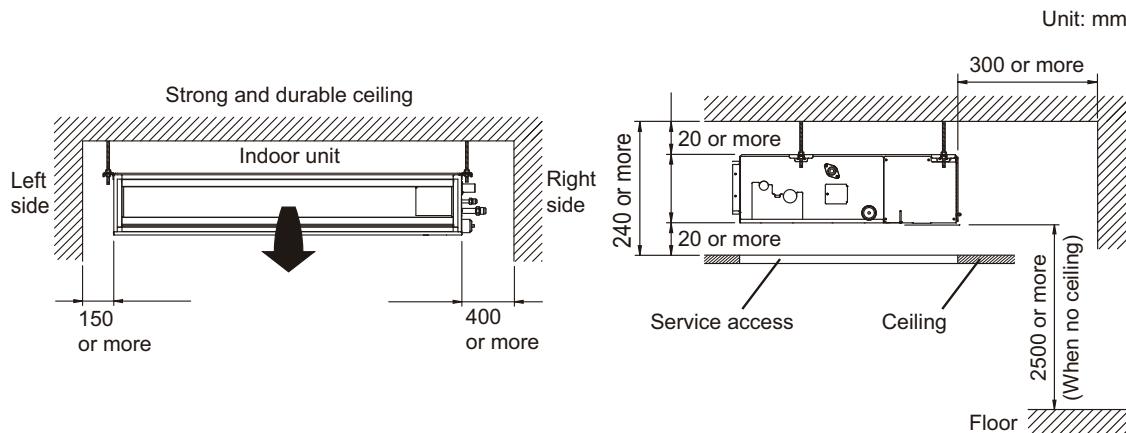

● Maintenance space requirement

Provide enough clearance for efficient maintenance.


NOTE: Do not place wiring or illumination in the maintenance space, as they impede maintenance work.

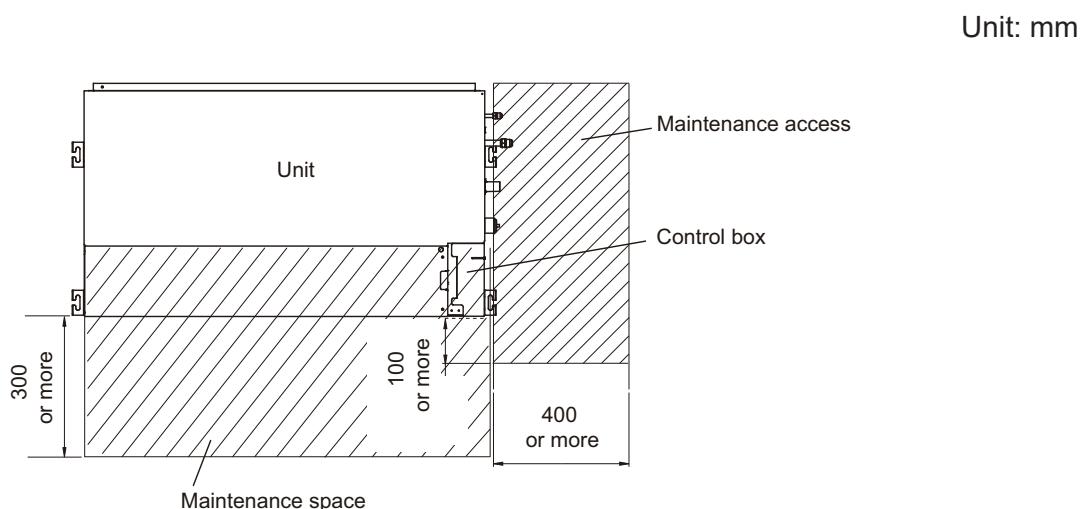


4-4. Medium static pressure duct type

■ Models: ARXH12-14KMTAP


Unit: mm

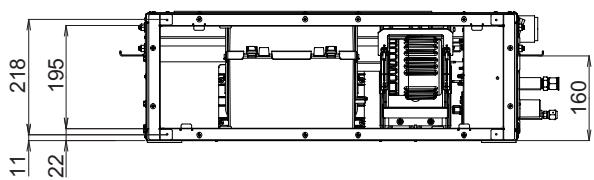


Rear view

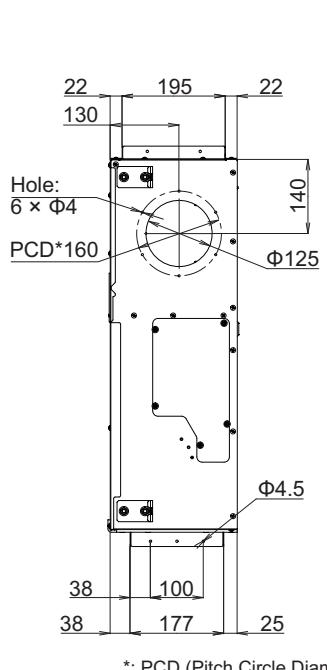


Side view (L)

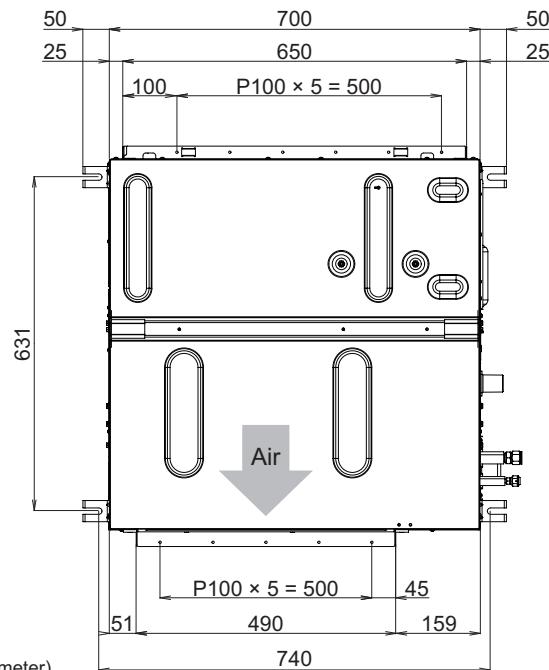

Top view

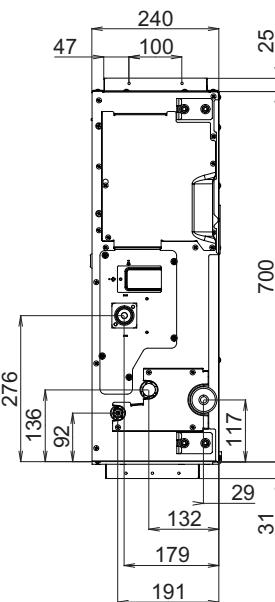

Side view (R)

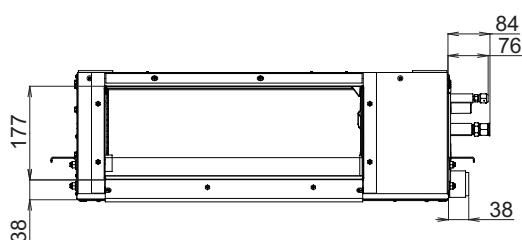


Front view

● Installation space requirement

Provide enough clearance for product safety.

NOTE: The detailed component shape depends on the model.

Unit: mm

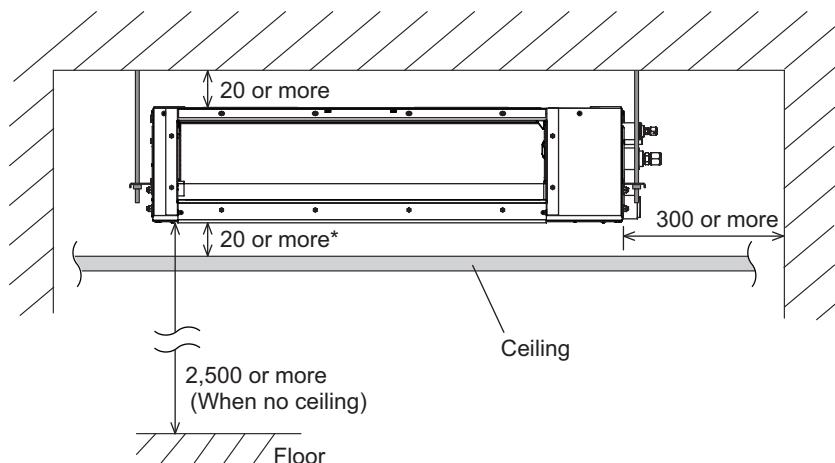

*: According to the distance between the ceiling and the unit, the construction plan of the maintenance access differs.


● Maintenance space requirement

Provide one or two maintenance accesses for the fan units and the filters or the inspections of the control box, drain pump, and the other parts.

Numbers and the sizes of the maintenance accesses differ according to the distance between the ceiling and the unit as follows.

Unit: mm

- Distance between the ceiling and the unit is 300 or more:

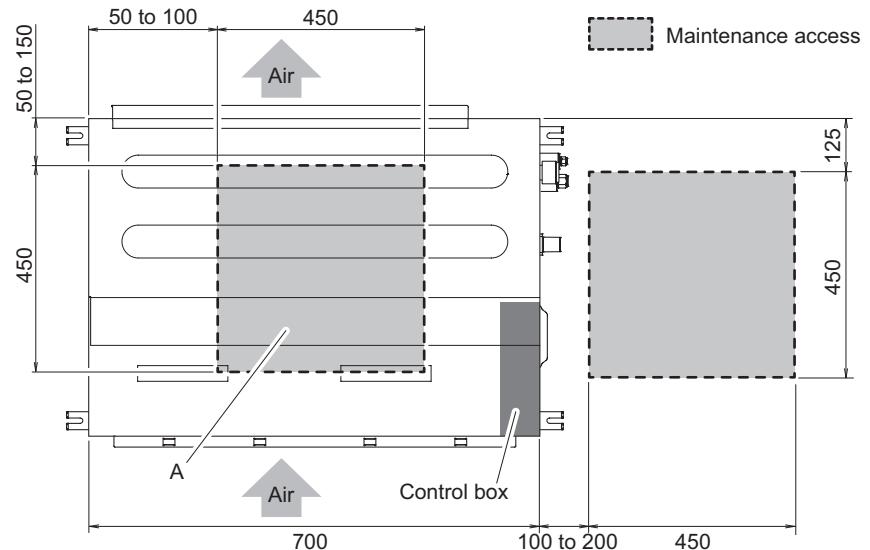


Bottom view


NOTE: If there is sufficient working space between the indoor unit and the ceiling plate, the maintenance access under the unit (A) is not necessary.

- Distance between the ceiling and the unit is from 20 to 300:
Choose one of these methods to set up the maintenance access.

Pattern A

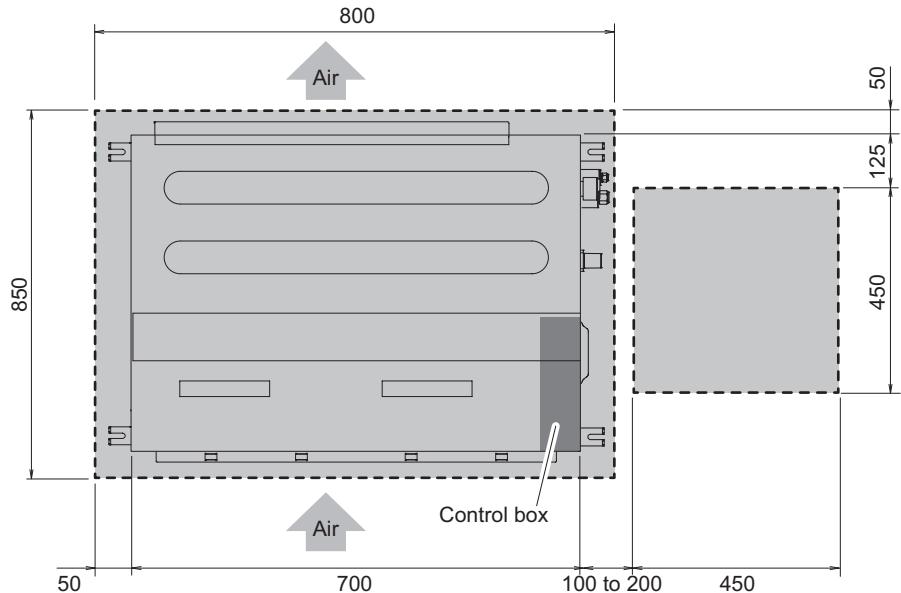 Maintenance access


Pattern B

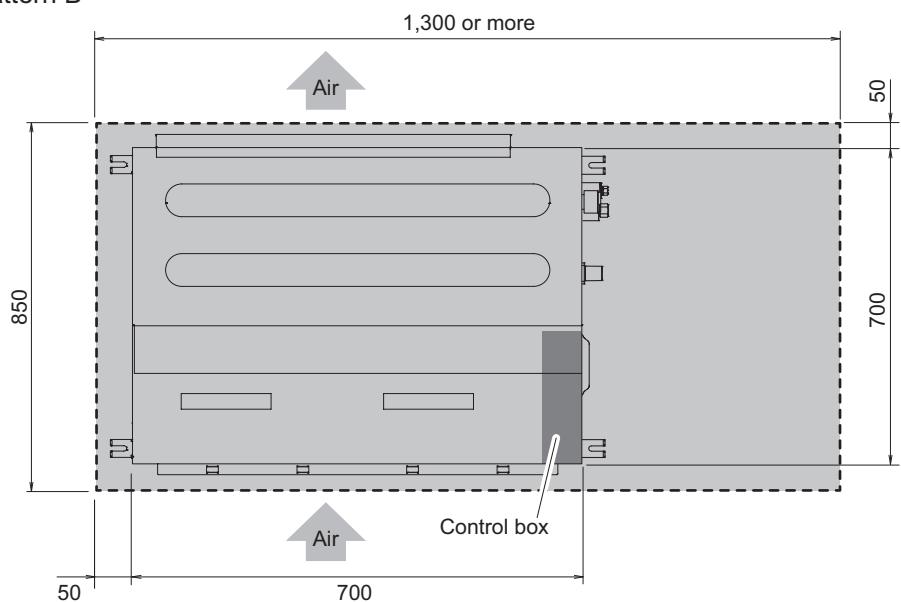


Bottom view

4-5. Wall mounted type

■ Models: ASHG07-14KMTB and ASHG07-14KMCC



Unit: mm

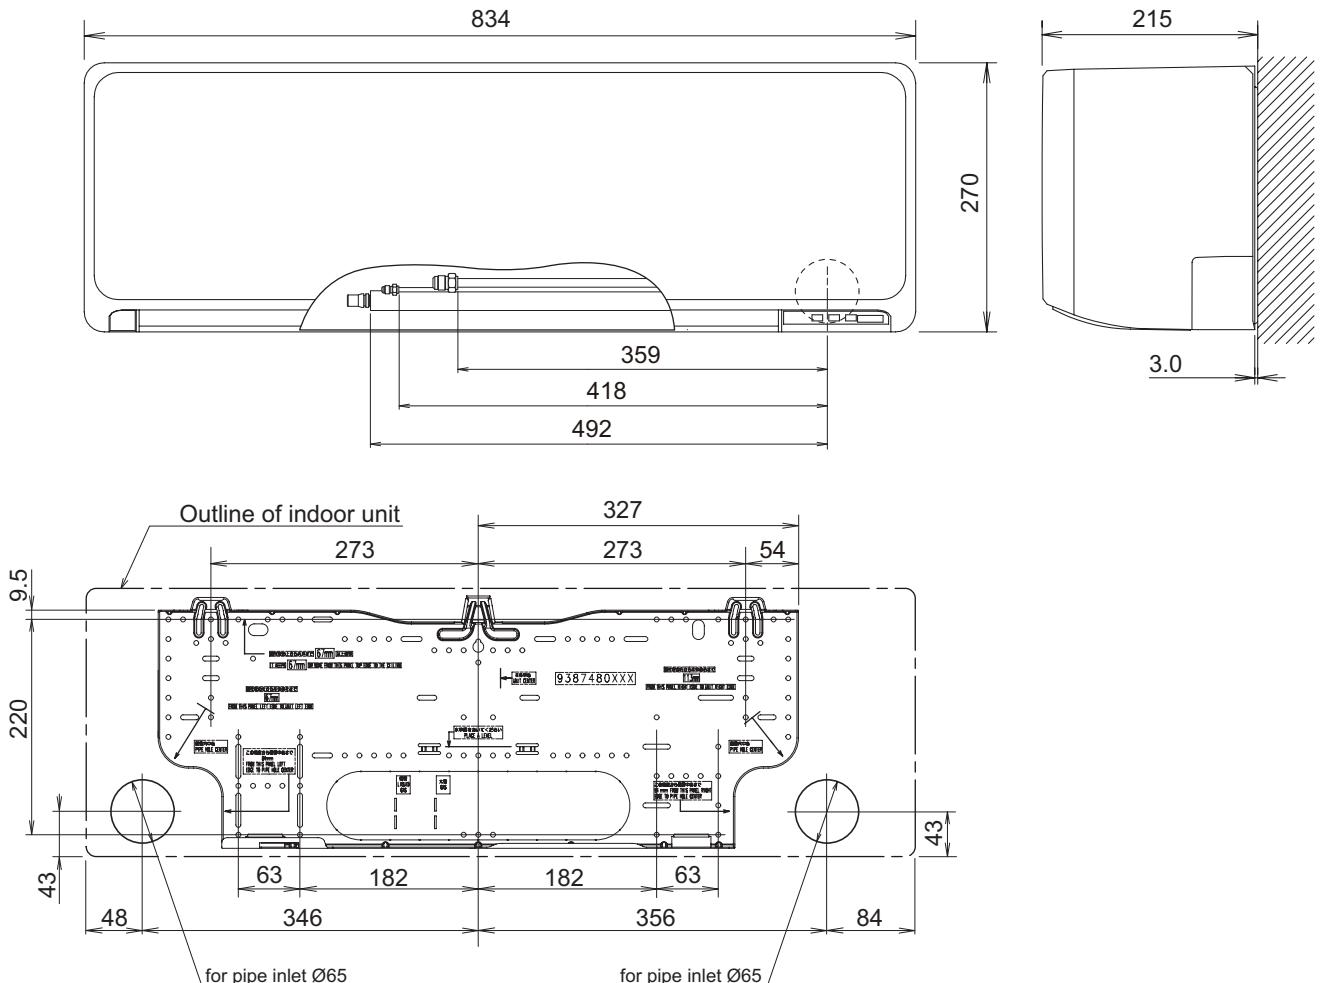

● Installation space requirement



Provide sufficient installation space for product safety.

Unit: mm

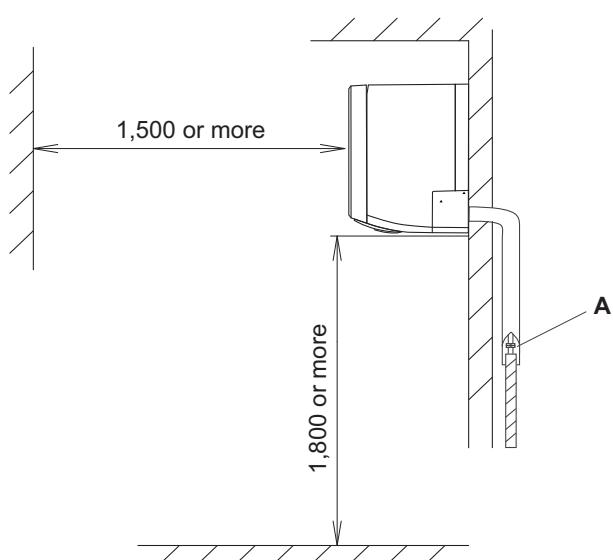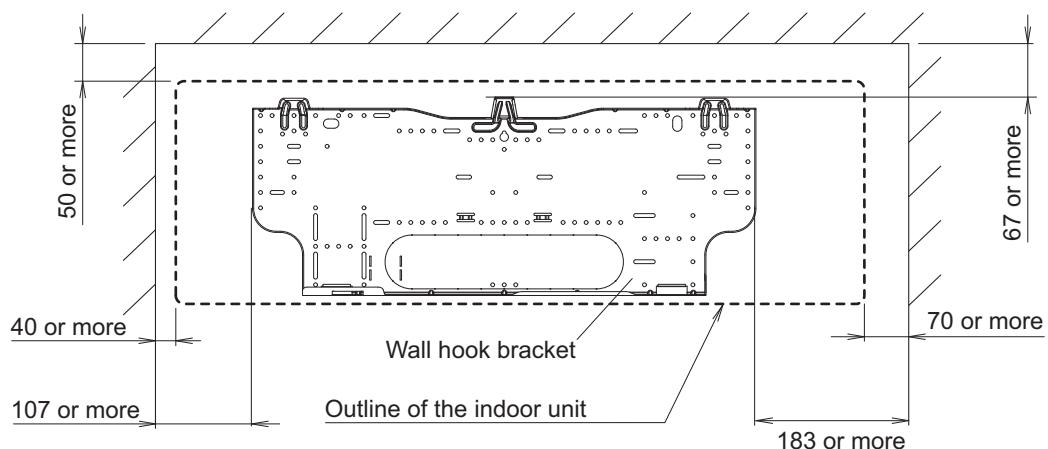

■ Models: ASHG07-14KMCE, ASHG07-14KMCF, ASHH07-14KMCG, ASHH07-14KMCG-B, and ASHH07-14KMCH-B



Unit: mm

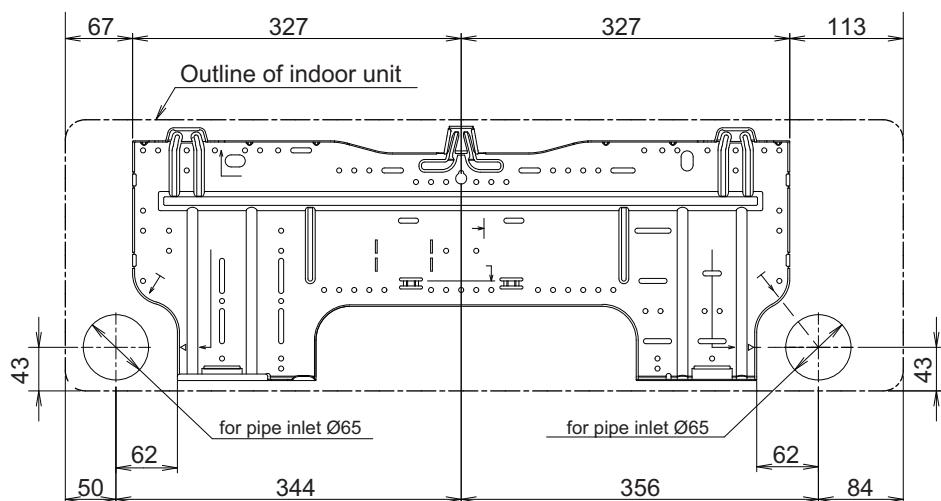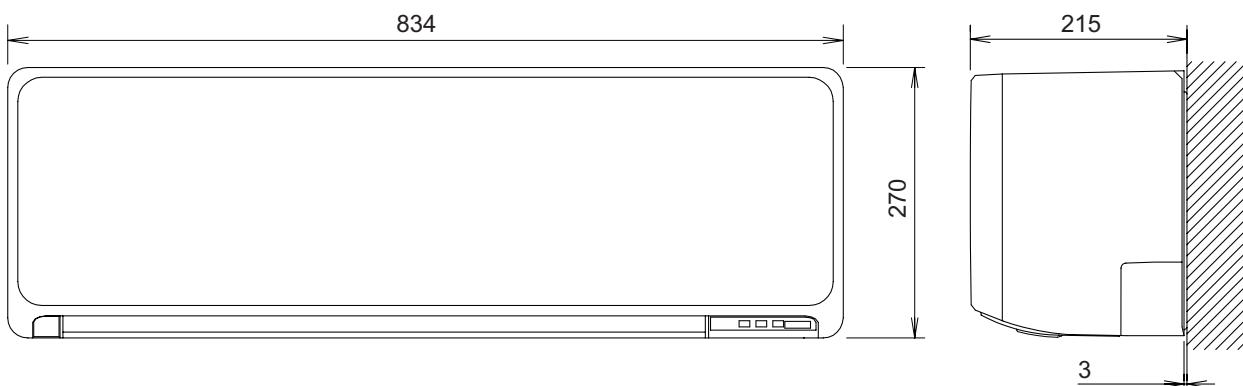

● Installation space requirement

Provide sufficient installation space for product safety.




Unit: mm

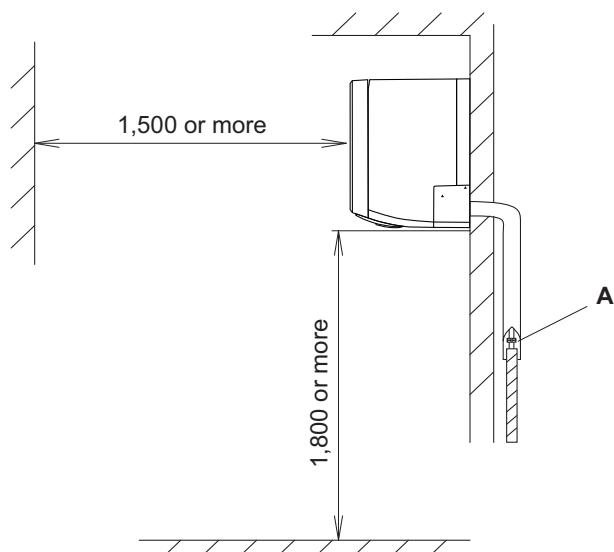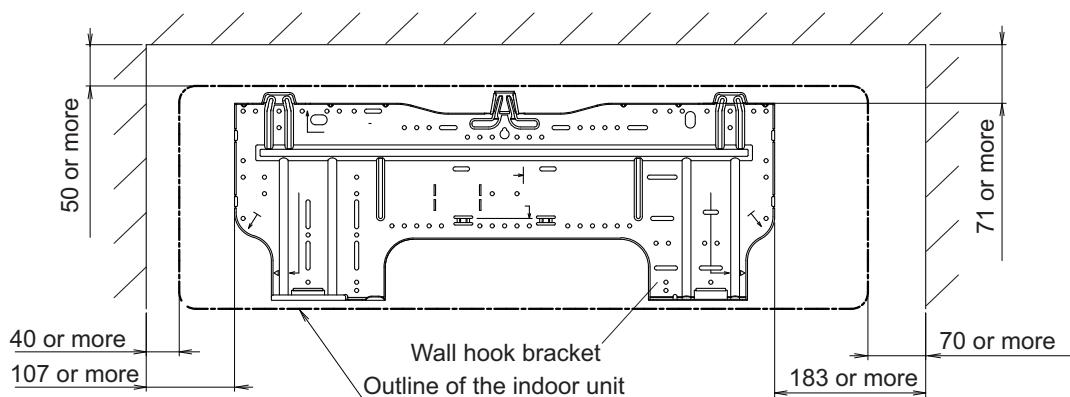

A: Install so that the flare connection part is outdoors.

■ Models: ASHH07-14KMCH



Unit: mm

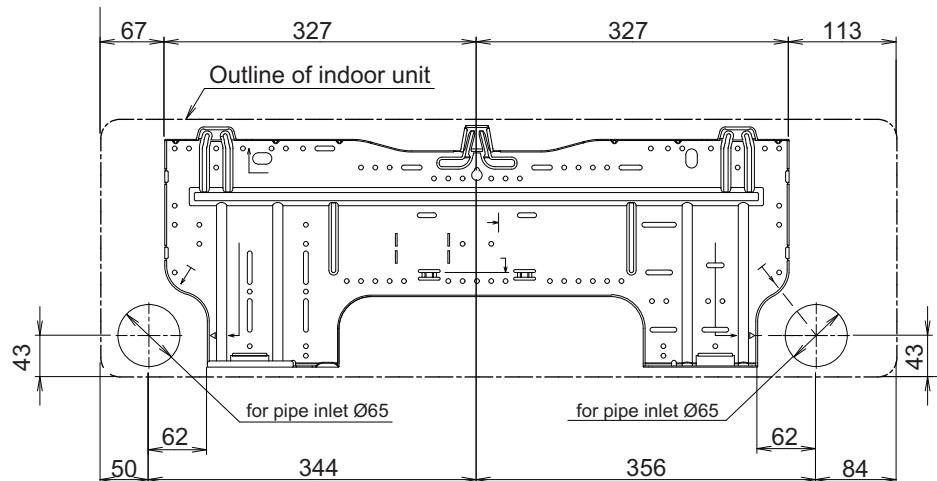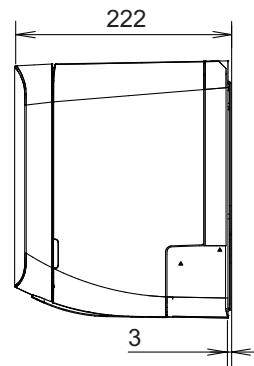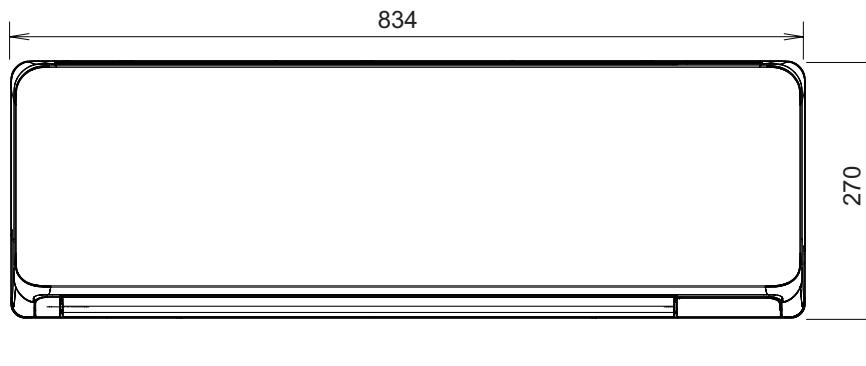

● Installation space requirement

Provide sufficient installation space for product safety.


Unit: mm

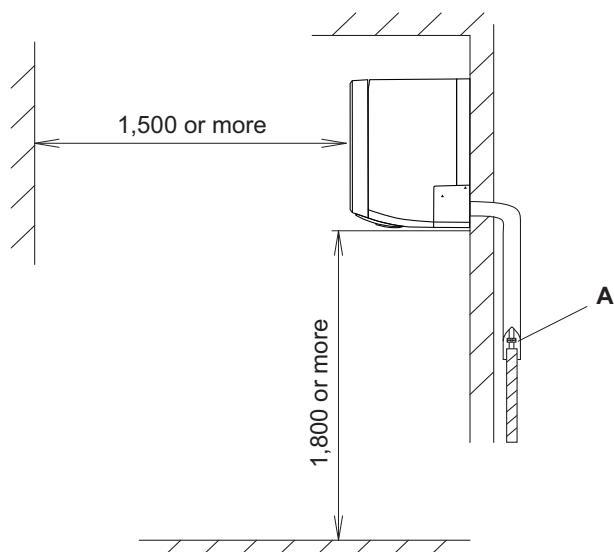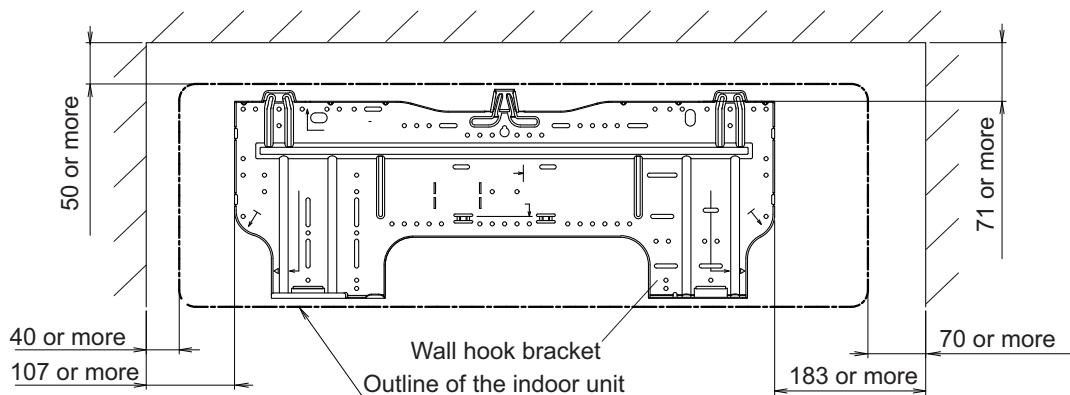

A: Install so that the flare connection part is outdoors.

■ Models: ASHG07-14KETA, ASHG07-14KETA-B, ASHG07-14KETE, ASHG07-14KETE-B, ASHG07-14KETF, and ASHG07-14KETF-B



Unit: mm

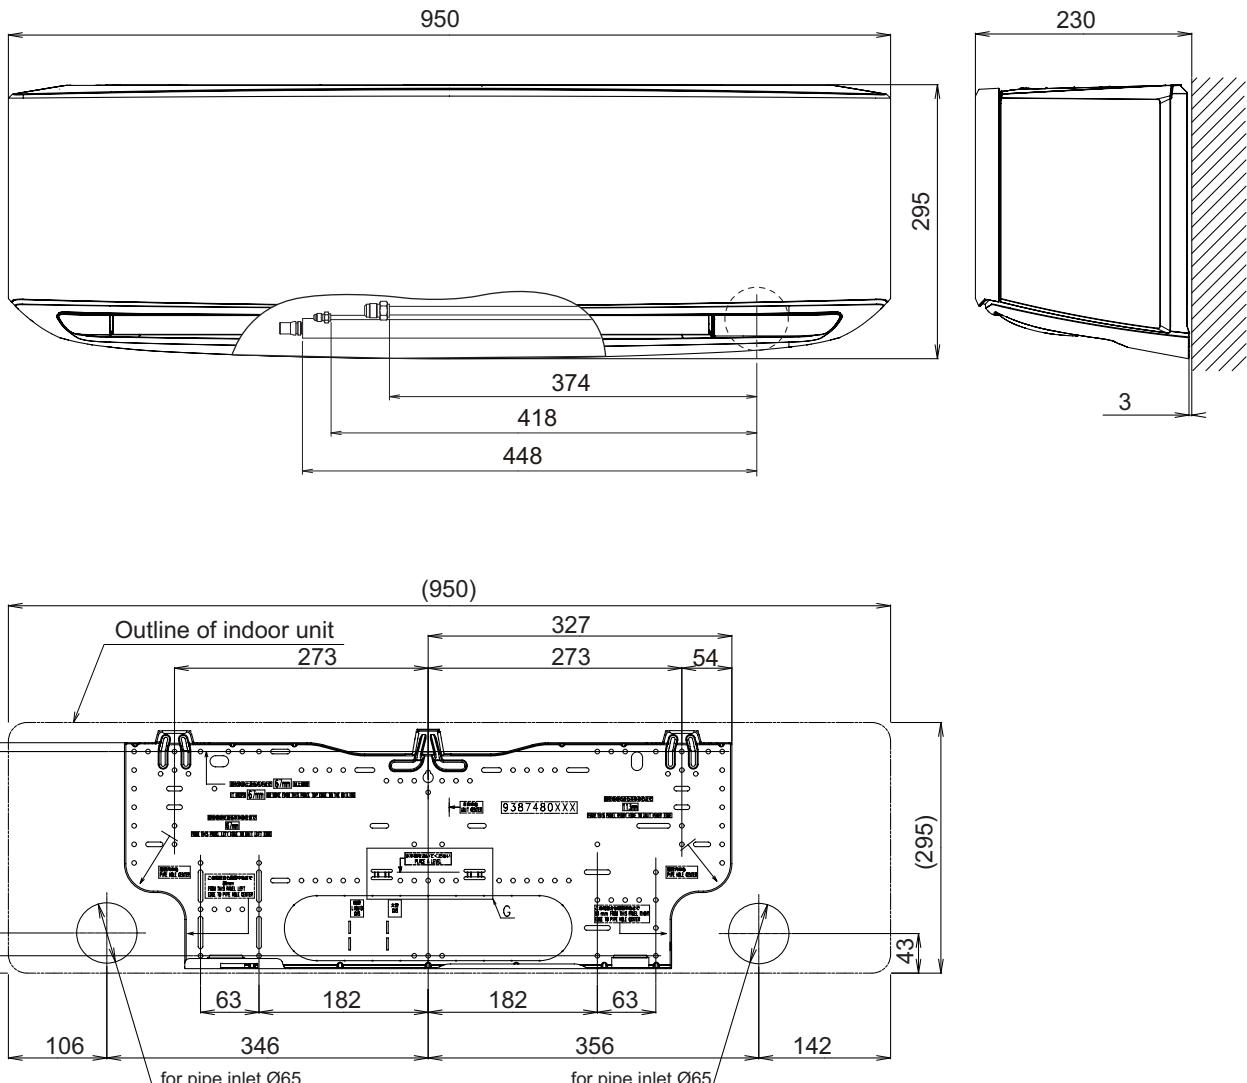

● Installation space requirement



Provide sufficient installation space for product safety.

Unit: mm

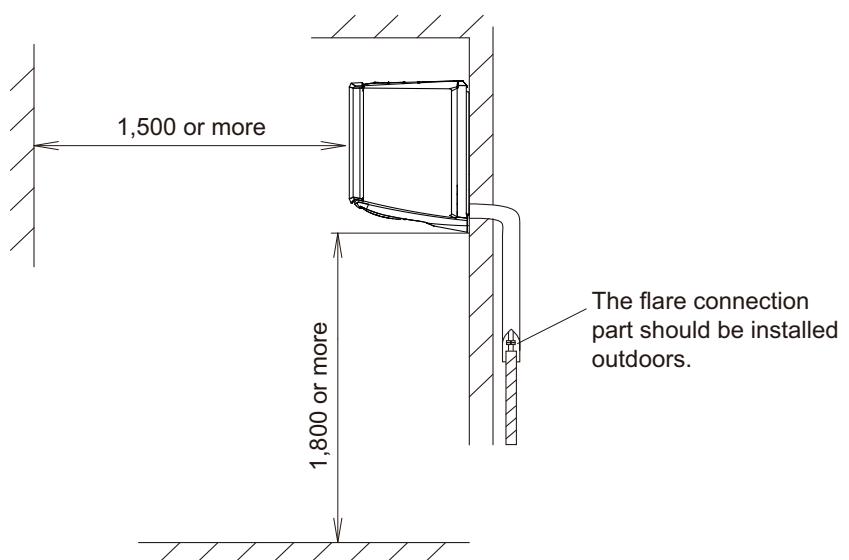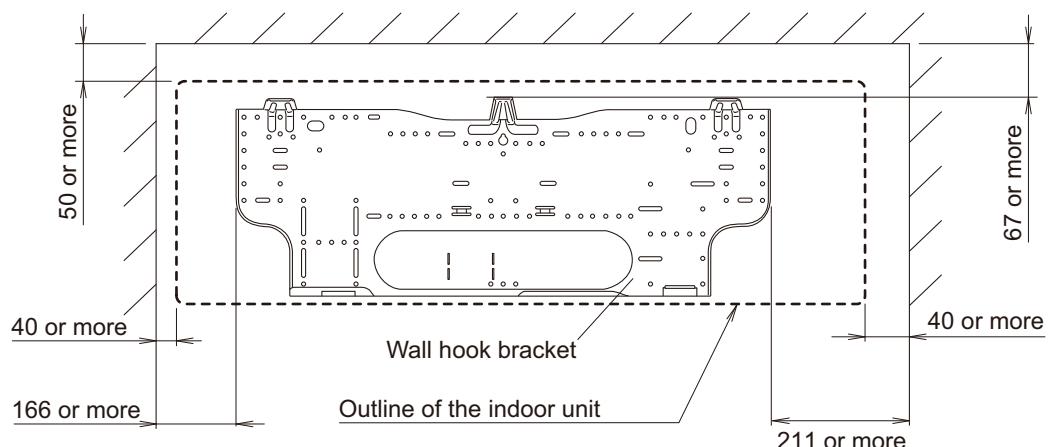

■ Models: ASHG07–14KGTB



Unit: mm

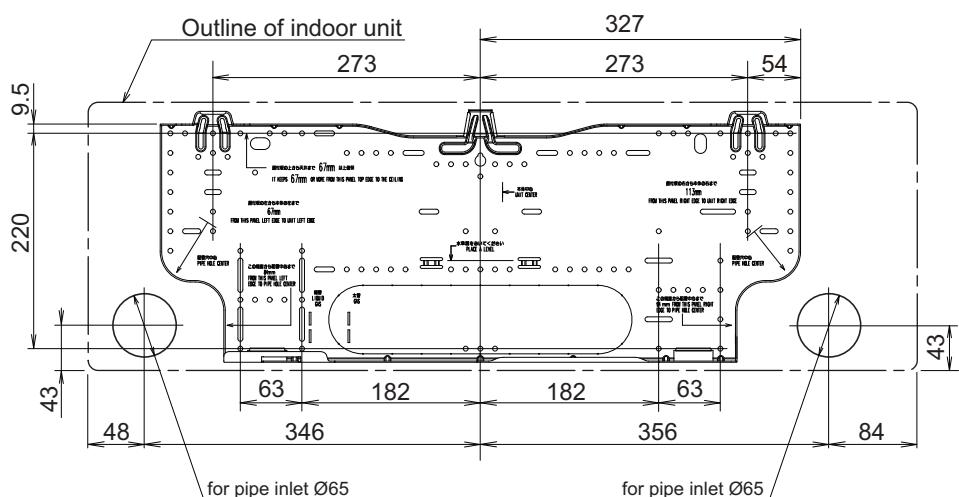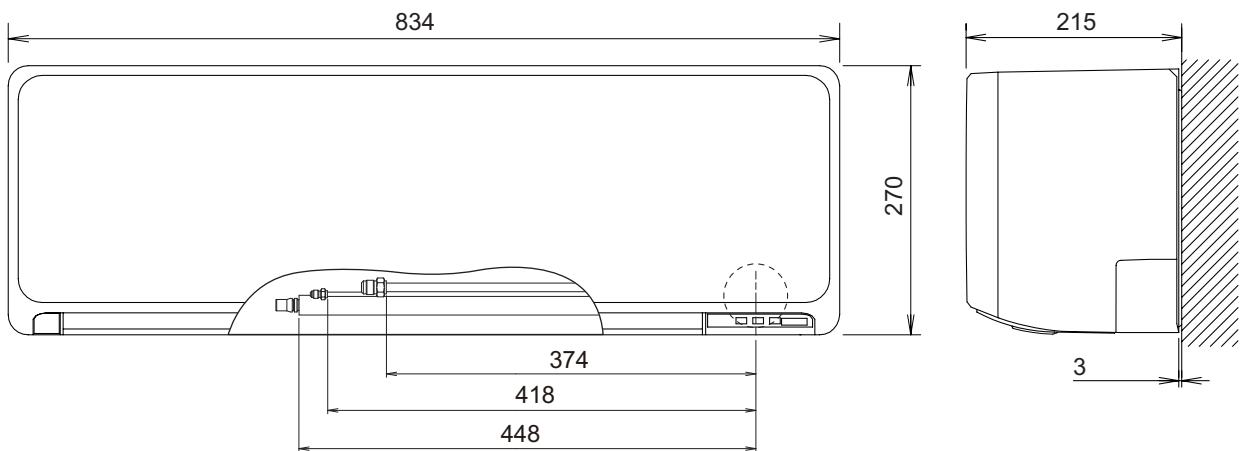

● Installation space requirement

Provide sufficient installation space for product safety.




Unit: mm

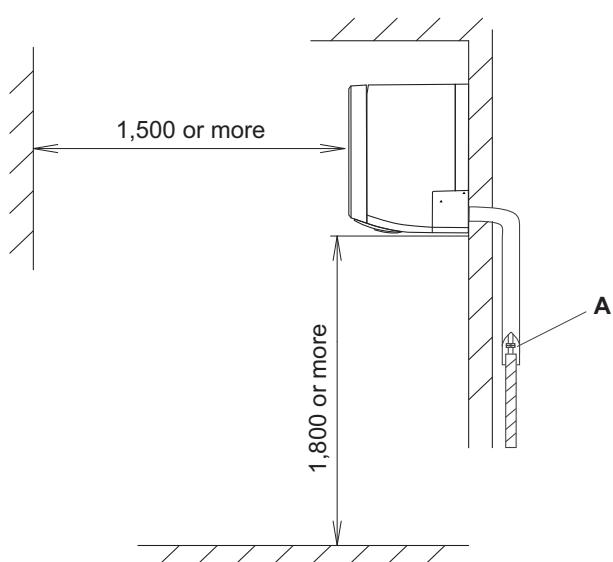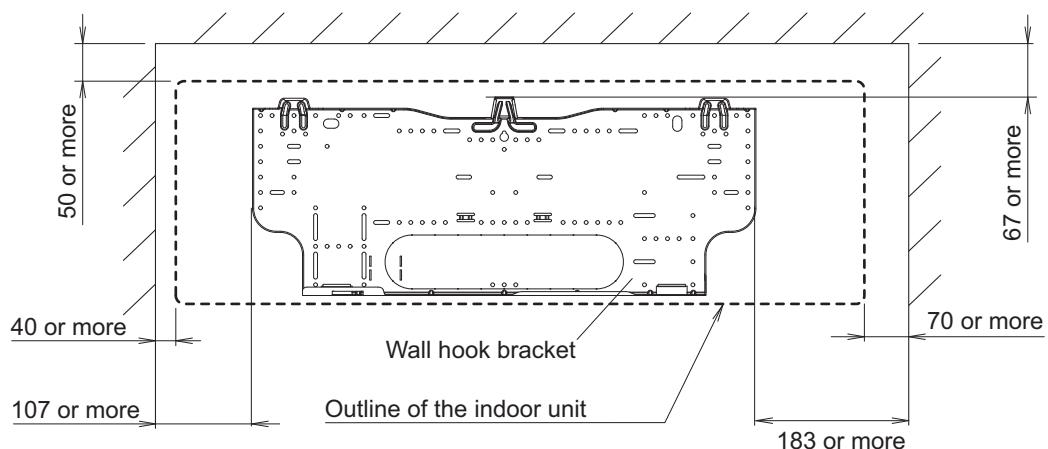

A: Install so that the flare connection part is outdoors.

■ Models: ASHG07-14KGTE, ASHG07-14KGTF, ASHH07-14KG TG , and ASHH07-14KGTH



Unit: mm

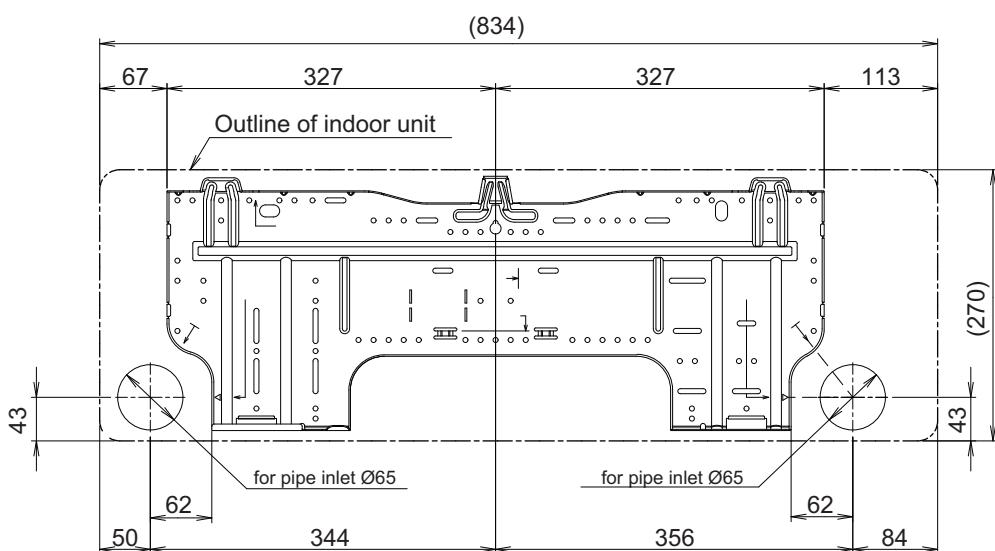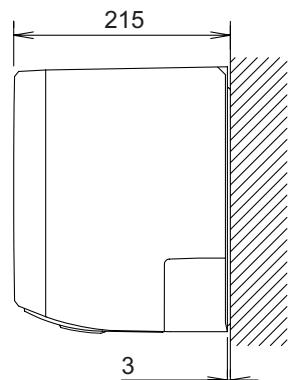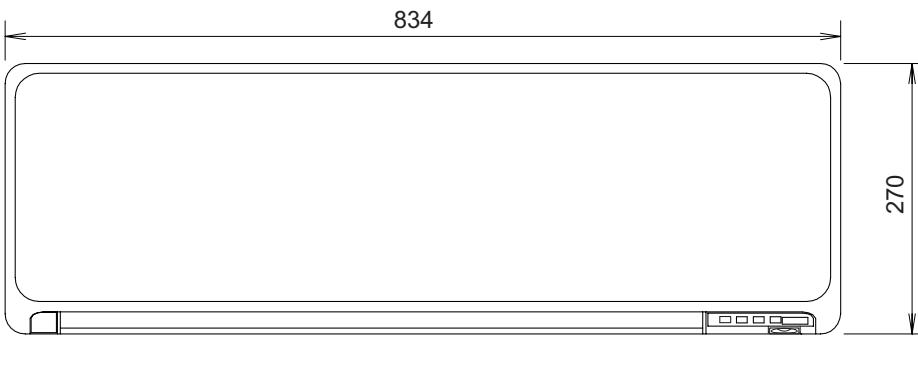

● Installation space requirement

Provide sufficient installation space for product safety.



Unit: mm

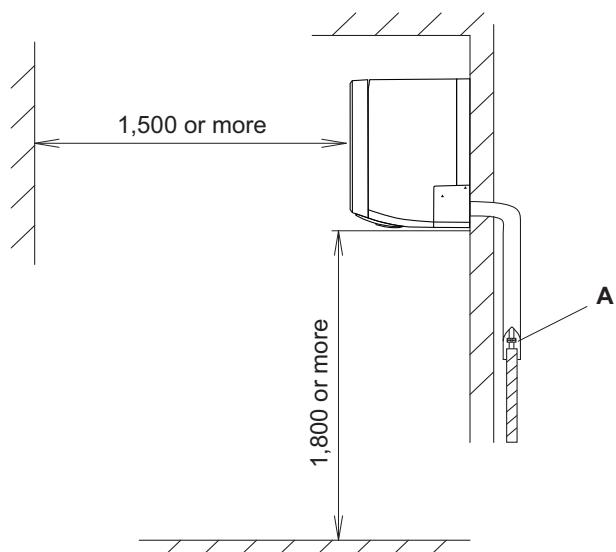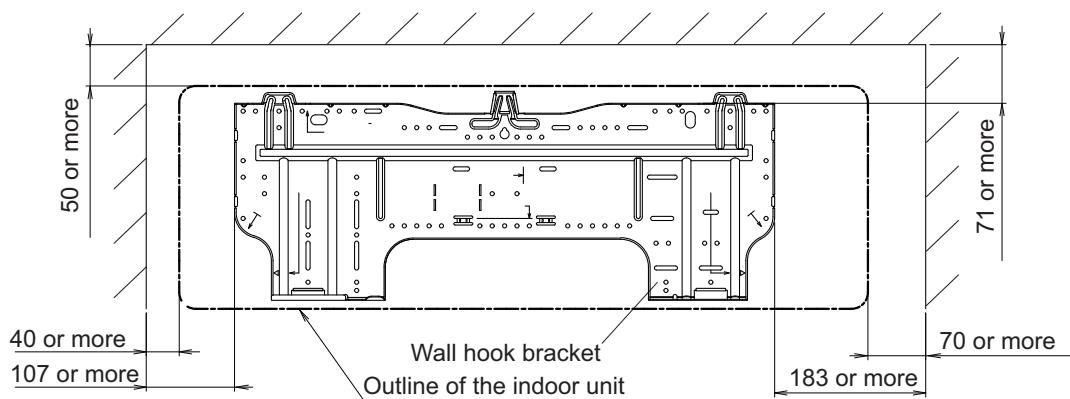

A: Install so that the flare connection part is outdoors.

■ Models: ASHH05-12KNCA and ASHH05-12KNCH



Unit: mm

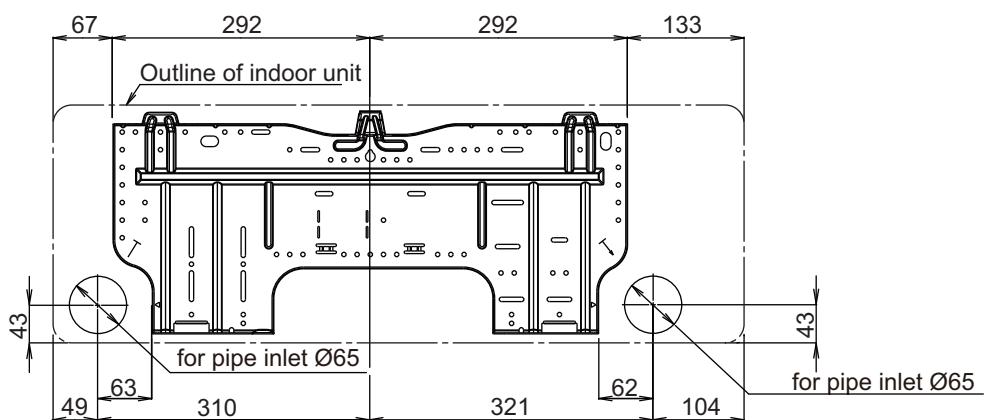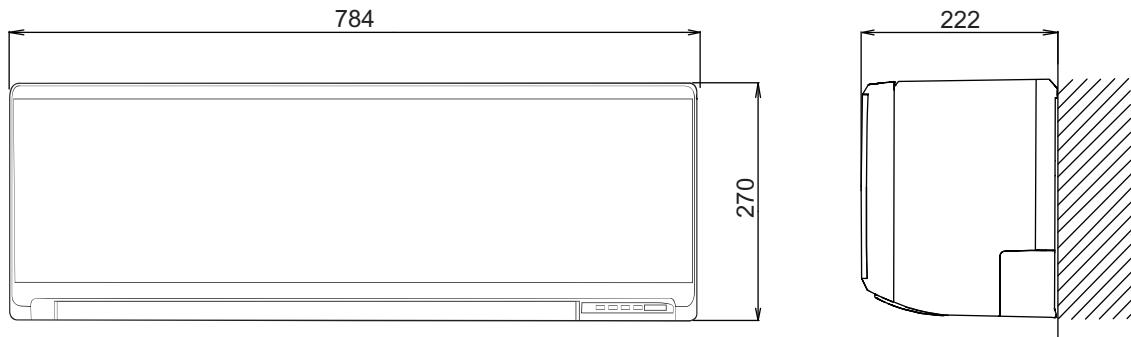

● Installation space requirement

Provide sufficient installation space for product safety.

Unit: mm

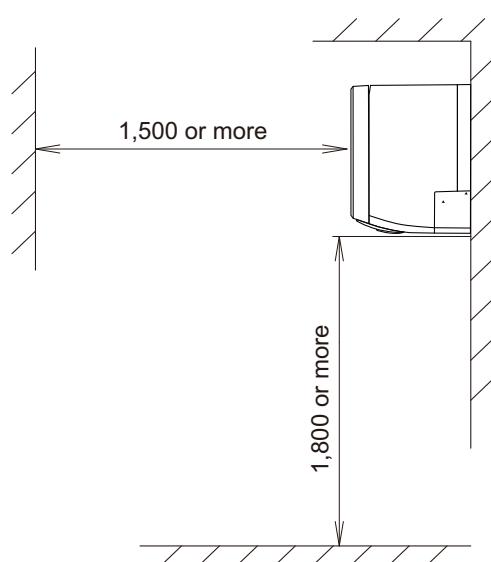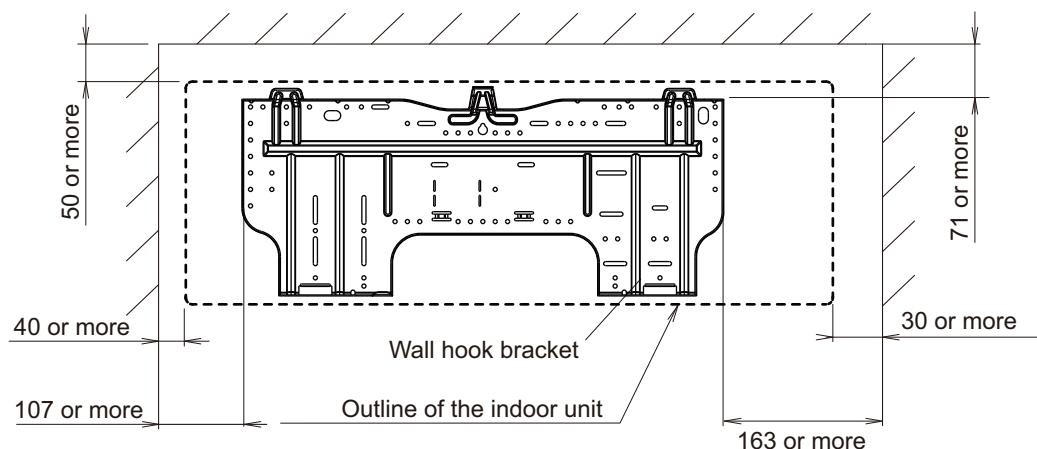


■ Pipe exit length from the rear (for KMCG, KMCG-B, KMCH, KMCH-B, KGTG, KGTH, KNCA, and KNCH)

Design the system considering the length of the pipes or hose exiting from the rear of the indoor unit.

NOTE: Detailed shapes of the indoor unit and the tip of each pipe or hose may vary depending on the model.

Unit: mm

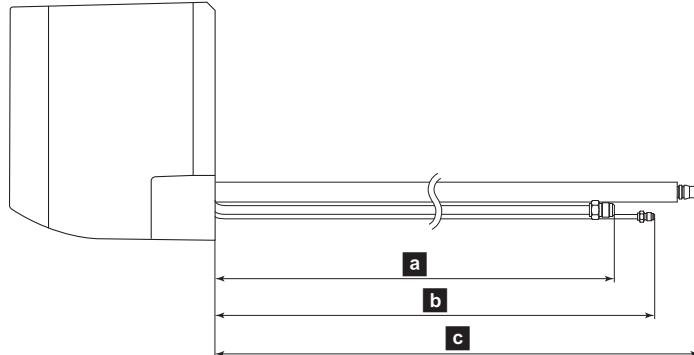


Model name	Approximate length		
	a Gas pipe	b Liquid pipe	c Drain hose
ASHH07-14KMCG ASHH07-14KMCG-B ASHH07-14KMCH ASHH07-14KMCH-B	395	435	480
ASHH07-14KGTG ASHH07-14KGTH	380	430	480
ASHH05-12KNCA ASHH05-12KNCH	380	430	485

4-6. Floor type



■ Models: AGHG09–14KVCA

Unit: mm

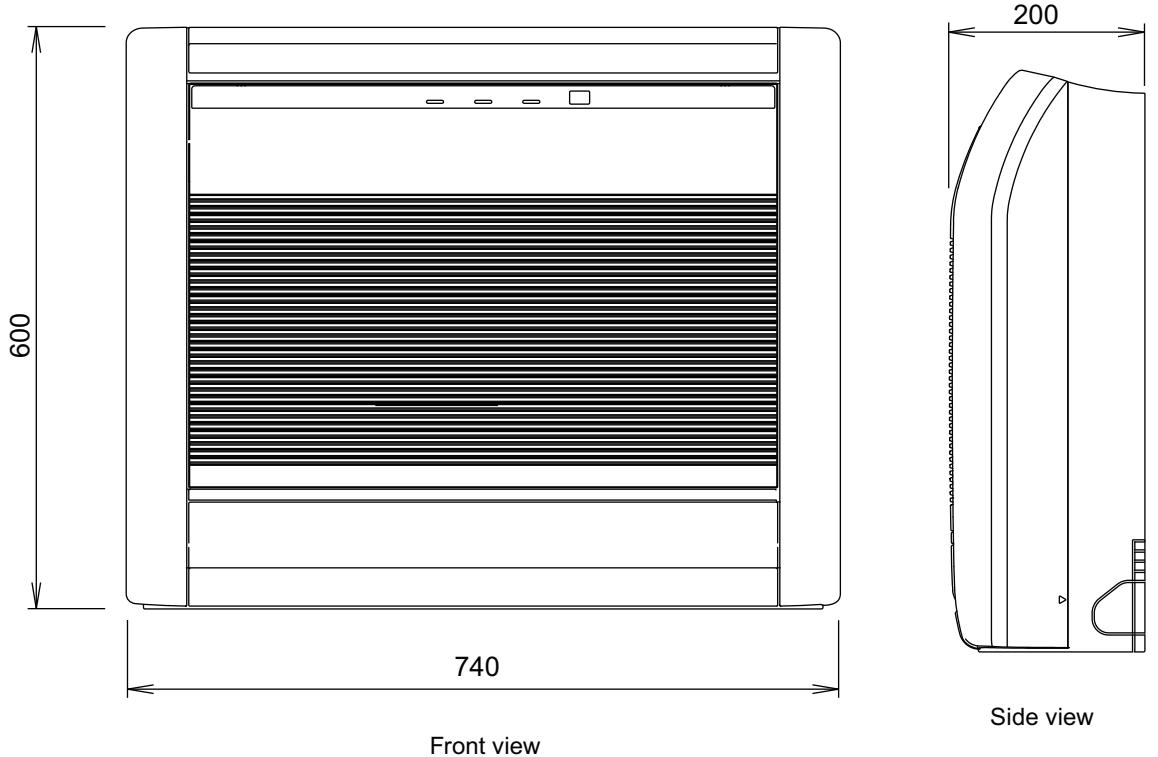

● Installation space

Unit: mm

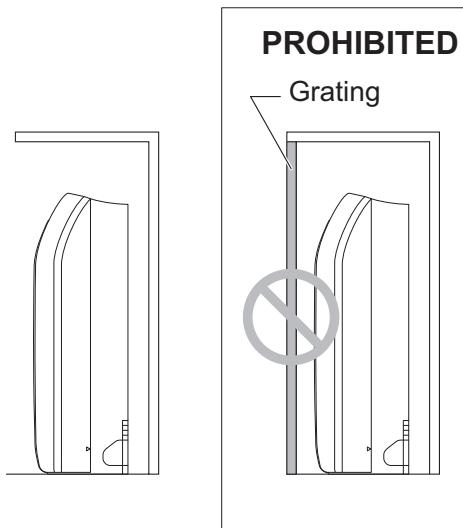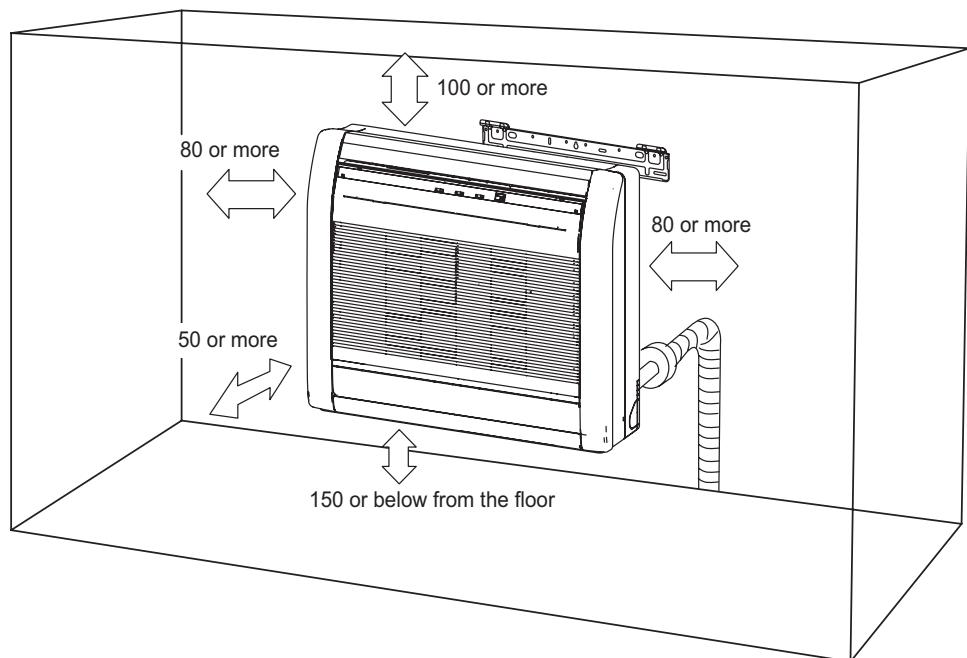

⚠ WARNING

- The appliance shall be installed, operated and stored in a room with a floor area larger than X m².


Amount of refrigerant charge M (kg)	Minimum room area X (m ²)
M ≤ 1.22	-
1.22 < M ≤ 1.23	12.99
1.23 < M ≤ 1.50	19.31
1.50 < M ≤ 1.75	26.28
1.75 < M ≤ 2.0	34.33
2.0 < M ≤ 2.5	53.63
2.5 < M ≤ 3.0	77.23
3.0 < M ≤ 3.5	105.12
3.5 < M ≤ 4.0	137.29

(IEC 60335-2-40)

5. Wiring diagrams


5-1. Compact cassette type

■ Models: AUXG07-14KVLA

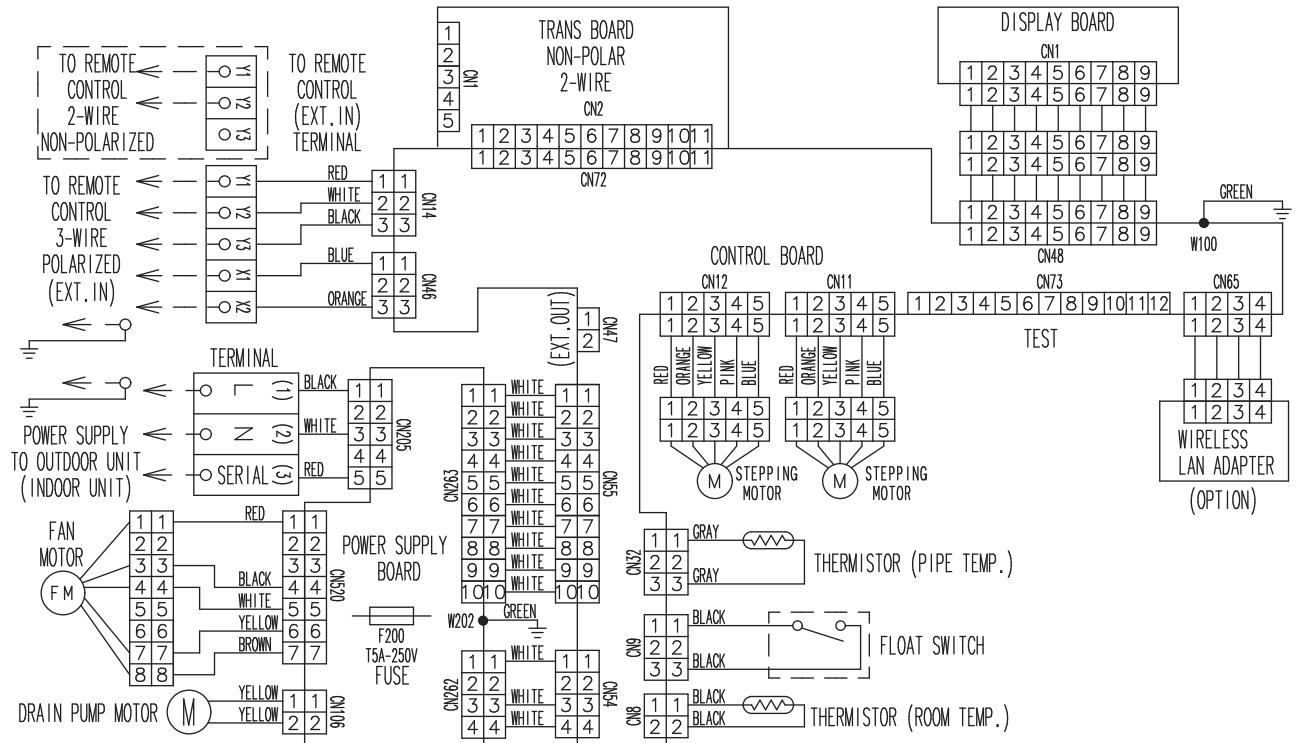


5-2. Mini duct type and Slim duct type

■ Models: ARXG07-14KSLAP and ARXG07-14KLLAP

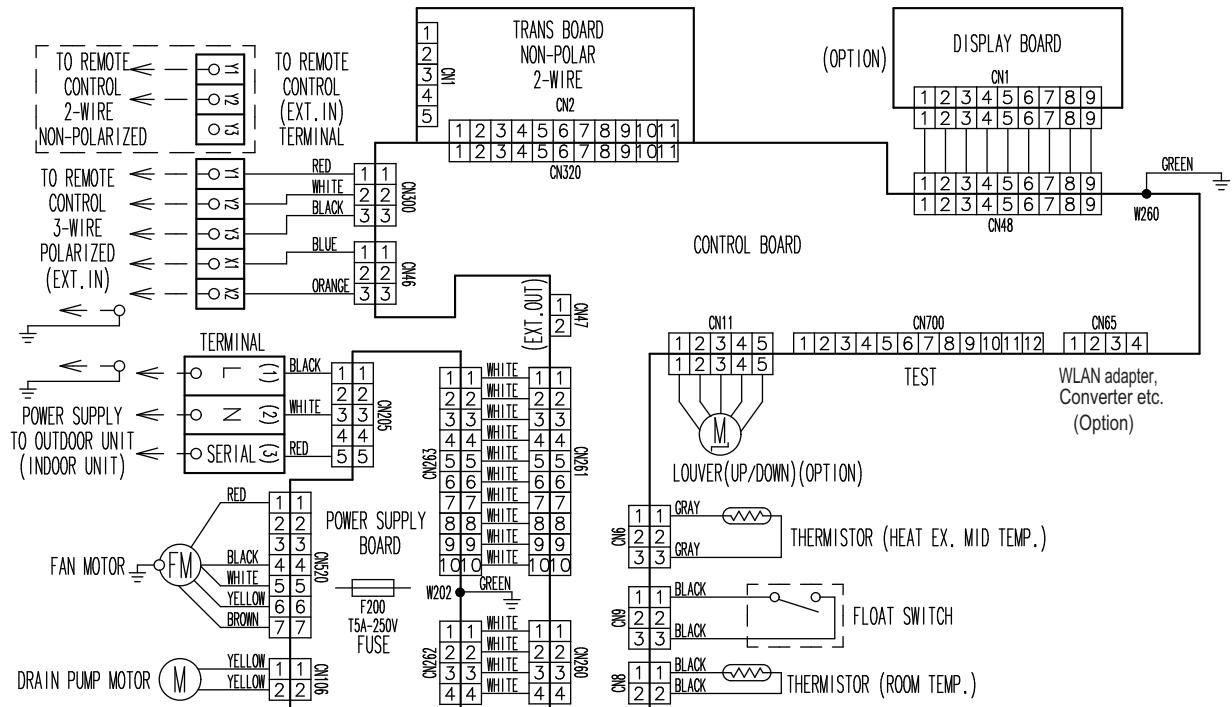


5-3. Medium static pressure duct type

■ Models: ARXH12-14KMTAP

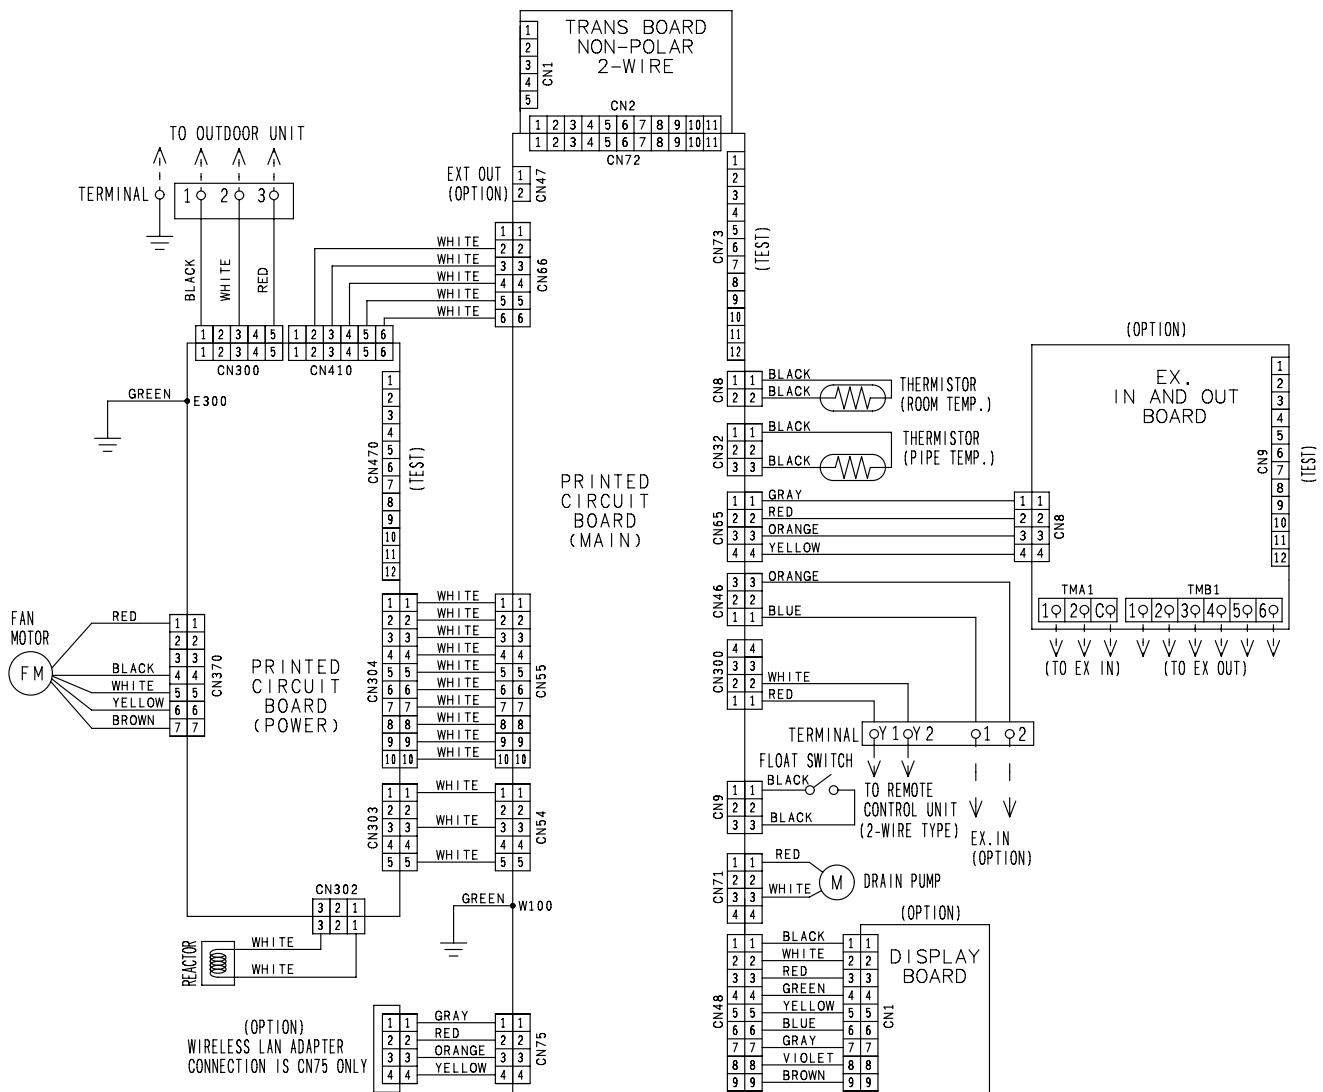


5-4. Wall mounted type


■ Models: ASHG07-14KMTB

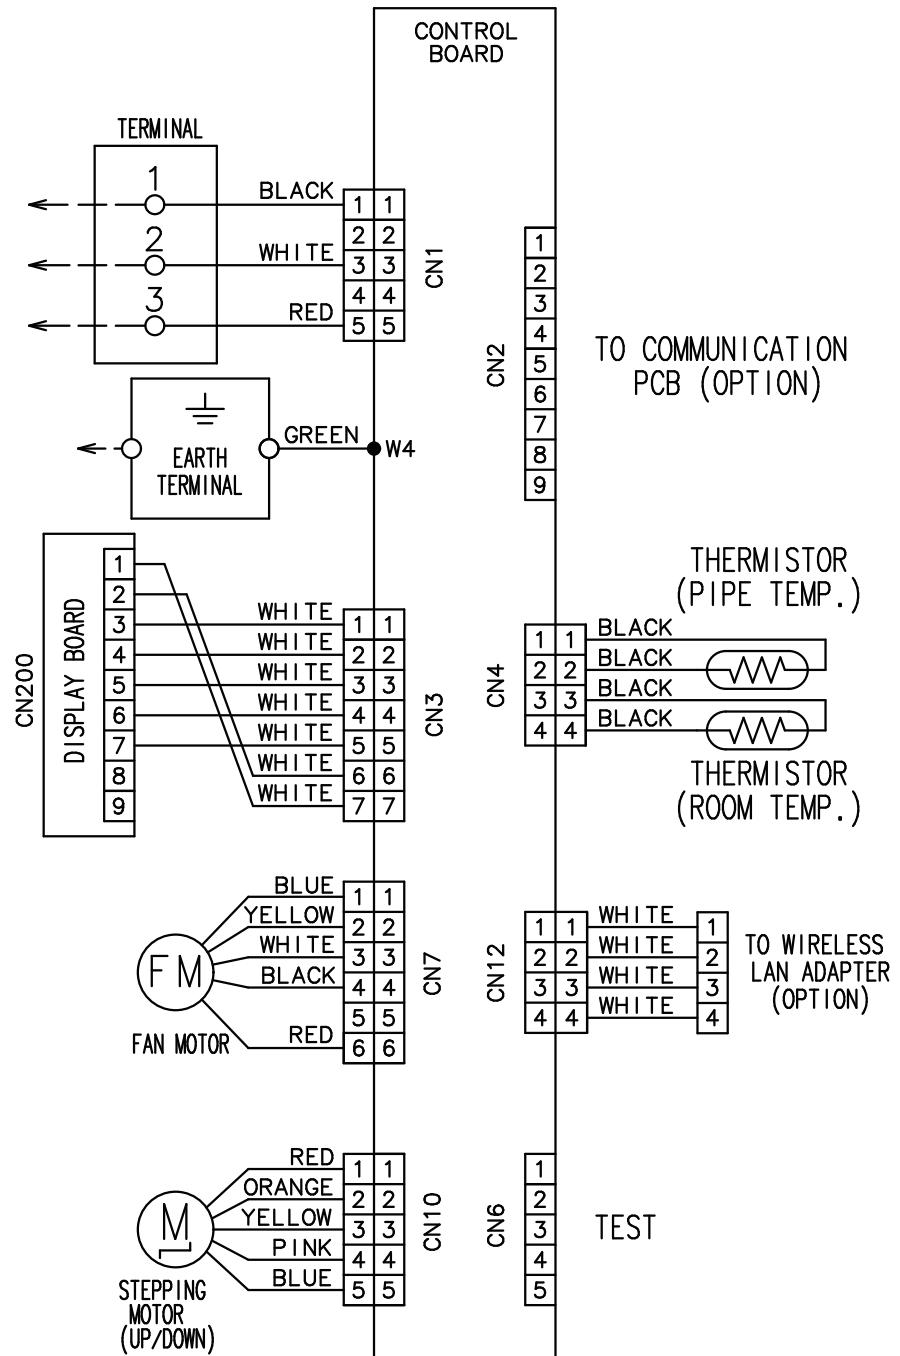


■ Models: ASHG07-14KMCC

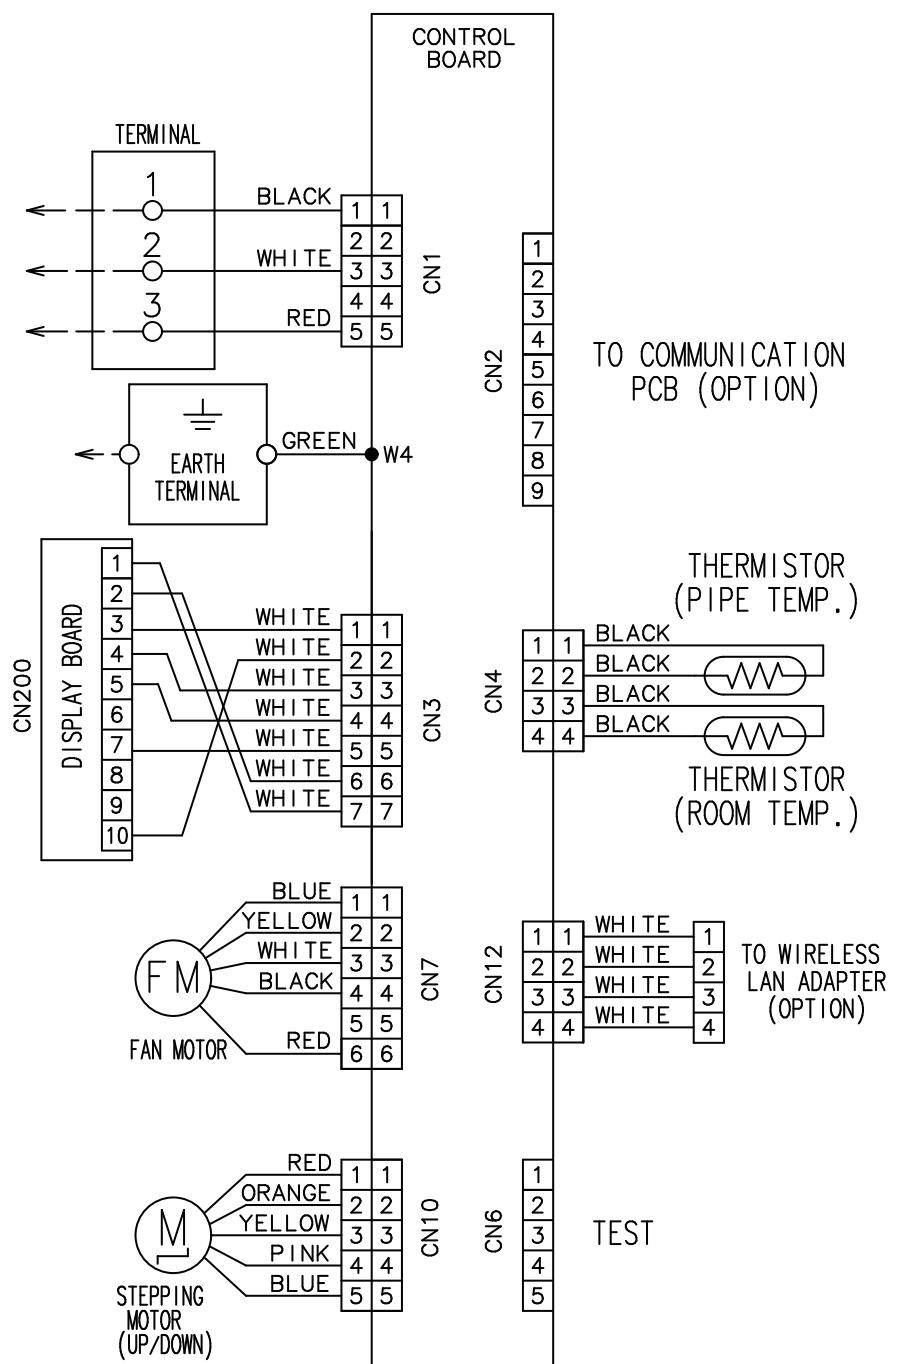


■ Models: ASHG07-14KMCE, ASHH07-14KMCH, and ASHH07-14KMCH-B

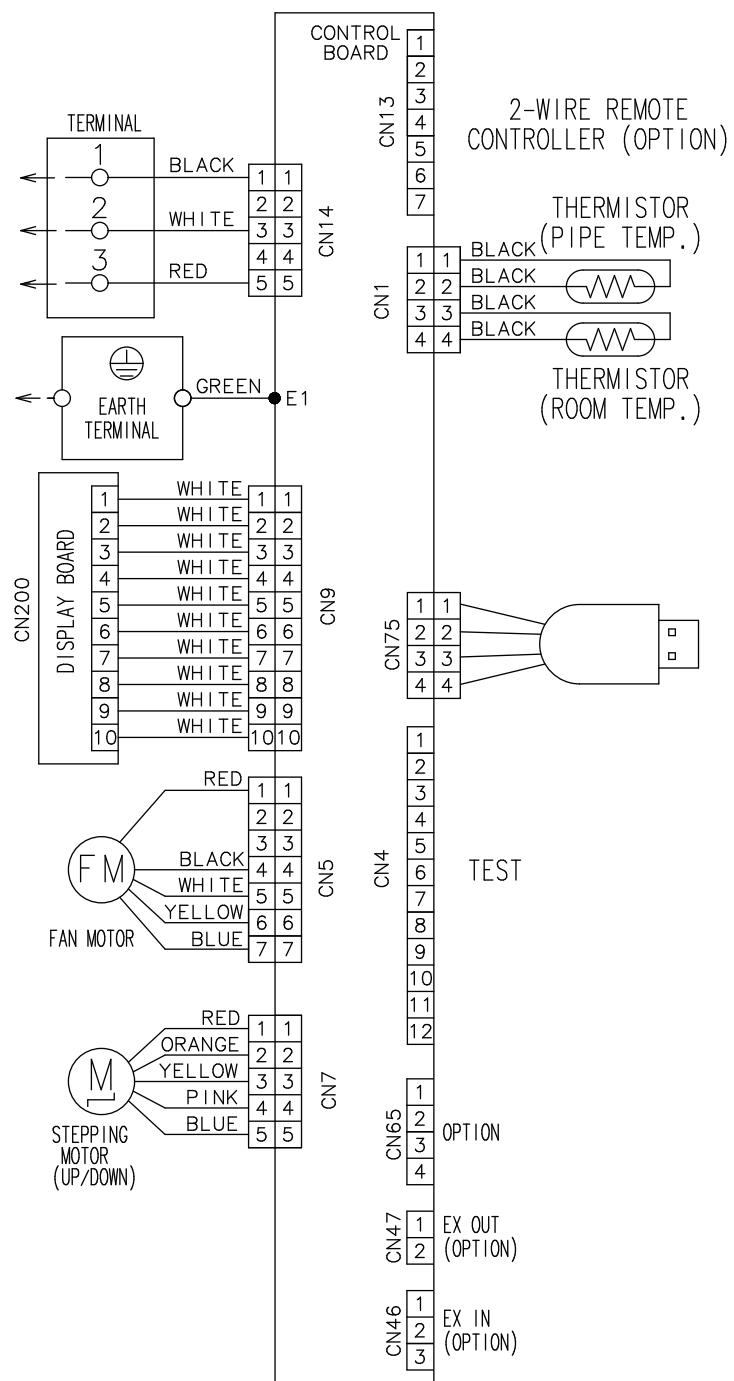


■ Models: ASHG07-14KMCF, ASHH07-14KMCG, and ASHH07-14KMCG-B

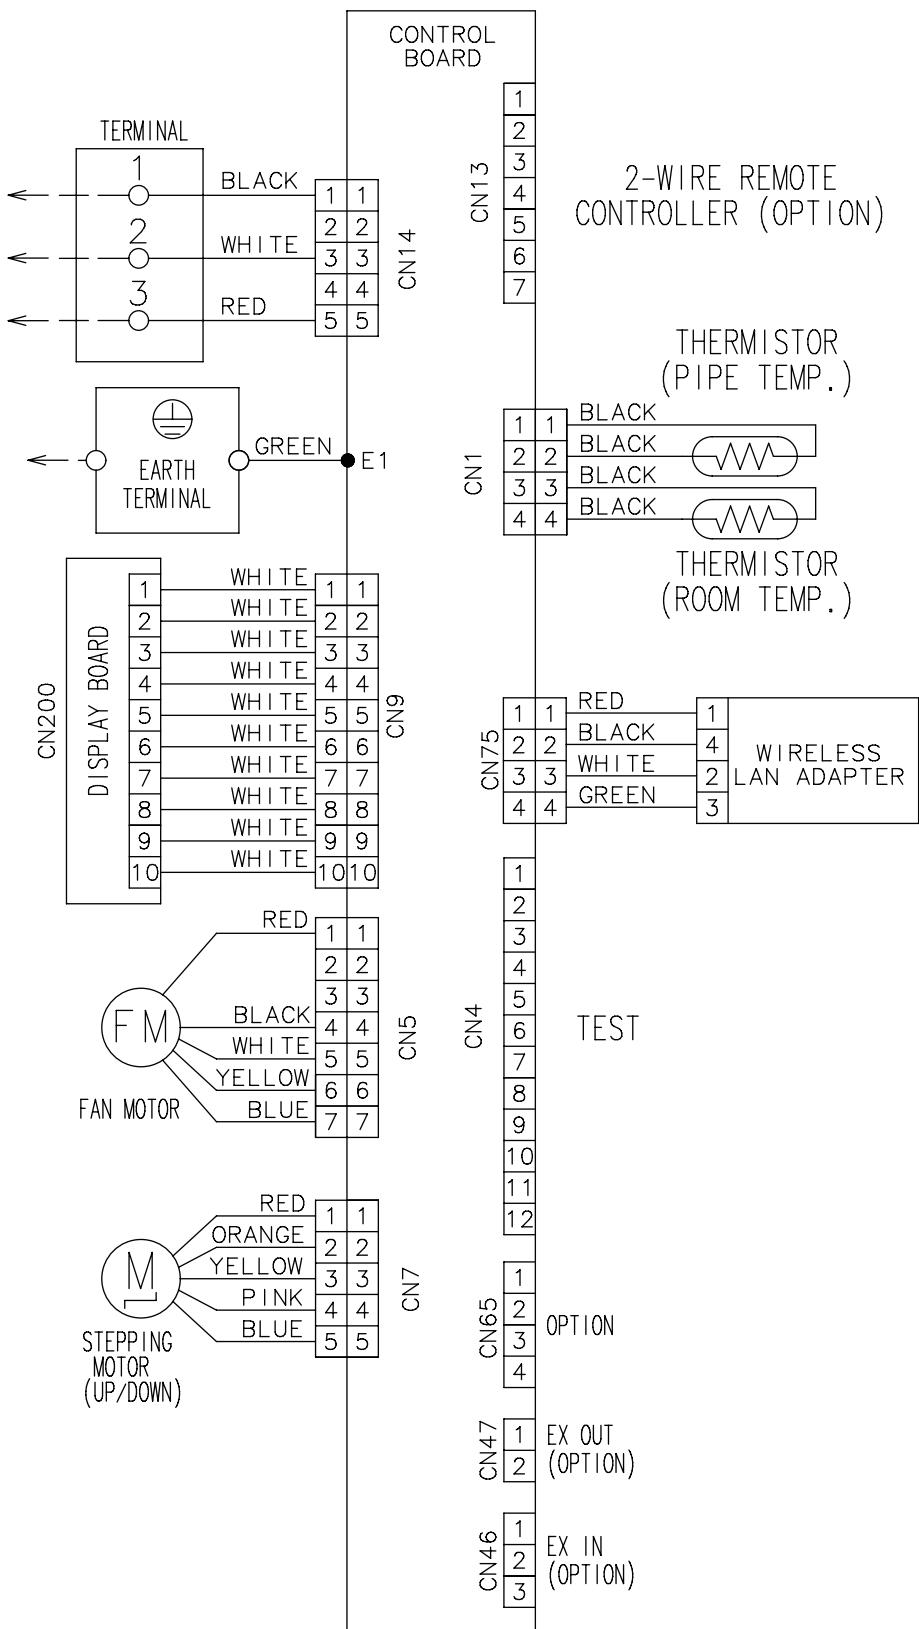


■ Models: ASHG07-14KETA and ASHG07-14KETA-B

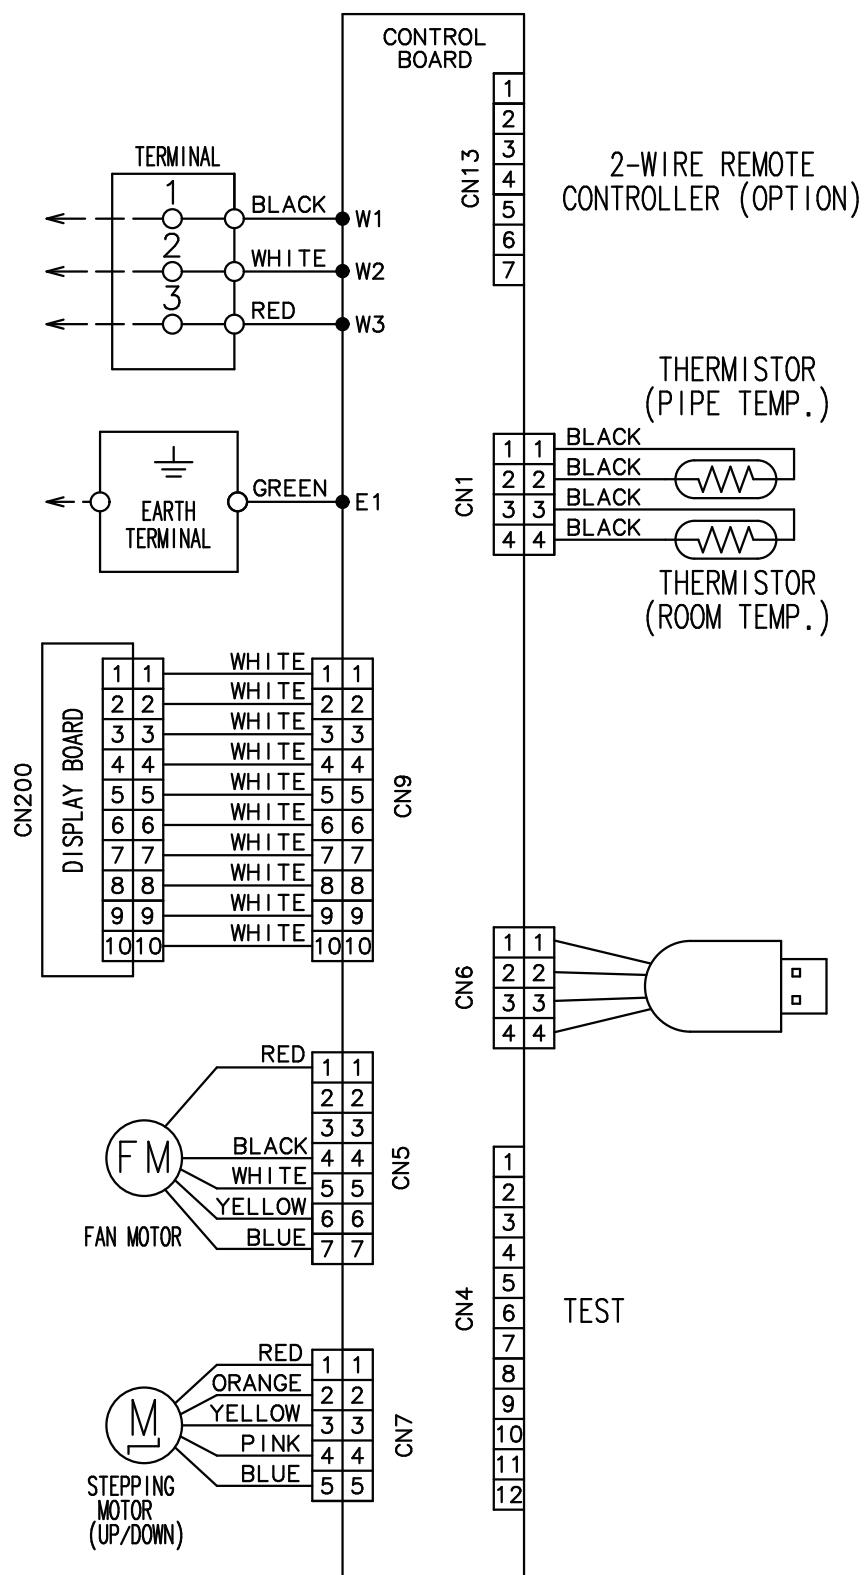


■ Models: ASHG07-14KETE and ASHG07-14KETE-B

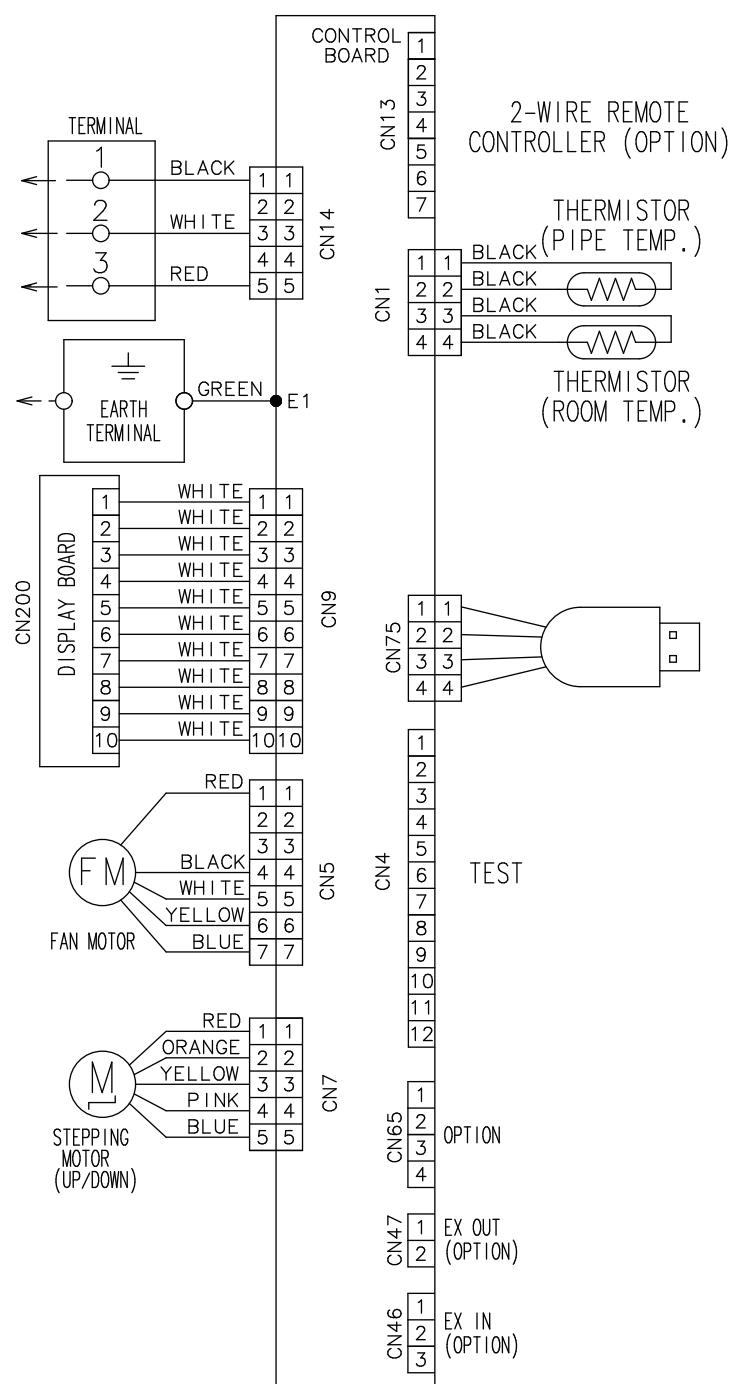


■ Models: ASHG07-14KETF and ASHG07-14KETF-B

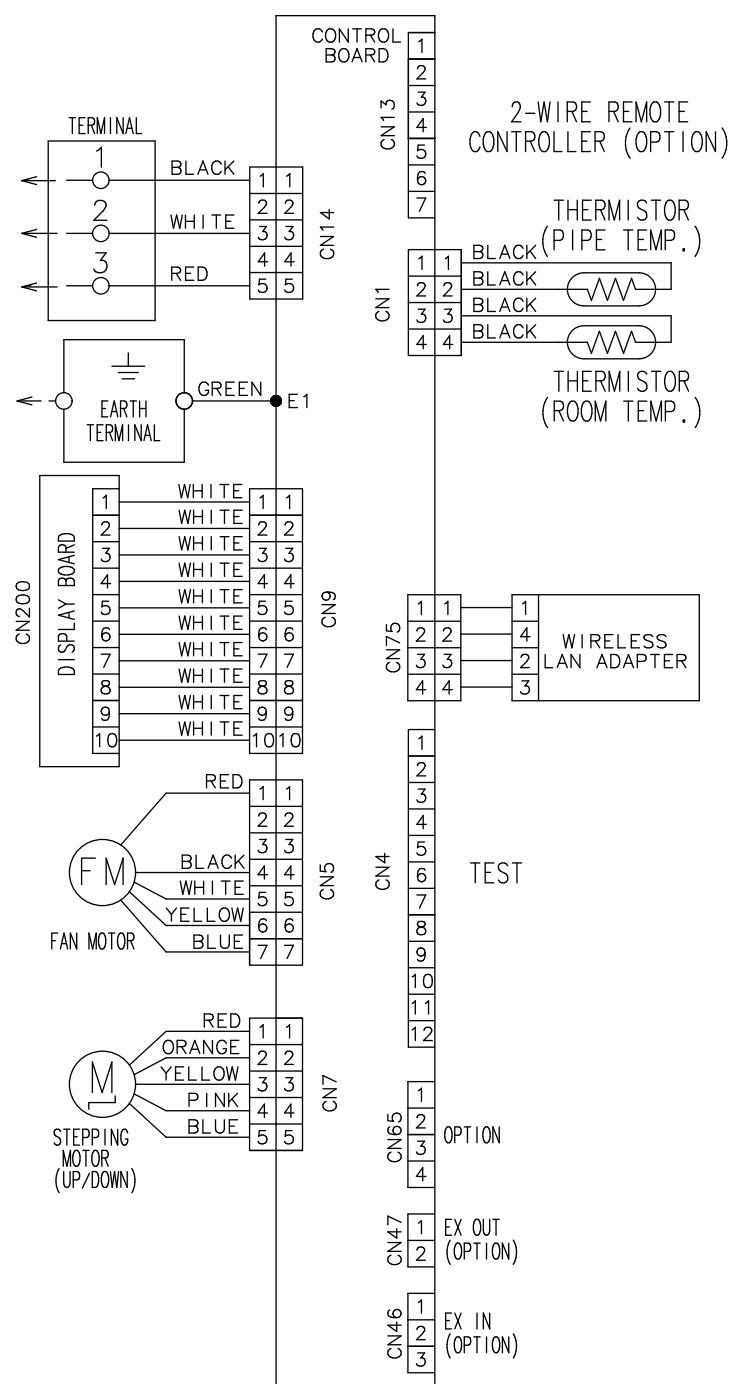


■ Models: ASHG07-14KGTB

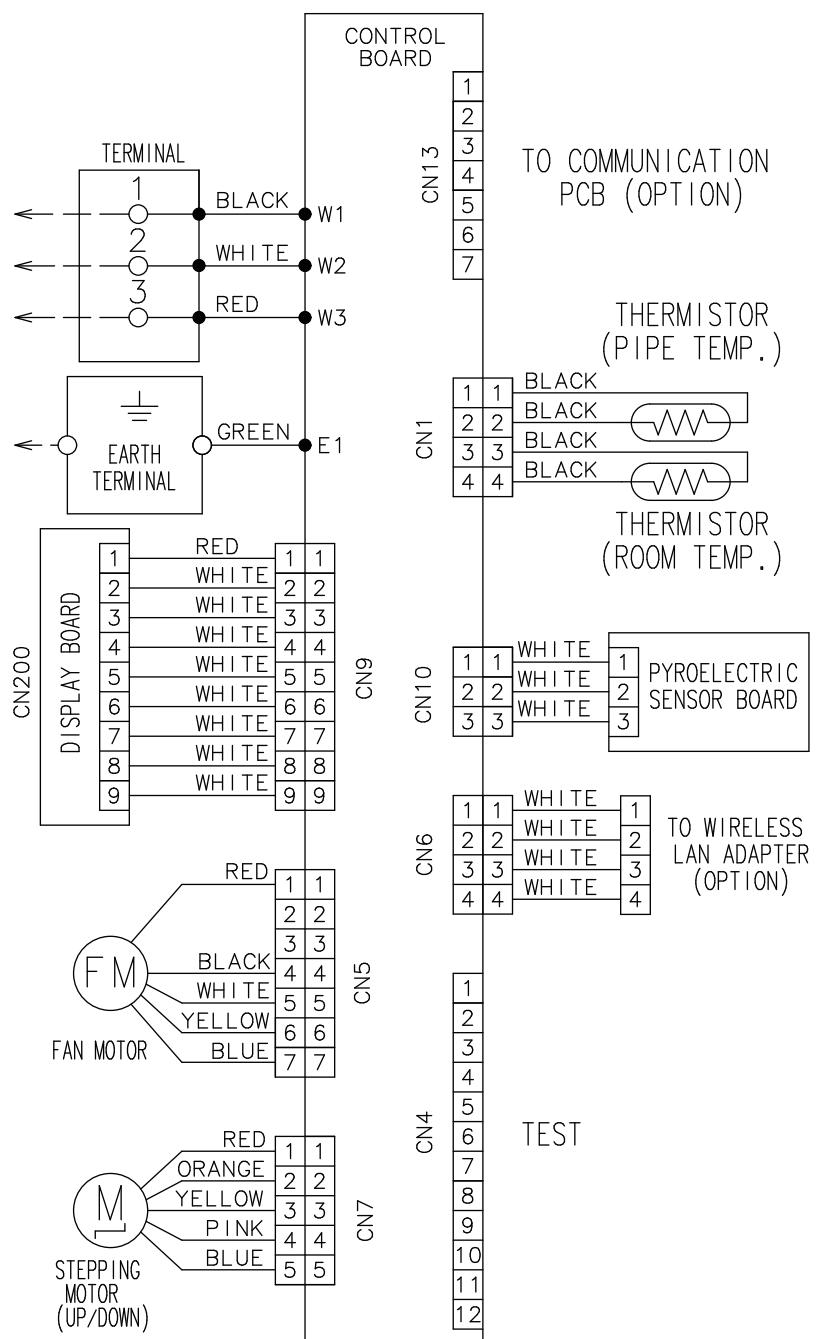


■ Models: ASHG07-14KGTE and ASHH07-14KGTH

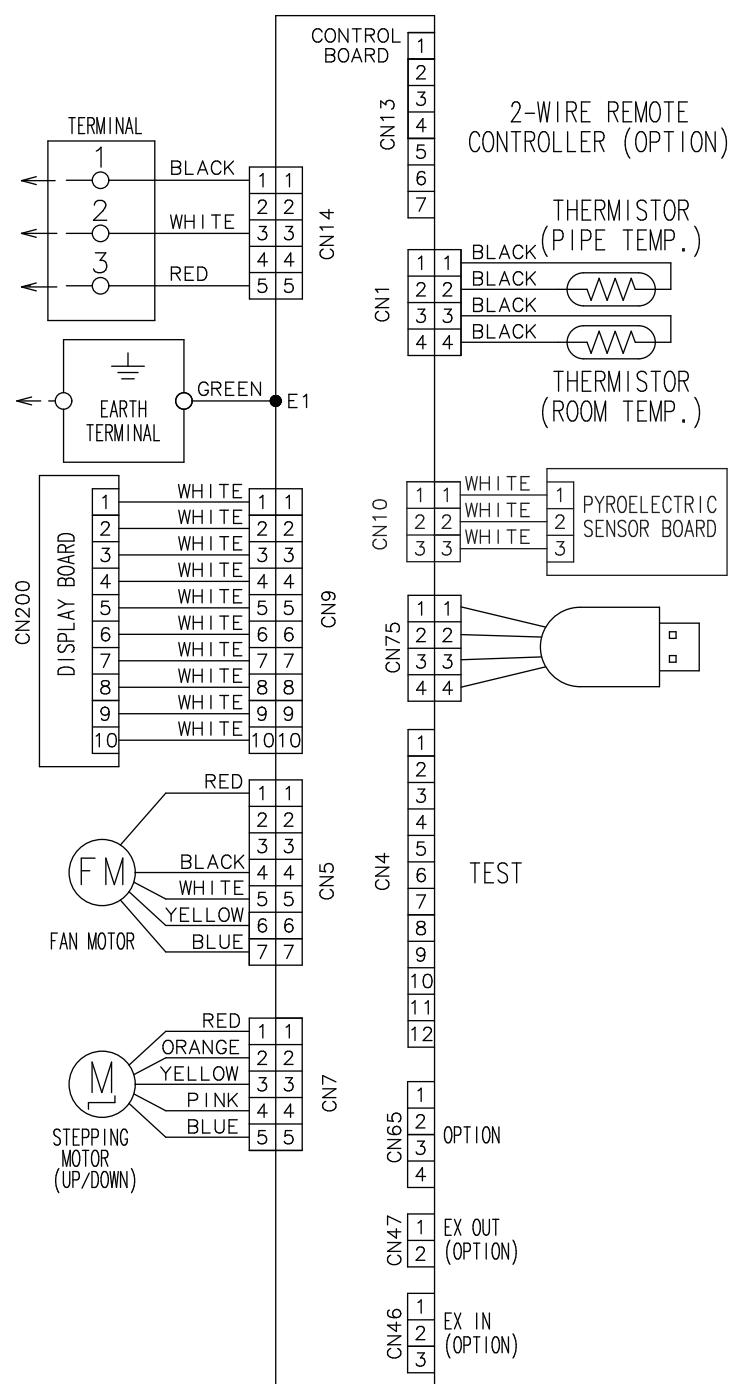


■ Models: ASHG07-14KGTF and ASHH07-14KGTF

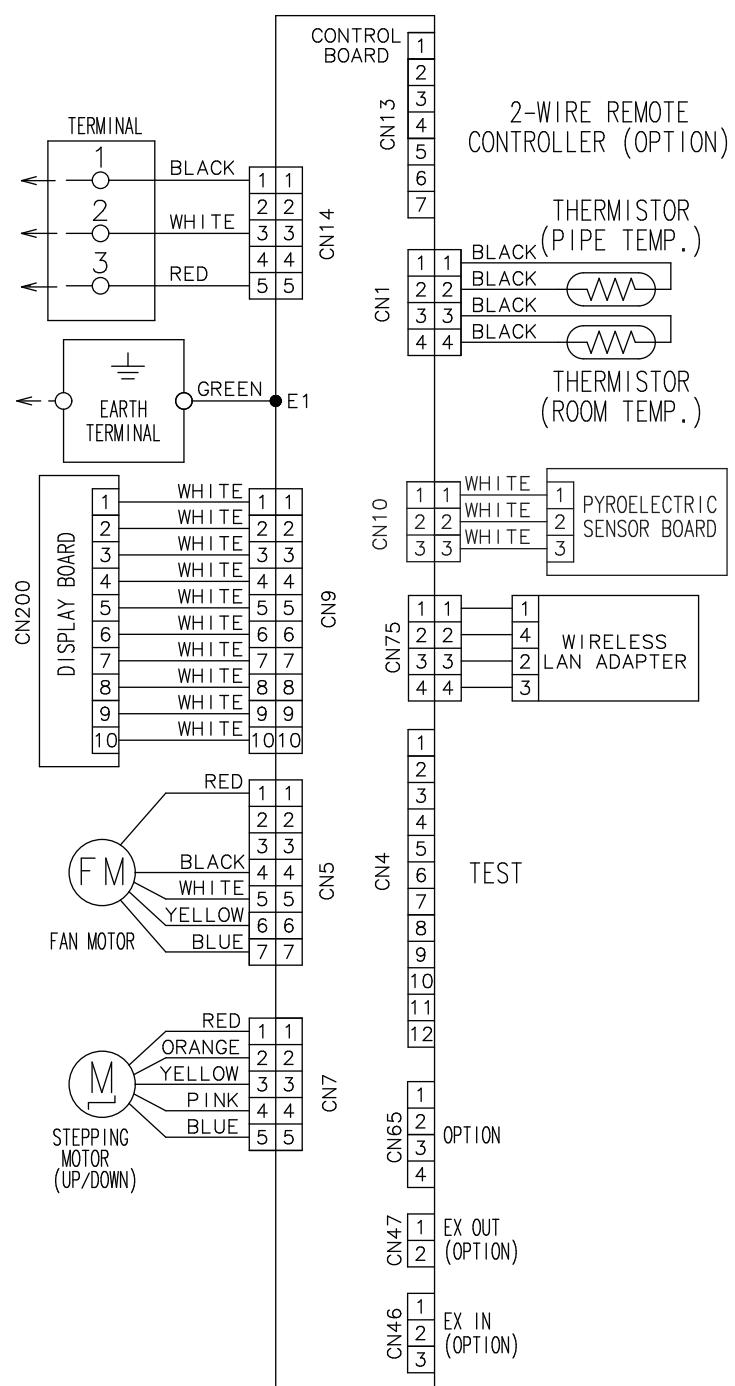

■ Models: ASHH05-12KNCA

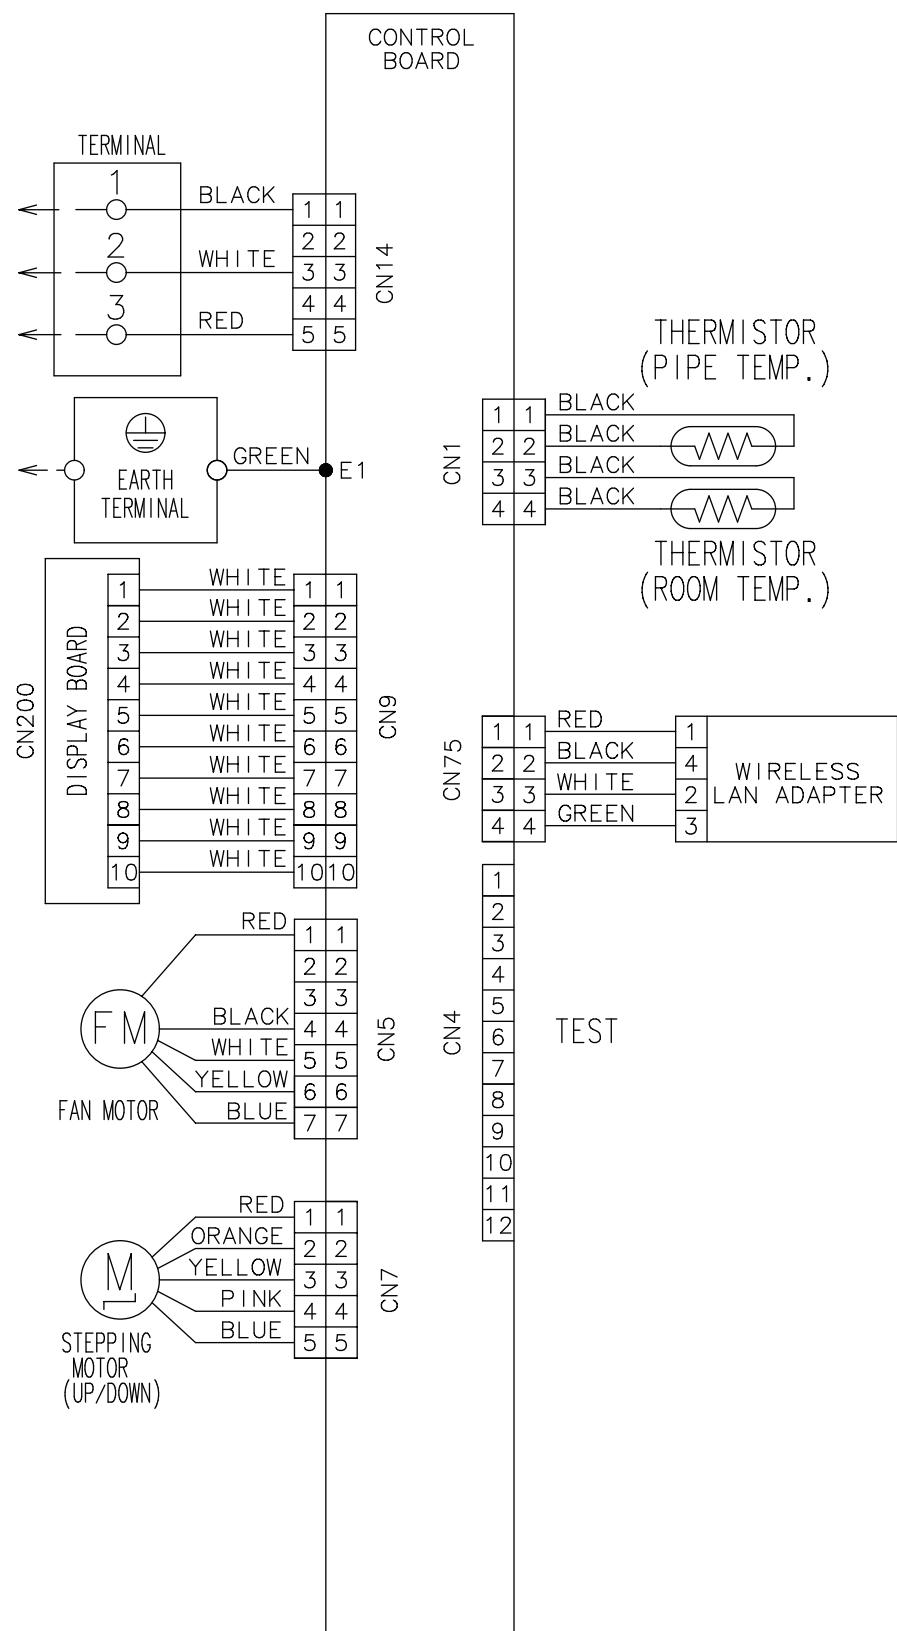


■ Models: ASHH05-12KNCH

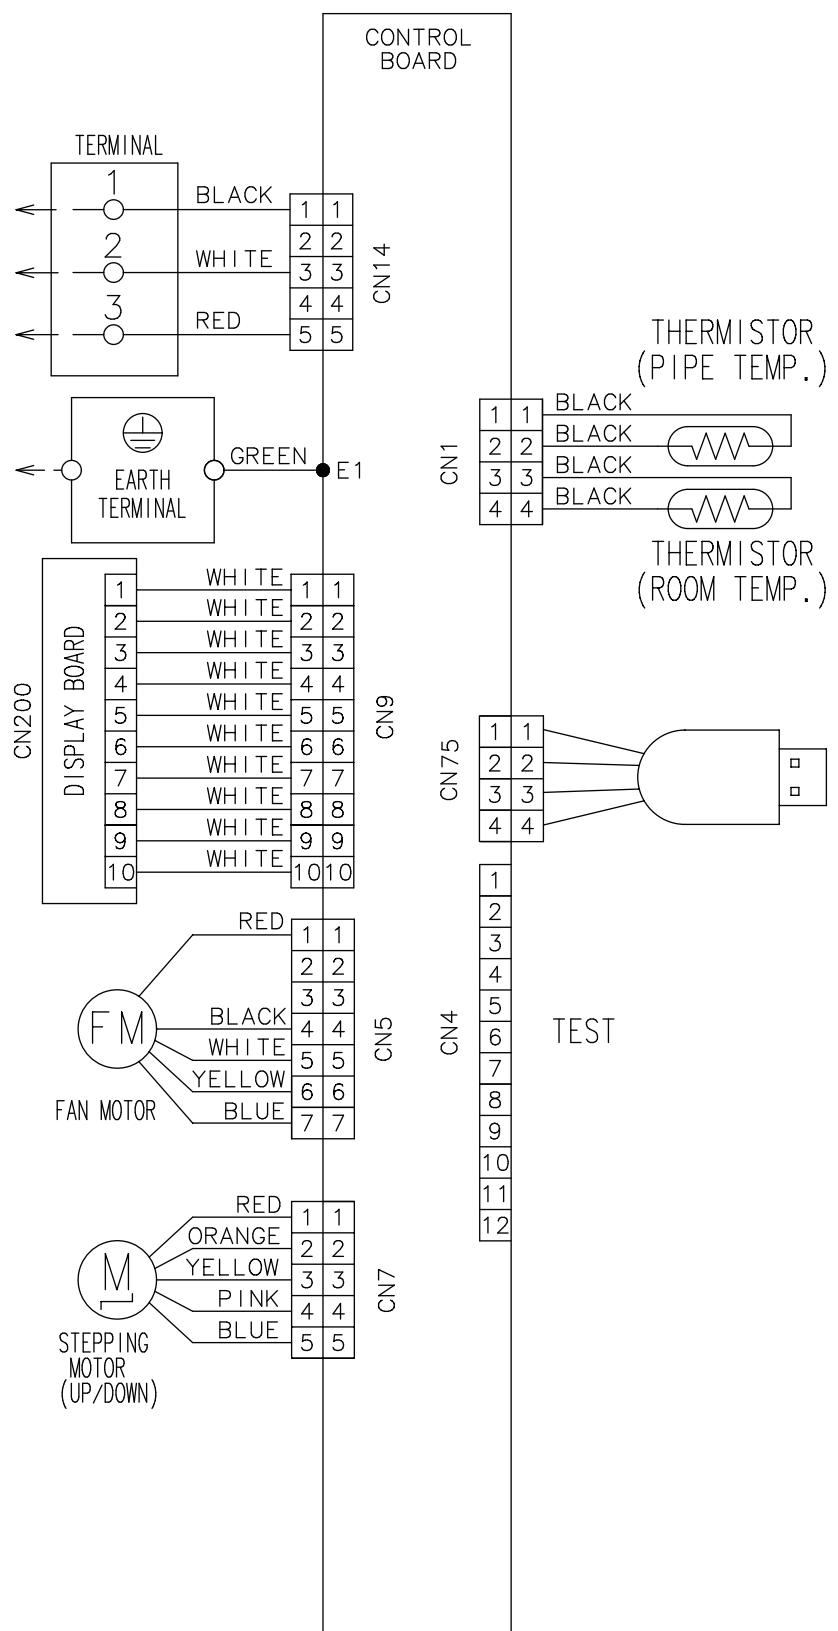

5-5. Floor type

■ Models: AGHG09–14KVCA

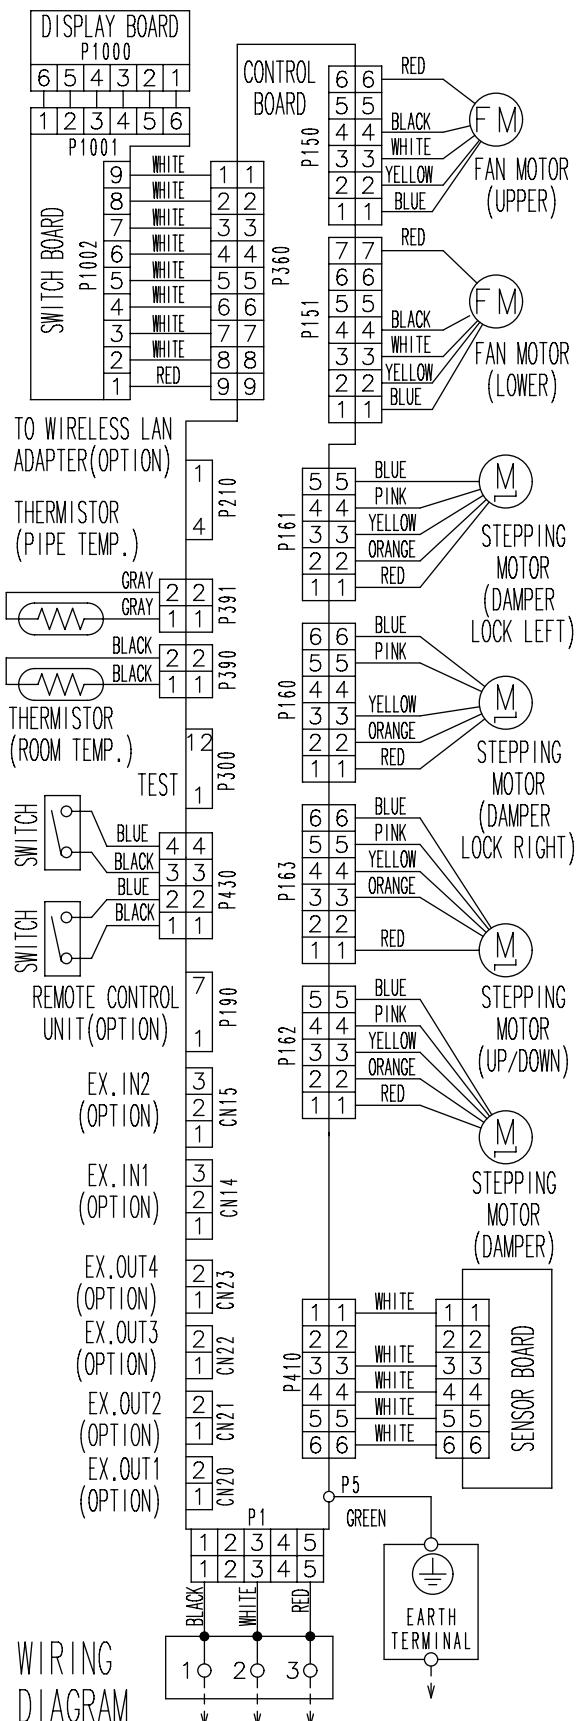



6. Air velocity and temperature distributions

6-1. Compact cassette type

■ Models: AUXG07-09KVLA

- Air velocity distribution


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

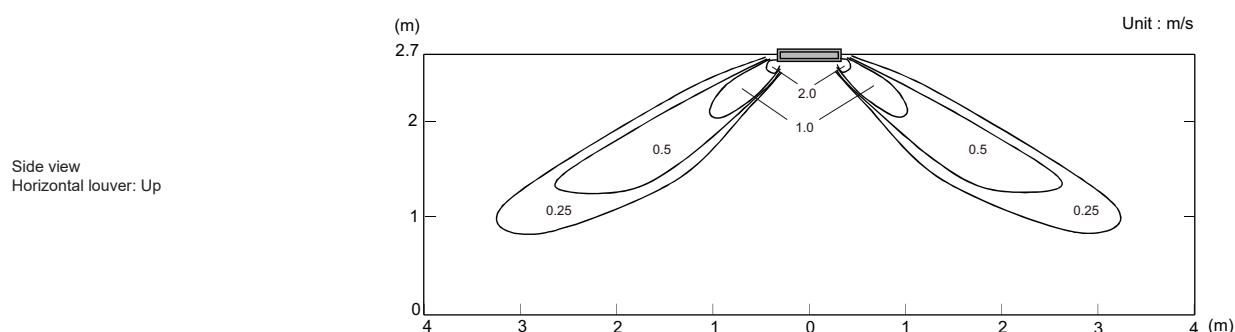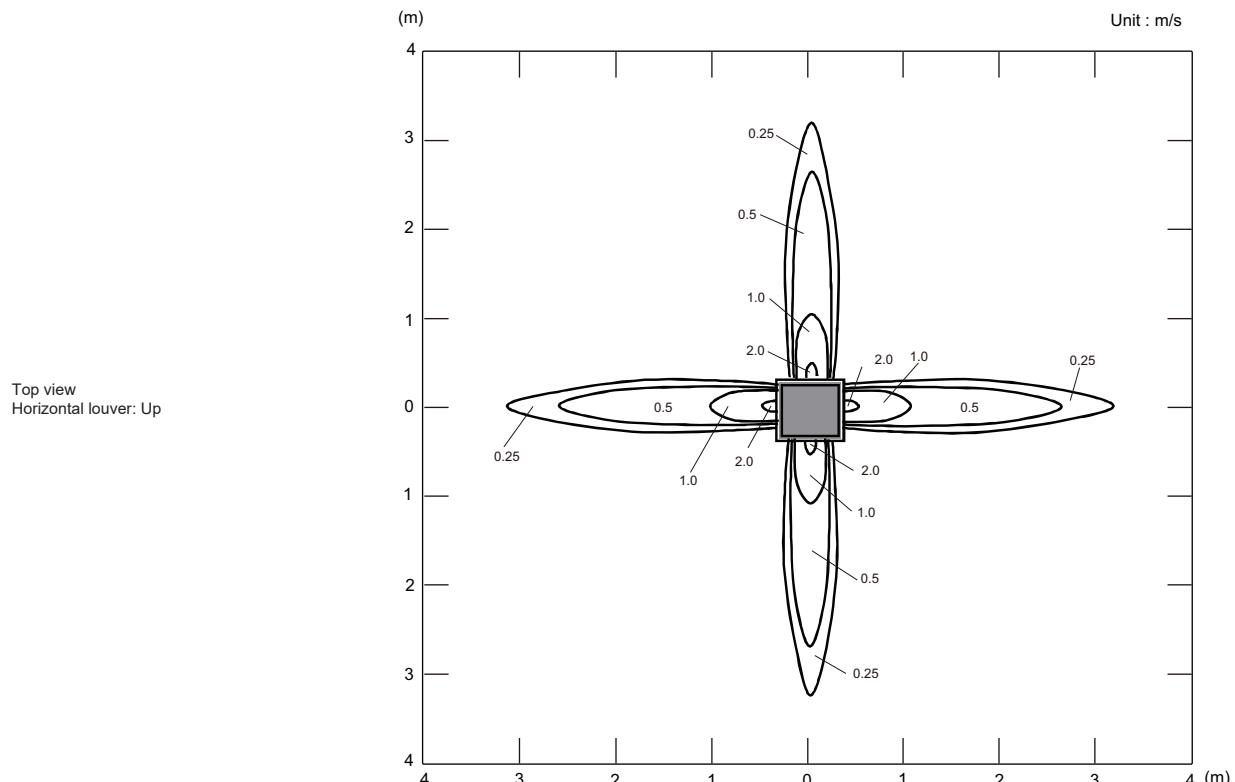

- Air velocity distribution

Measuring conditions NOTE: Reference data	Fan speed HIGH	Operation mode HEAT	Outlet directions 4-way air outlet
---	-------------------	------------------------	---------------------------------------


Side view
Horizontal louver: Down

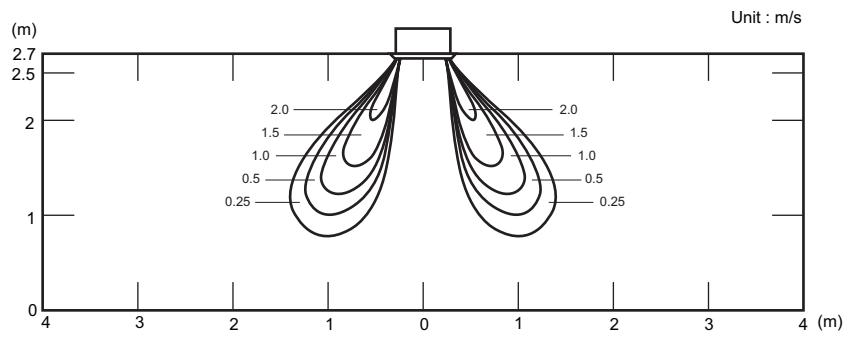

- Air temperature distribution

Measuring conditions NOTE: Reference data	Fan speed HIGH	Operation mode HEAT	Outlet directions 4-way air outlet
---	-------------------	------------------------	---------------------------------------


Side view
Horizontal louver: Down

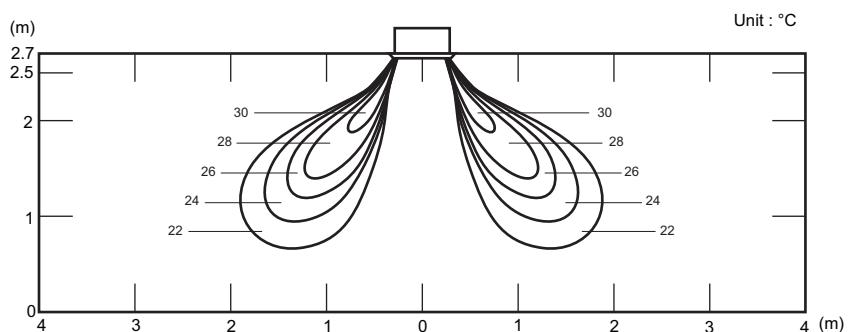

■ Model: AUXG12KVLA

- Air velocity distribution


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

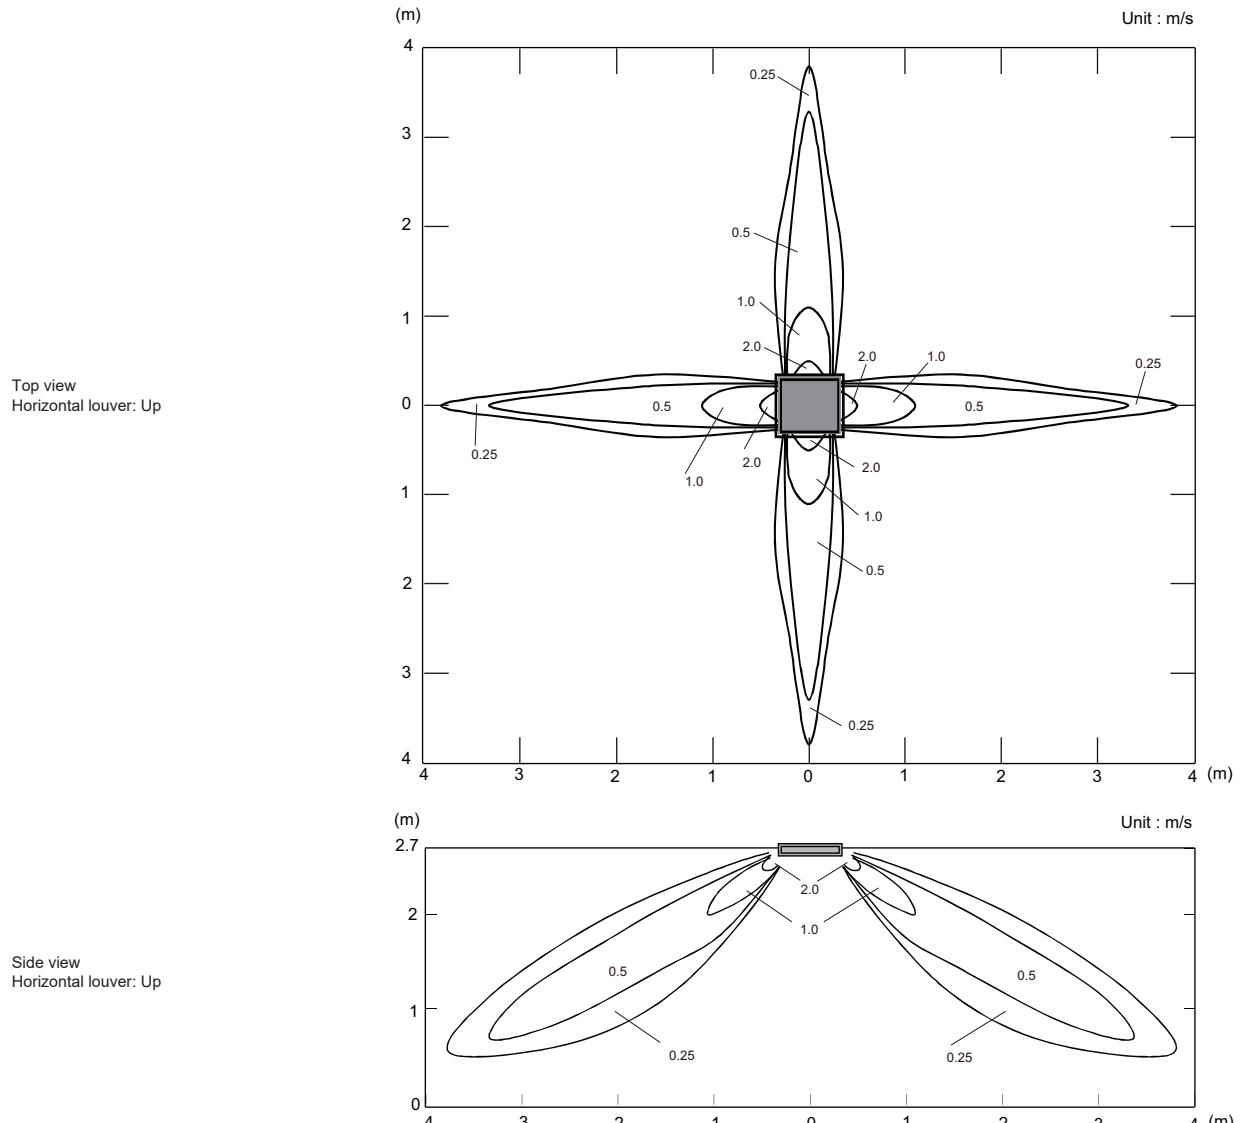

- Air velocity distribution

Measuring conditions NOTE: Reference data	Fan speed HIGH	Operation mode HEAT	Outlet directions 4-way air outlet
---	-------------------	------------------------	---------------------------------------


Side view
Horizontal louver: Down

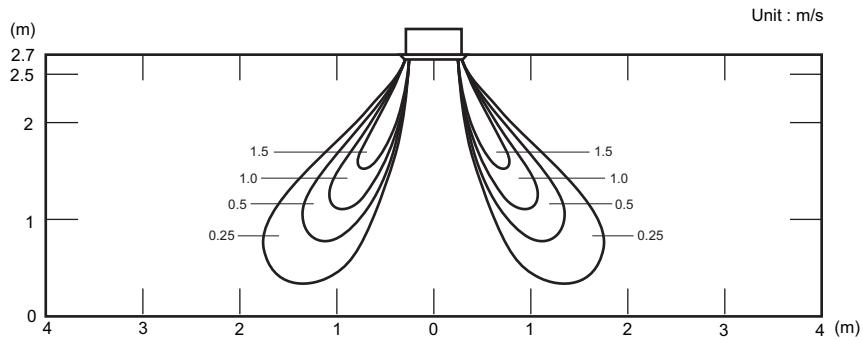

- Air temperature distribution

Measuring conditions NOTE: Reference data	Fan speed HIGH	Operation mode HEAT	Outlet directions 4-way air outlet
---	-------------------	------------------------	---------------------------------------



Side view
Horizontal louver: Down

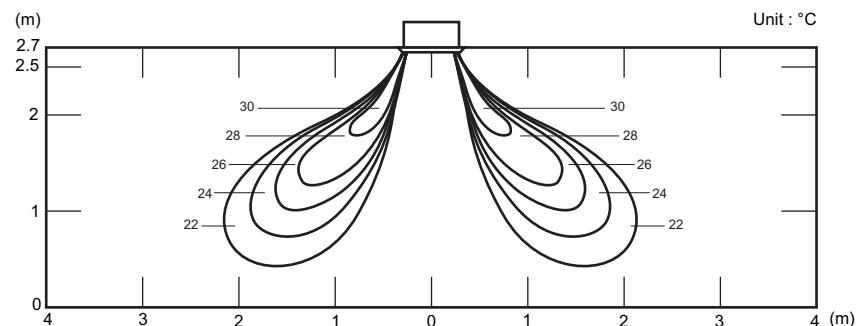

■ Model: AUXG14KVLA

- Air velocity distribution


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

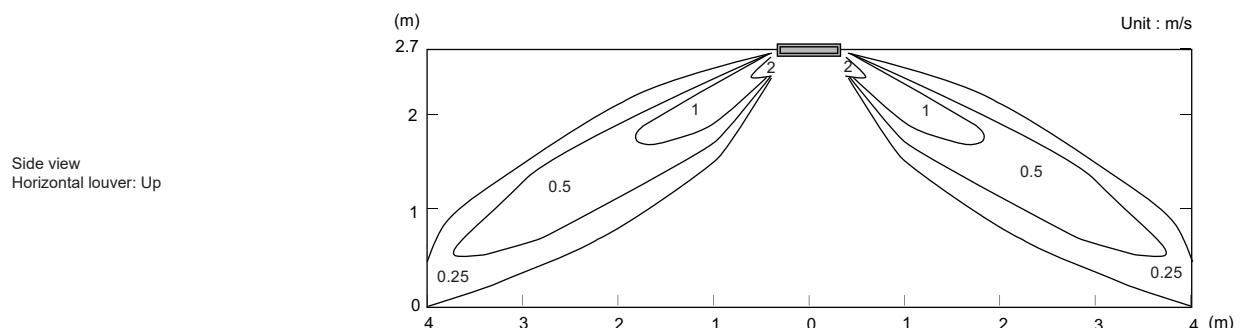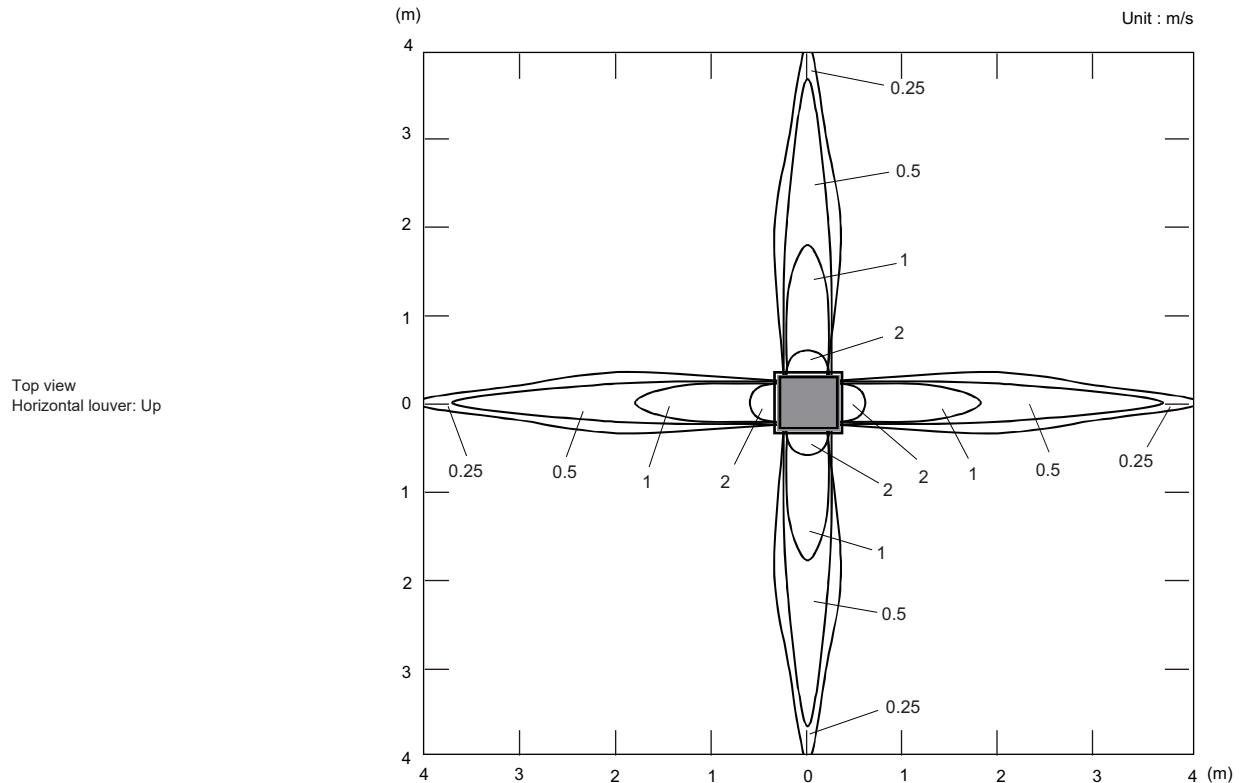

- Air velocity distribution

Measuring conditions NOTE: Reference data	Fan speed HIGH	Operation mode HEAT	Outlet directions 4-way air outlet
---	-------------------	------------------------	---------------------------------------


Side view
Horizontal louver: Down

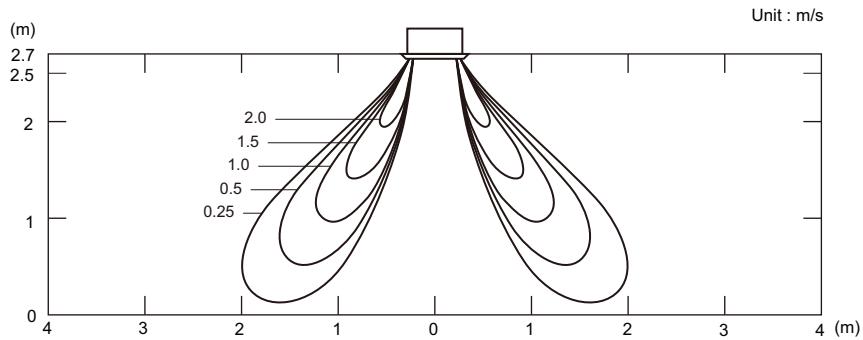

- Air temperature distribution

Measuring conditions NOTE: Reference data	Fan speed HIGH	Operation mode HEAT	Outlet directions 4-way air outlet
---	-------------------	------------------------	---------------------------------------

Side view
Horizontal louver: Down

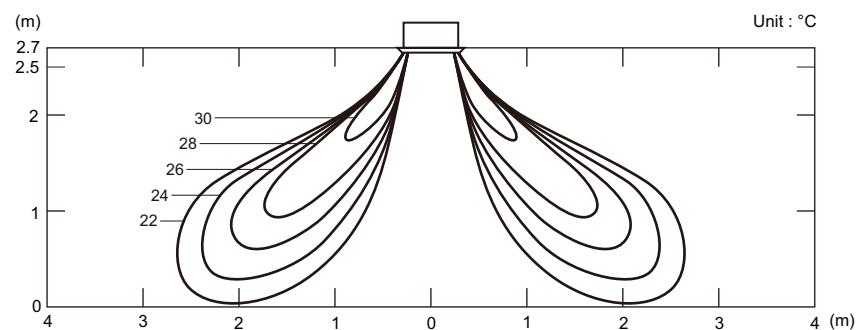

6-2. Mini duct type


■ Model: ARXG07KSLAP

NOTE: This data is measured after installing optional Auto louver grille kit.


- Air velocity distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	FAN


Top view
Horizontal louver: Up
Vertical louver: Center

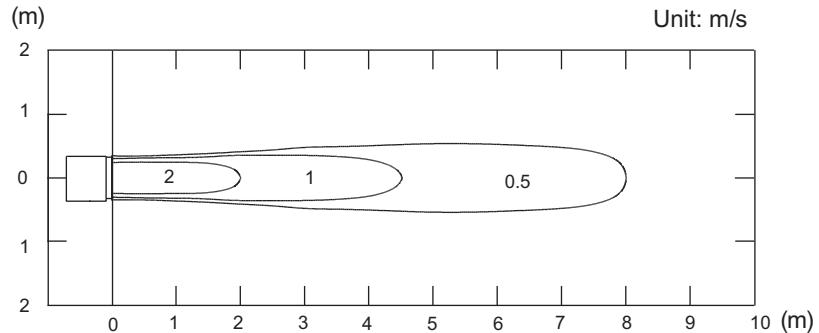

Top view
Horizontal louver: Up
Vertical louver: Left & Right

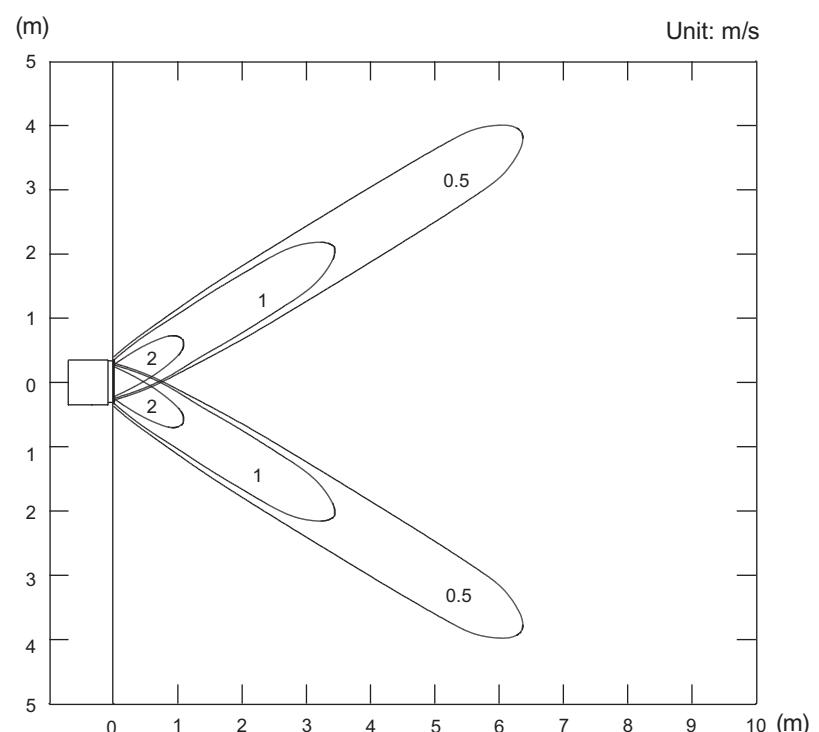


Side view
Horizontal louver: Up
Vertical louver: Center

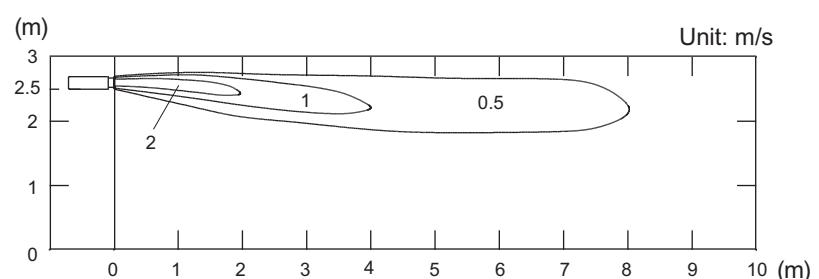

- Air velocity distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT


Side view
Horizontal louver: Down
Vertical louver: Center

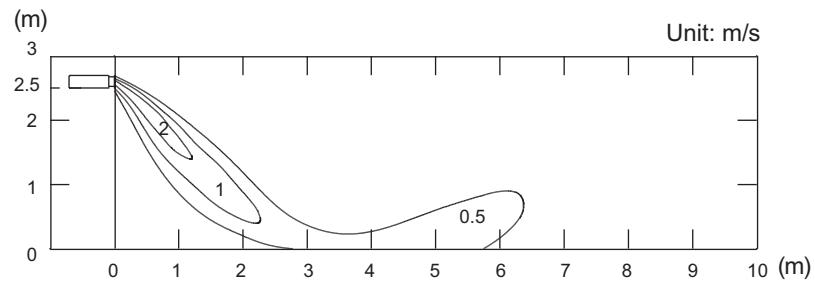

- Air temperature distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT

Side view
Horizontal louver: Down
Vertical louver: Center

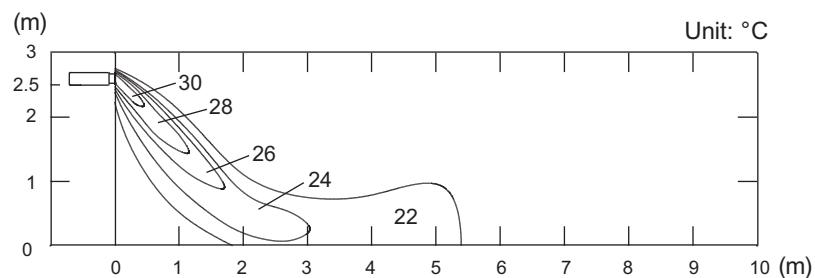


■ Model: ARXG09KSLAP

NOTE: This data is measured after installing optional Auto Louver Grille Kit.

- Air velocity distribution


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

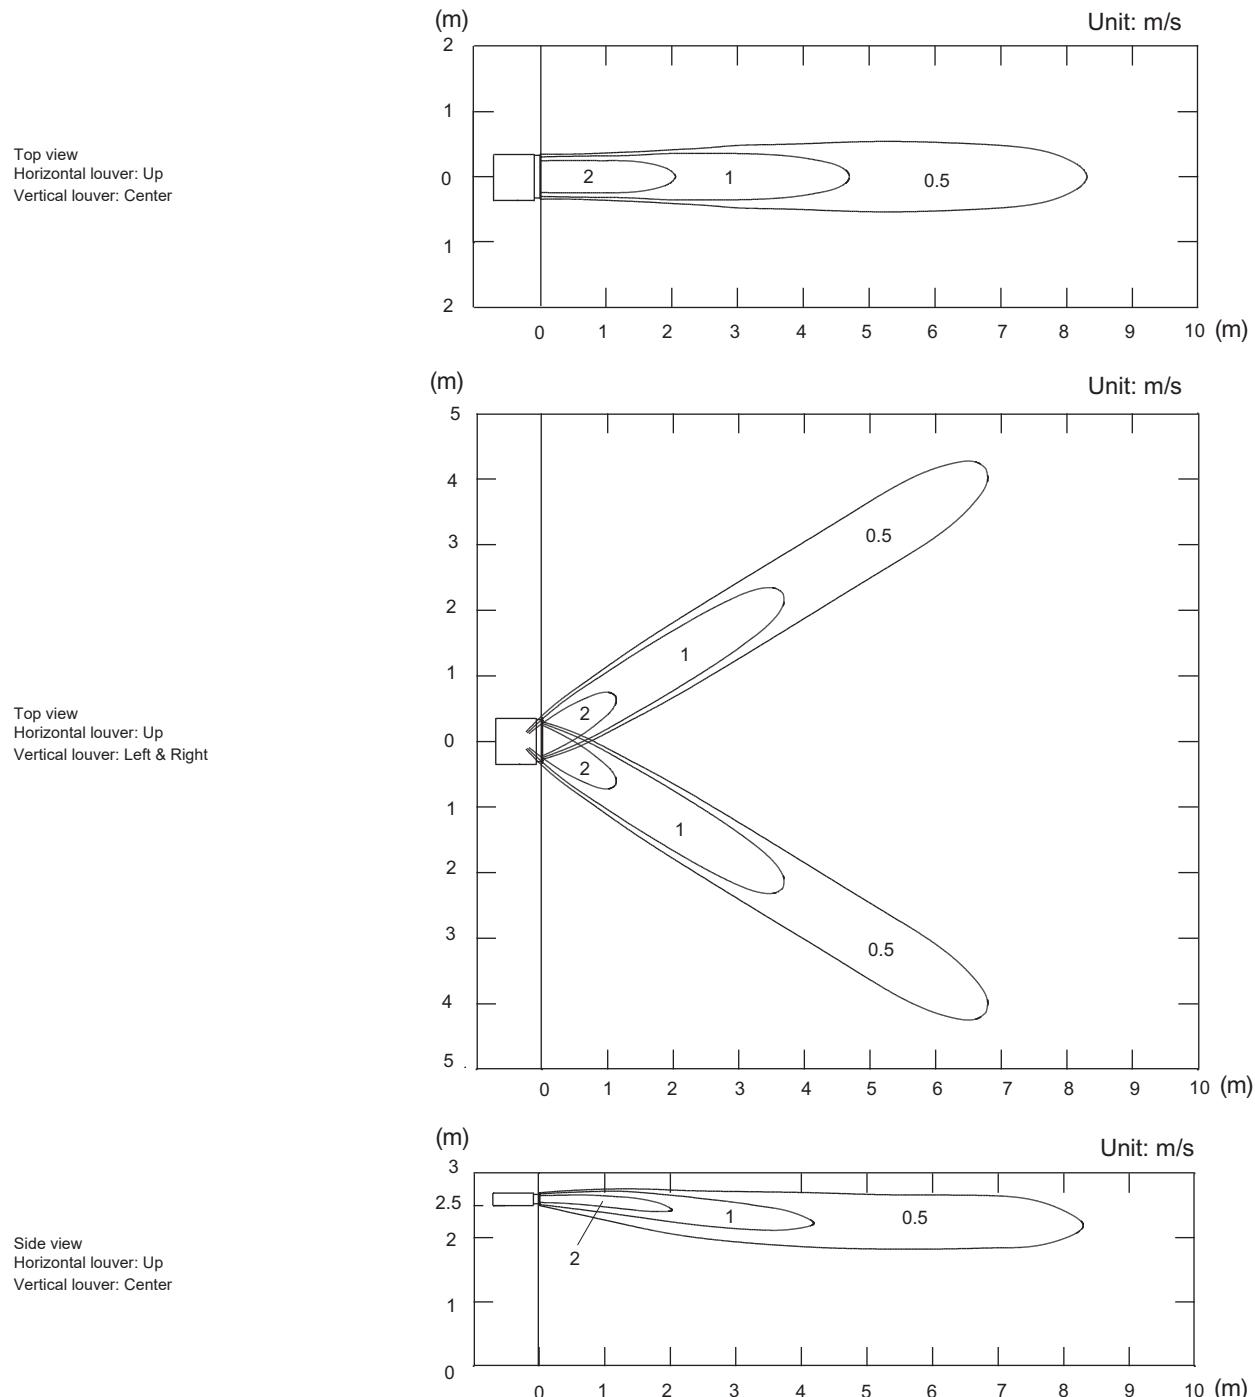

- Air velocity distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT


Side view
Horizontal louver: Down
Vertical louver: Center

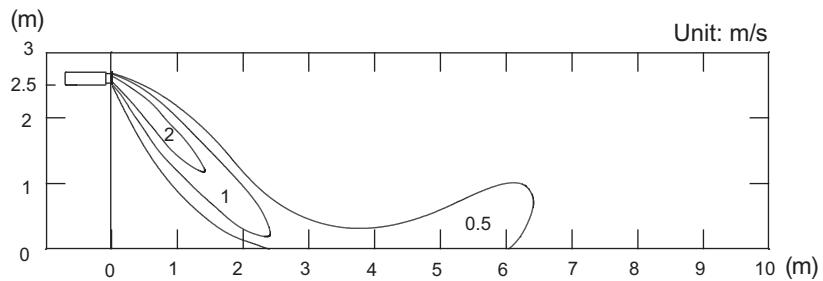

- Air temperature distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT

Side view
Horizontal louver: Down
Vertical louver: Center



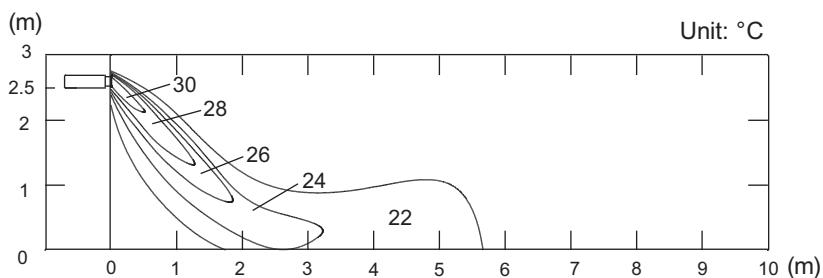


■ Model: ARXG12KSLAP

NOTE: This data is measured after installing optional Auto Louver Grille Kit.

- Air velocity distribution


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

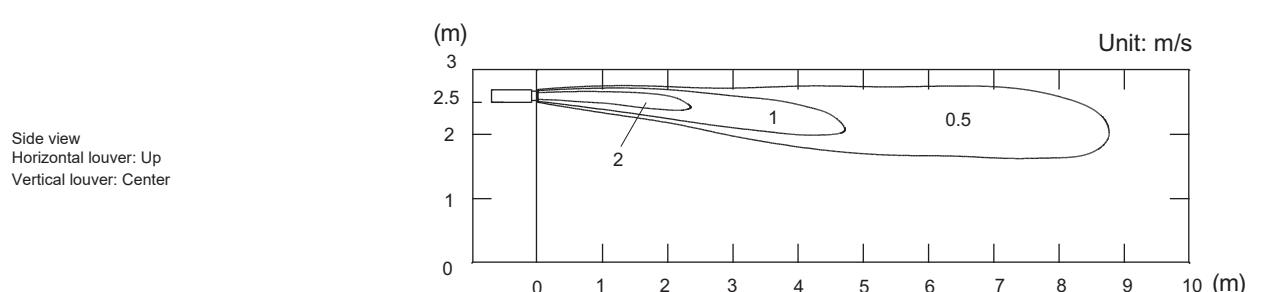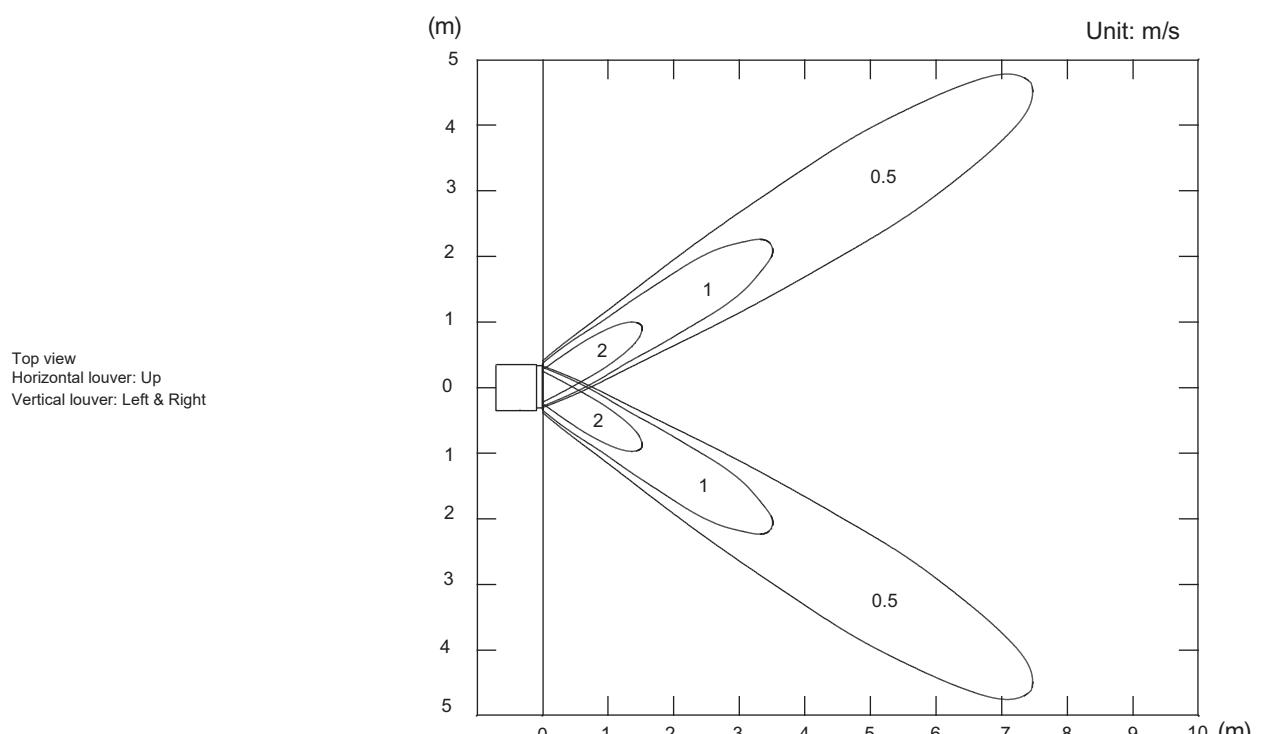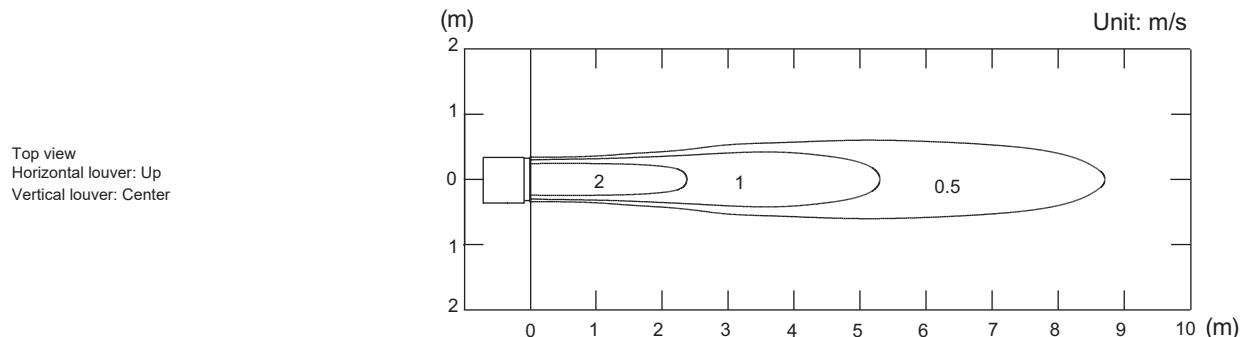

- Air velocity distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT


Side view
Horizontal louver: Down
Vertical louver: Center

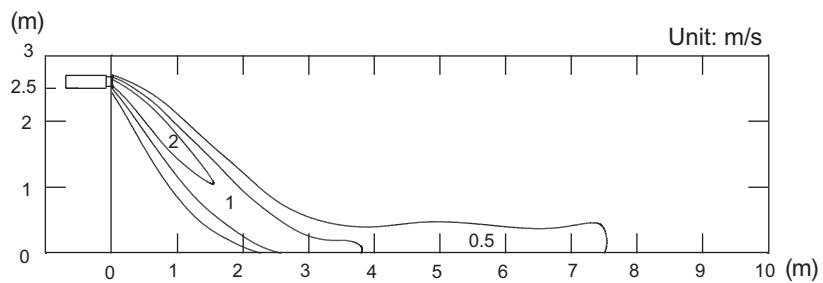

- Air temperature distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT

Side view
Horizontal louver: Down
Vertical louver: Center



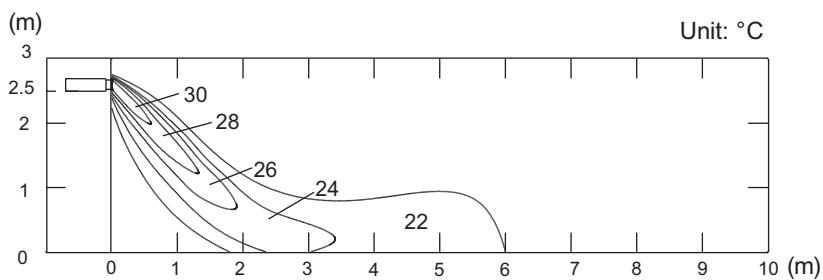


■ Model: ARXG14KSLAP

NOTE: This data is measured after installing optional Auto louver grille kit.

- Air velocity distribution


Measuring conditions	Fan speed	Operation mode
	HIGH	

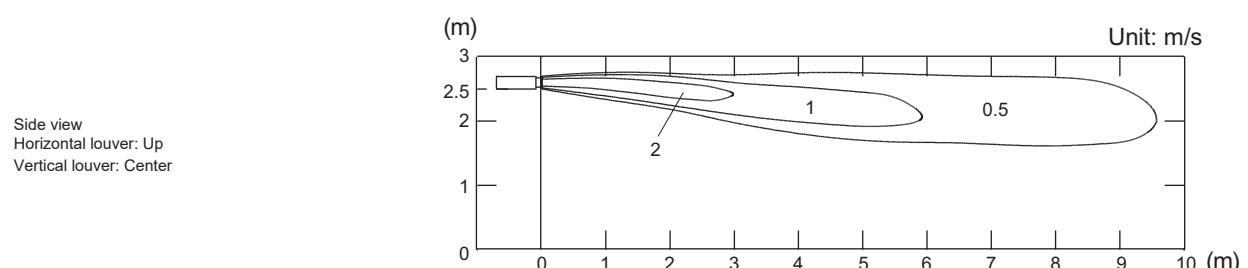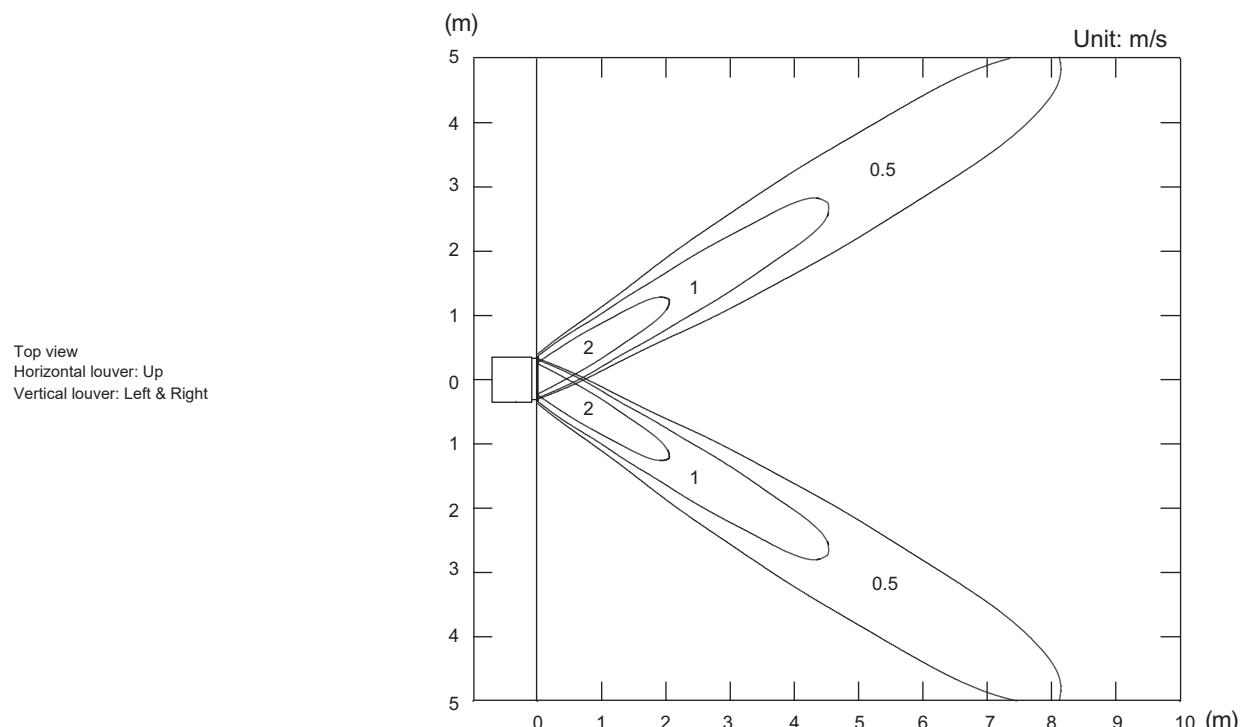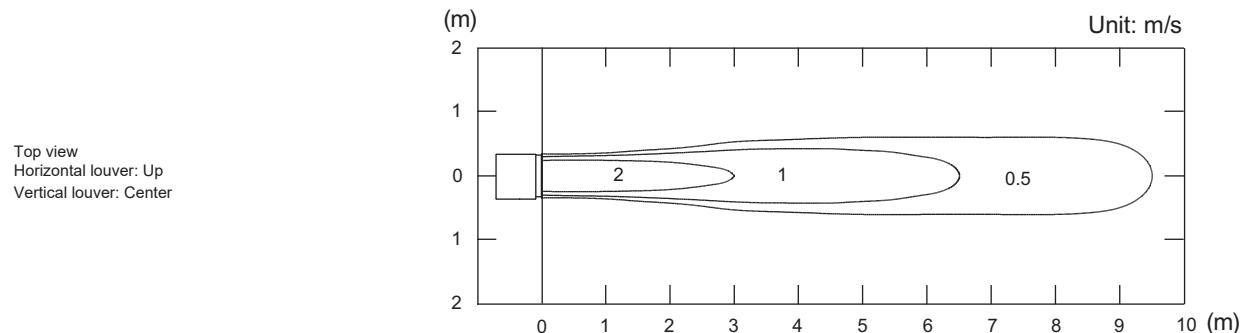

- Air velocity distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT


Side view
Horizontal louver: Down
Vertical louver: Center

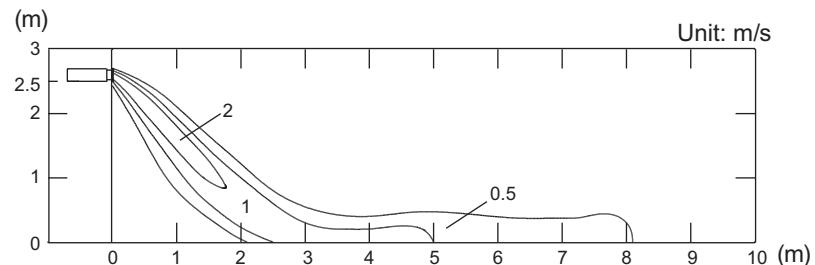

- Air temperature distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT

Side view
Horizontal louver: Down
Vertical louver: Center

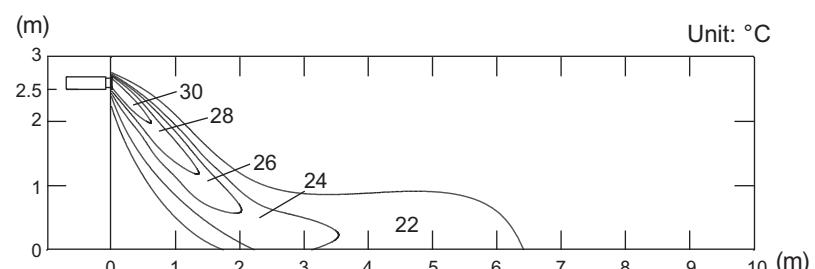

6-3. Slim duct type


■ Model: ARXG07KLLAP

NOTE: This data is measured after installing optional Auto louver grille kit.


- Air velocity distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	FAN


Top view
Horizontal louver: Up
Vertical louver: Center

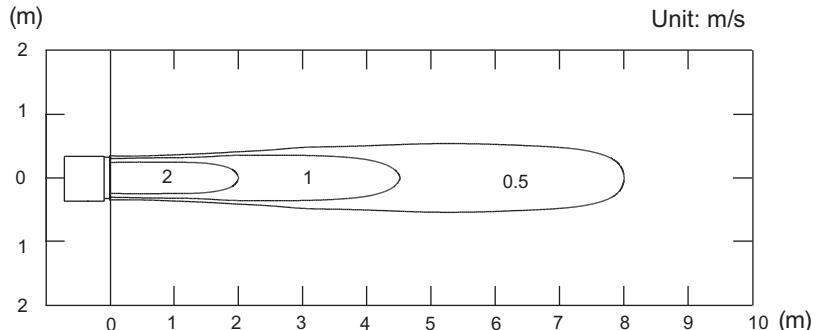

Top view
Horizontal louver: Up
Vertical louver: Left & Right

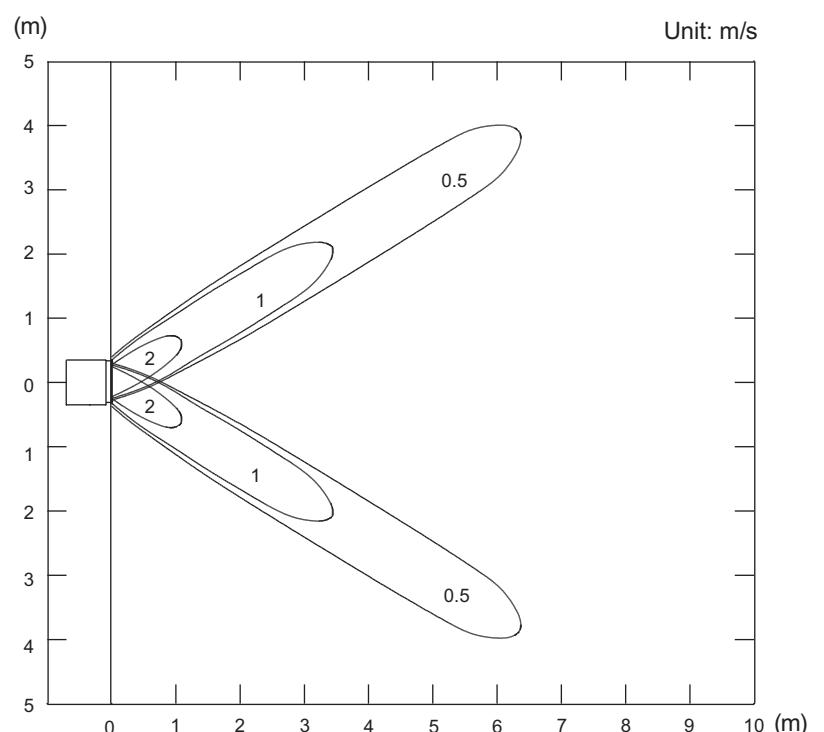


Side view
Horizontal louver: Up
Vertical louver: Center

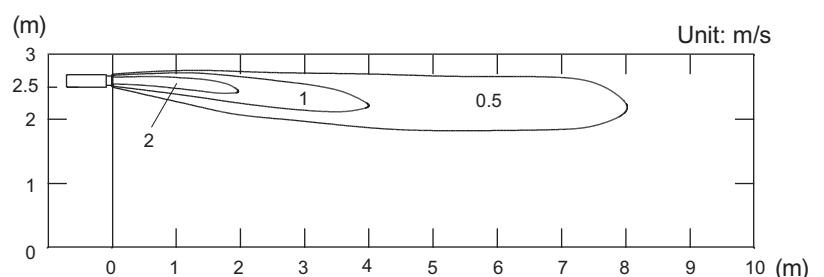

- Air velocity distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT


Side view
Horizontal louver: Down
Vertical louver: Center

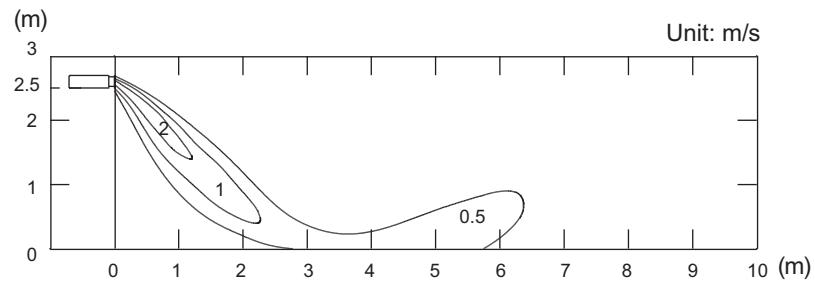

- Air temperature distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT

Side view
Horizontal louver: Down
Vertical louver: Center



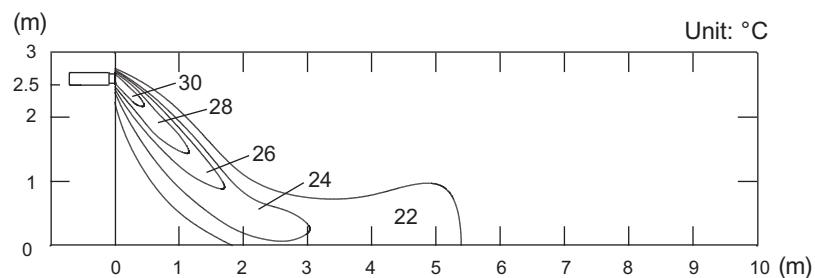


■ Model: ARXG09KLLAP

NOTE: This data is measured after installing optional Auto louver grille kit.

- Air velocity distribution


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

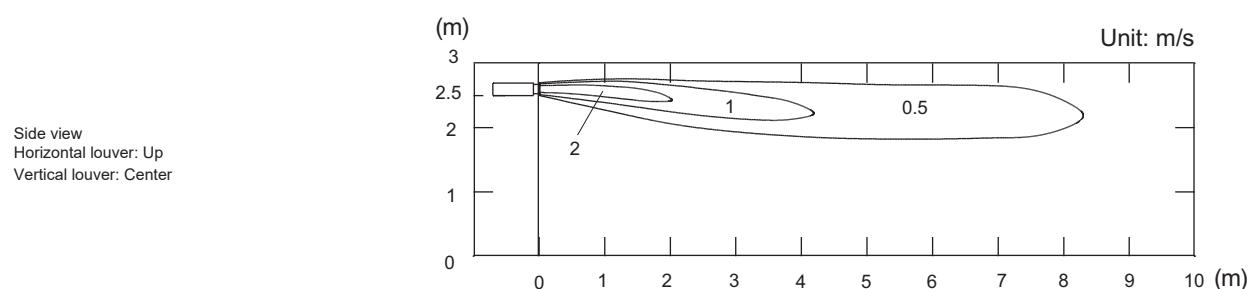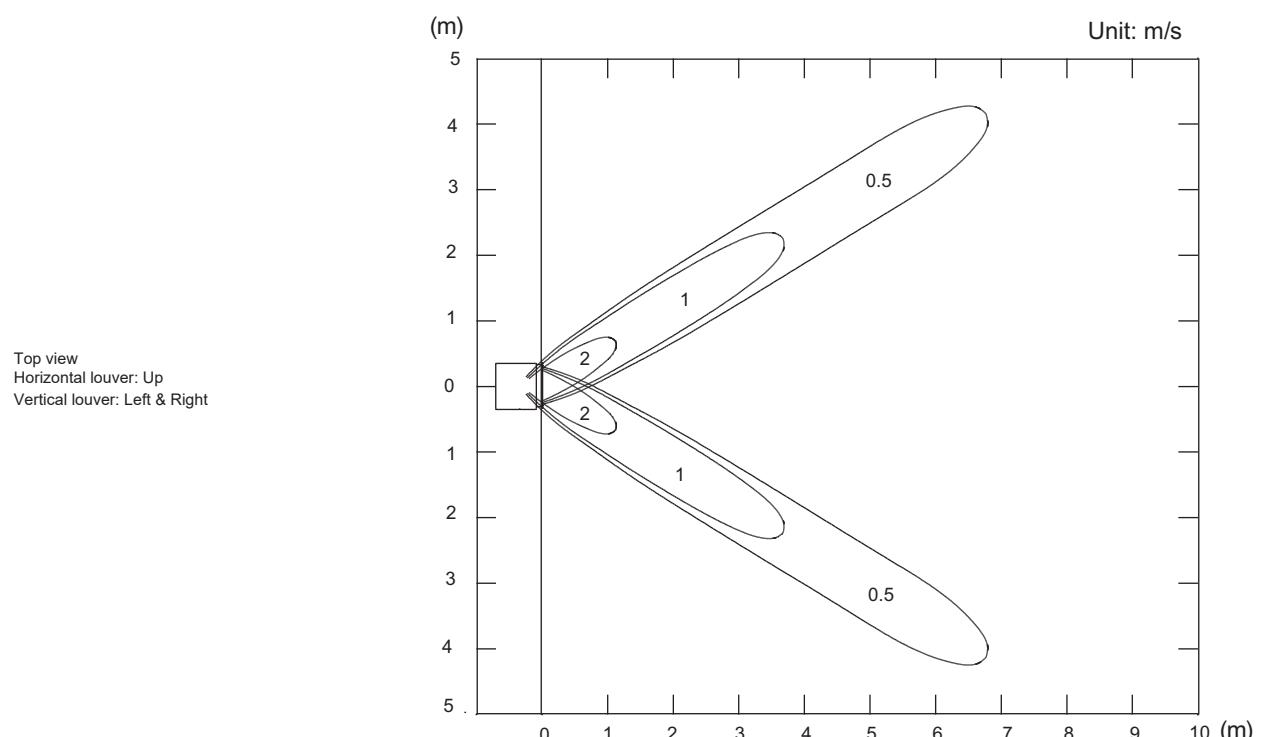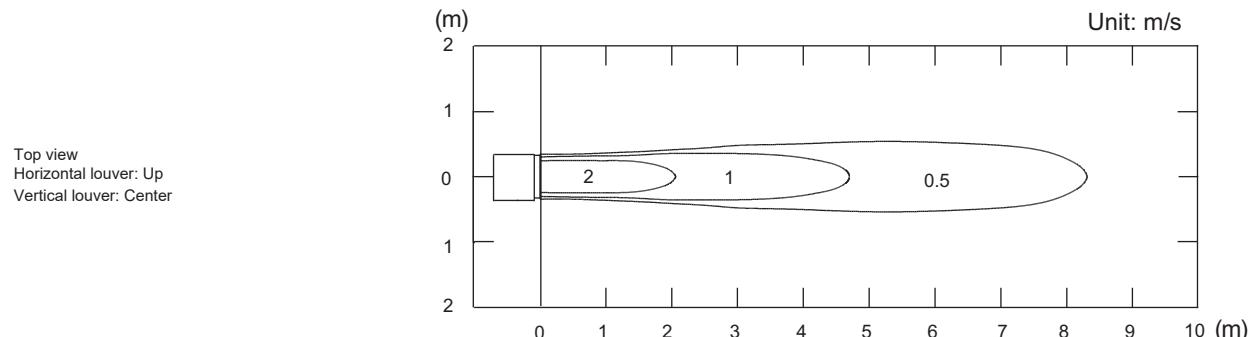

- Air velocity distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT


Side view
Horizontal louver: Down
Vertical louver: Center

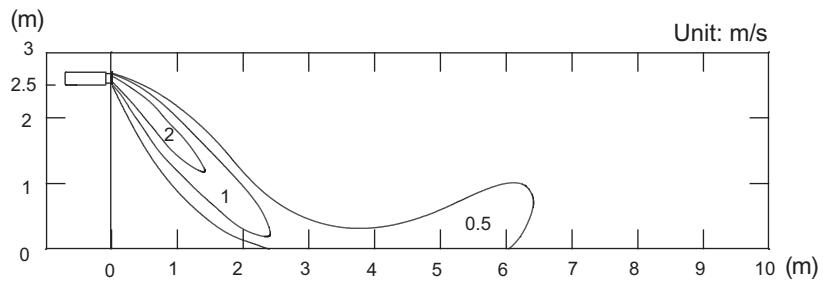

- Air temperature distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT

Side view
Horizontal louver: Down
Vertical louver: Center



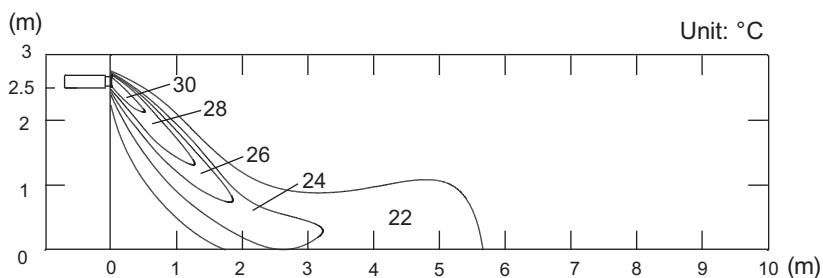


■ Model: ARXG12KLLAP

NOTE: This data is measured after installing optional Auto louver grille kit.

- Air velocity distribution


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

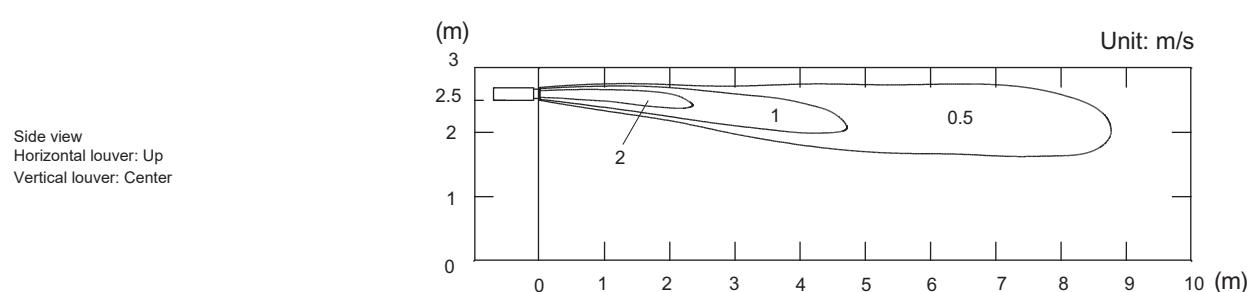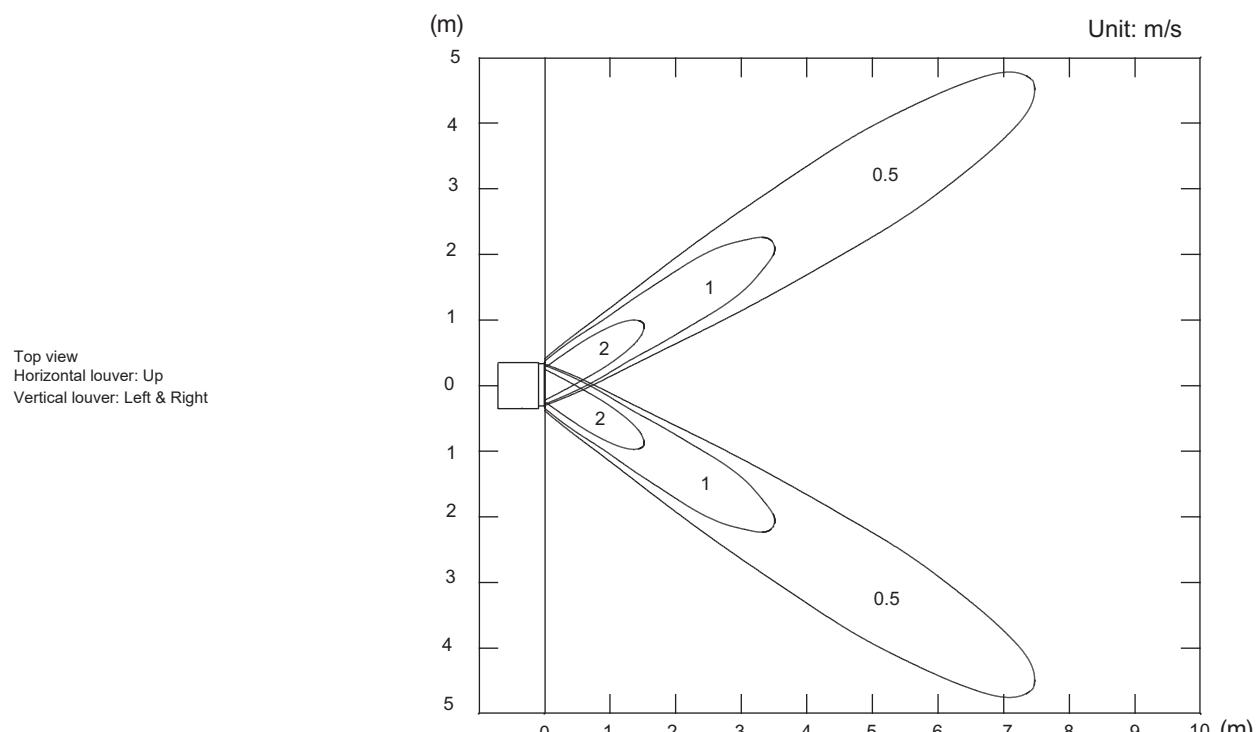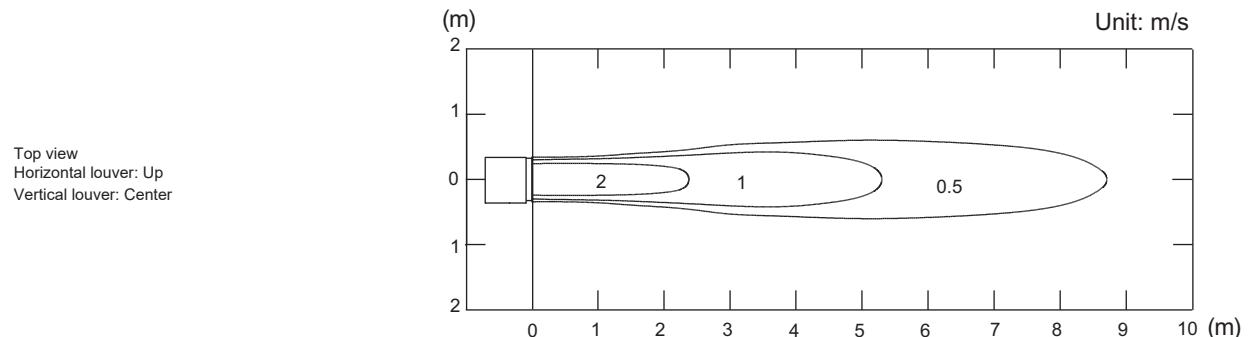

- Air velocity distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT


Side view
Horizontal louver: Down
Vertical louver: Center

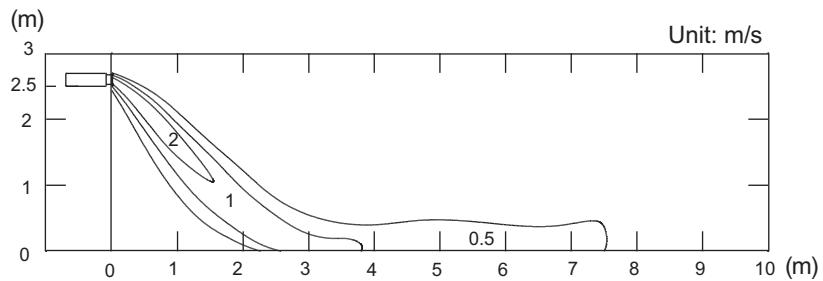

- Air temperature distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT

Side view
Horizontal louver: Down
Vertical louver: Center



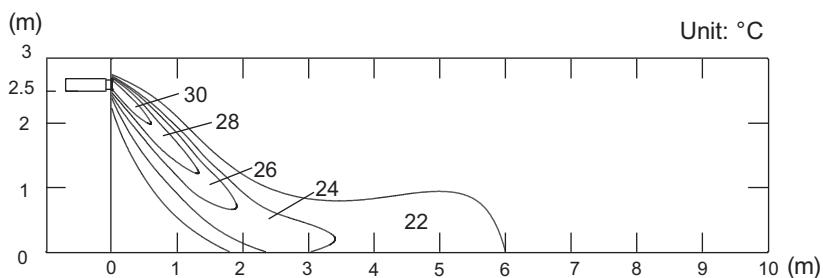


■ Model: ARXG14KLLAP

NOTE: This data is measured after installing optional Auto louver grille kit.

- Air velocity distribution


Measuring conditions	Fan speed	Operation mode
	HIGH	

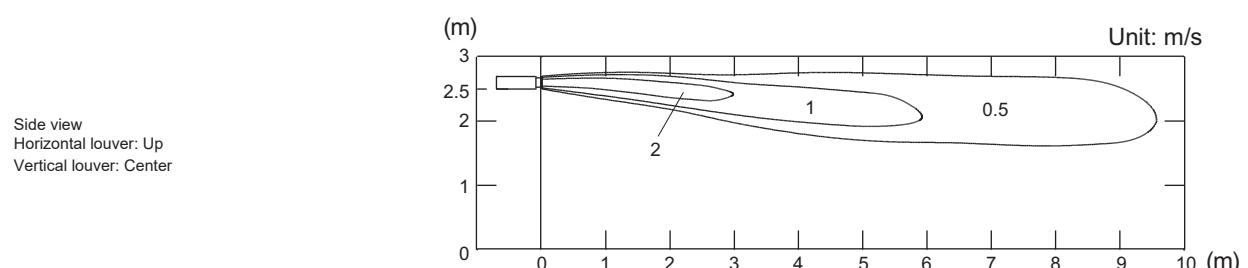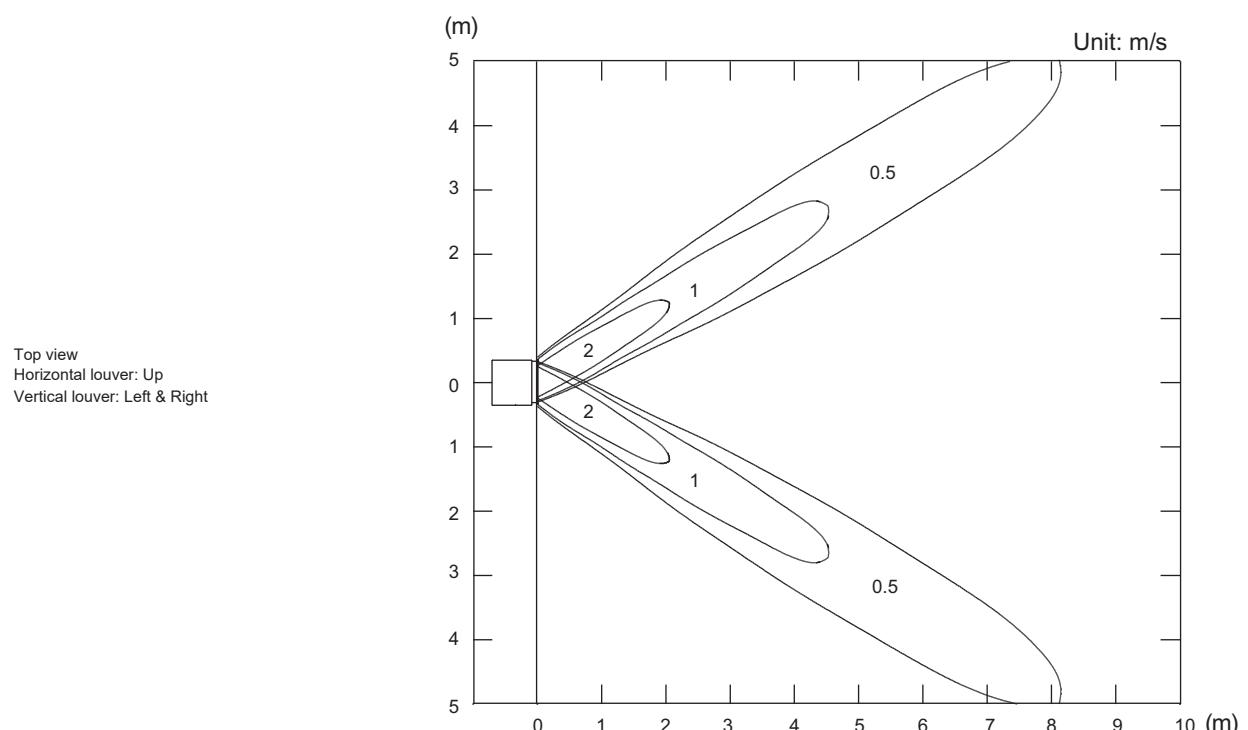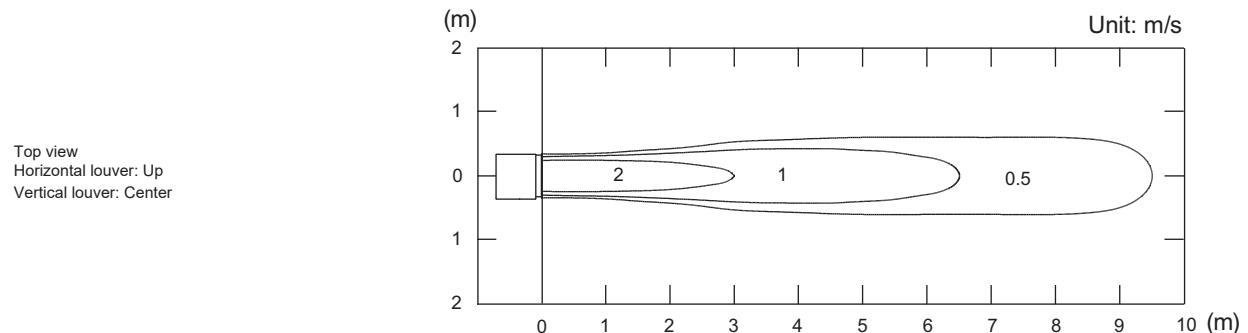

- Air velocity distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT


Side view
Horizontal louver: Down
Vertical louver: Center

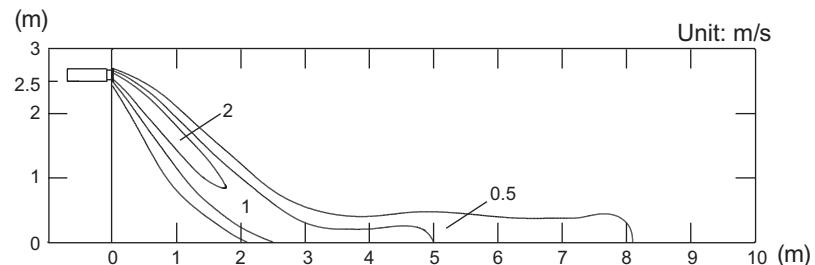

- Air temperature distribution

Measuring conditions	Fan speed	Operation mode
	HIGH	HEAT





Side view
Horizontal louver: Down
Vertical louver: Center

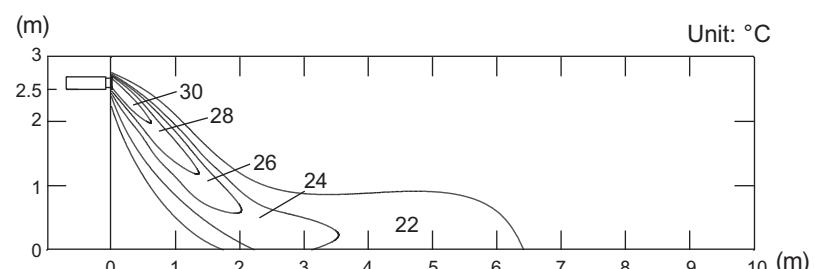

6-4. Wall mounted type


- Models: ASHG07-12KMTB, ASHG07-12KMCC, ASHG07-12KMCE, ASHG07-12KMCF, ASHH07-12KMCG, ASHH07-12KMCG-B, ASHH07-12KMCH, ASHH07-12KMCH-B, ASHG07-12KETA, ASHG07-12KETA-B, ASHG07-12KETE, ASHG07-12KETE-B, ASHG07-12KETF, ASHG07-12KETF-B, ASHG07-09KGTB, ASHG07-09KGTE, ASHG07-09KGTF, ASHH07-09KG TG, and ASHH07-09KGTH

Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

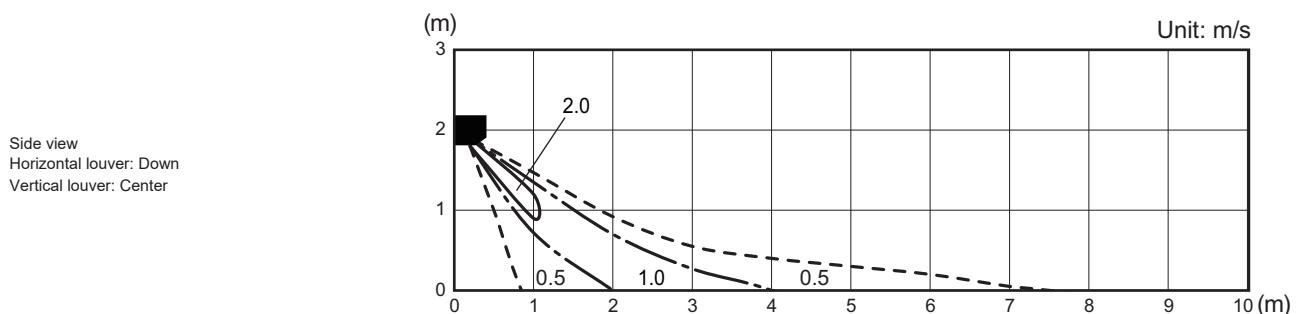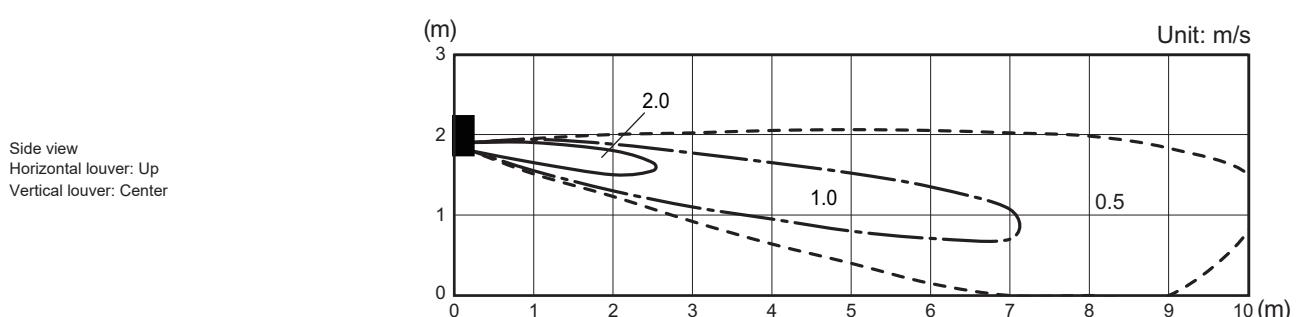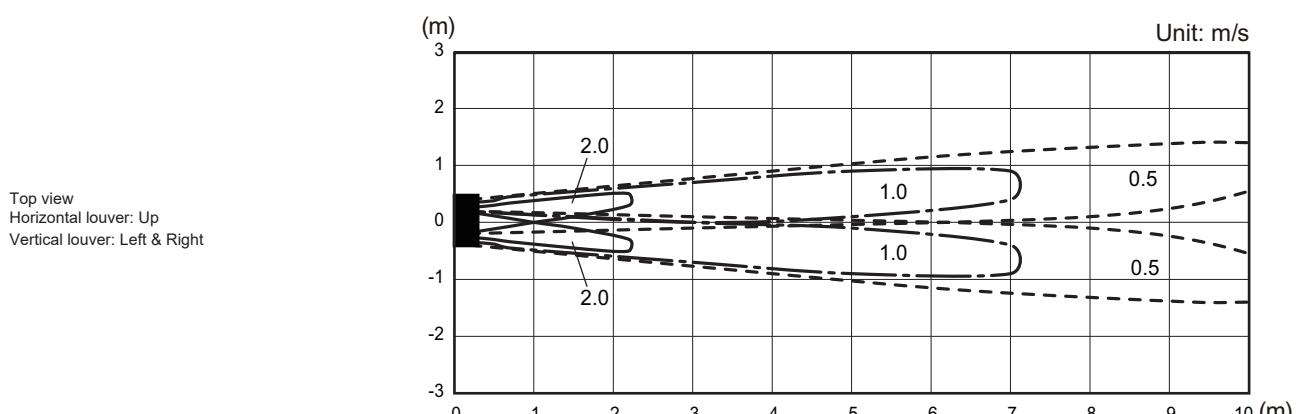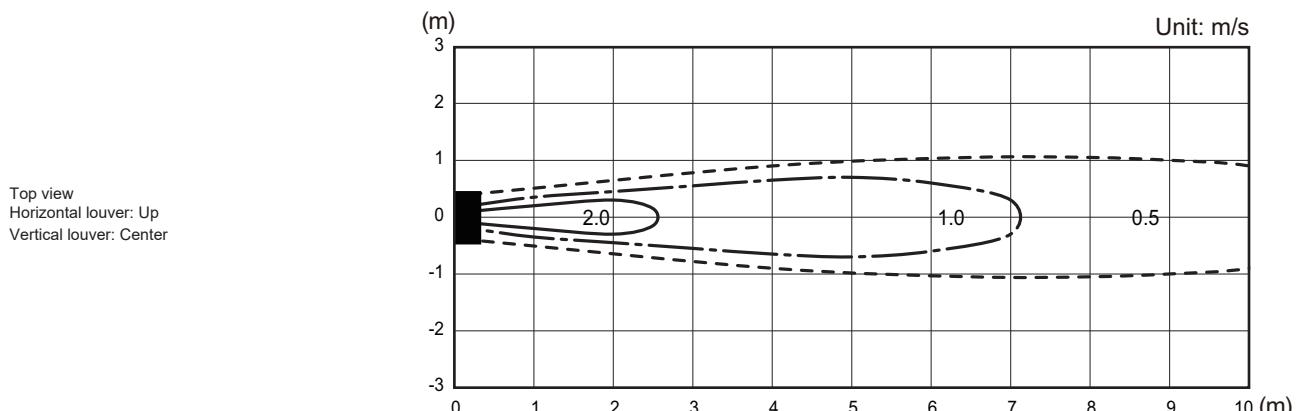


**■ Models: ASHG14KMTB, ASHG14KMCC, ASHG14KMCE,
ASHG14KMCF, ASHH14KMCG, ASHH14KMCG-B,
ASHH14KMCH, ASHH14KMCH-B, ASHG14KETA, ASHG14KETA-B,
ASHG14KETE, ASHG14KETE-B, ASHG14KETF,
ASHG14KETF-B, ASHG12-14KGTB, ASHG12-14KGTE,
ASHG12-14KGTF, ASHH12-14KG TG, and ASHH12-14KGTH**

Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

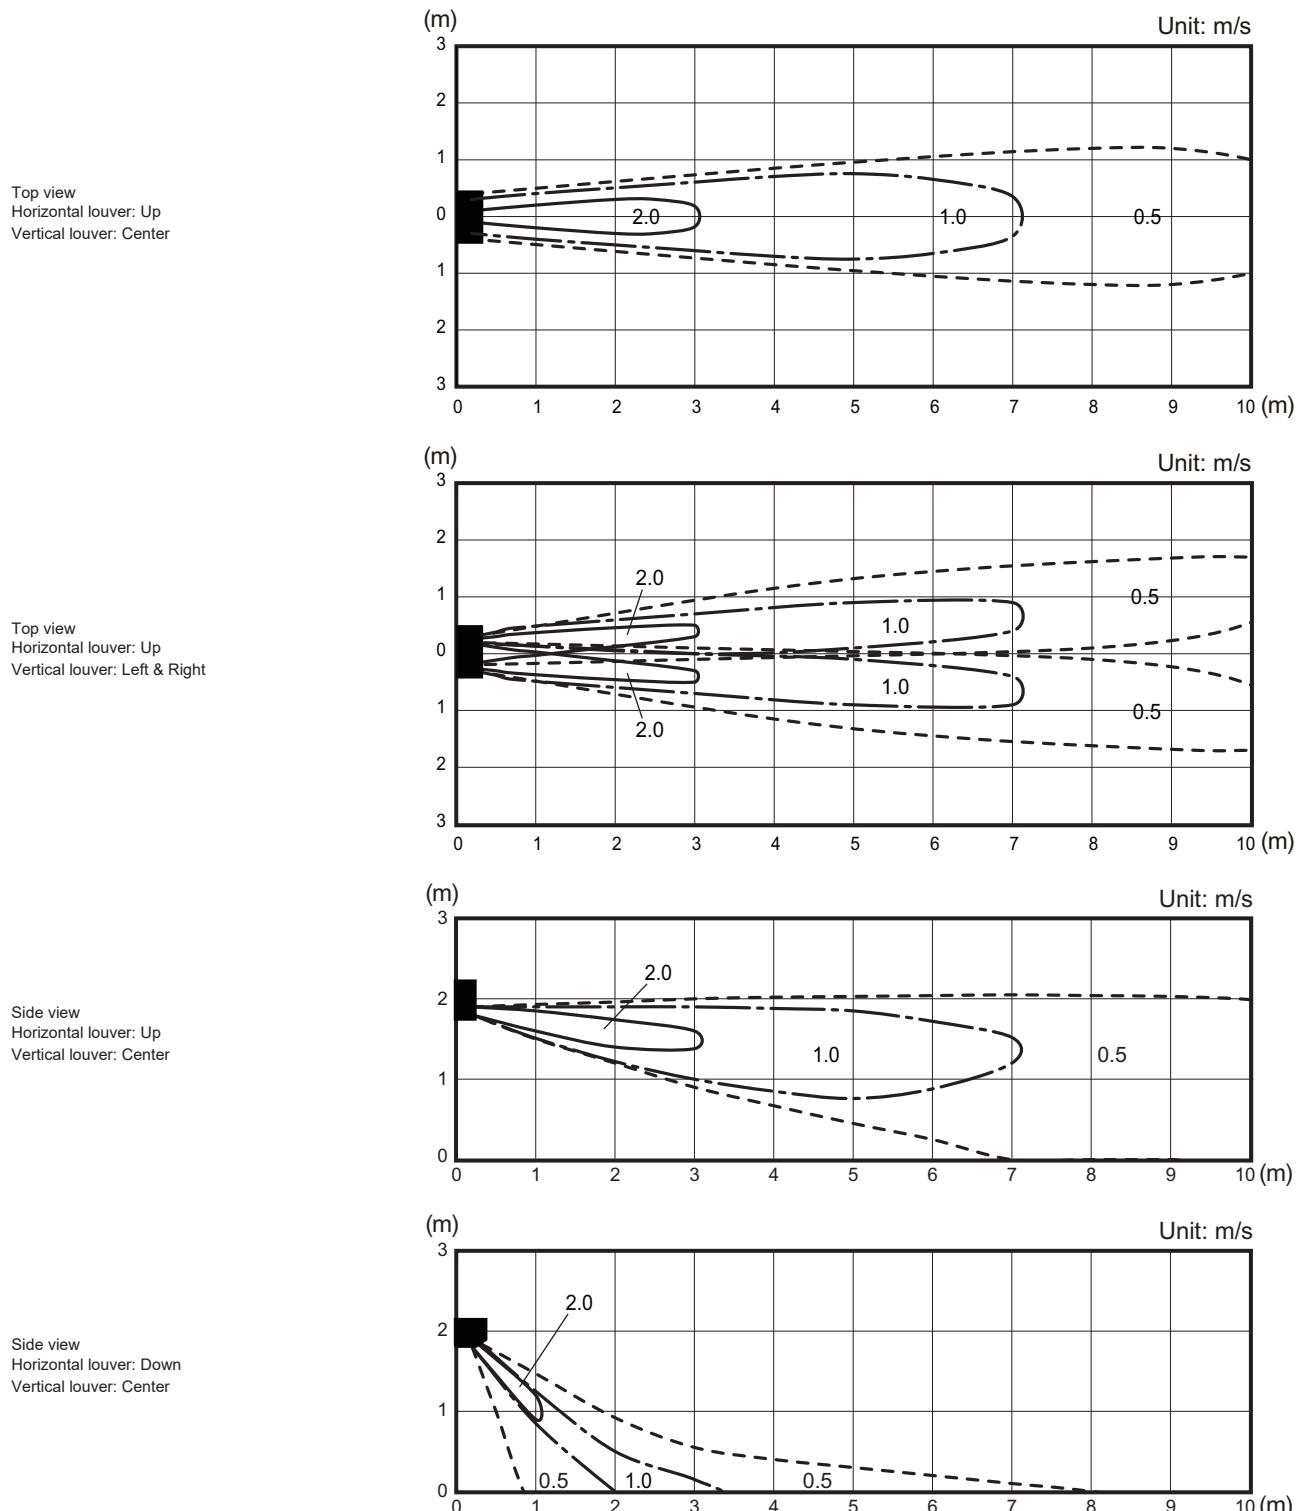


■ Models: ASHH05KNCA and ASHH05KNCH

Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

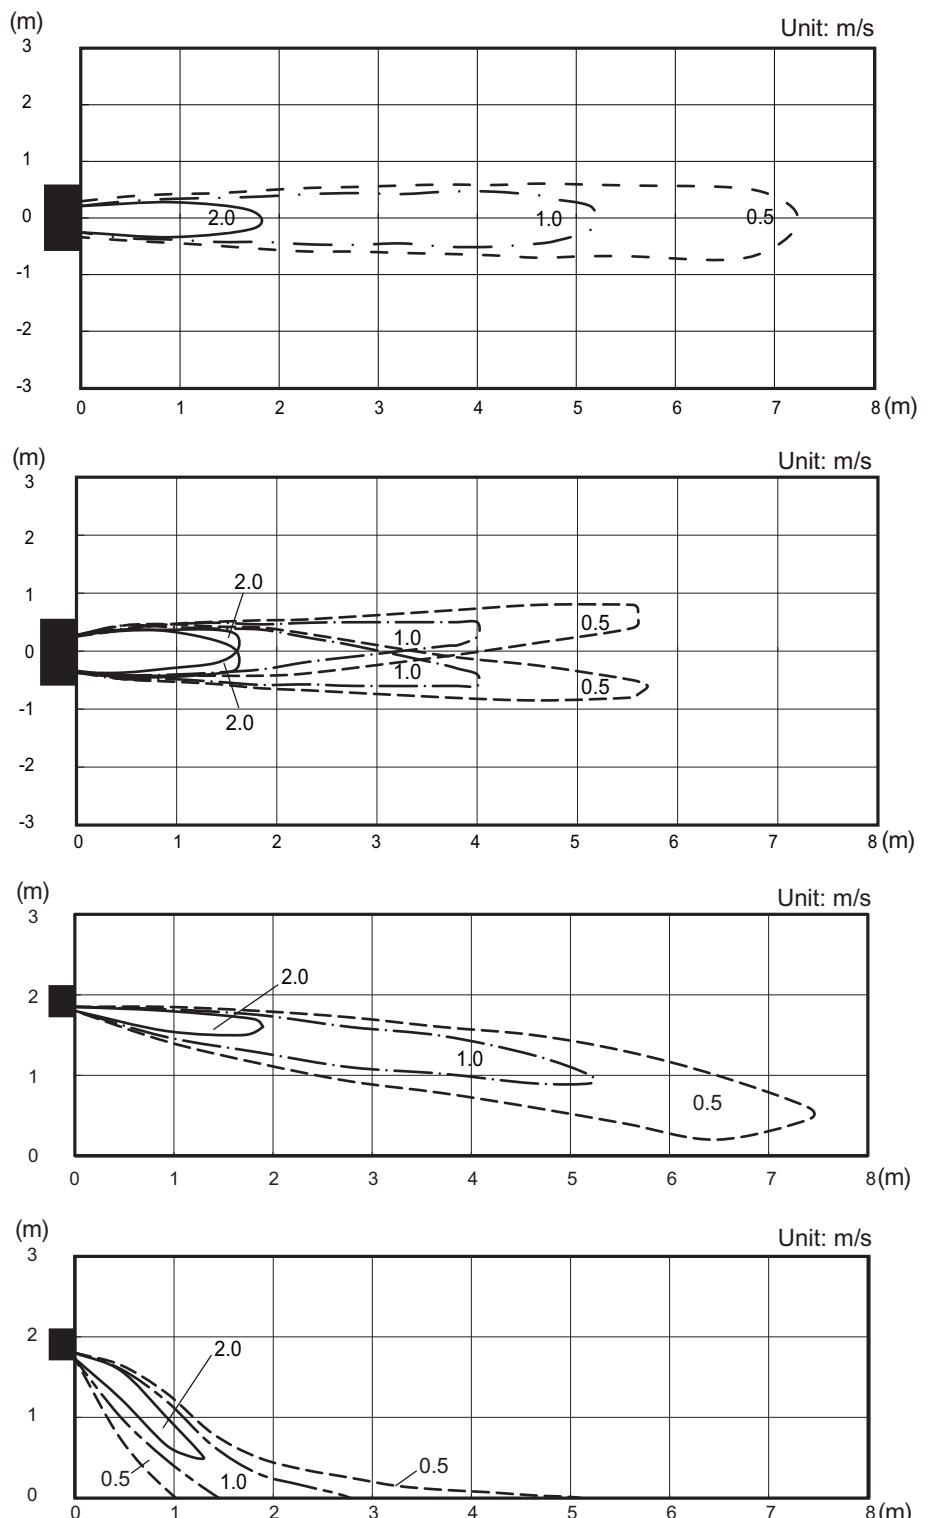


■ Models: ASHH07KNCA and ASHH07KNCH

Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

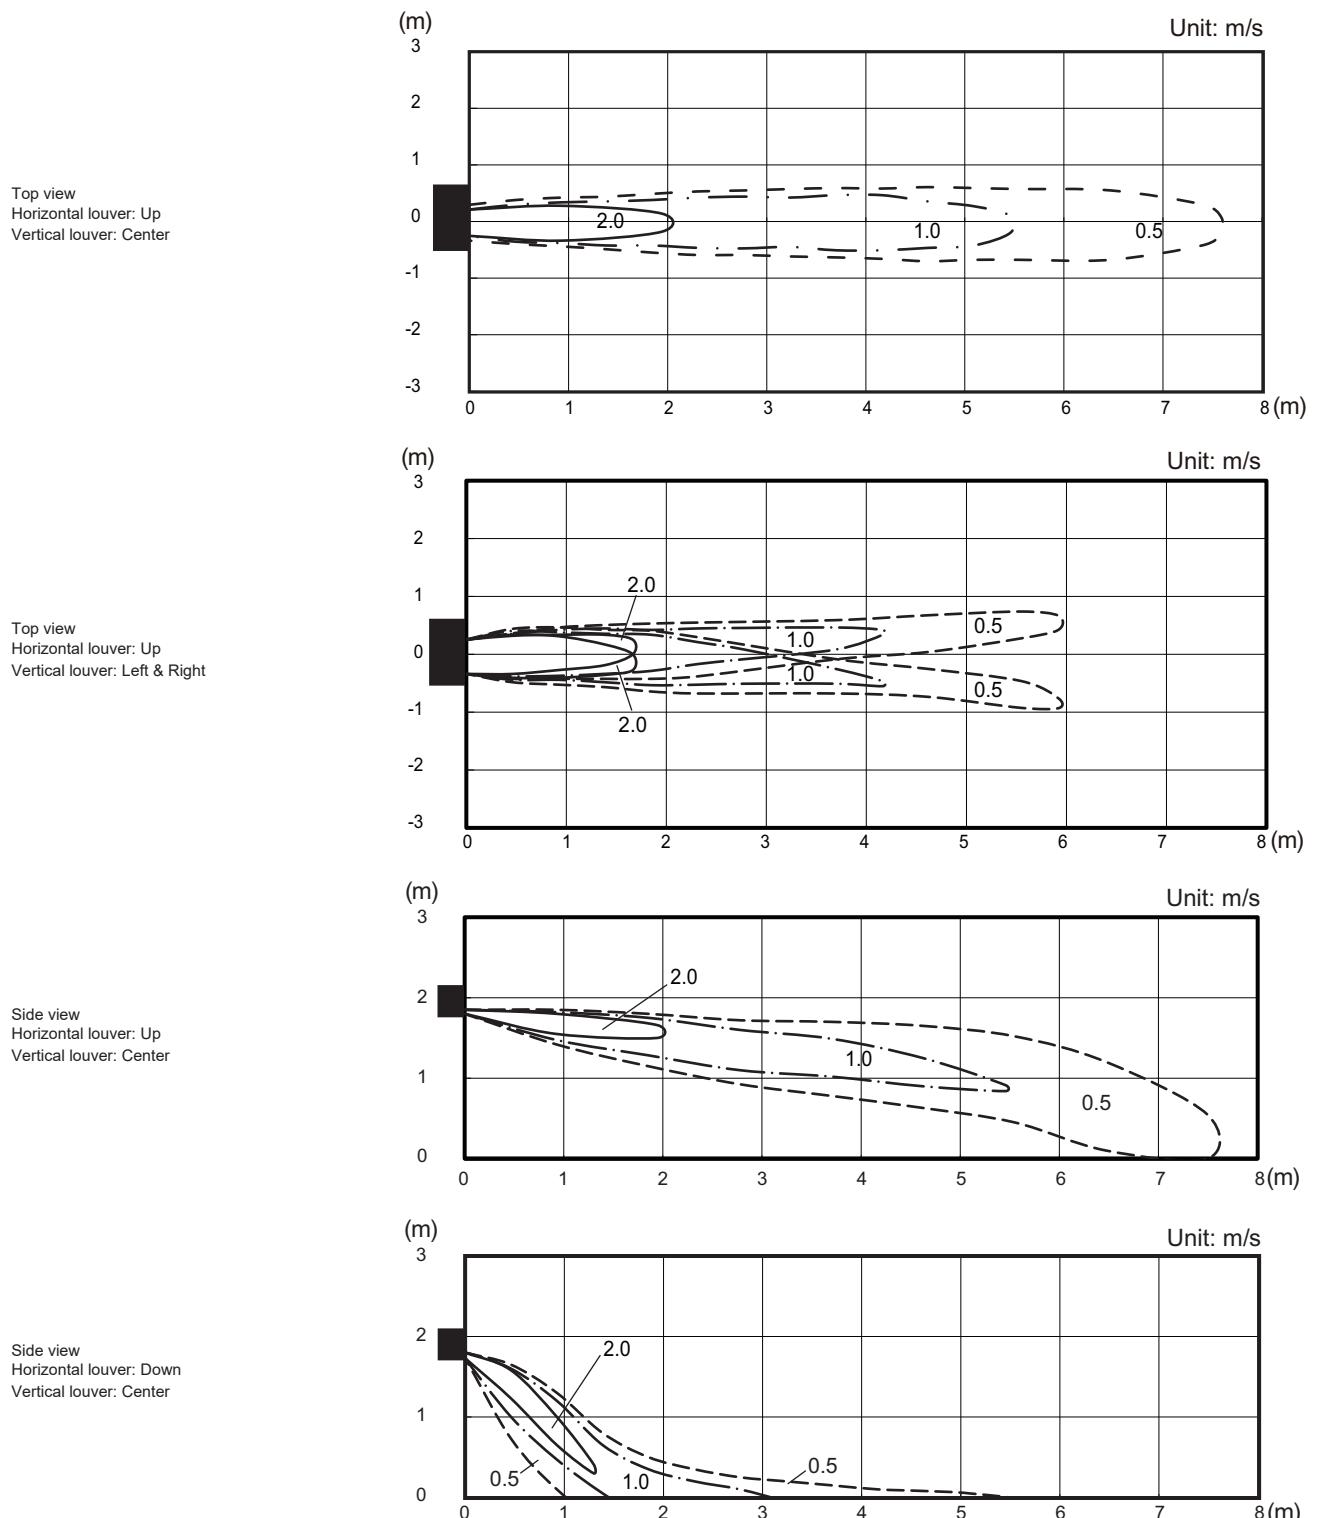


■ Models: ASHH09KNCA and ASHH09KNCH

Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

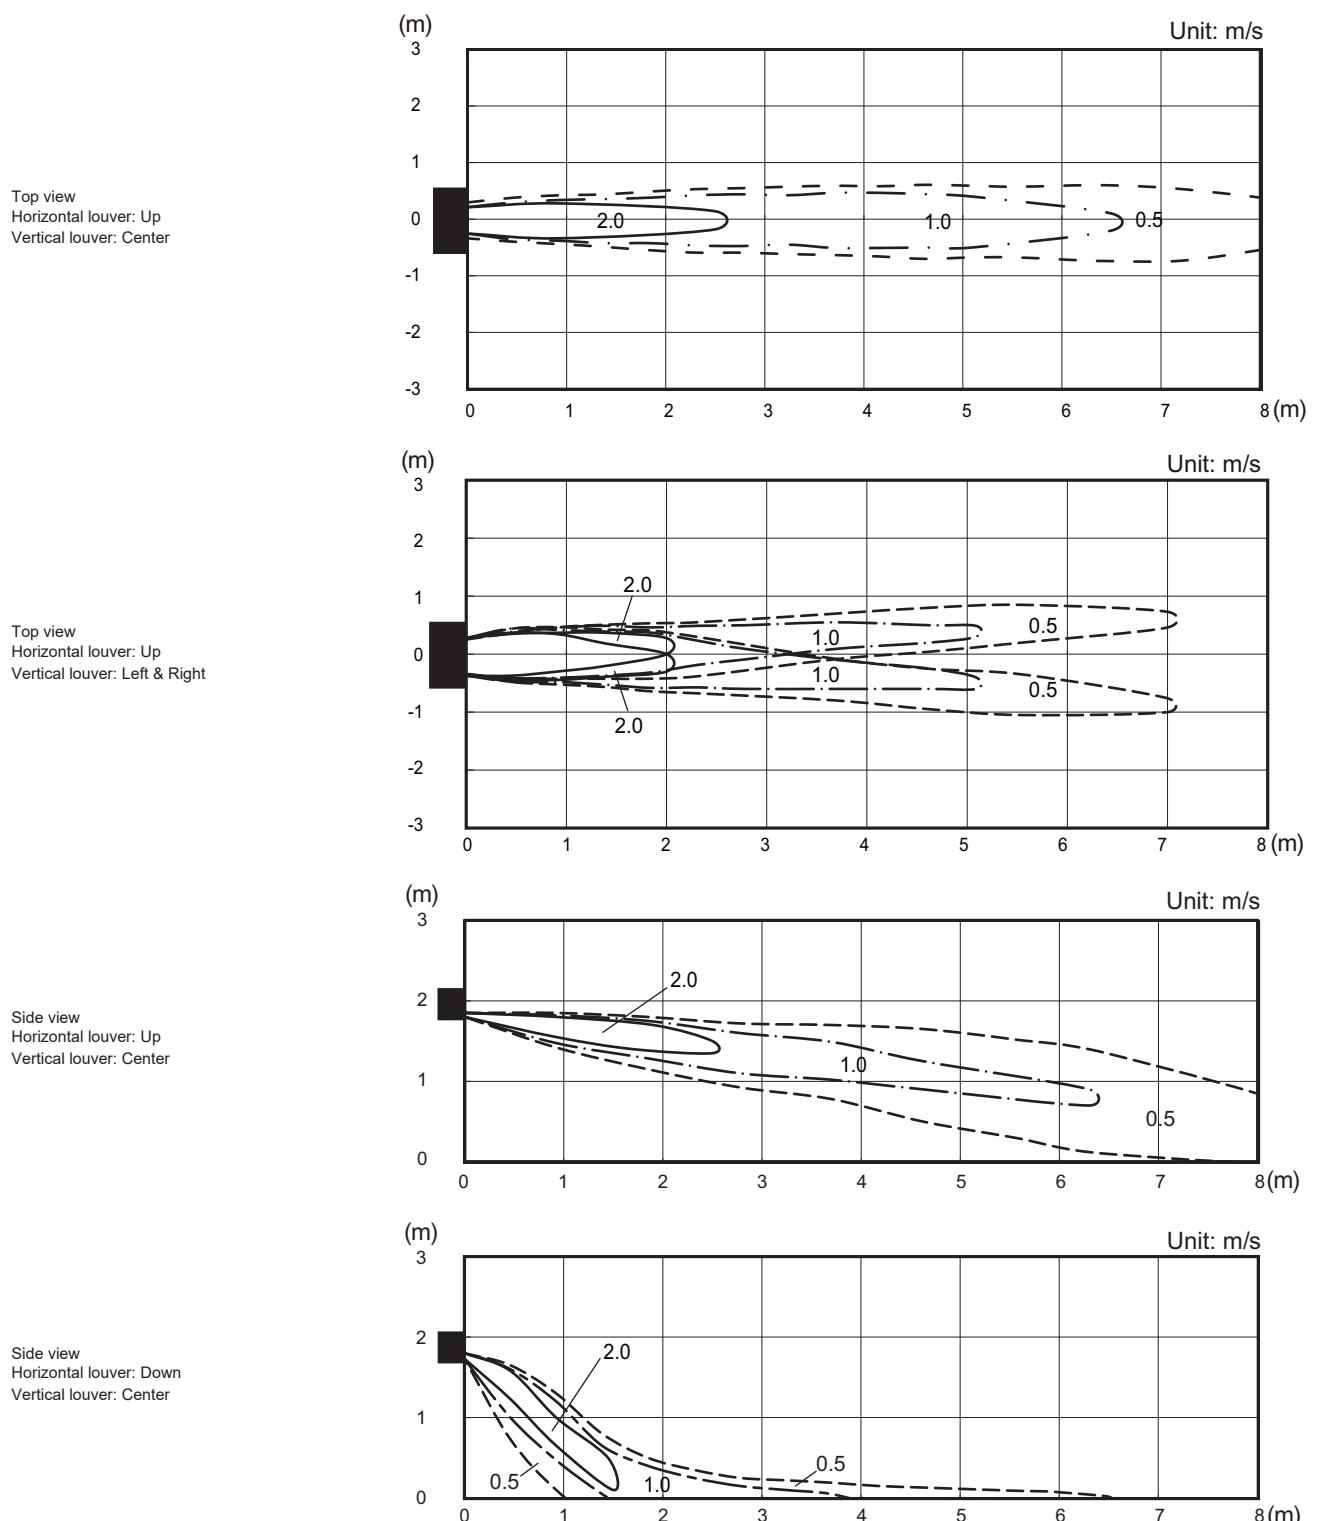

■ Models: ASHH12KNCA and ASHH12KNCH

Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

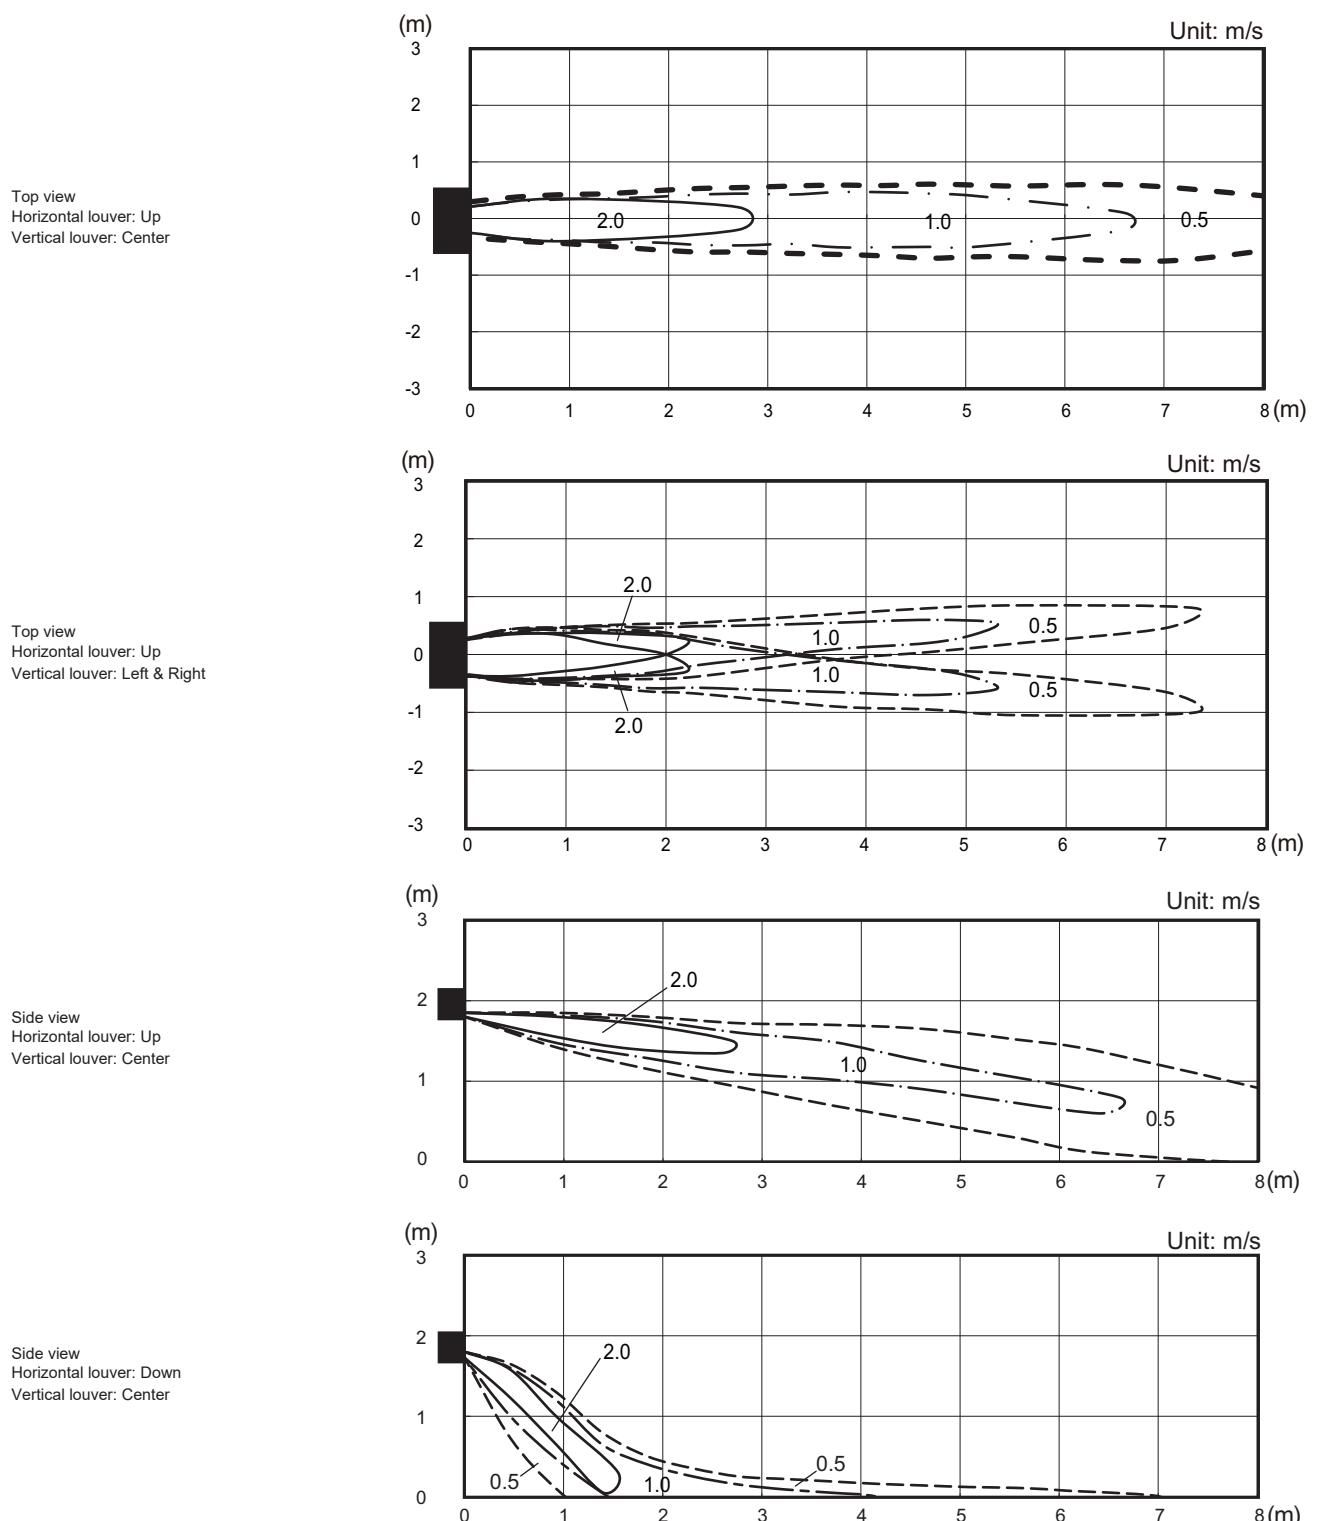


6-5. Floor type


■ Models: AGHG09-14KVCA

Measuring conditions	Fan speed	Operation mode	Fan select
	HIGH	FAN	Upper and lower


Top view
Horizontal louver: Up
Vertical louver: Center

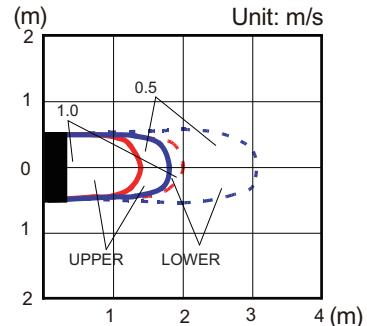


Top view
Horizontal louver: Up
Vertical louver: Left & Right

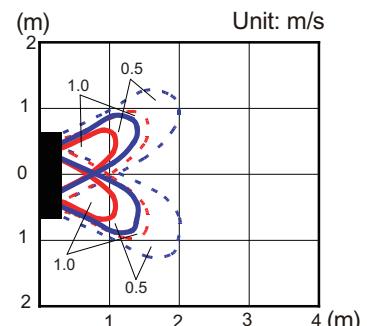

Side view
Horizontal louver: Up
Vertical louver: Center

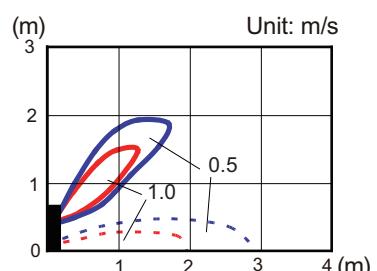

Side view
Horizontal louver: Down
Vertical louver: Center

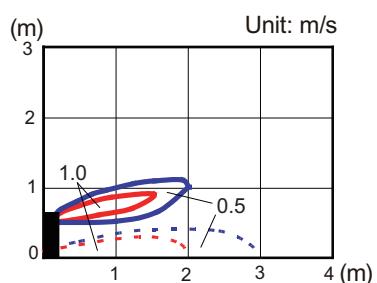


7. Fan performance

NOTE: Airflow and capacity/outlet temperature curve data are measured based on the same conditions mentioned in "Specifications".

7-1. Mini duct type

■ Model: ARXG07KSLAP

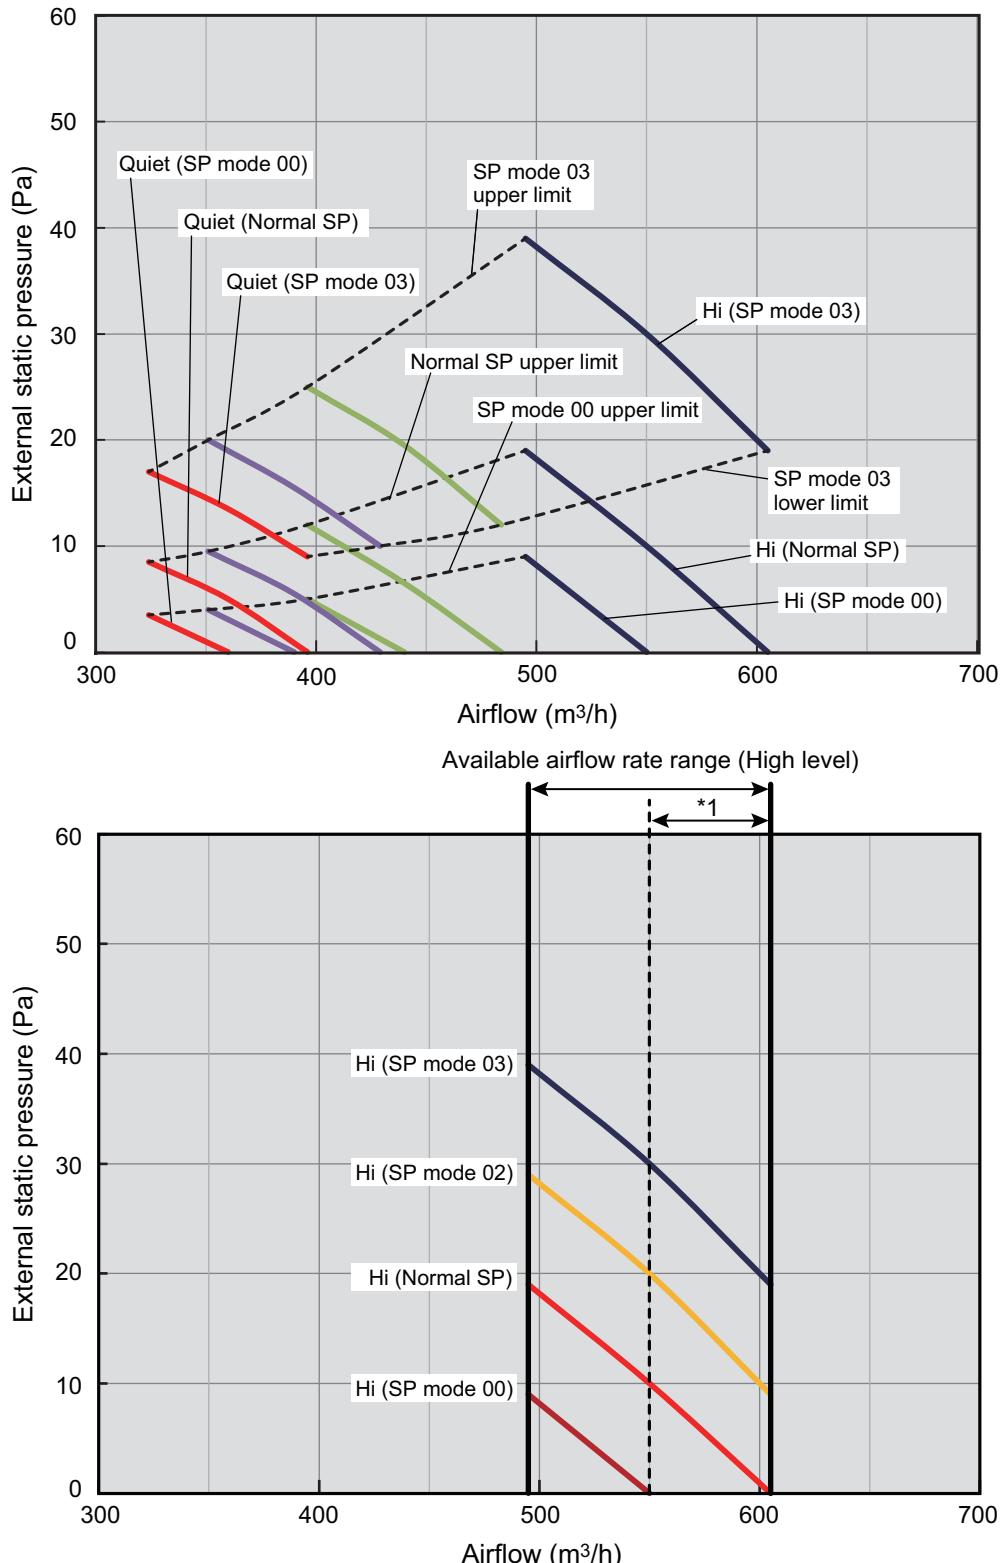


*1: Available airflow rate range when Auto louver grille (option) is installed.

Fan speed: HIGH


Vertical airflow direction louver: Up

● Characteristics of air volume and capacity


- Cooling

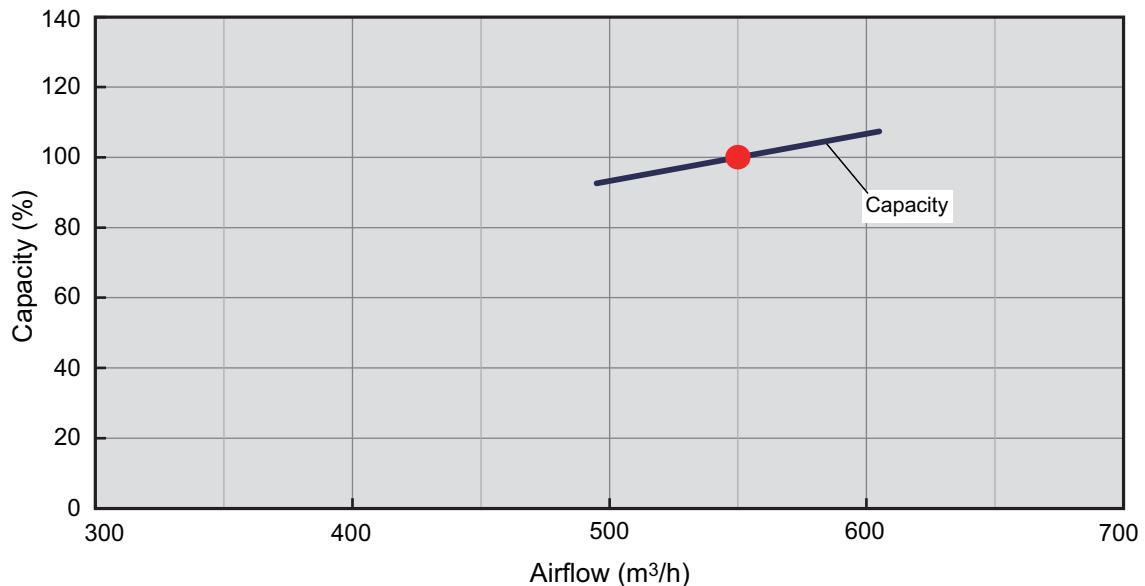

- Heating

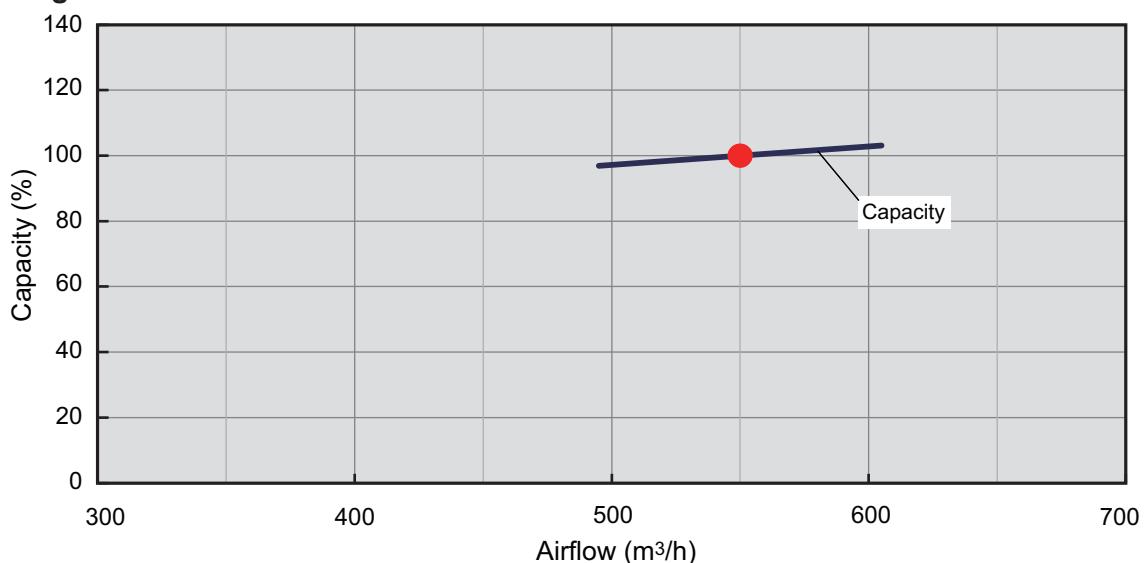

■ Model: ARXG09KSLAP

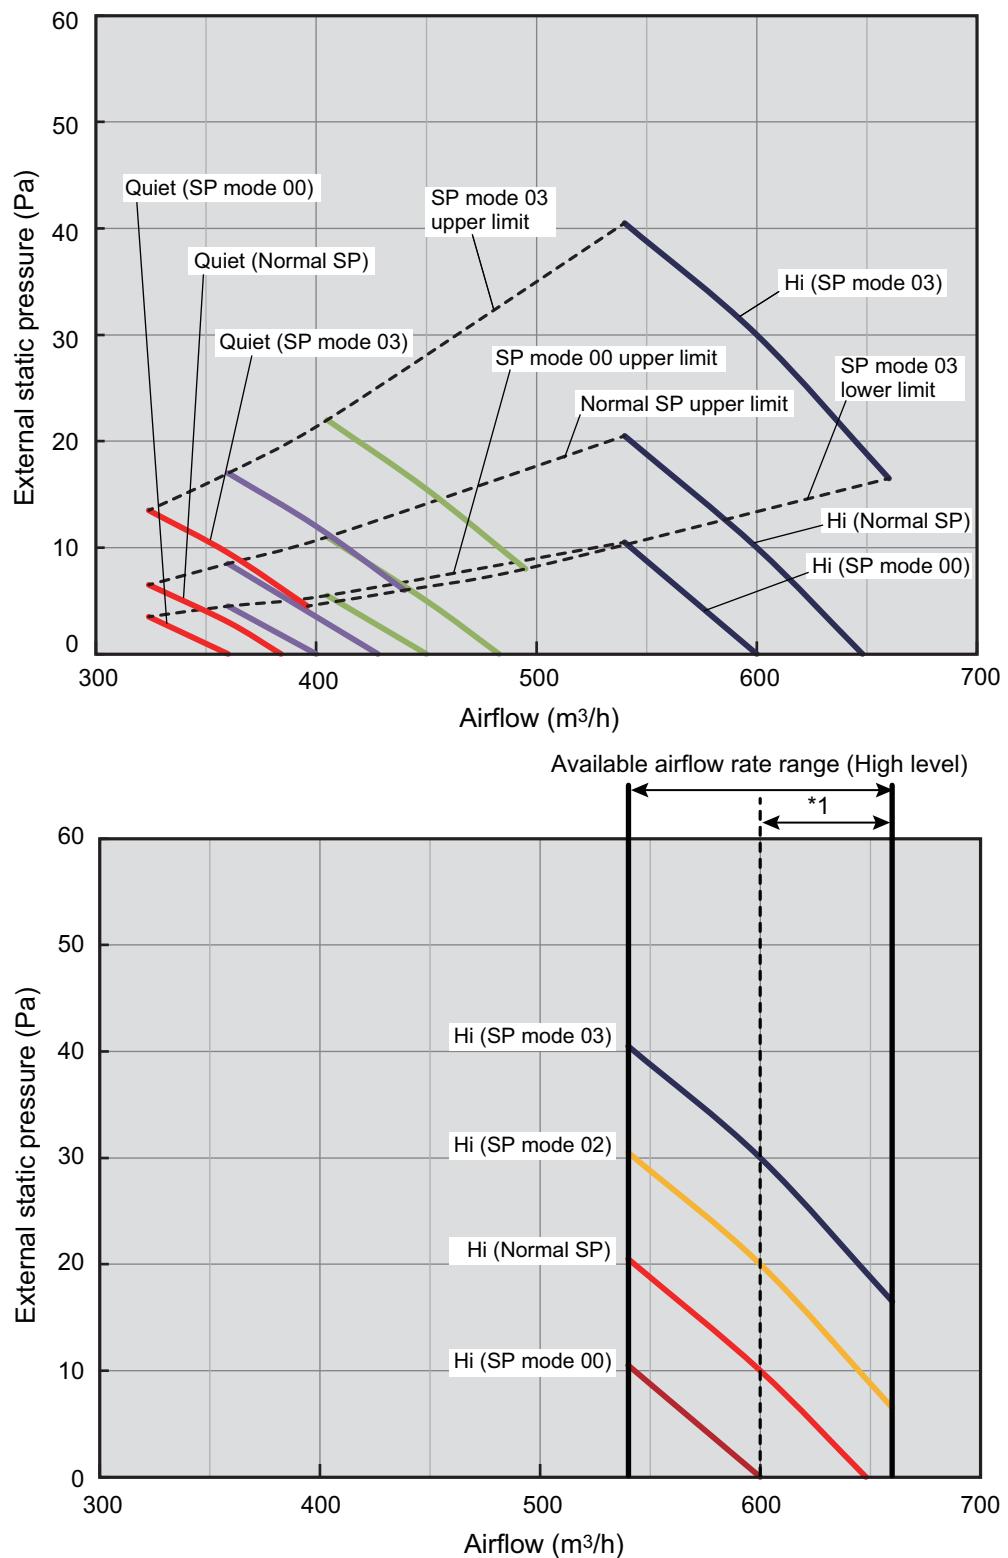


*1: Available airflow rate range when Auto louver grille (option) is installed.

Fan speed: HIGH


Vertical airflow direction louver: Up

● Characteristics of air volume and capacity


- Cooling

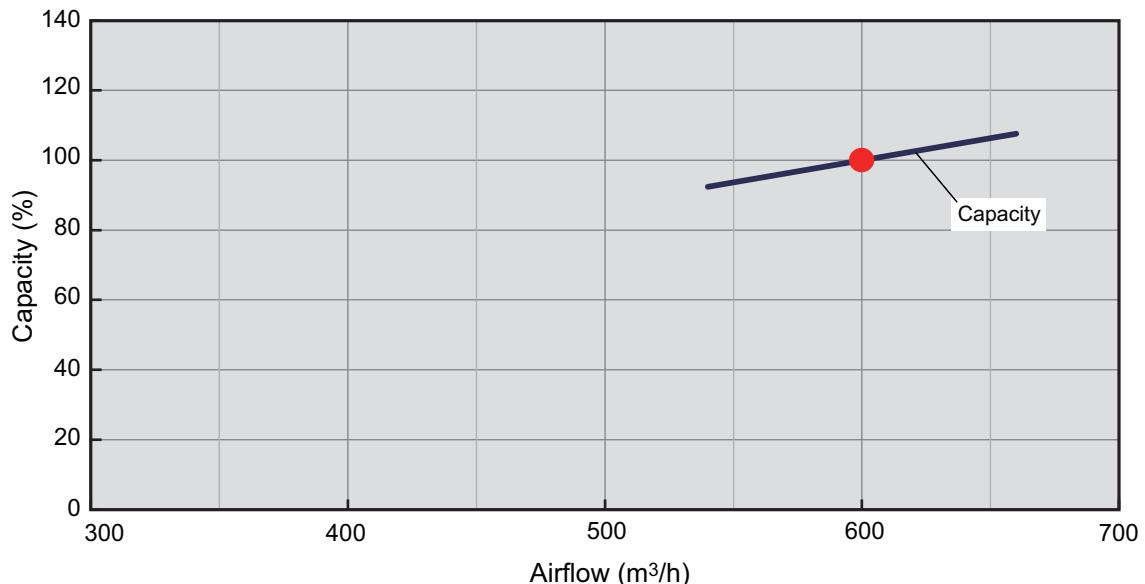


- Heating

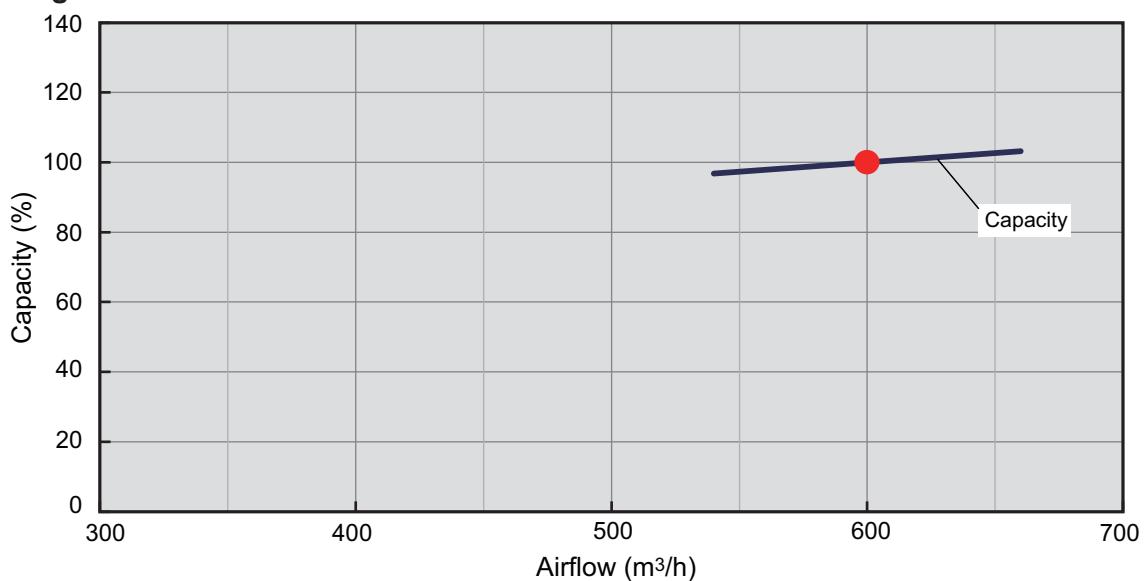

■ Model: ARXG12KSLAP

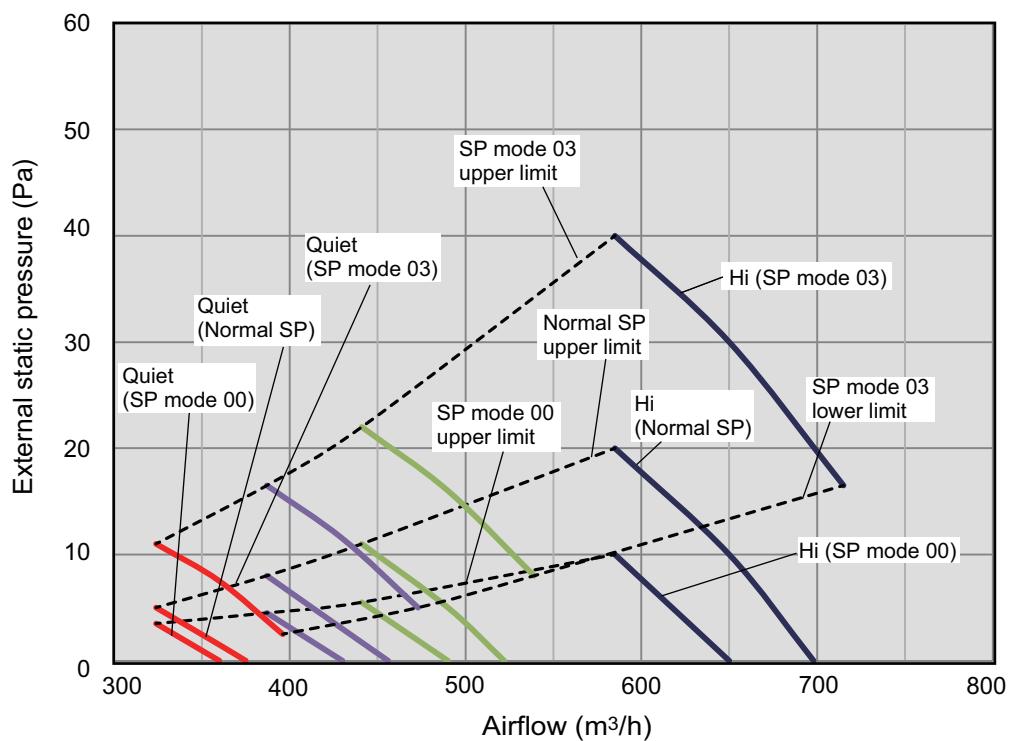

Available airflow rate range (High level)

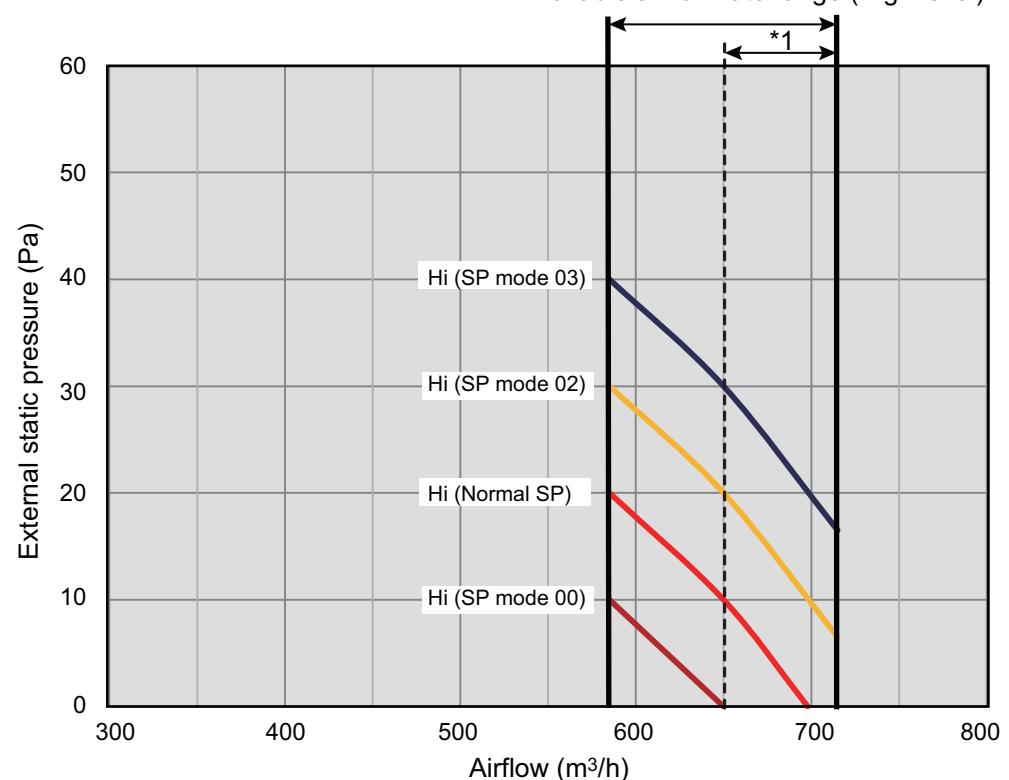


*1: Available airflow rate range when Auto louver grille (option) is installed.

Fan speed: HIGH


Vertical airflow direction louver: Up

● Characteristics of air volume and capacity



- Cooling

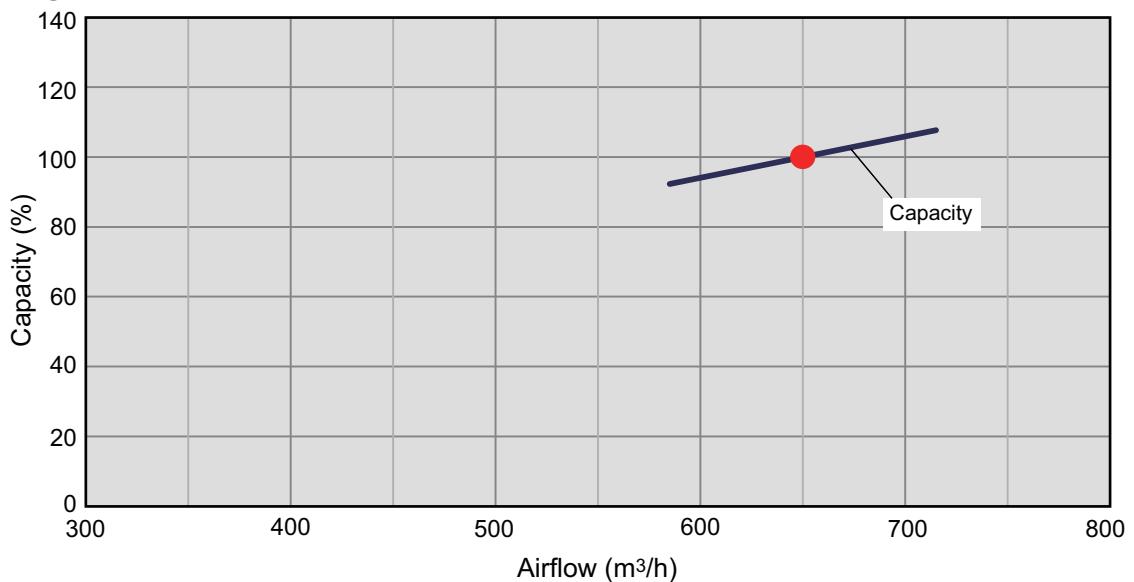

- Heating

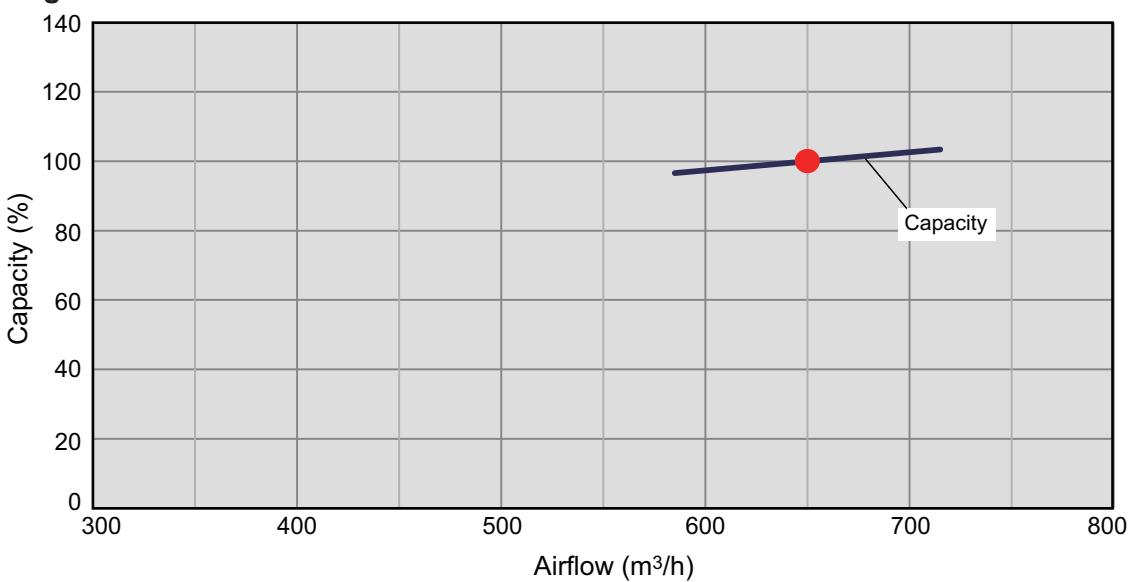

■ Model: ARXG14KSLAP

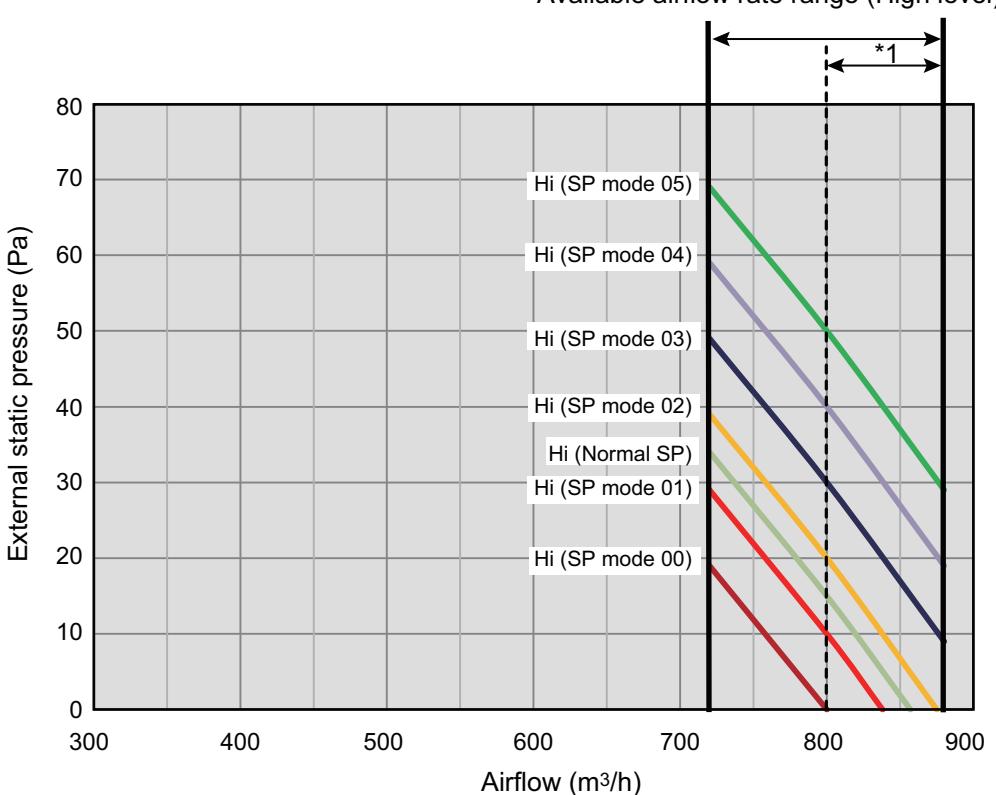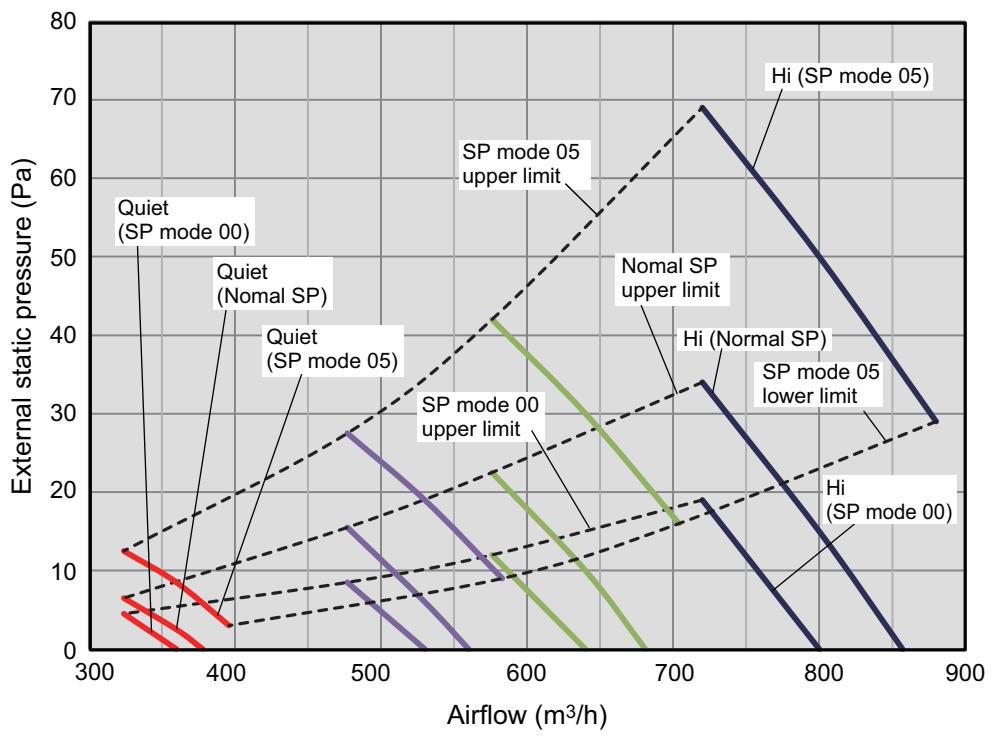


*1: Available airflow rate range when Auto louver grille (option) is installed.

Fan speed: HIGH


Vertical airflow direction louver: Up

● Characteristics of air volume and capacity

- Cooling

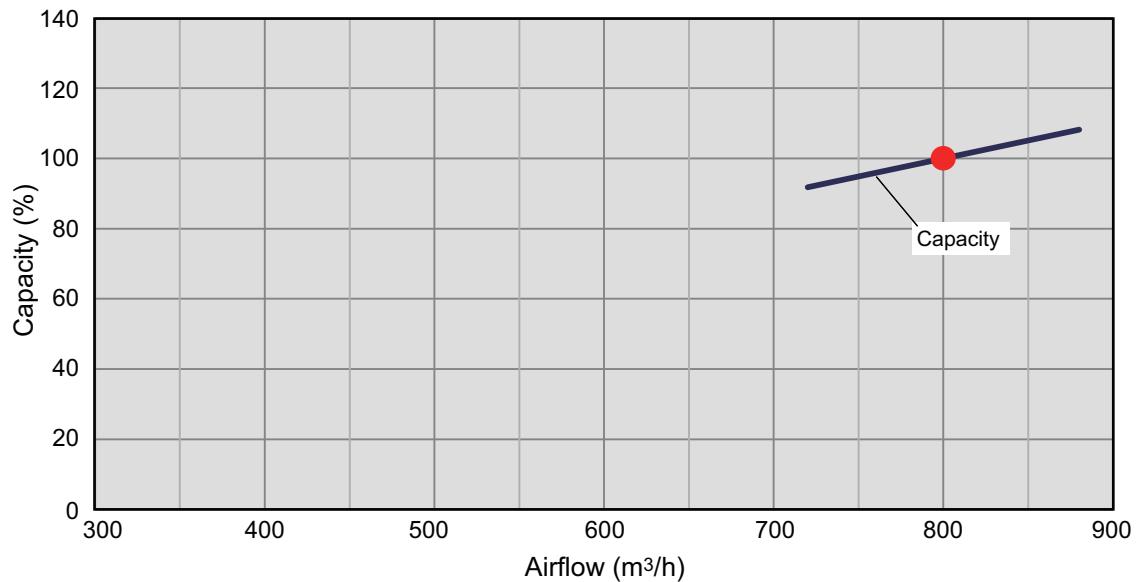


- Heating

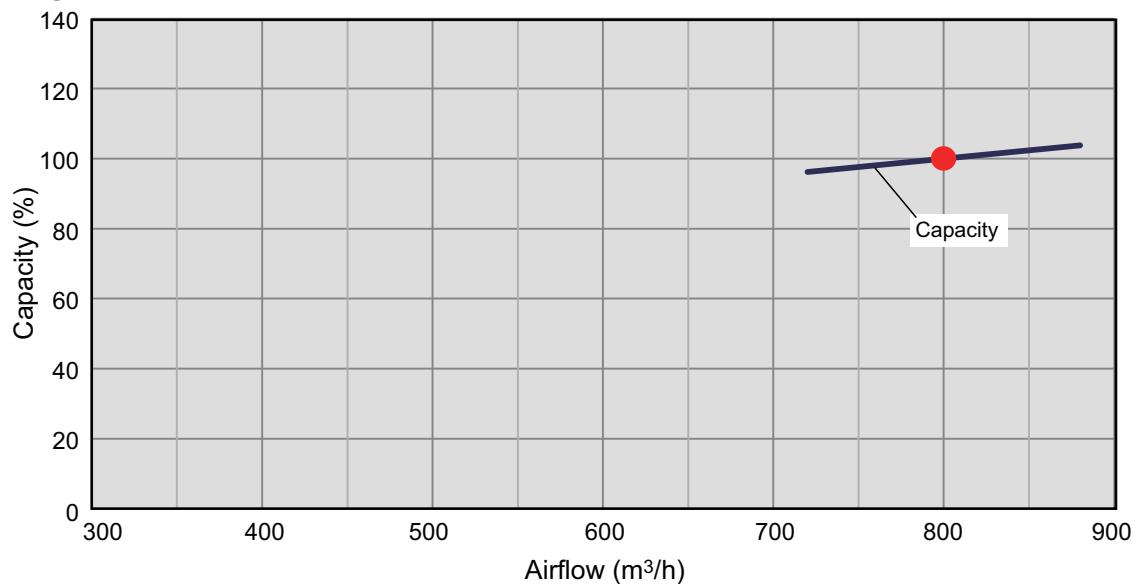

7-2. Slim duct type

■ Model: ARXG07KLLAP

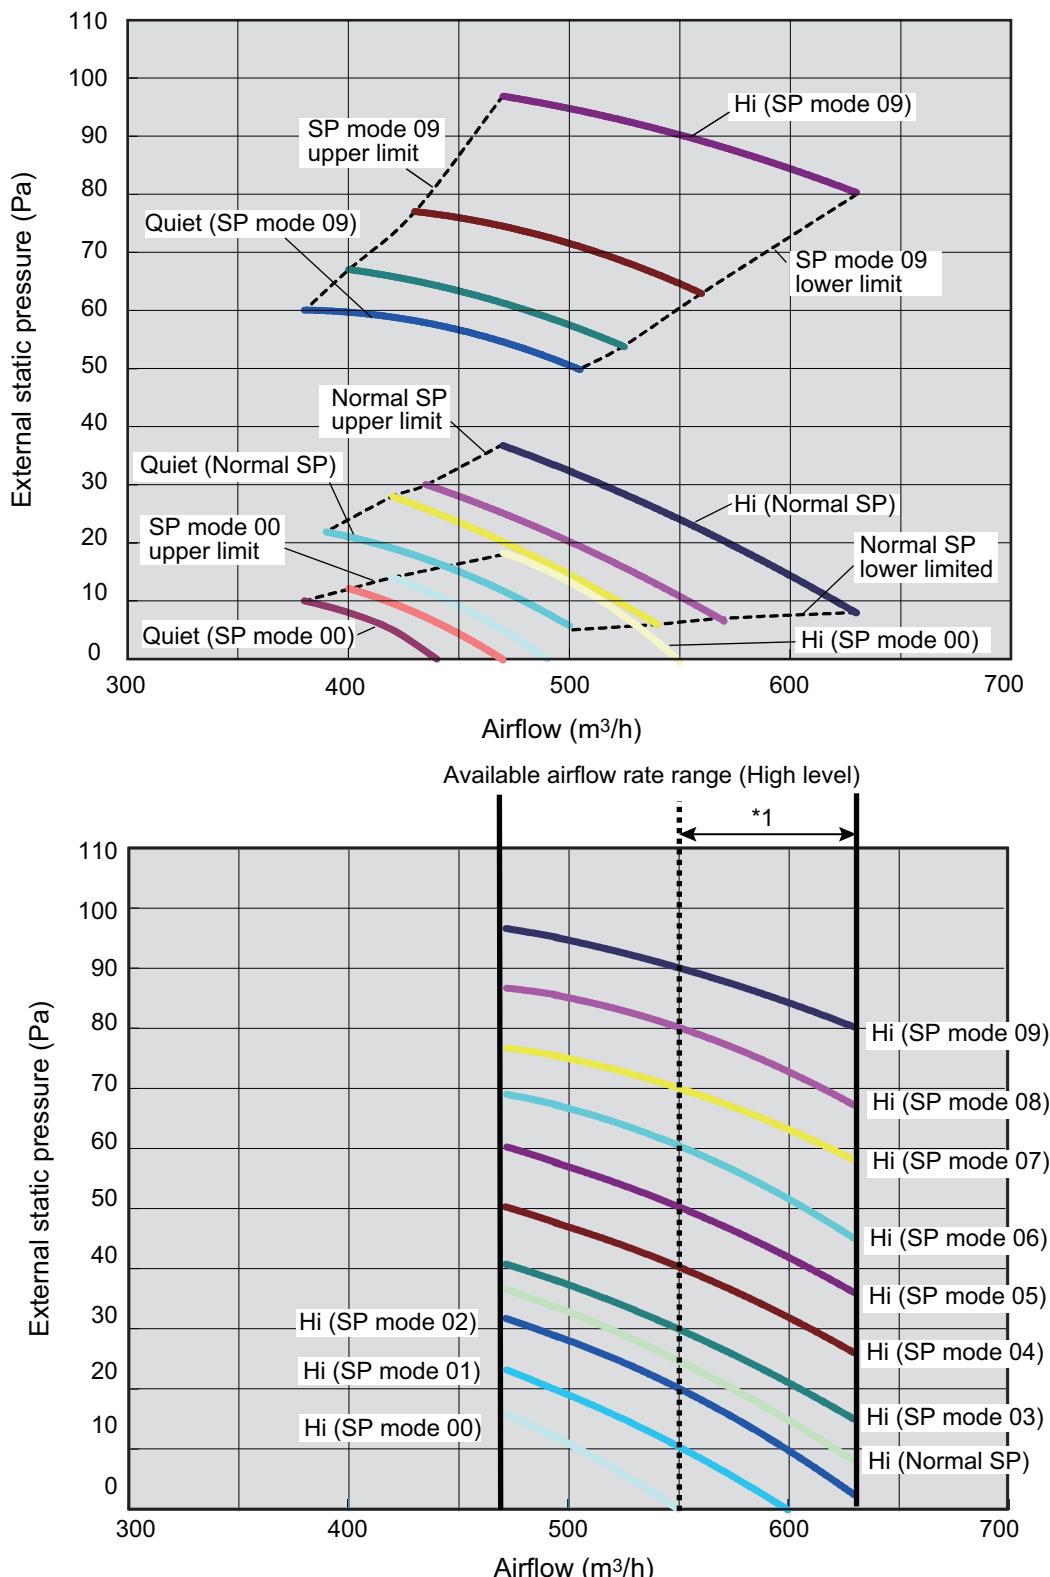


*1: Available airflow rate range when Auto louver grille (option) is installed.

Fan speed: HIGH


Vertical airflow direction louver: Up

● Characteristics of air volume and capacity


- Cooling

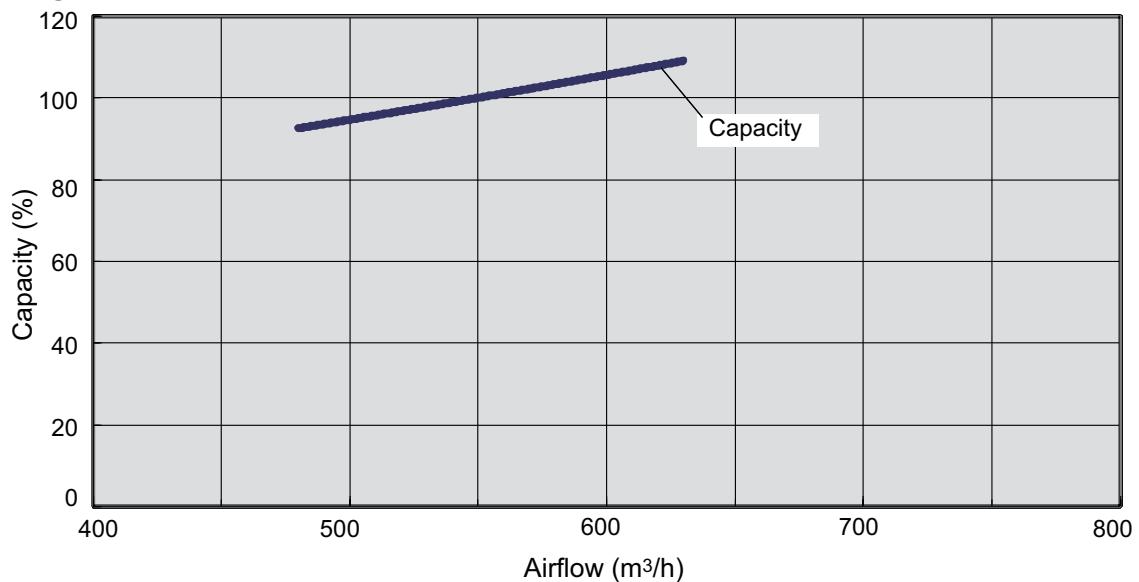

- Heating

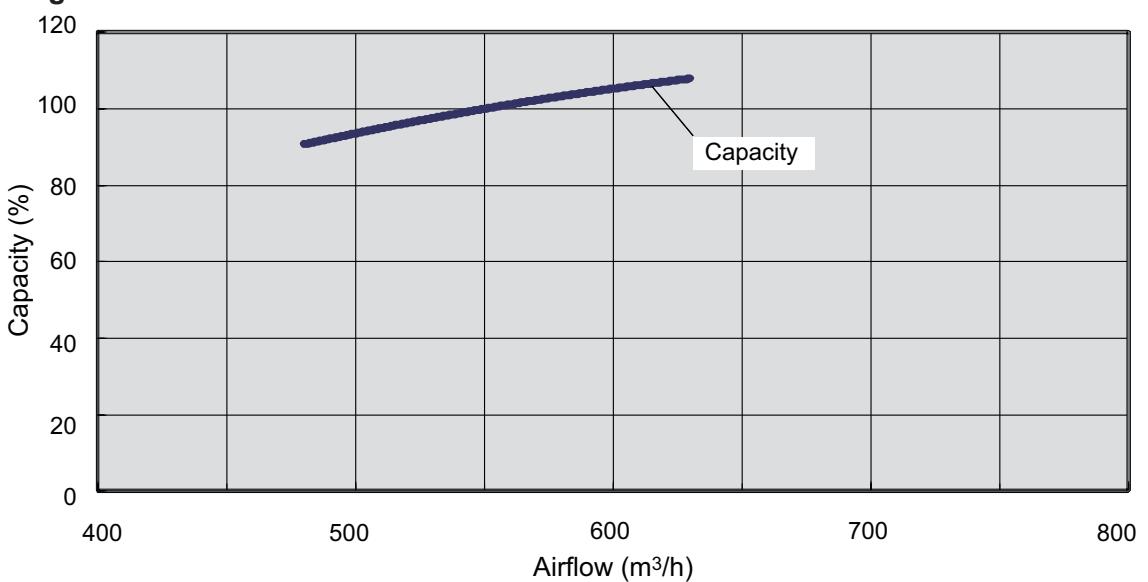

■ Model: ARXG09KLLAP

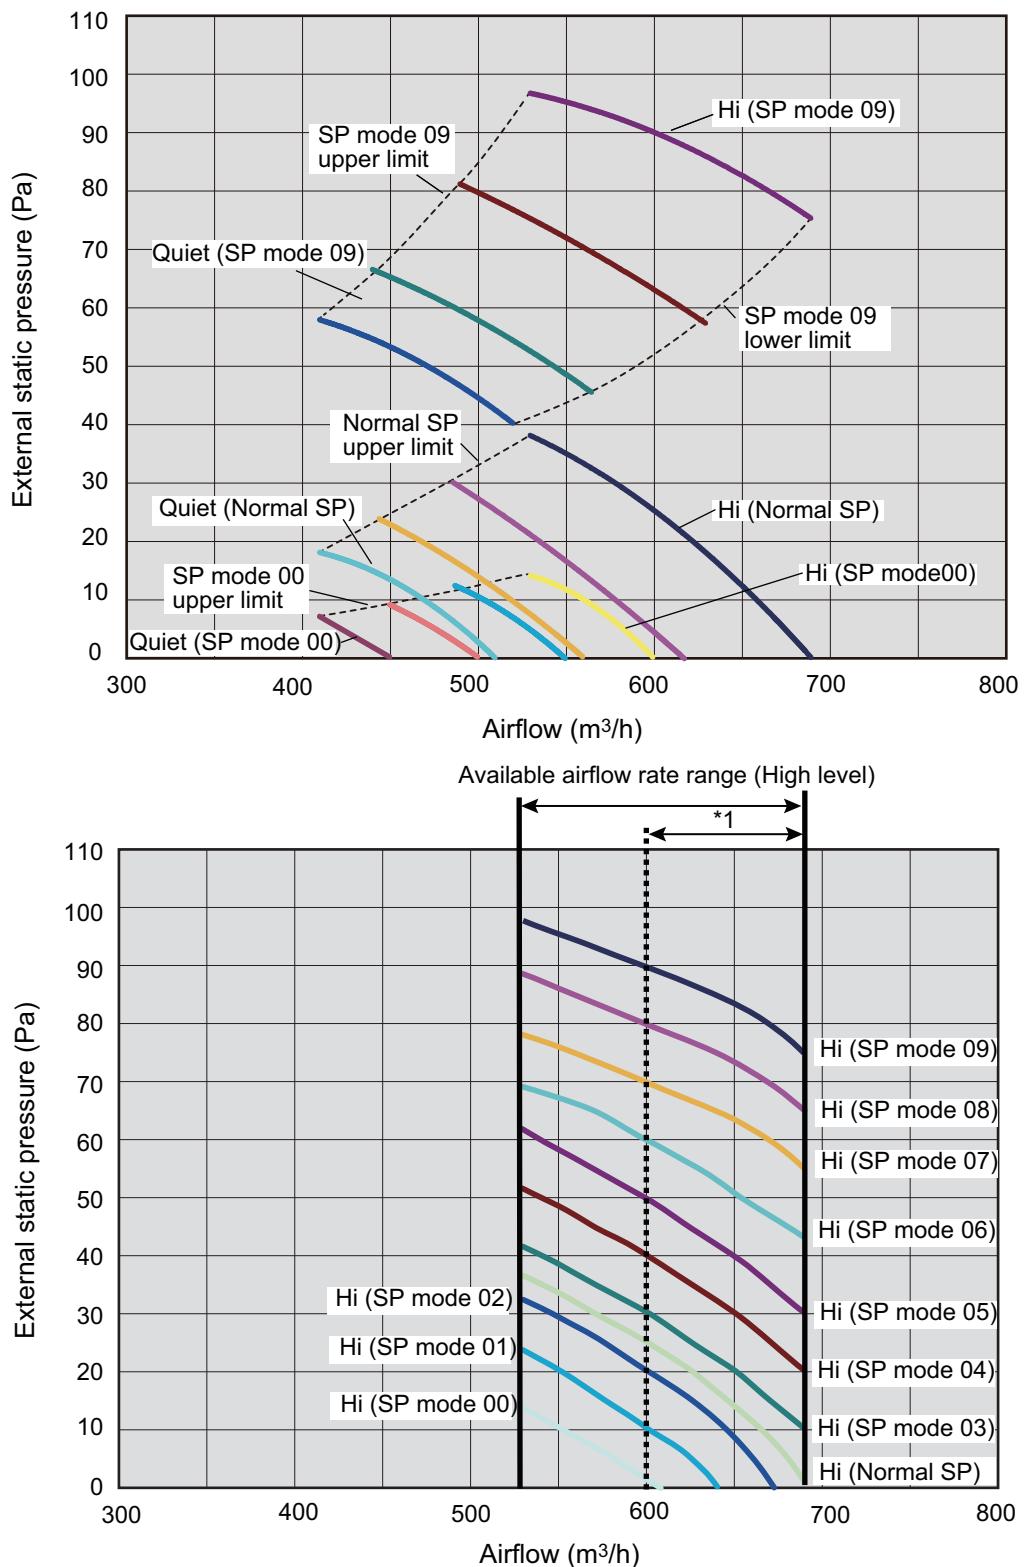


*1: Available airflow rate range when Auto louver grille (option) is installed.

Fan speed: HIGH


Vertical airflow direction louver: Up

● Characteristics of air volume and capacity


- Cooling

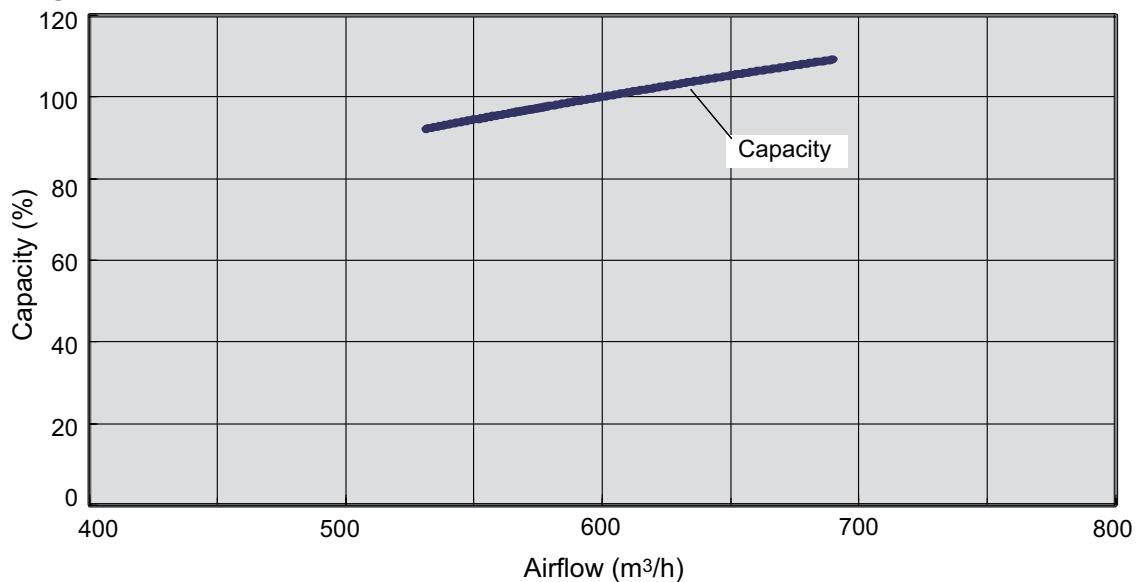


- Heating

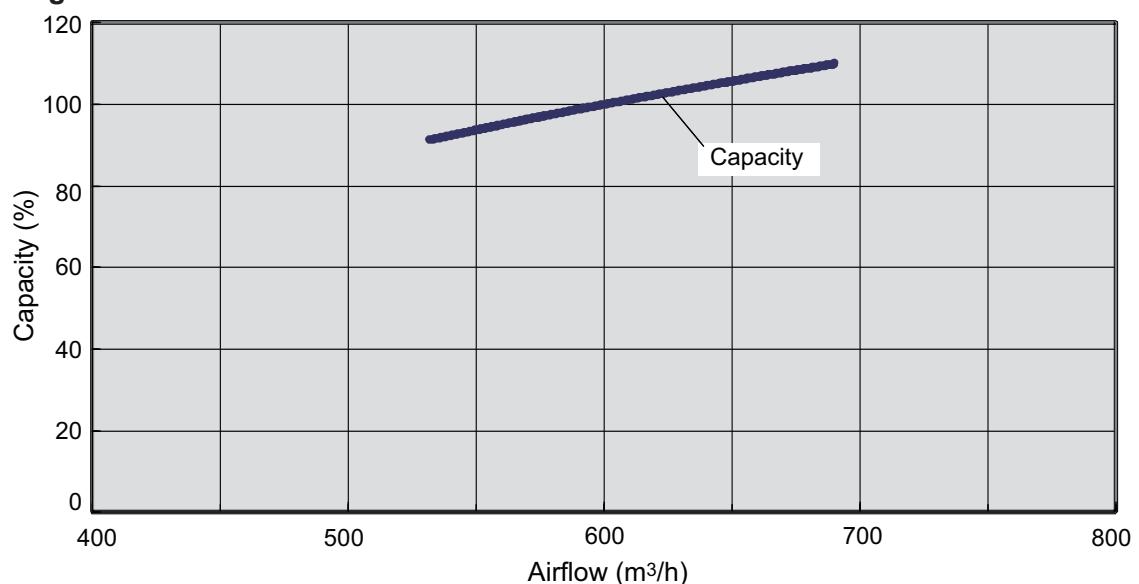

■ Model: ARXG12KLLAP

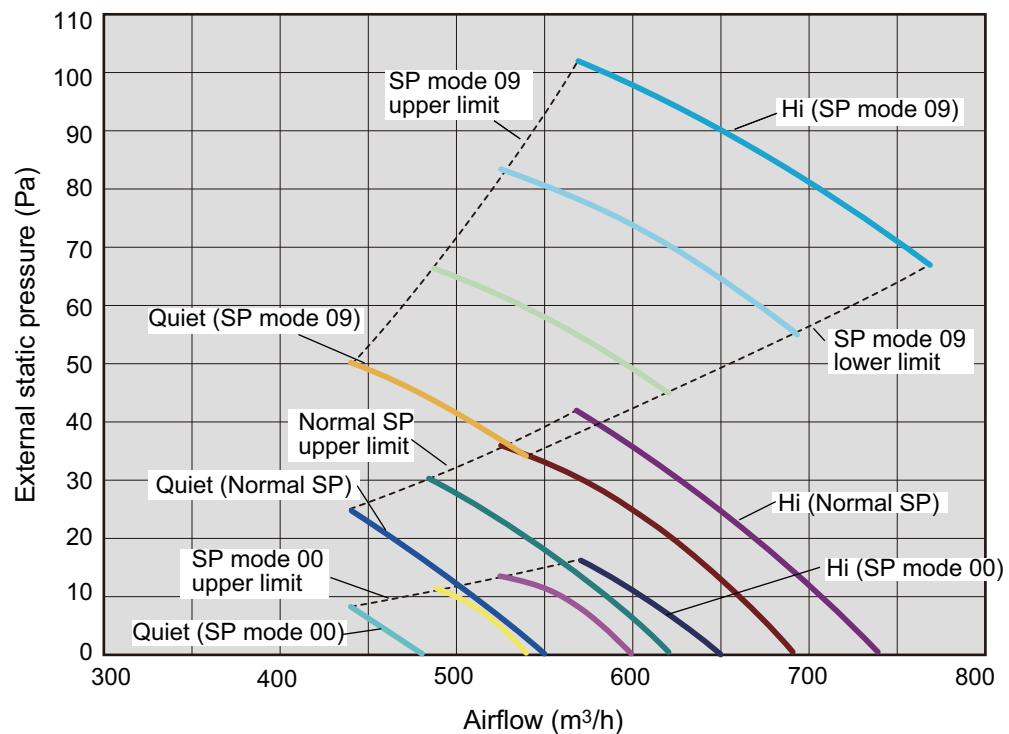

Available airflow rate range (High level)

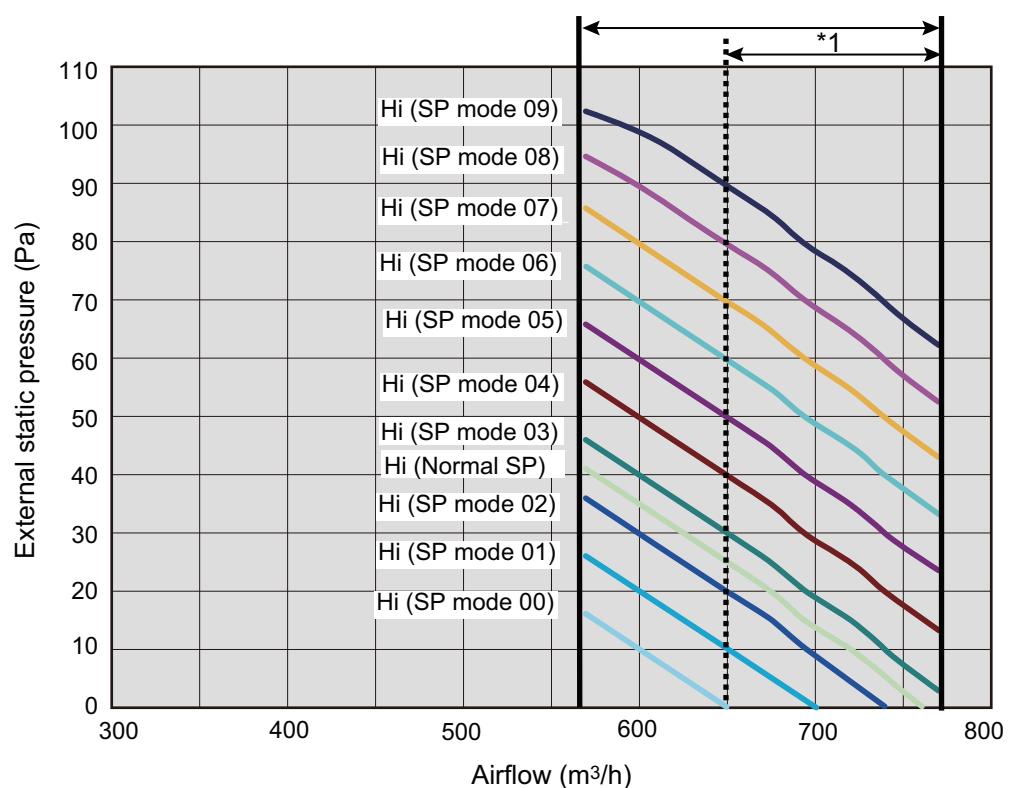


*1: Available airflow rate range when Auto louver grille (option) is installed.

Fan speed: HIGH


Vertical airflow direction louver: Up

● Characteristics of air volume and capacity


- Cooling

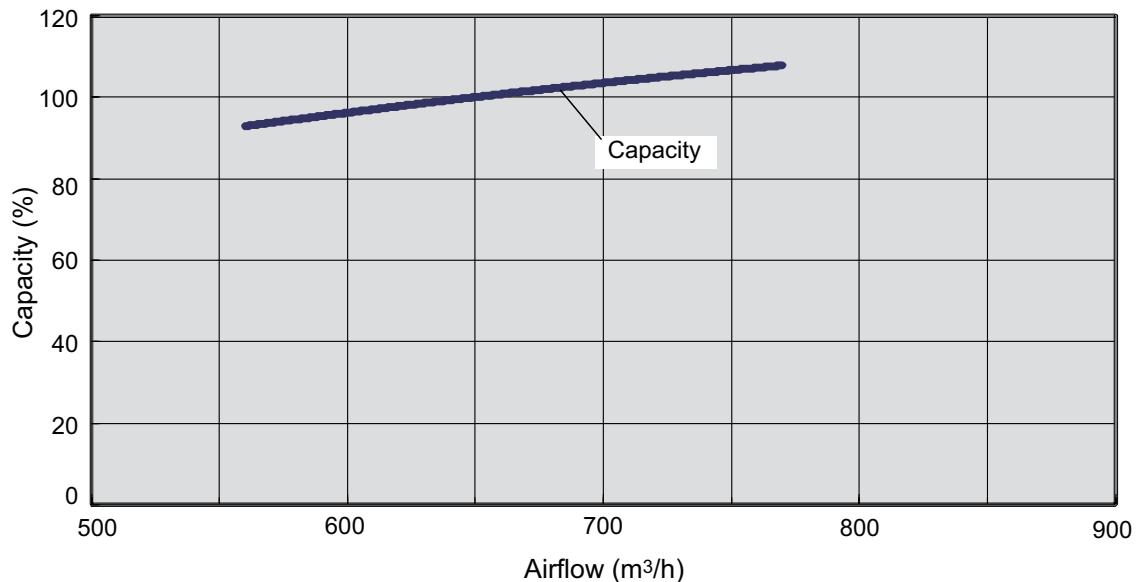

- Heating

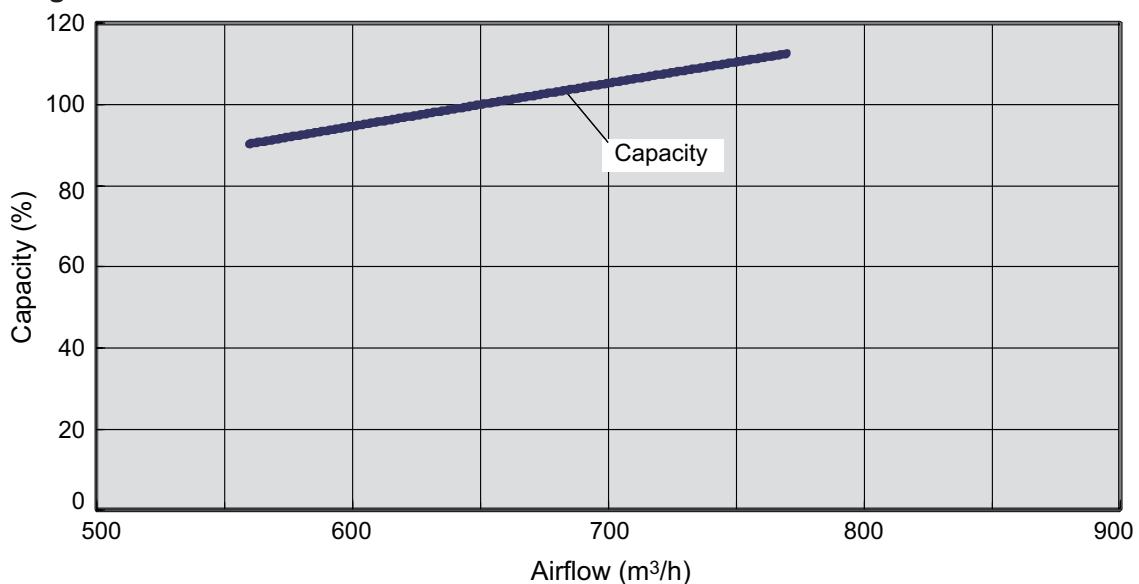


■ Model: ARXG14KLLAP

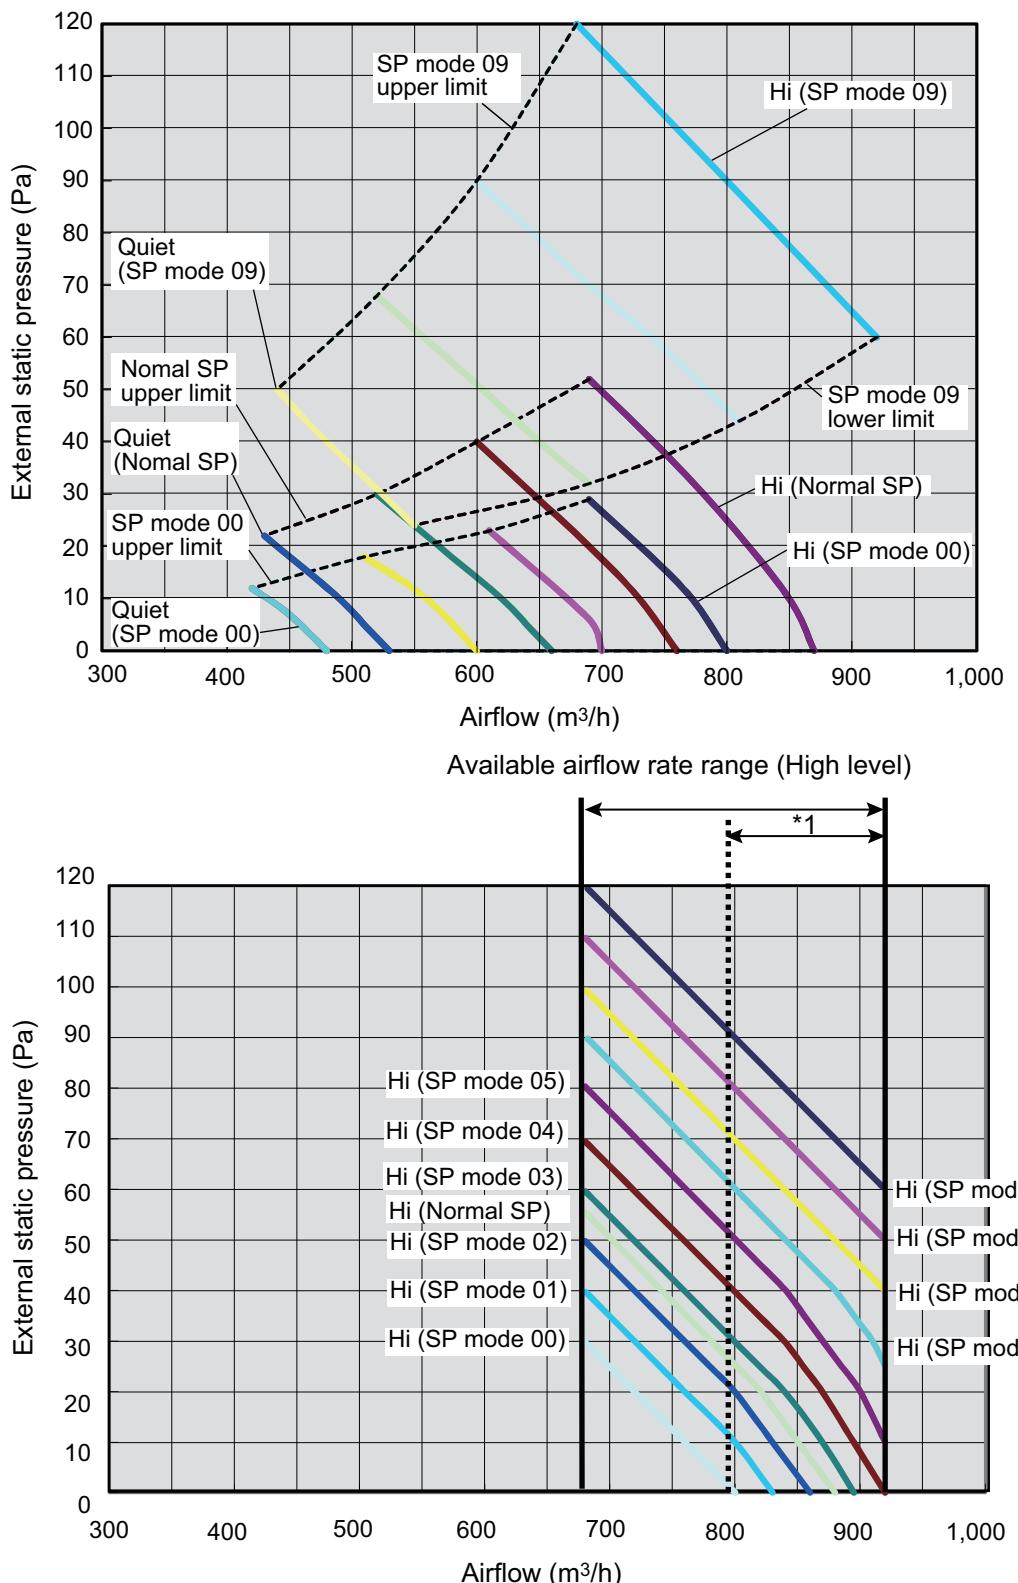


● Characteristics of air volume and capacity

- Cooling

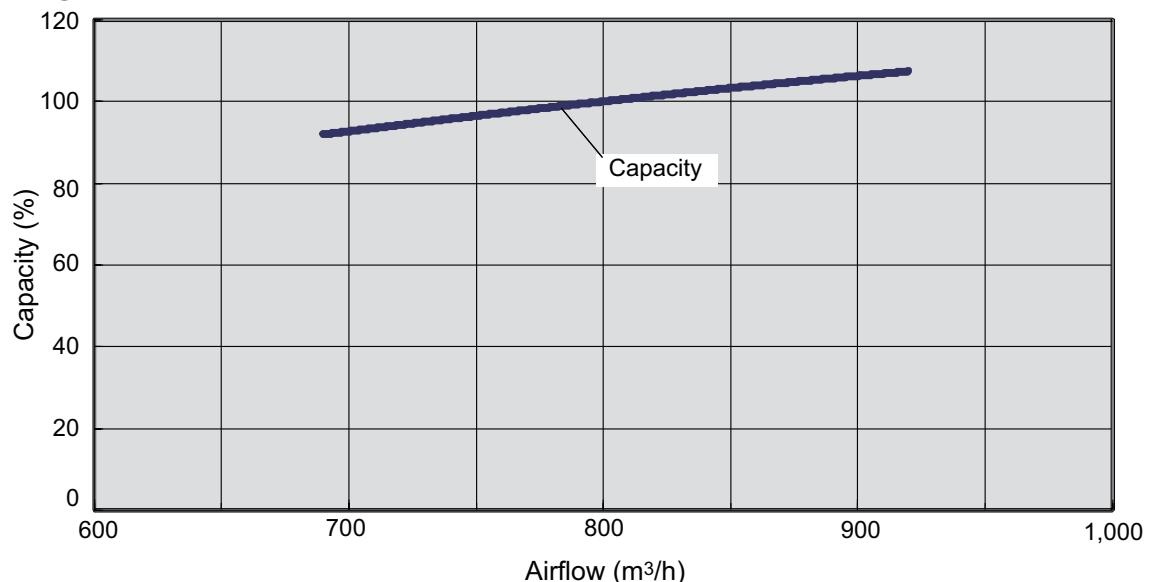


- Heating

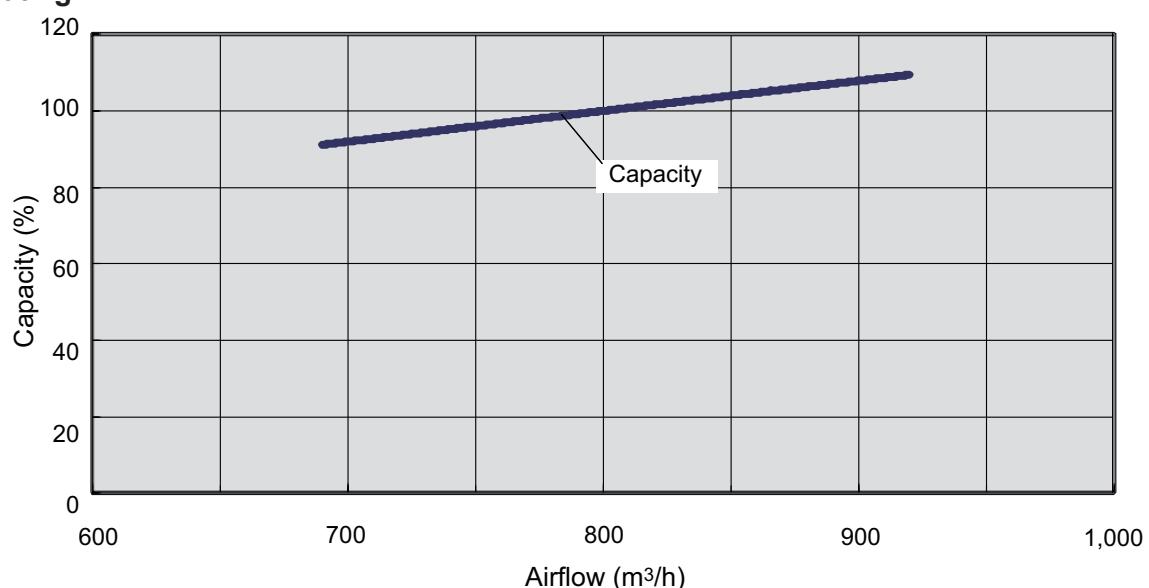

7-3. Medium static pressure duct type

■ Model: ARXH12KMTAP

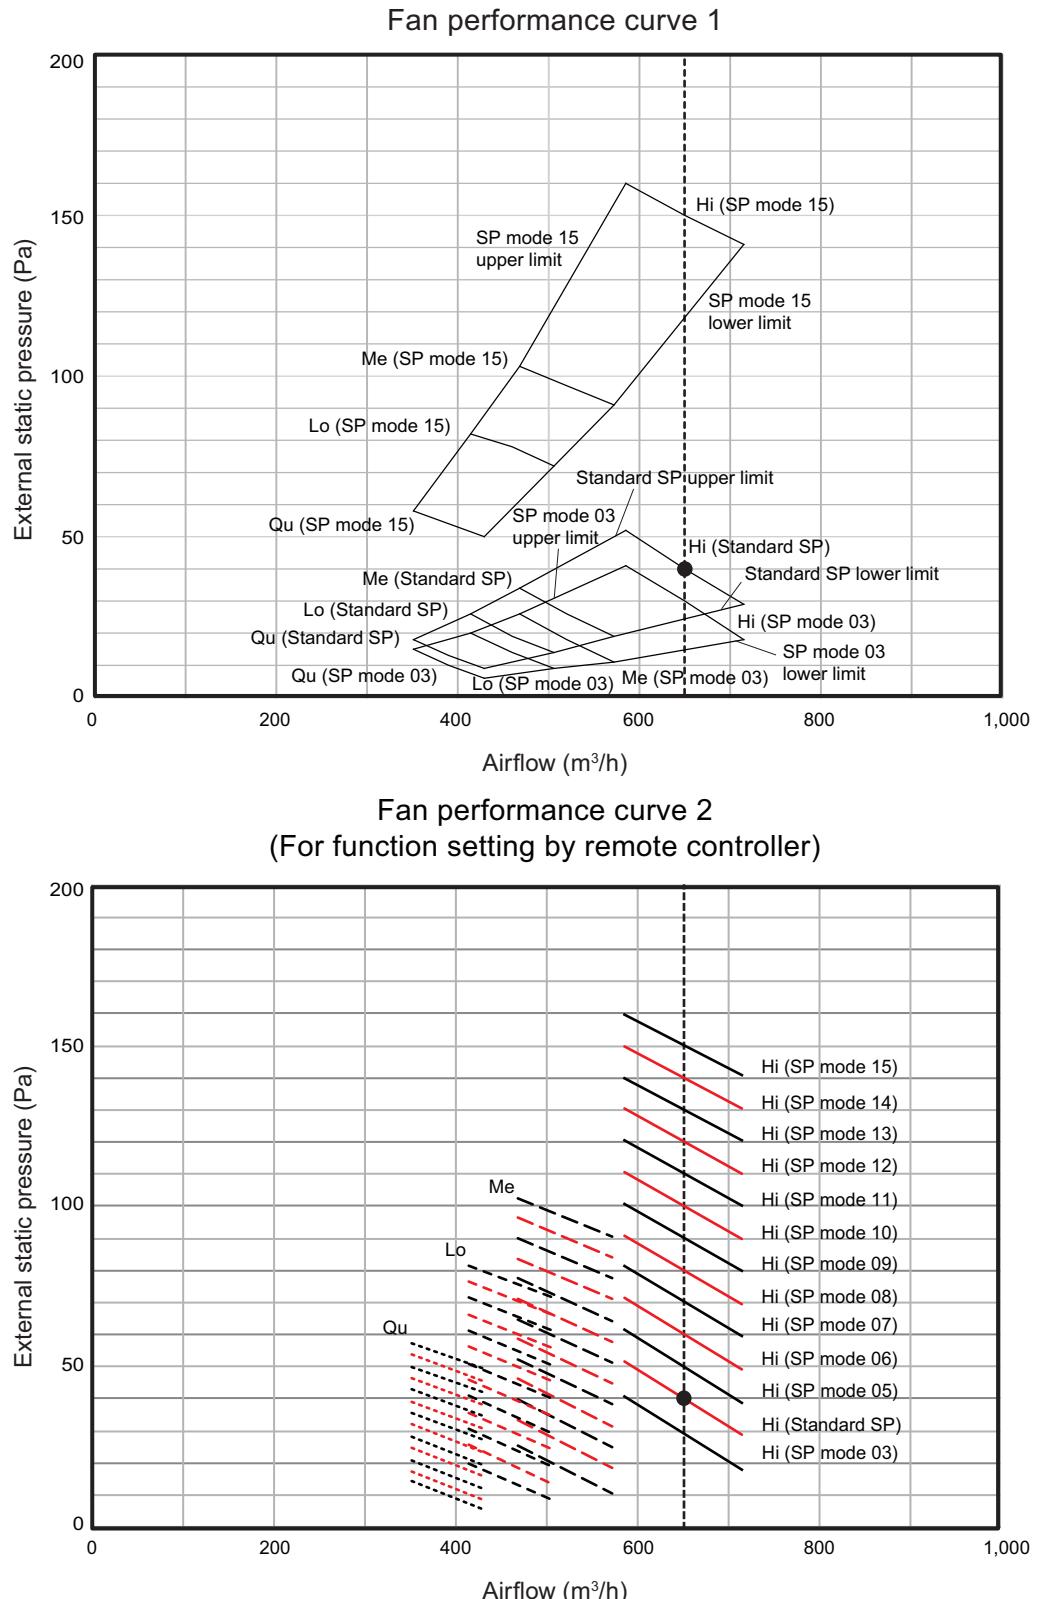


NOTES:


- Setting of the external static pressure is switchable into modes by using the remote controller.
- According to the resistance of the connecting duct, perform the setting of the external static pressure with referring "Fan performance curve 2" above.
- The default setting is set at "Standard SP".

● Characteristics of air volume and capacity

- Cooling

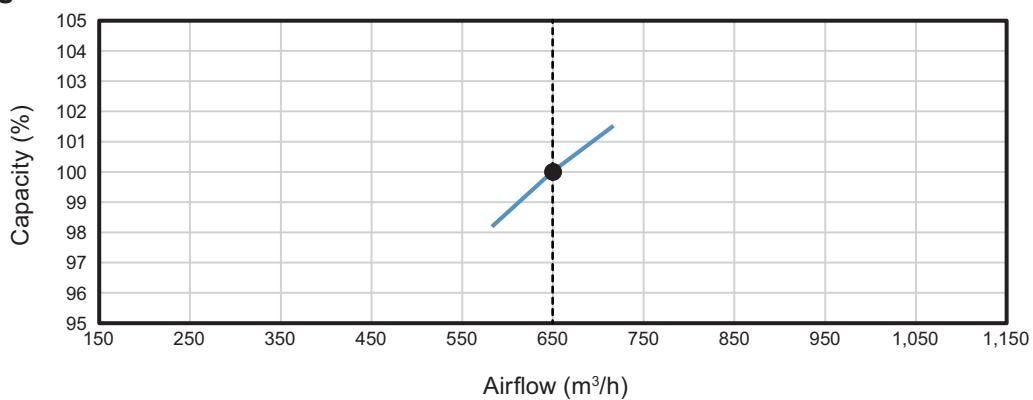


- Heating

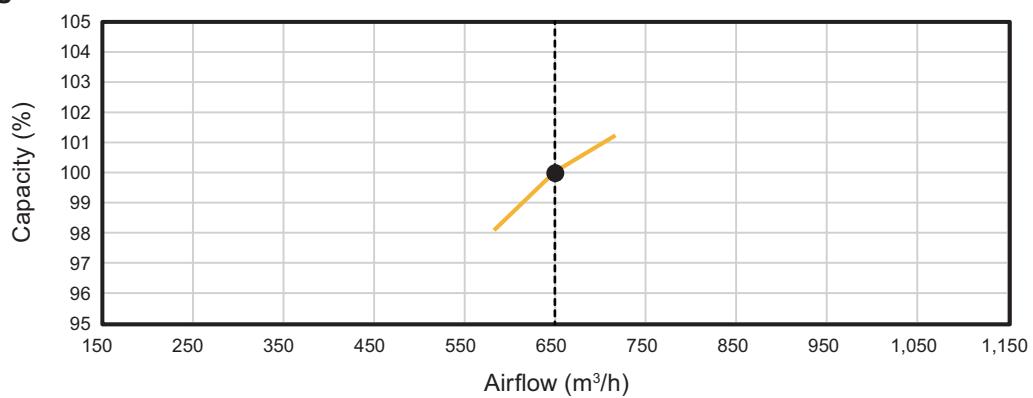


■ Model: ARXH14KMTAP

Fan performance curve 1

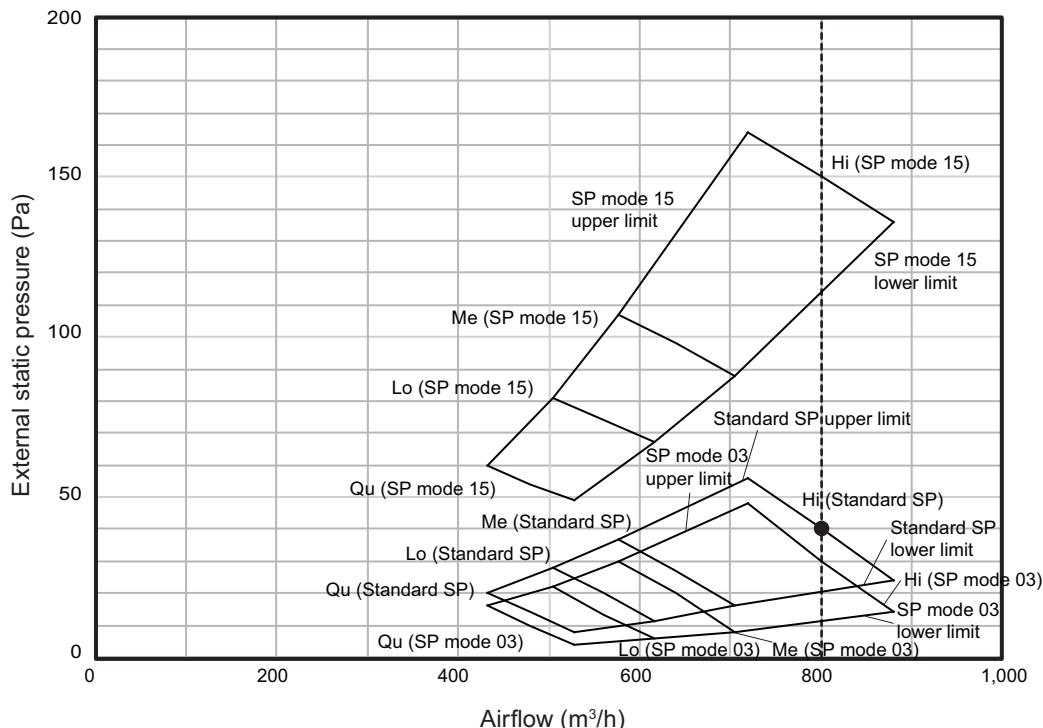

Fan performance curve 2
(For function setting by remote controller)

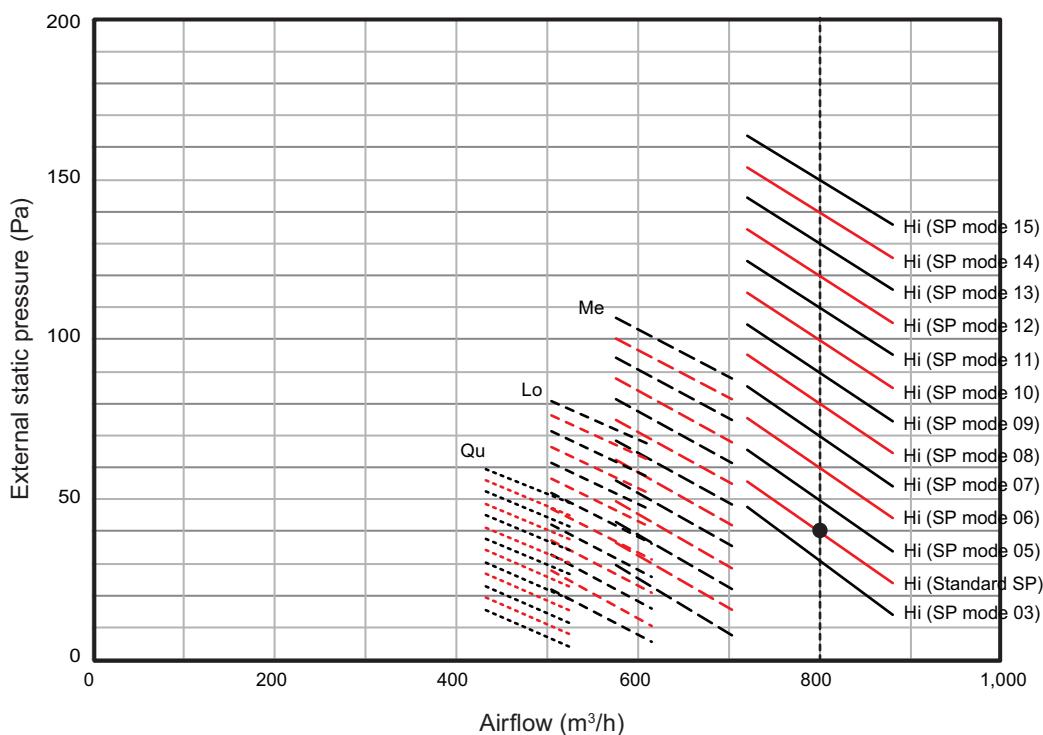


NOTES:


- Setting of the external static pressure is switchable into modes by using the remote controller.
- According to the resistance of the connecting duct, perform the setting of the external static pressure with referring "Fan performance curve 2" above.
- The default setting is set at "Standard SP".

● Characteristics of air volume and capacity

- Cooling

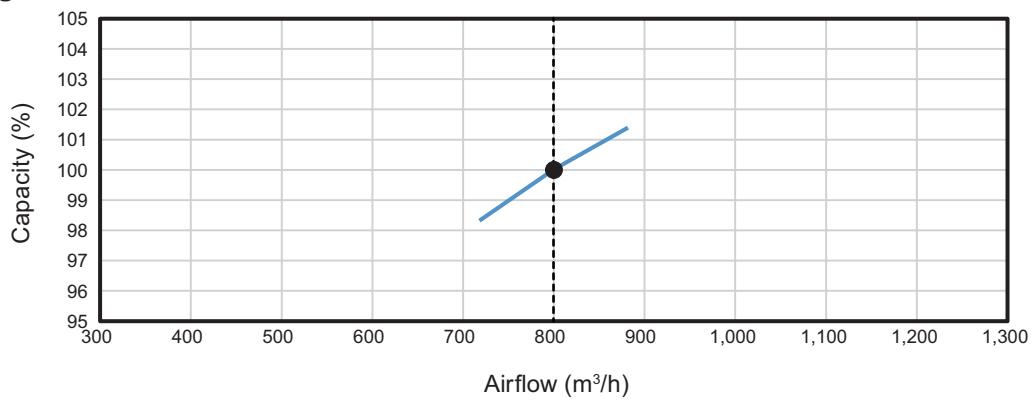

- Heating

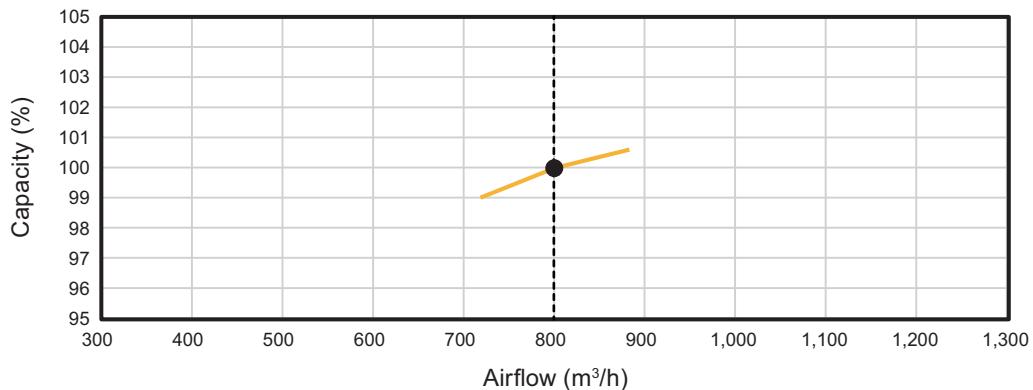

8. Airflow

Conversion factor:

- $1 \text{ m}^3/\text{h} = 0.2778 \text{ l/s} = 0.5886 \text{ CFM}$
- $3.6 \text{ m}^3/\text{h} = 1 \text{ l/s}$
- $1.699 \text{ m}^3/\text{h} = 1 \text{ CFM}$

8-1. Compact cassette type

Model	Operation mode	Fan speed	Airflow		
			m^3/h	l/s	CFM
AUXG07KVLA AUXG09KVLA	Cooling	High	540	150	318
		Med	490	136	288
		Low	440	122	259
		Quiet	390	108	230
	Heating	High	540	150	318
		Med	490	136	288
		Low	440	122	259
		Quiet	390	108	230
AUXG12KVLA	Cooling	High	610	169	359
		Med	530	147	312
		Low	470	131	277
		Quiet	410	114	241
	Heating	High	610	169	359
		Med	530	147	312
		Low	470	131	277
		Quiet	410	114	241
AUXG14KVLA	Cooling	High	680	189	400
		Med	580	161	341
		Low	490	136	288
		Quiet	410	114	241
	Heating	High	790	219	465
		Med	680	189	400
		Low	580	161	341
		Quiet	450	125	265

8-2. Mini duct type

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ARXG07KSLAP	Cooling	High	550	153	324
		Med	440	122	259
		Low	390	108	230
		Quiet	360	100	212
	Heating	High	550	153	324
		Med	440	122	259
		Low	390	108	230
		Quiet	360	100	212
ARXG09KSLAP	Cooling	High	600	167	353
		Med	450	125	265
		Low	400	111	235
		Quiet	360	100	212
	Heating	High	600	167	353
		Med	450	125	265
		Low	400	111	235
		Quiet	360	100	212
ARXG12KSLAP	Cooling	High	650	181	383
		Med	490	136	288
		Low	430	119	253
		Quiet	360	100	212
	Heating	High	650	181	383
		Med	490	136	288
		Low	430	119	253
		Quiet	360	100	212
ARXG14KSLAP	Cooling	High	800	222	471
		Med	640	178	377
		Low	530	147	312
		Quiet	360	100	212
	Heating	High	800	222	471
		Med	640	178	377
		Low	530	147	312
		Quiet	360	100	212

8-3. Slim duct type

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ARXG07KLLAP	Cooling	High	550	153	324
		Med	490	136	288
		Low	470	131	277
		Quiet	440	122	259
	Heating	High	550	153	324
		Med	490	136	288
		Low	470	131	277
		Quiet	440	122	259
ARXG09KLLAP	Cooling	High	600	167	353
		Med	550	153	324
		Low	500	139	294
		Quiet	450	125	265
	Heating	High	600	167	353
		Med	550	153	324
		Low	500	139	294
		Quiet	450	125	265
ARXG12KLLAP	Cooling	High	650	181	383
		Med	600	167	353
		Low	550	153	324
		Quiet	480	133	283
	Heating	High	650	181	383
		Med	600	167	353
		Low	550	153	324
		Quiet	480	133	283
ARXG14KLLAP	Cooling	High	800	222	471
		Med	700	194	412
		Low	600	167	353
		Quiet	480	133	283
	Heating	High	800	222	471
		Med	700	194	412
		Low	600	167	353
		Quiet	480	133	283

8-4. Medium static pressure duct type

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ARXH12KMTAP	Cooling	High	650	181	383
		Med	520	144	306
		Low	460	128	271
		Quiet	390	108	230
	Heating	High	650	181	383
		Med	520	144	306
		Low	460	128	271
		Quiet	390	108	230
ARXH14KMTAP	Cooling	High	800	222	471
		Med	640	178	377
		Low	560	156	330
		Quiet	480	133	283
	Heating	High	800	222	471
		Med	640	178	377
		Low	560	156	330
		Quiet	480	133	283

8-5. Wall mounted type

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ASHG07KMTB	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHG09KMTB	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194
ASHG12KMTB	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	770	214	453
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHG14KMTB	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	280	78	165
	Heating	High	800	222	471
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200
ASHG07KMCC	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHG09KMCC	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ASHG12KMCC	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	780	217	459
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHG14KMCC	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	310	86	182
	Heating	High	820	228	483
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200
ASHG07KMCE	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHG09KMCE	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194
ASHG12KMCE	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	780	217	459
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHG14KMCE	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	310	86	182
	Heating	High	820	228	483
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ASHG07KMCF	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHG09KMCF	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194
ASHG12KMCF	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	780	217	459
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHG14KMCF	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	310	86	182
	Heating	High	820	228	483
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200
ASHH07KMCG ASHH07KMCG-B	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHH09KMCG ASHH09KMCG-B	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ASHH12KMCG ASHH12KMCG-B	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	780	217	459
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHH14KMCG ASHH14KMCG-B	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	310	86	182
	Heating	High	820	228	483
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200
ASHH07KMCH ASHH07KMCH-B	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHH09KMCH ASHH09KMCH-B	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194
ASHH12KMCH ASHH12KMCH-B	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	320	89	188
	Heating	High	780	217	459
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHH14KMCH ASHH14KMCH-B	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	310	86	182
	Heating	High	820	228	483
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ASHG07KETA ASHG07KETA-B	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHG09KETA ASHG09KETA-B	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194
ASHG12KETA ASHG12KETA-B	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	770	214	453
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHG14KETA ASHG14KETA-B	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	280	78	165
	Heating	High	800	222	471
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200
ASHG07KETE ASHG07KETE-B	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHG09KETE ASHG09KETE-B	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ASHG12KETE ASHG12KETE-B	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	770	214	453
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHG14KETE ASHG14KETE-B	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	280	78	165
	Heating	High	800	222	471
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200
ASHG07KETF ASHG07KETF-B	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHG09KETF ASHG09KETF-B	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194
ASHG12KETF ASHG12KETF-B	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	770	214	453
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHG14KETF ASHG14KETF-B	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	280	78	165
	Heating	High	800	222	471
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ASHG07KGTB	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHG09KGTB	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194
ASHG12KGTB	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	770	214	453
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHG14KGTB	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	280	78	165
	Heating	High	800	222	471
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200
ASHG07KGTE	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHG09KGTE	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ASHG12KGTE	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	770	214	453
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHG14KGTE	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	280	78	165
	Heating	High	800	222	471
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200
ASHG07KGTF	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHG09KGTF	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194
ASHG12KGTF	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	770	214	453
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHG14KGTF	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	280	78	165
	Heating	High	800	222	471
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ASHH07KG TG	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHH09KG TG	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194
ASHH12KG TG	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	770	214	453
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHH14KG TG	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	280	78	165
	Heating	High	800	222	471
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200
ASHH07KG TH	Cooling	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	720	200	424
		Med	580	161	341
		Low	460	128	271
		Quiet	330	92	194
ASHH09KG TH	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	750	208	441
		Med	610	169	359
		Low	470	131	277
		Quiet	330	92	194

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ASHH12KGTH	Cooling	High	700	194	412
		Med	560	156	330
		Low	430	119	253
		Quiet	270	75	159
	Heating	High	770	214	453
		Med	640	178	377
		Low	520	144	306
		Quiet	330	92	194
ASHH14KGTH	Cooling	High	770	214	453
		Med	600	167	353
		Low	450	125	265
		Quiet	280	78	165
	Heating	High	800	222	471
		Med	660	183	388
		Low	520	144	306
		Quiet	340	94	200
ASHH05KNCA	Cooling	High	500	139	294
		Med	450	125	265
		Low	390	108	230
		Quiet	250	69	147
	Heating	High	500	139	294
		Med	450	125	265
		Low	420	117	247
		Quiet	280	78	165
ASHH07KNCA	Cooling	High	530	147	312
		Med	460	128	271
		Low	390	108	230
		Quiet	250	69	147
	Heating	High	530	147	312
		Med	460	128	271
		Low	420	117	247
		Quiet	280	78	165
ASHH09KNCA	Cooling	High	640	178	377
		Med	500	139	294
		Low	390	108	230
		Quiet	250	69	147
	Heating	High	640	178	377
		Med	500	139	294
		Low	420	117	247
		Quiet	280	78	165
ASHH12KNCA	Cooling	High	660	183	388
		Med	520	144	306
		Low	440	122	259
		Quiet	250	69	147
	Heating	High	660	183	388
		Med	520	144	306
		Low	440	122	259
		Quiet	280	78	165

Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
ASHH05KNCH	Cooling	High	500	139	294
		Med	450	125	265
		Low	390	108	230
		Quiet	250	69	147
	Heating	High	500	139	294
		Med	450	125	265
		Low	420	117	247
		Quiet	280	78	165
ASHH07KNCH	Cooling	High	530	147	312
		Med	460	128	271
		Low	390	108	230
		Quiet	250	69	147
	Heating	High	530	147	312
		Med	460	128	271
		Low	420	117	247
		Quiet	280	78	165
ASHH09KNCH	Cooling	High	640	178	377
		Med	500	139	294
		Low	390	108	230
		Quiet	250	69	147
	Heating	High	640	178	377
		Med	500	139	294
		Low	420	117	247
		Quiet	280	78	165
ASHH12KNCH	Cooling	High	660	183	388
		Med	520	144	306
		Low	440	122	259
		Quiet	250	69	147
	Heating	High	660	183	388
		Med	520	144	306
		Low	440	122	259
		Quiet	280	78	165

8-6. Floor type


Model	Operation mode	Fan speed	Airflow		
			m ³ /h	l/s	CFM
AGHG09KVCA	Cooling	High	530	147	312
		Med	440	111	235
		Low	360	100	212
		Quiet	270	75	159
	Heating	High	530	147	312
		Med	460	128	271
		Low	380	106	224
		Quiet	270	75	159
AGHG12KVCA	Cooling	High	600	167	353
		Med	490	136	288
		Low	380	106	224
		Quiet	270	75	159
	Heating	High	600	167	353
		Med	510	142	300
		Low	410	114	241
		Quiet	270	75	159
AGHG14KVCA	Cooling	High	650	181	383
		Med	520	144	306
		Low	400	131	277
		Quiet	270	75	159
	Heating	High	650	181	383
		Med	540	150	318
		Low	430	119	253
		Quiet	270	75	159

9. Noise level curve


9-1. Compact cassette type

■ Model: AUXG07KVLA

● Cooling

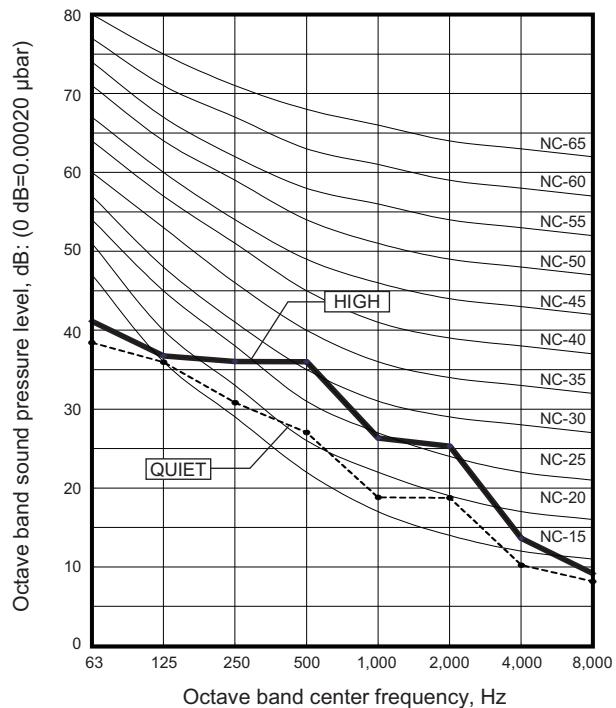


● Heating

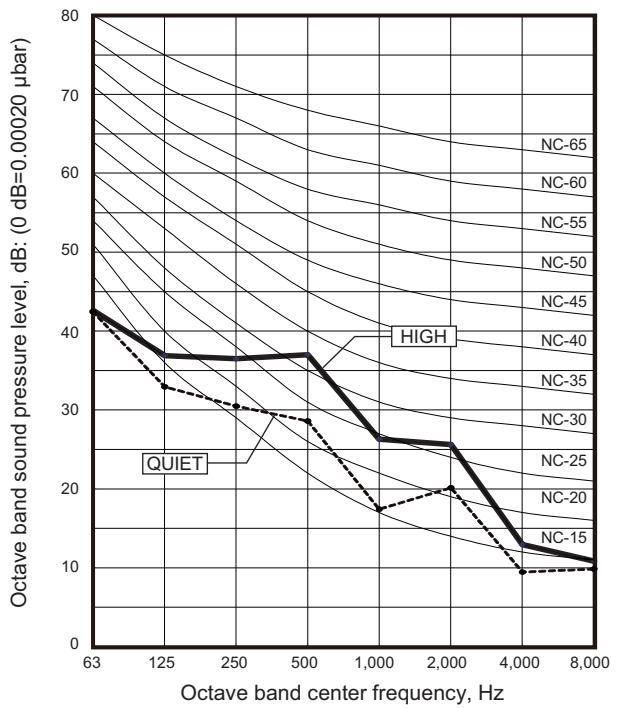






■ Model: AUXG09KVLA

● Cooling

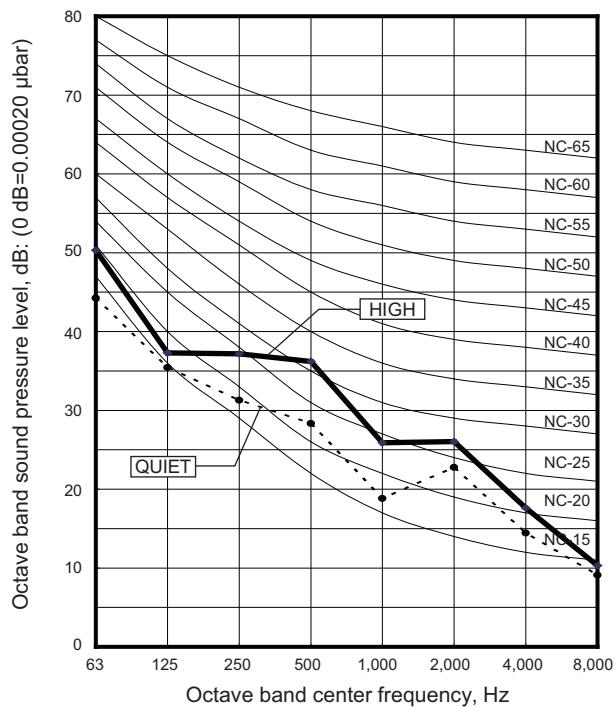

● Heating

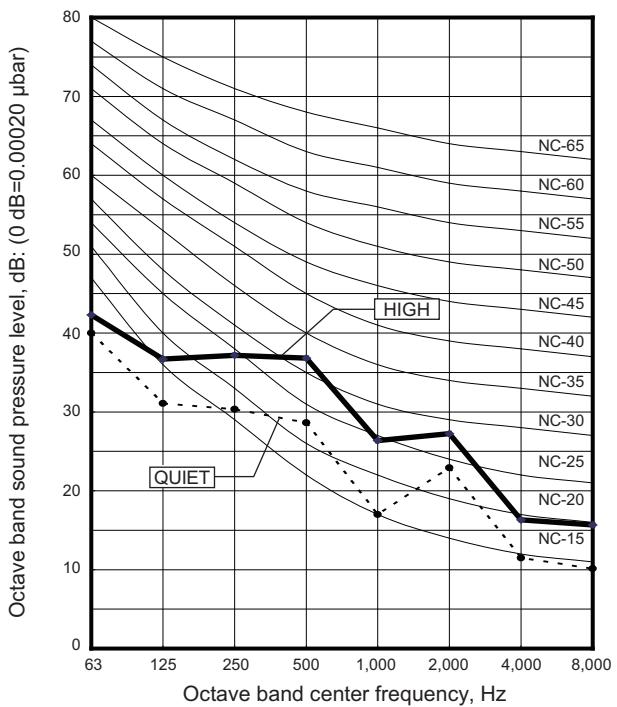


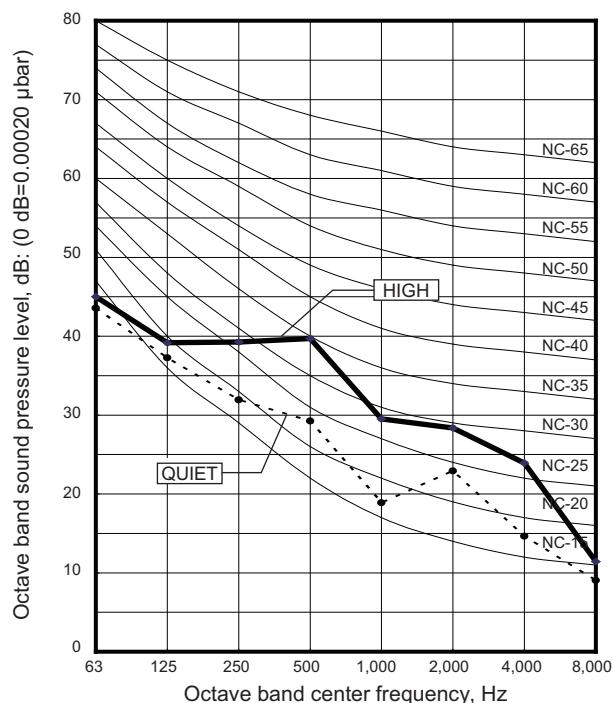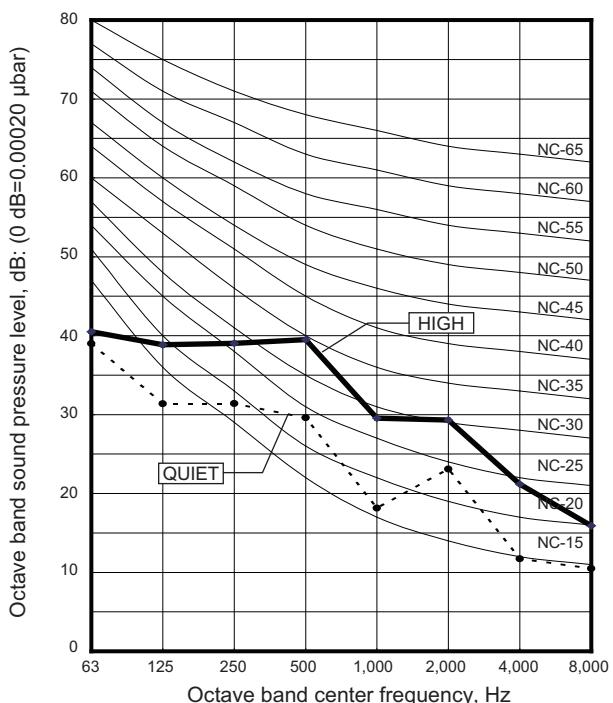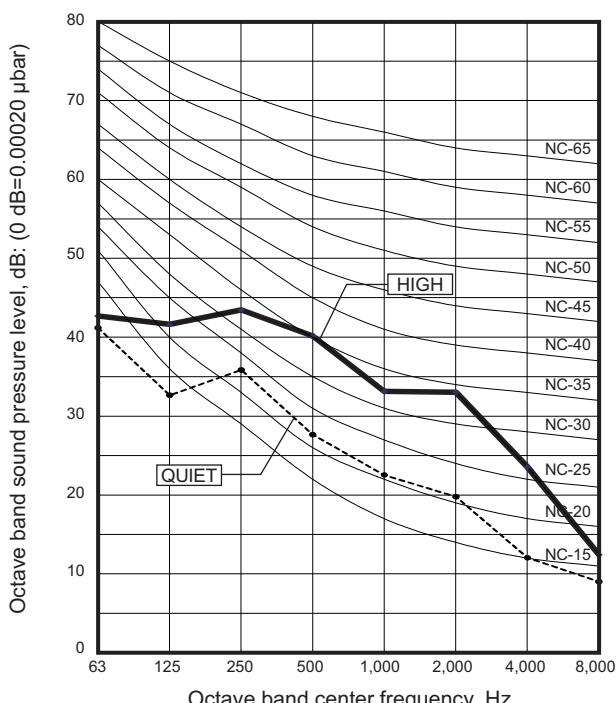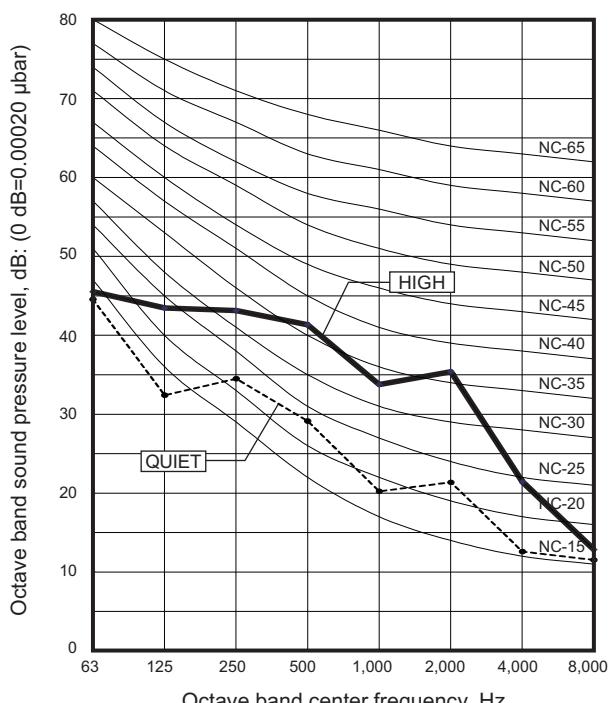■ Model: AUXG12KVLA**● Cooling****● Heating****■ Model: AUXG14KVLA****● Cooling****● Heating**


9-2. Mini duct type

■ Model: ARXG07KSLAP

● Cooling

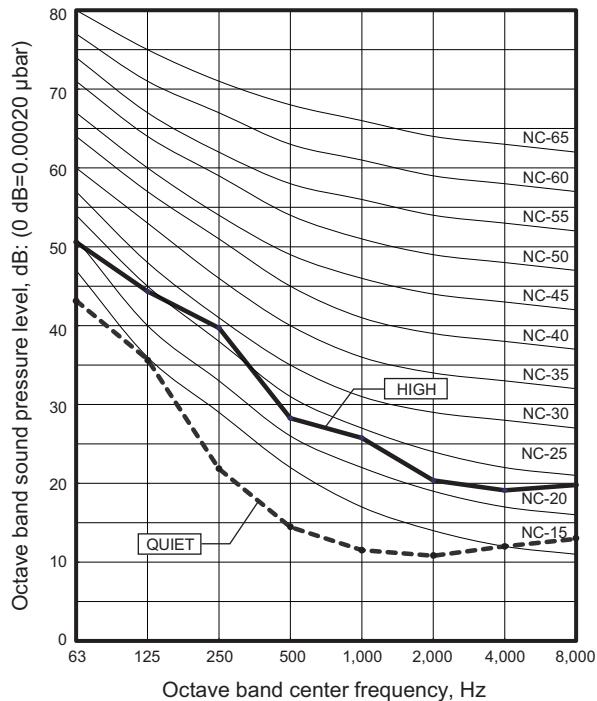


● Heating

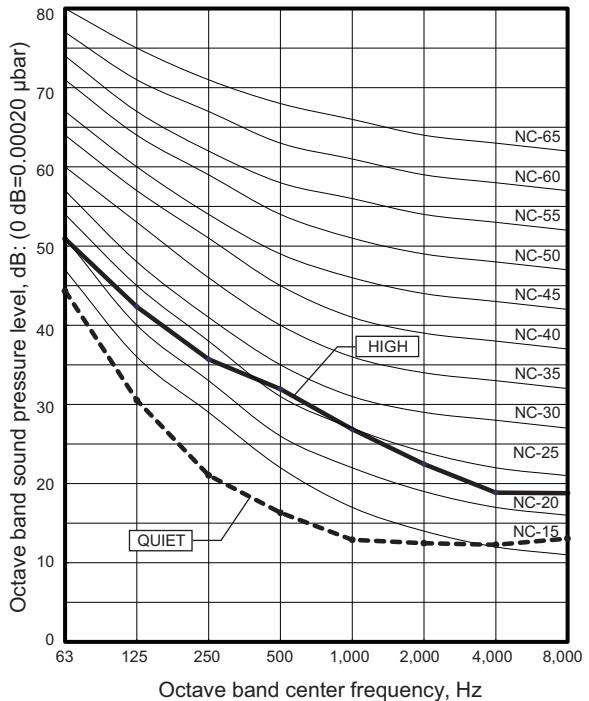






■ Model: ARXG09KSLAP

● Cooling

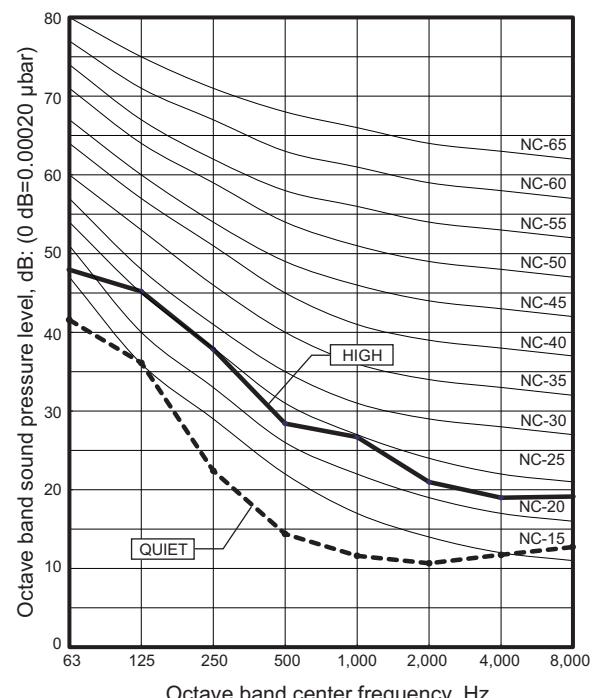

● Heating

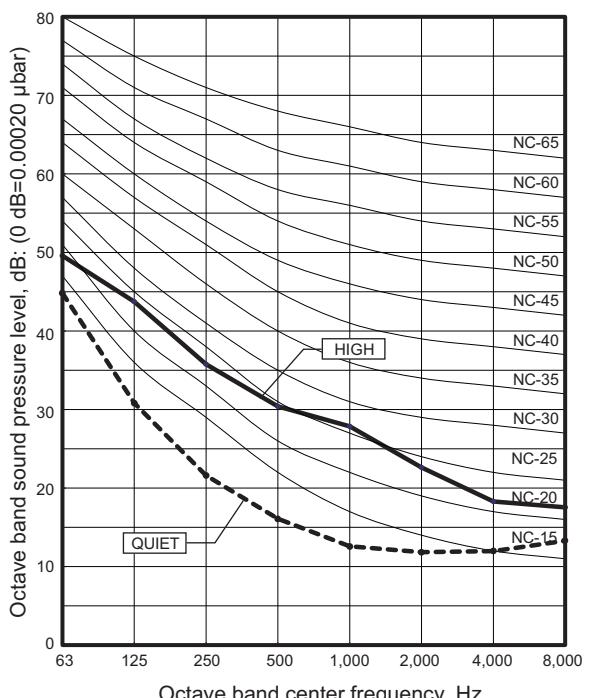


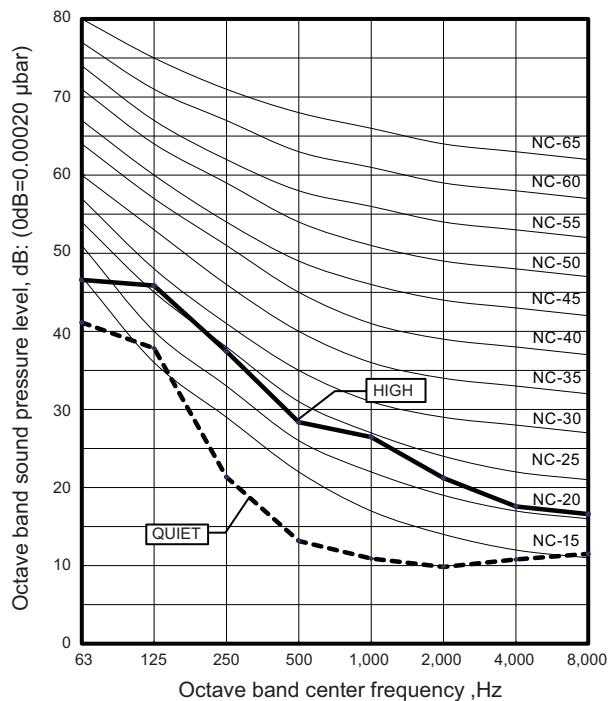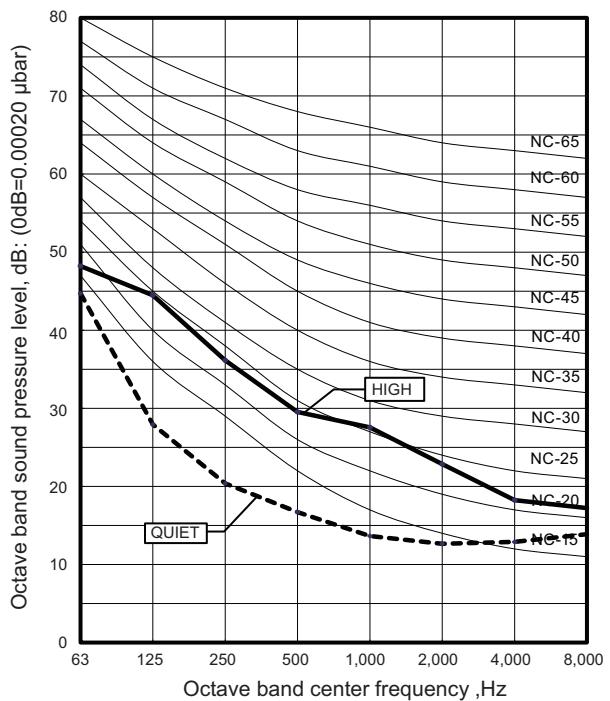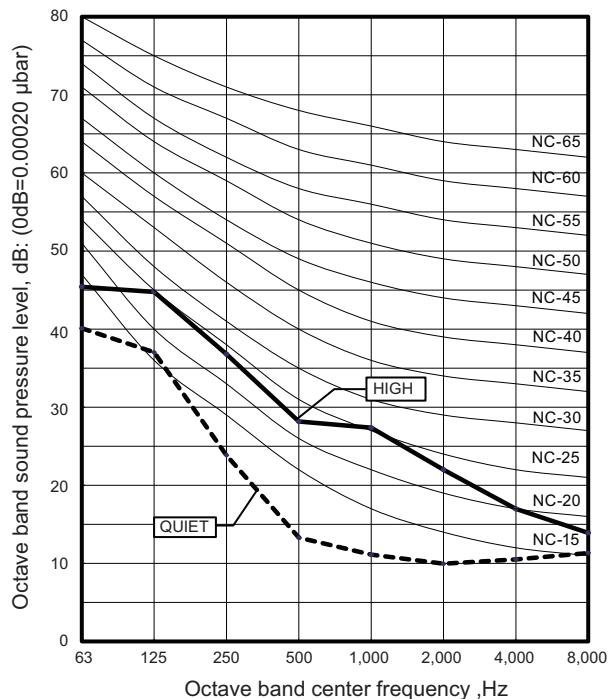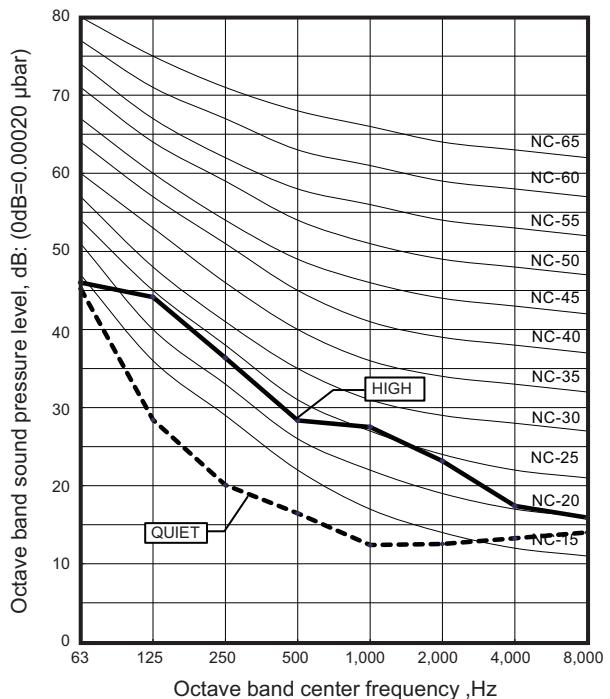■ Model: ARXG12KSLAP**● Cooling****● Heating****■ Model: ARXG14KSLAP****● Cooling****● Heating**


9-3. Slim duct type

■ Model: ARXG07KLLAP

● Cooling

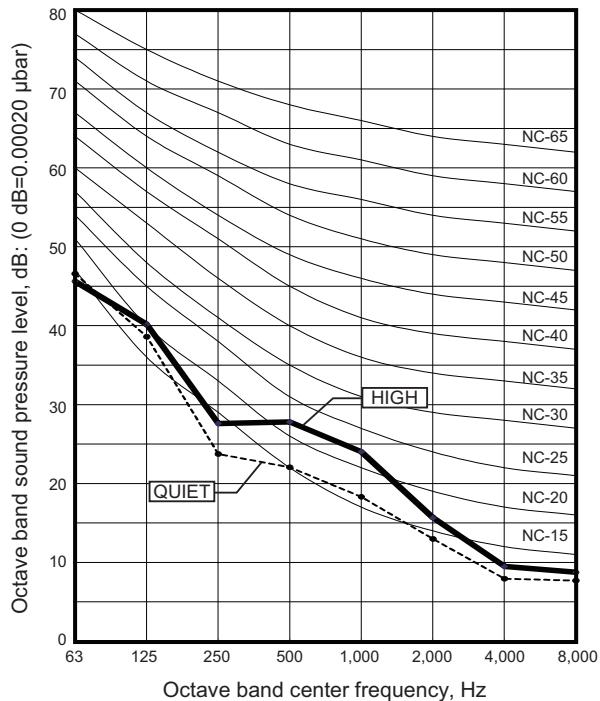


● Heating

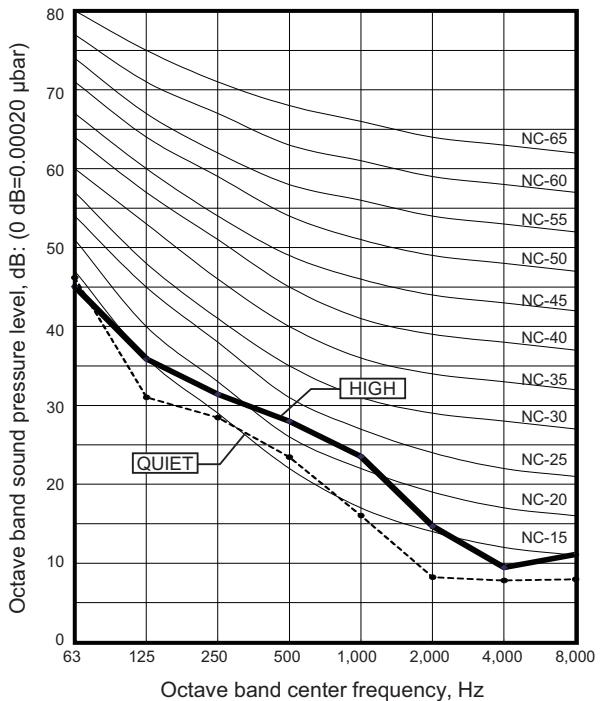






■ Model: ARXG09KLLAP

● Cooling

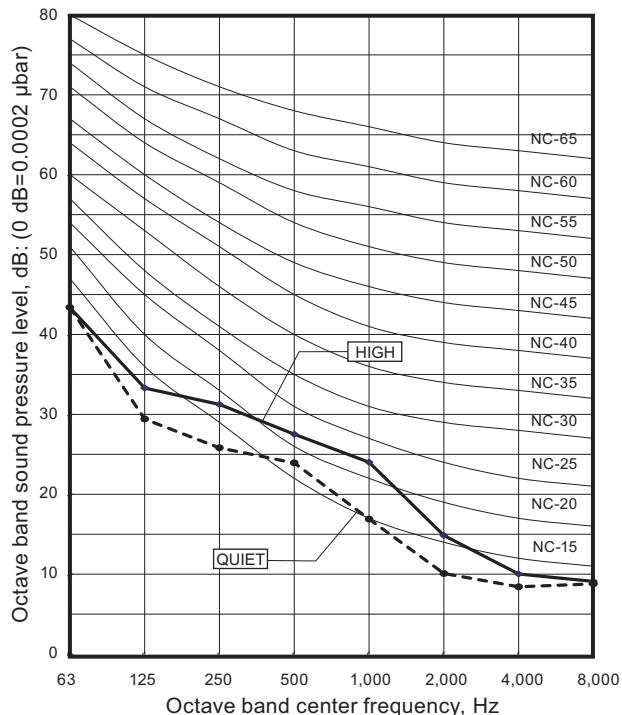

● Heating

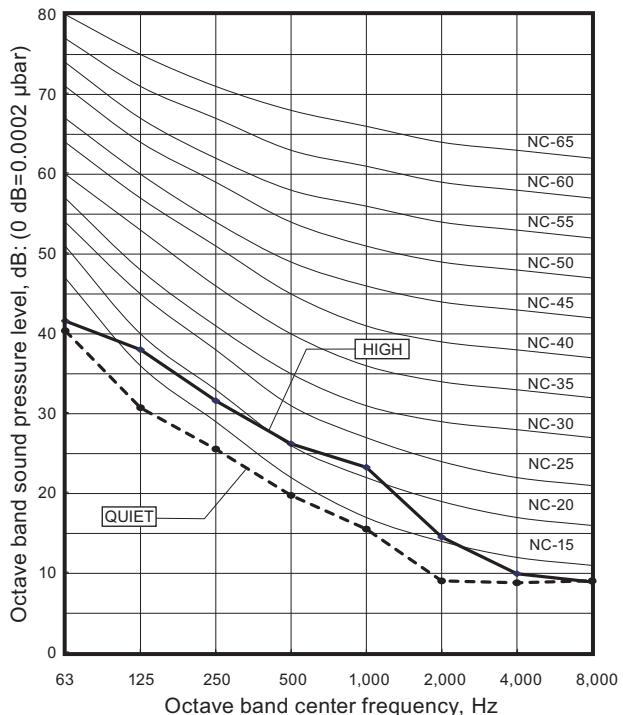


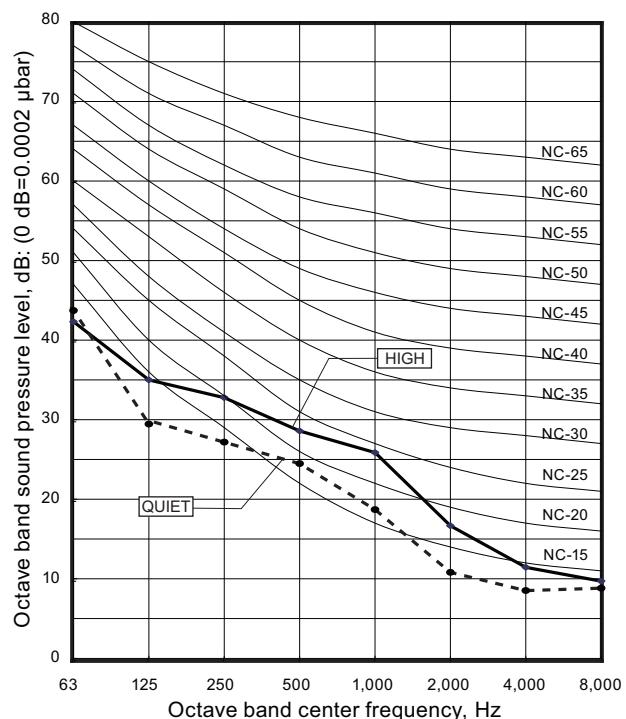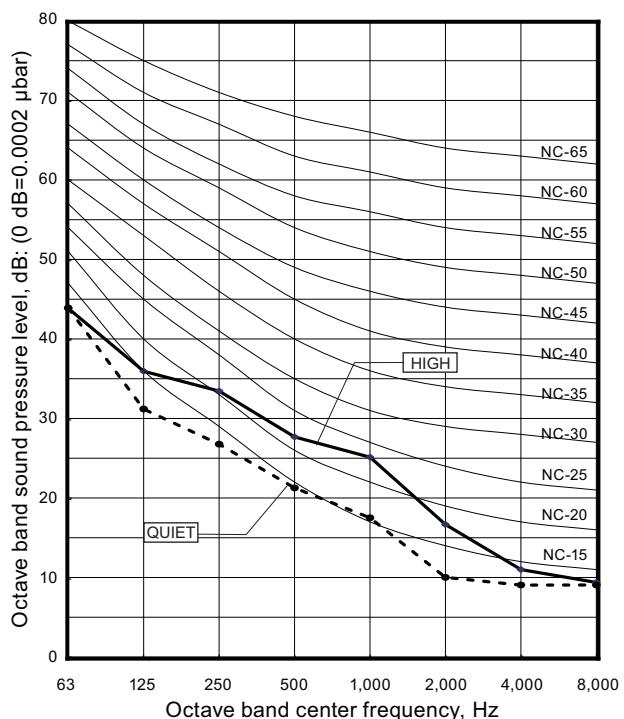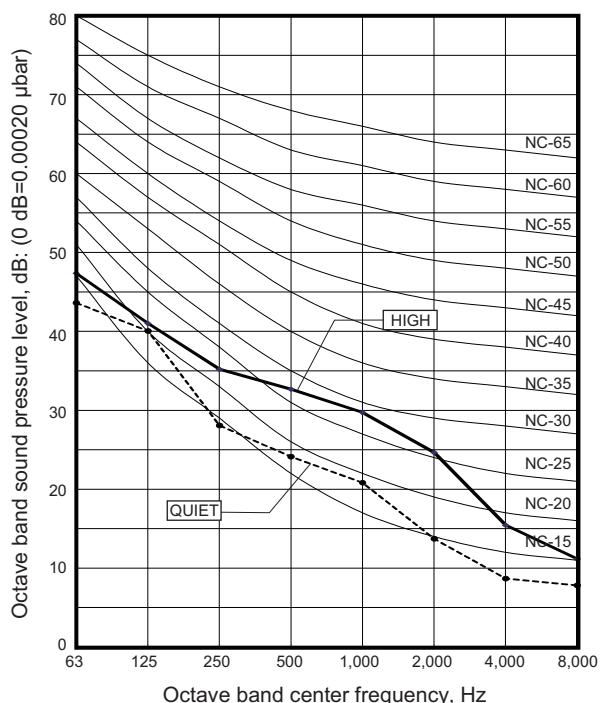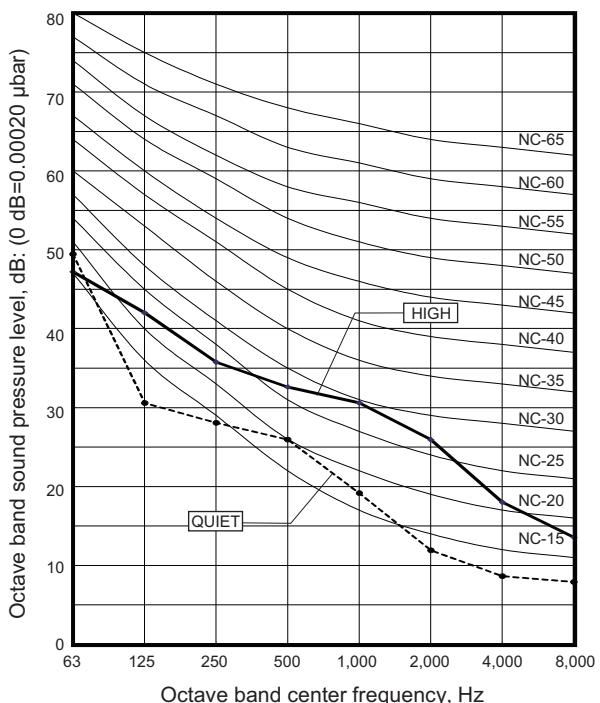■ Model: ARXG12KLLAP**● Cooling****● Heating****■ Model: ARXG14KLLAP****● Cooling****● Heating**


9-4. Medium static pressure duct type

■ Model: ARXH12KMTAP

● Cooling

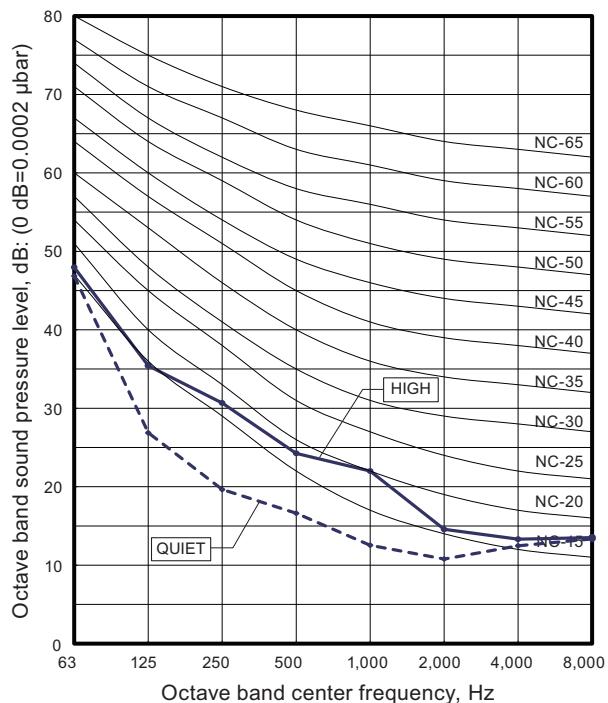


● Heating

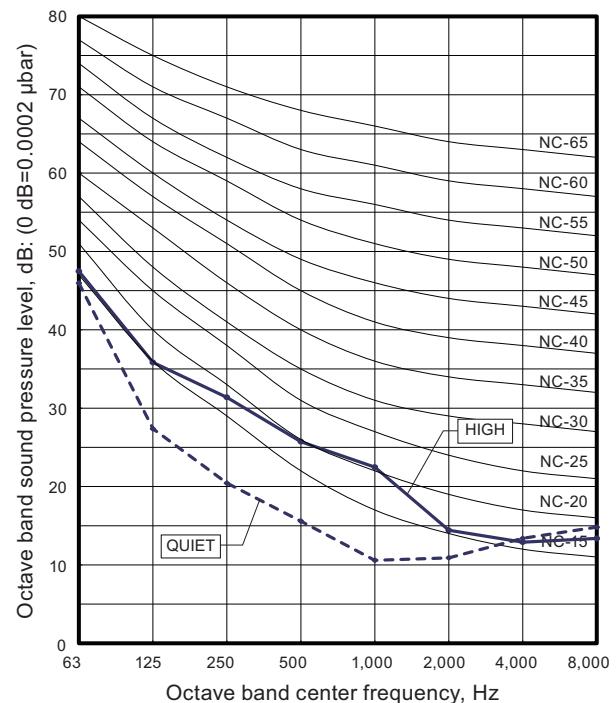


■ Model: ARXH14KMTAP

● Cooling

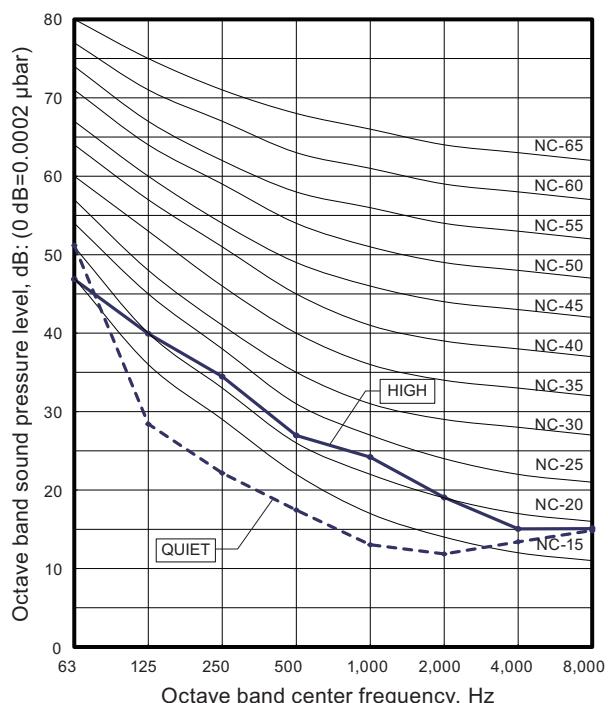


● Heating

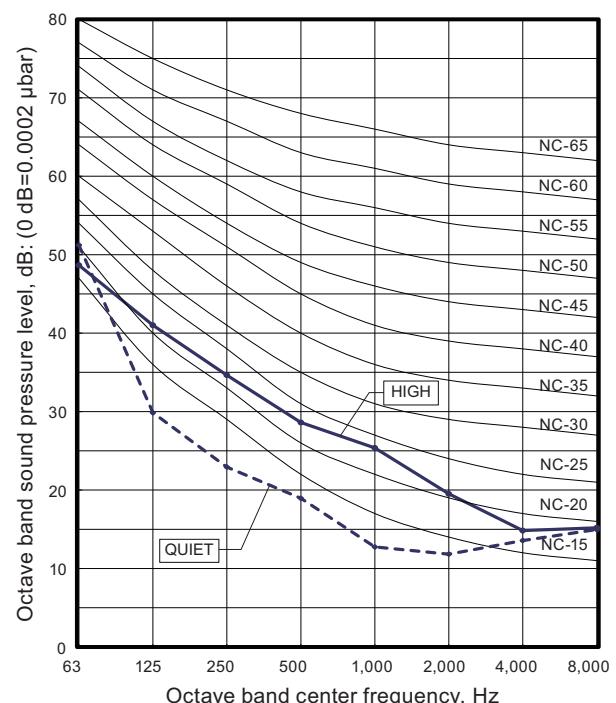


9-5. Wall mounted type

■ Models: ASHG07KMTB, ASHG07KMCC, ASHG07KMCE, ASHG07KMCF, ASHH07KMCG, ASHH07KMCG-B, ASHH07KMCH, ASHH07KMCH-B, ASHG07KETA, ASHG07KETA-B, ASHG07KETE, ASHG07KETE-B, ASHG07KETF, and ASHG07KETF-B

● Cooling

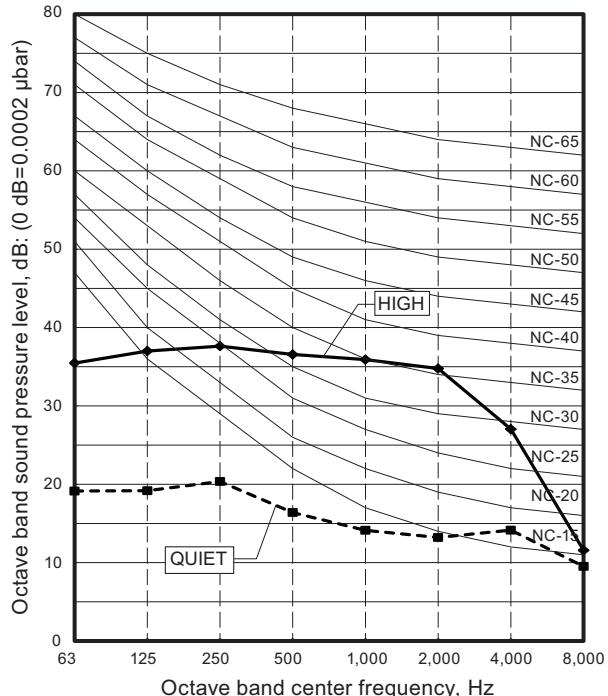


● Heating

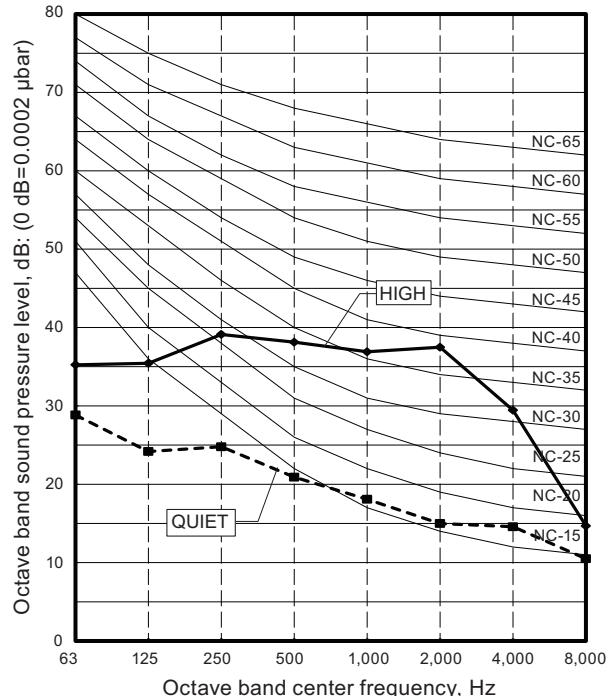


**■ Models: ASHG09KMTB, ASHG09KMCC, ASHG09KMCE,
ASHG09KMCF, ASHH09KMCG, ASHH09KMCG-B,
ASHH09KMCH, ASHH09KMCH-B, ASHG09KETA, ASHG09KETA-B,
ASHG09KETE, ASHG09KETE-B, ASHG09KETF, and
ASHG09KETF-B**

● Cooling

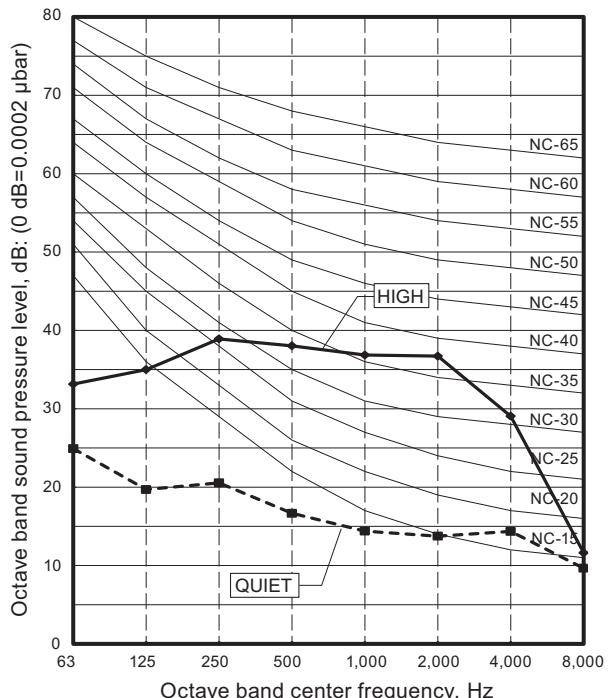


● Heating

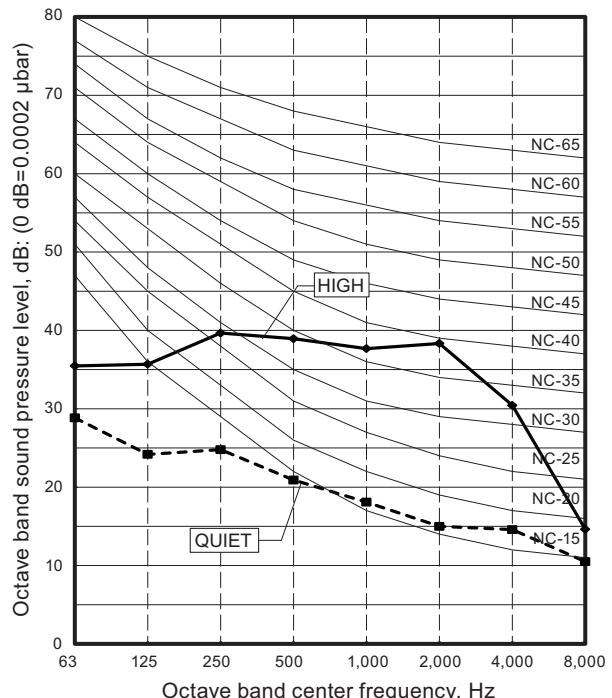


**■ Models: ASHG12KMTB, ASHG12KMCC, ASHG12KMCE,
ASHG12KMCF, ASHH12KMCG, ASHH12KMCG-B,
ASHH12KMCH, ASHH12KMCH-B, ASHG12KETA, ASHG12KETA-B,
ASHG12KETE, ASHG12KETE-B, ASHG12KETF, and
ASHG12KETF-B**

● Cooling

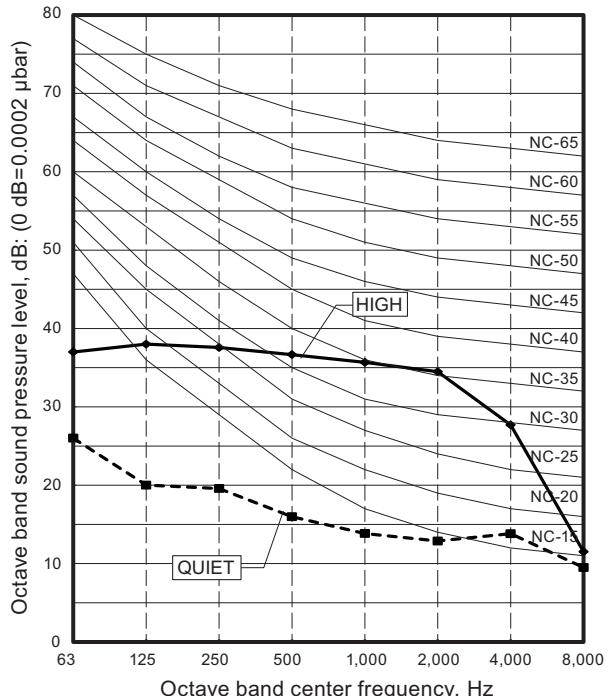


● Heating

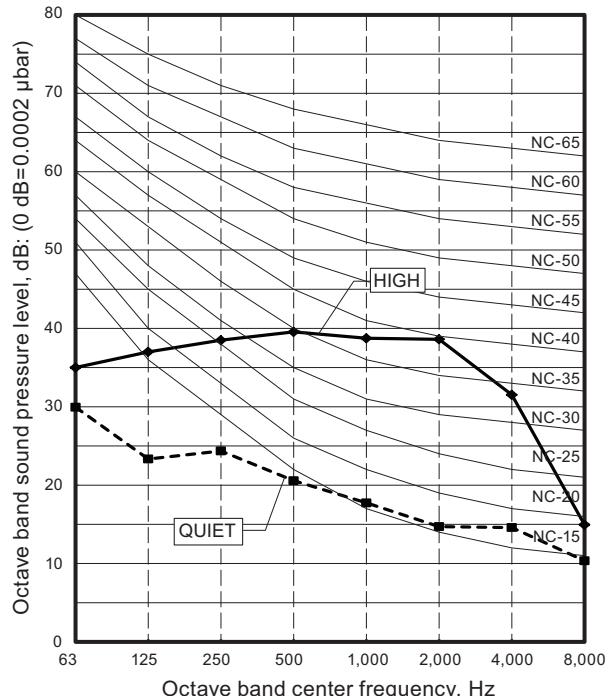


**■ Models: ASHG14KMTB, ASHG14KMCC, ASHG14KMCE,
ASHG14KMCF, ASHH14KMCG, ASHH14KMCG-B,
ASHH14KMCH, ASHH14KMCH-B, ASHG14KETA, ASHG14KETA-B,
ASHG14KETE, ASHG14KETE-B, ASHG14KETF, and
ASHG14KETF-B**

● Cooling

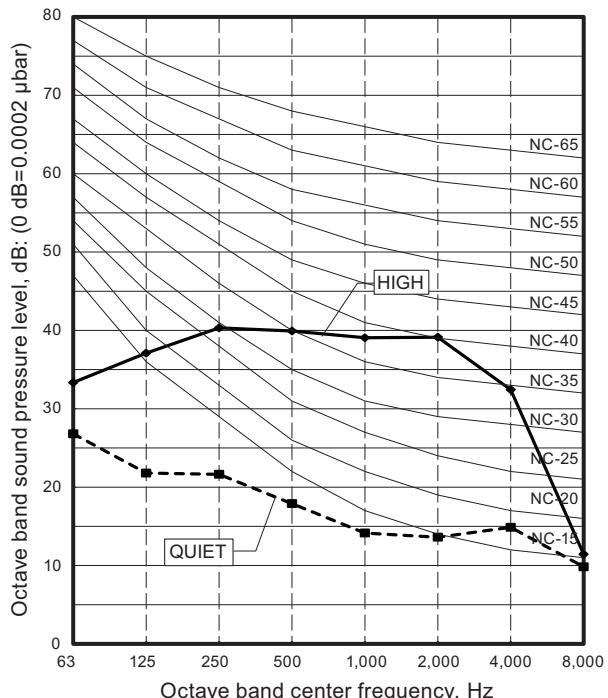


● Heating

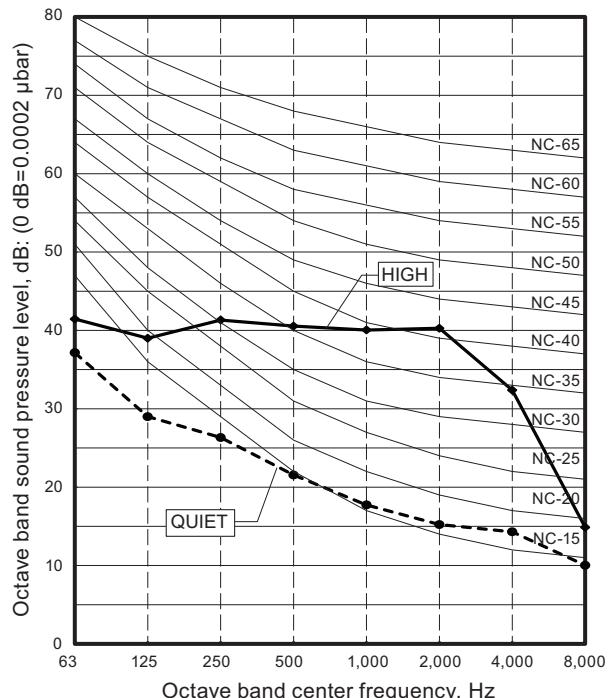


■ Models: ASHG07KGTB, ASHG07KGTE, ASHG07KGTF,
ASHH07KG TG, and ASHH07KGTH

● Cooling

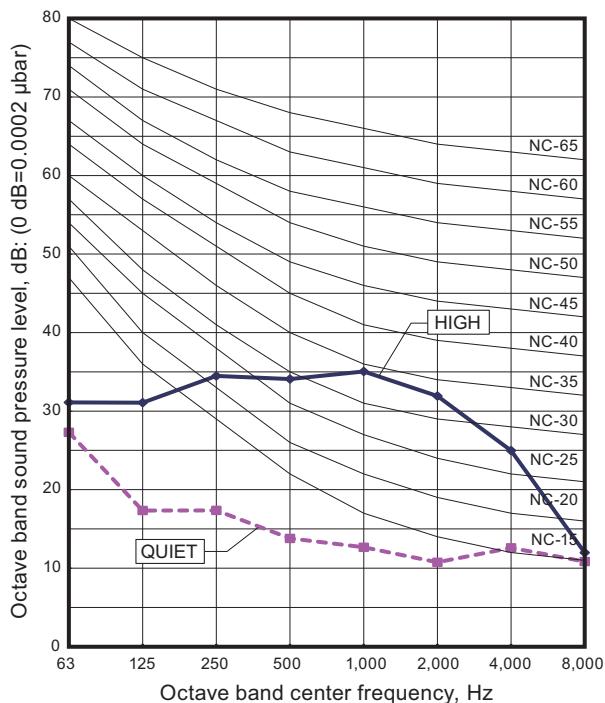


● Heating

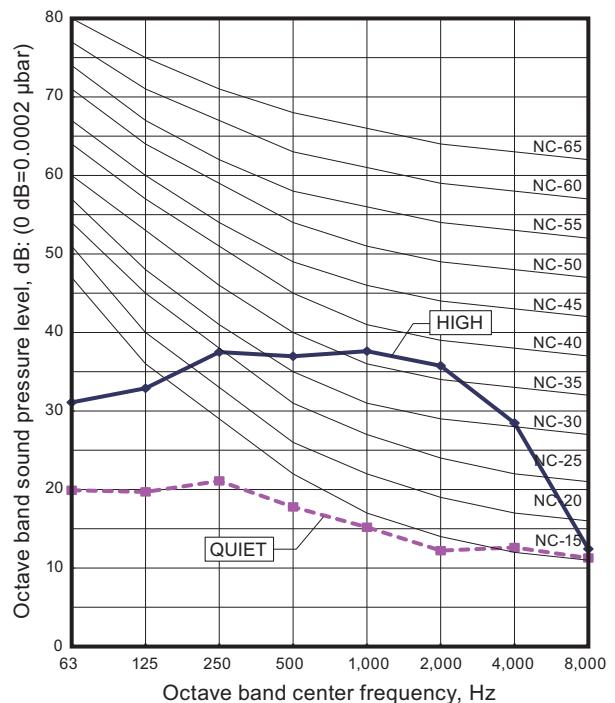


■ Models: ASHG09KG TB, ASHG09KG TE, ASHG09KG TF,
ASHH09KG TG, and ASHH09KG TH

● Cooling

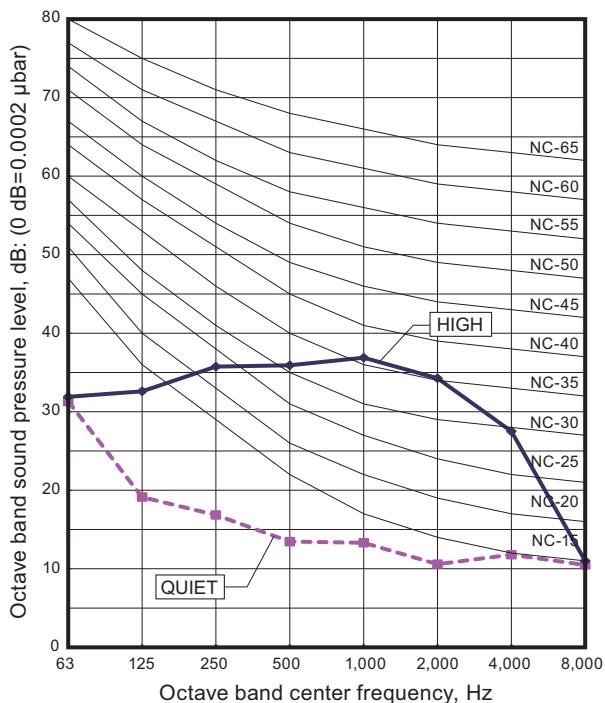


● Heating

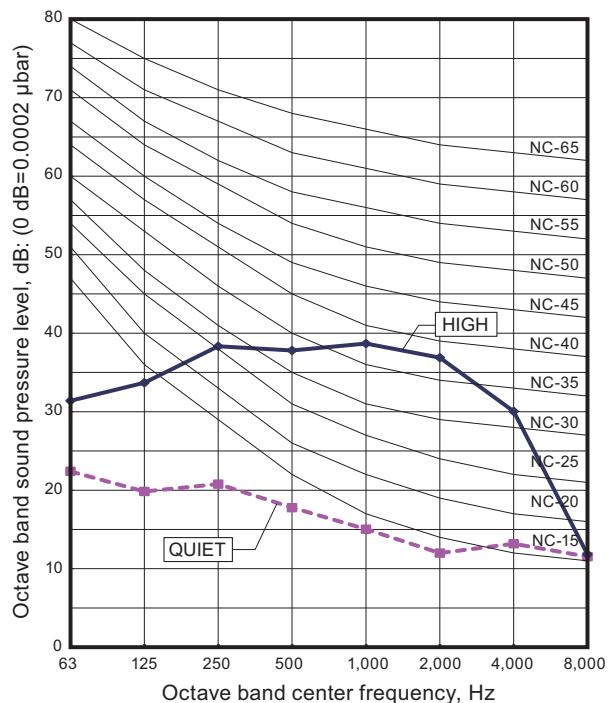


■ Models: ASHG12KGTE, ASHG12KGTF,
ASHH12KGTH, and ASHH12KGTH

● Cooling

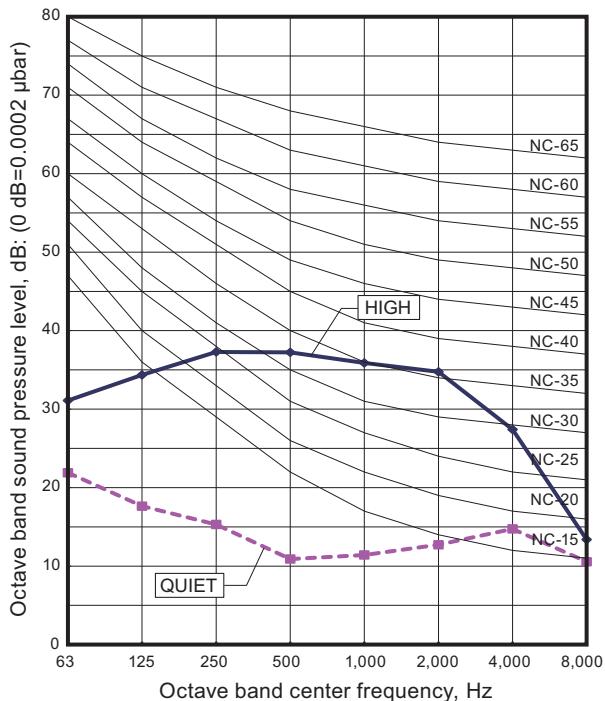


● Heating

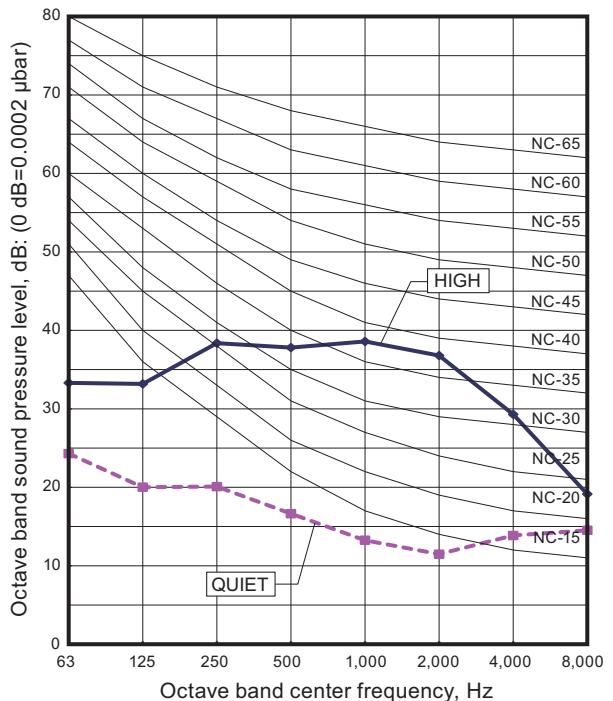


■ Models: ASHG14KGTE, ASHG14KGTF,
ASHH14KGTH, and ASHH14KGTH

● Cooling

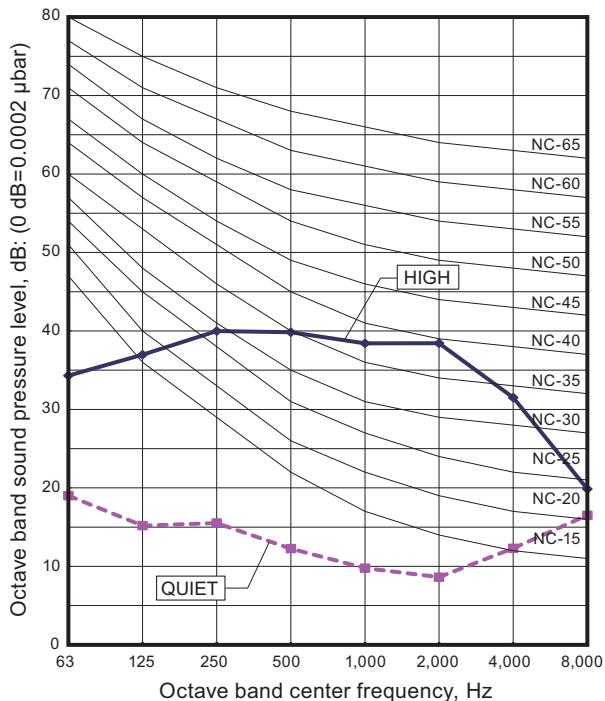


● Heating

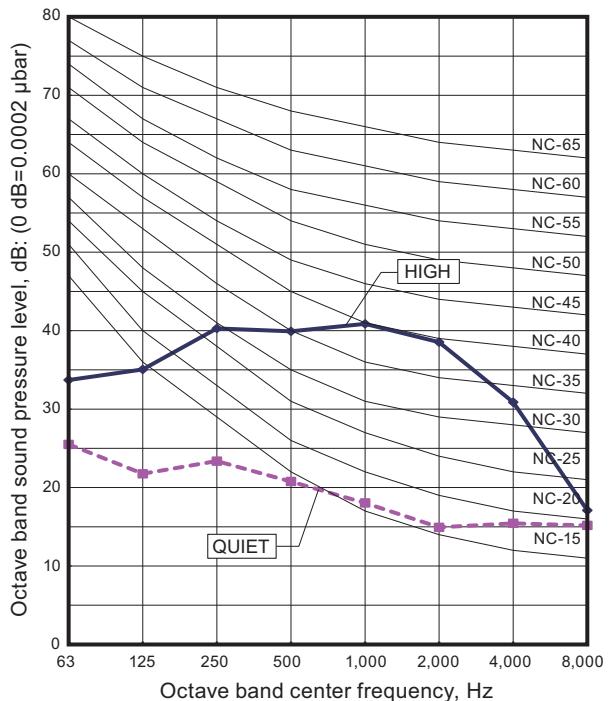


■ Models: ASHH05KNCA and ASHH05KNCH

● Cooling

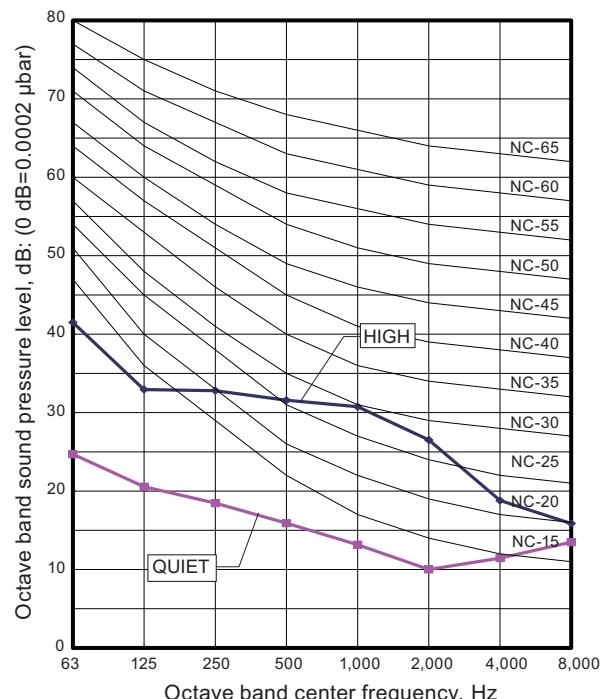


● Heating

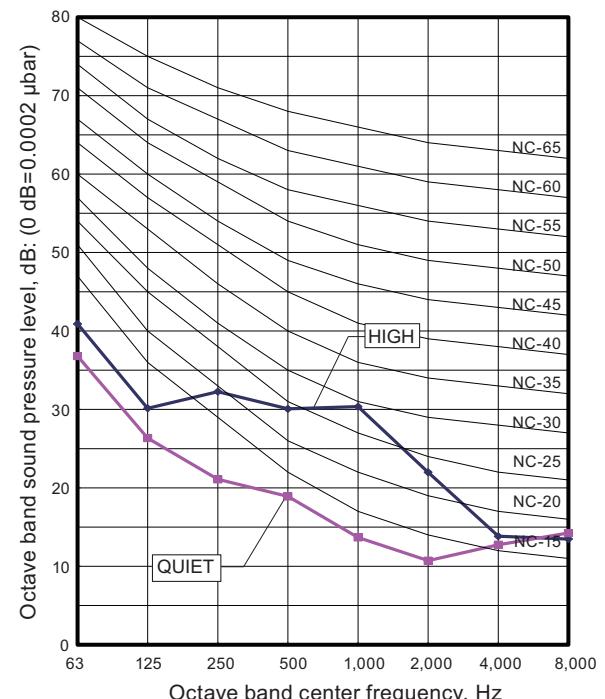


■ Models: ASHH07KNCA and ASHH07KNCH

● Cooling

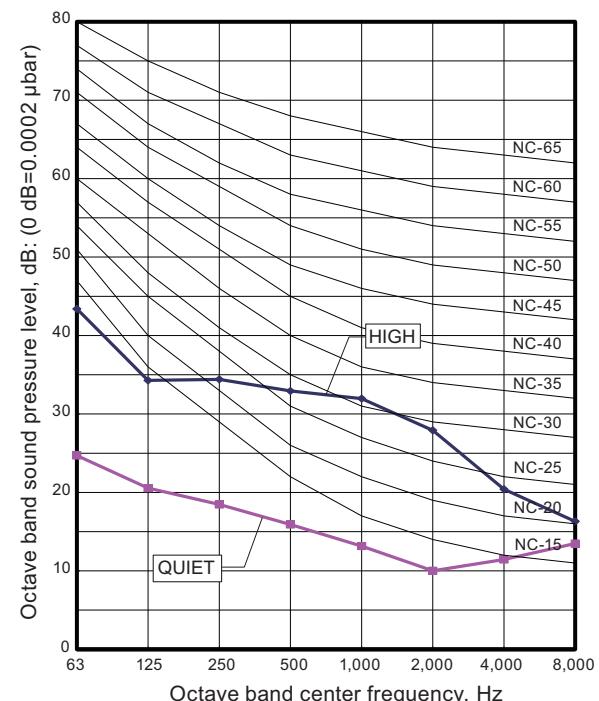


● Heating

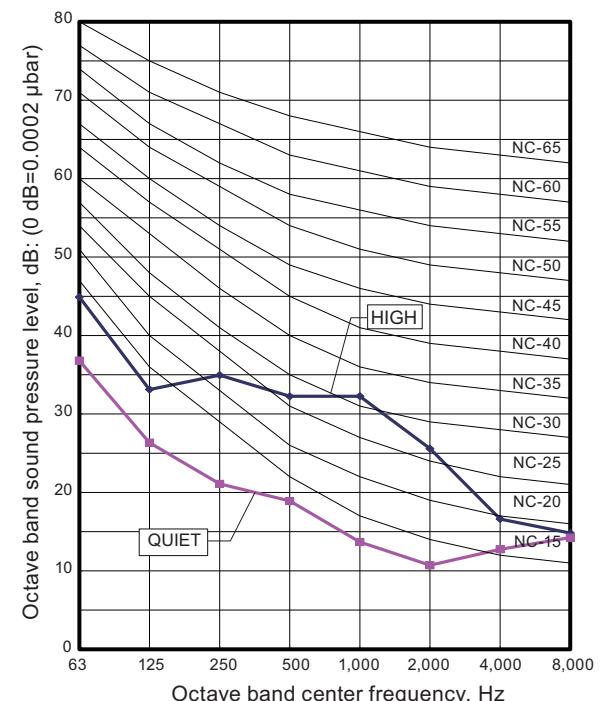


■ Models: ASHH09KNCA and ASHH09KNCH

● Cooling

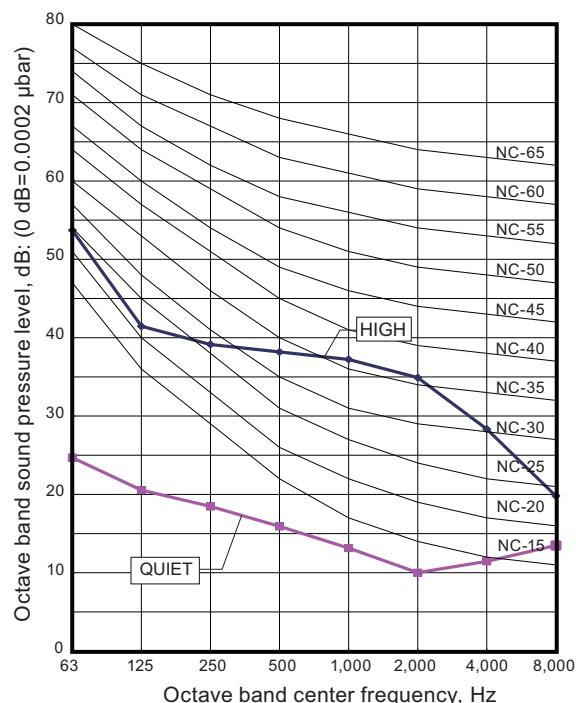


● Heating

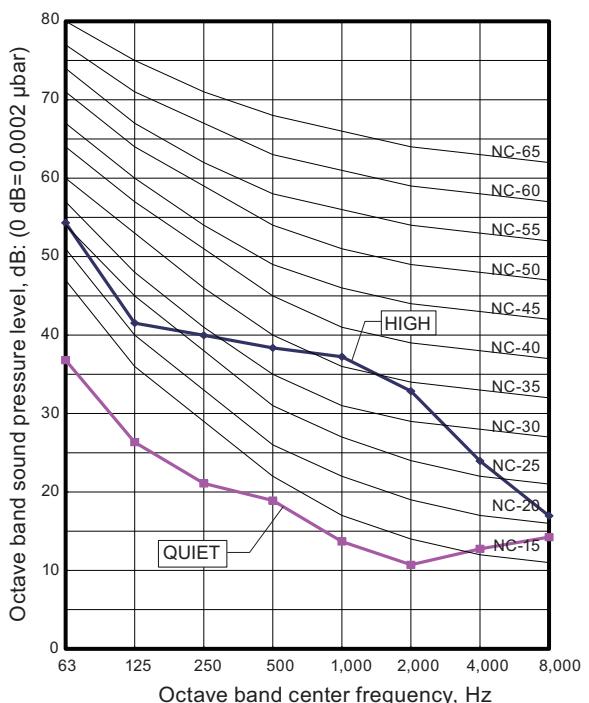


■ Models: ASHH12KNCA and ASHH12KNCH

● Cooling

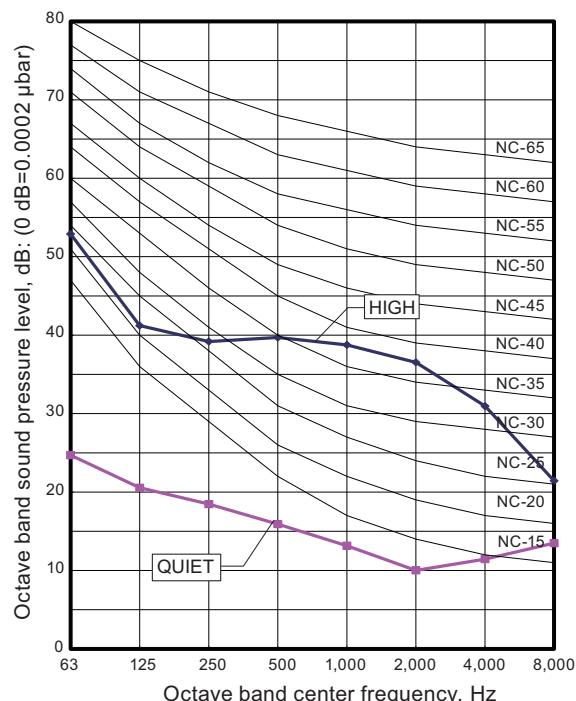


● Heating

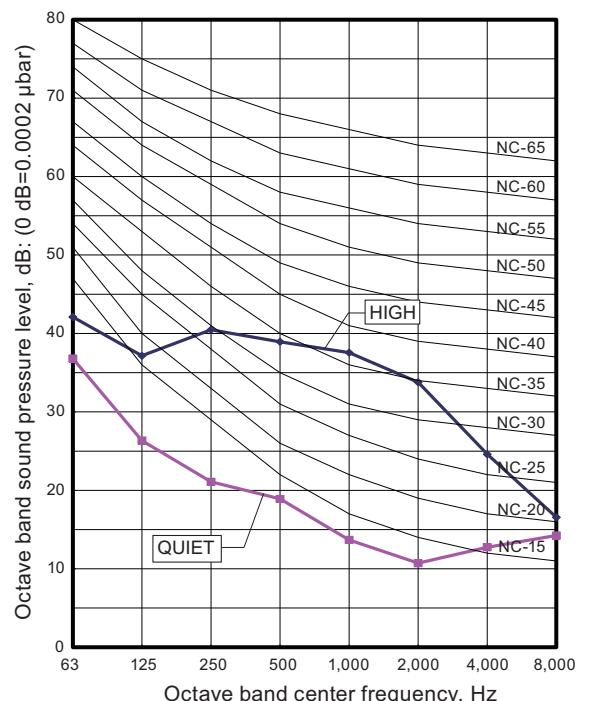


9-6. Floor type

■ Model: AGHG09KVCA

● Cooling

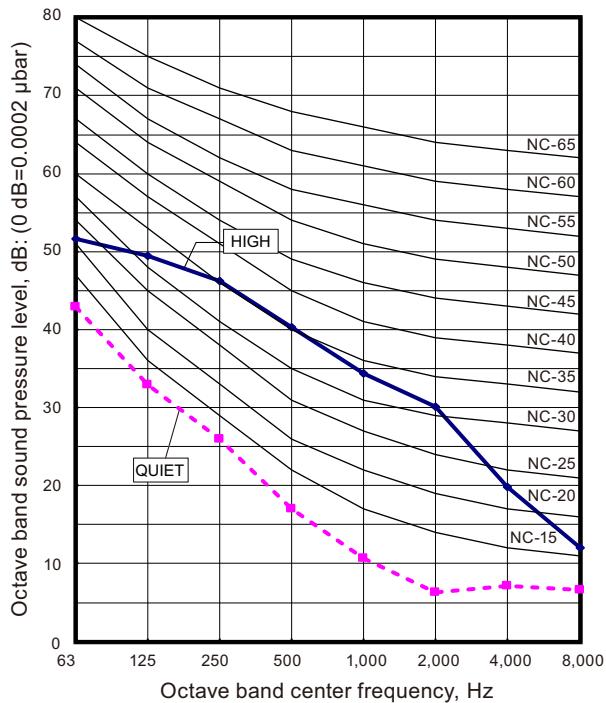


● Heating

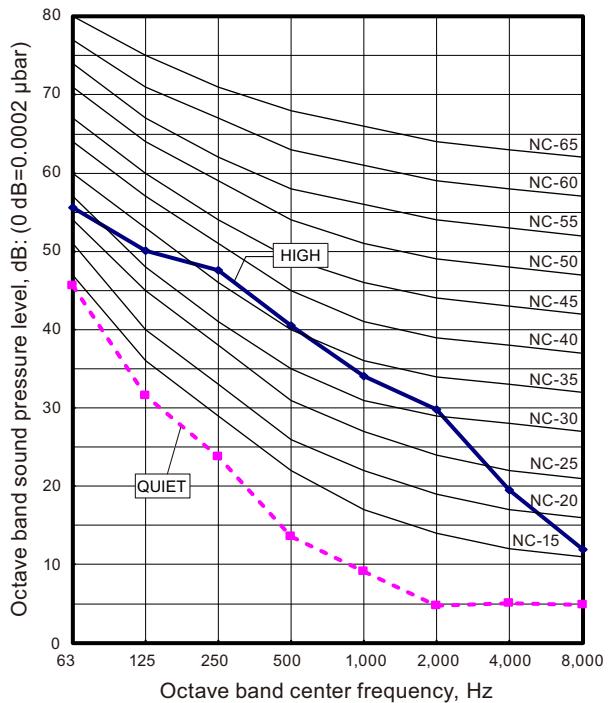


■ Model: AGHG12KVCA

● Cooling

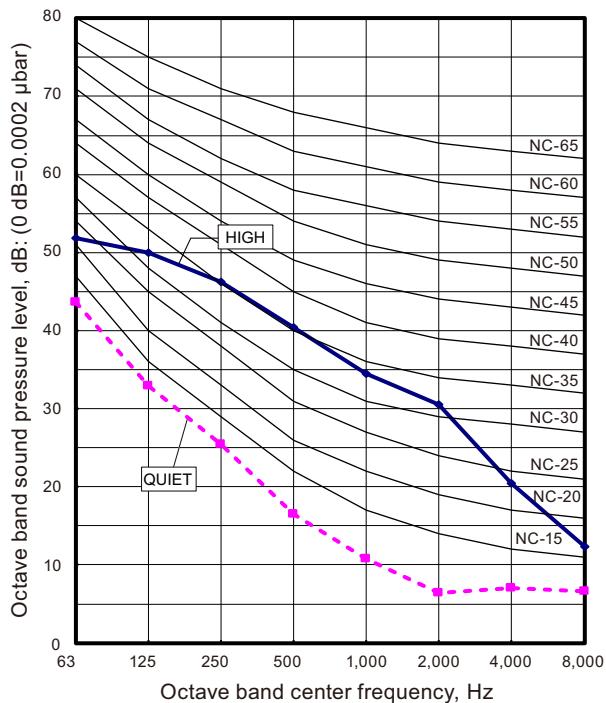


● Heating

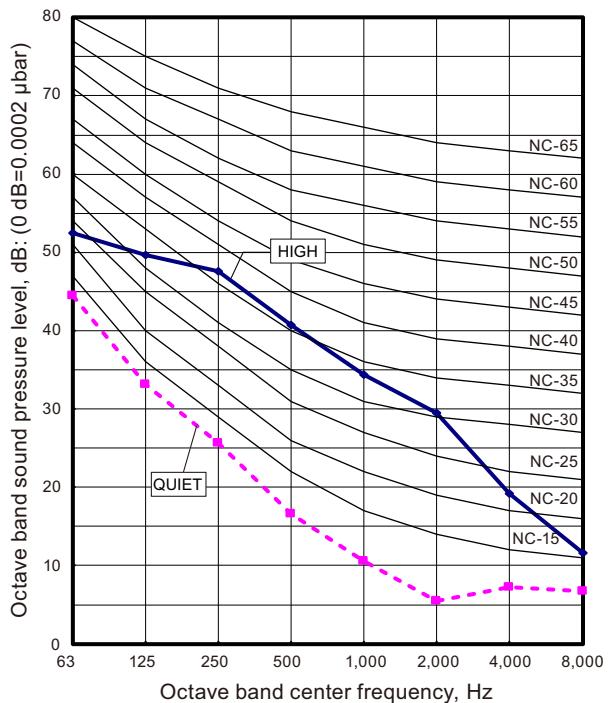


■ Model: AGHG14KVCA

● Cooling


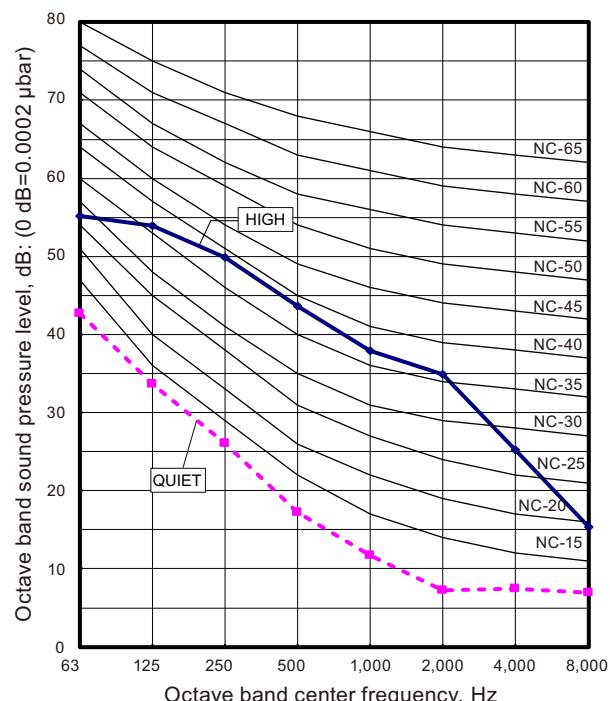


● Heating

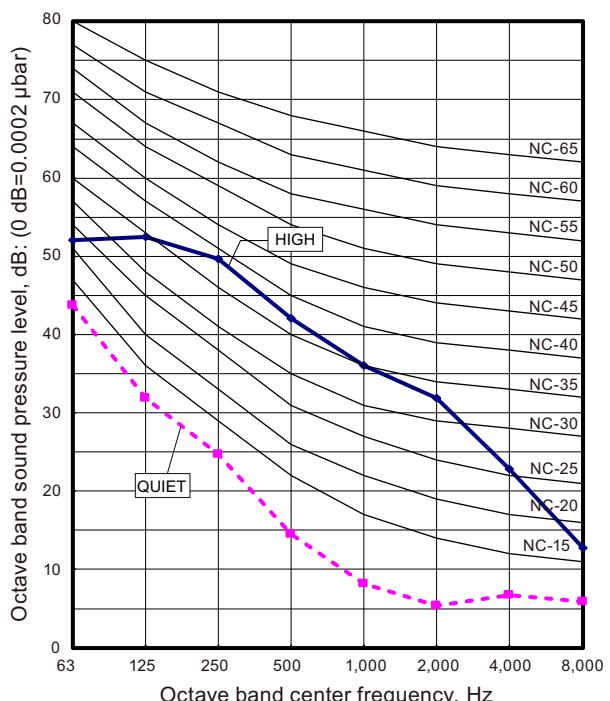


9-7. Sound level check point

■ Compact cassette type

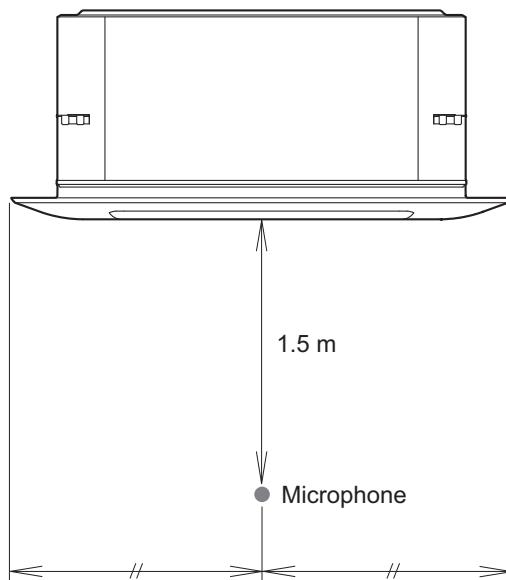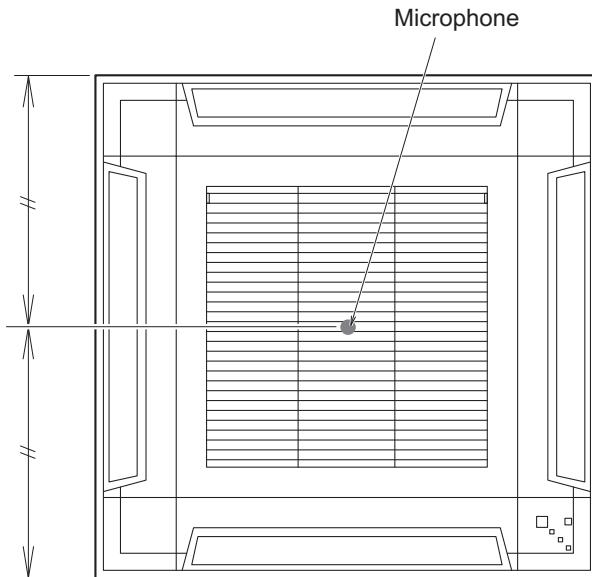


■ Mini duct type , Slim duct type, and Medium static pressure duct type

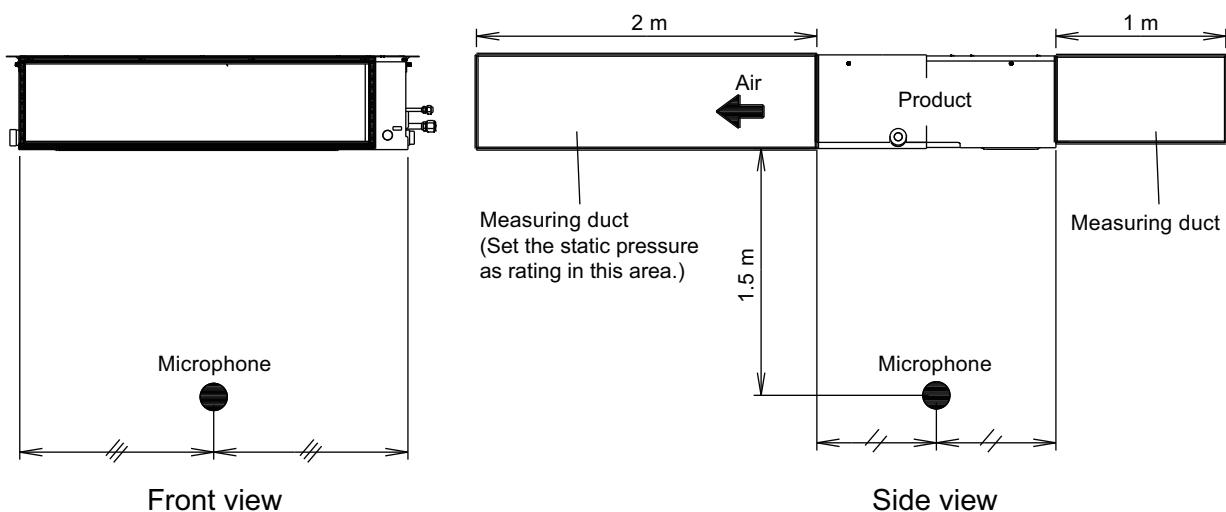


NOTE: Detailed shape of the actual indoor unit might be slightly different from the one illustrated above.

■ Wall mounted type

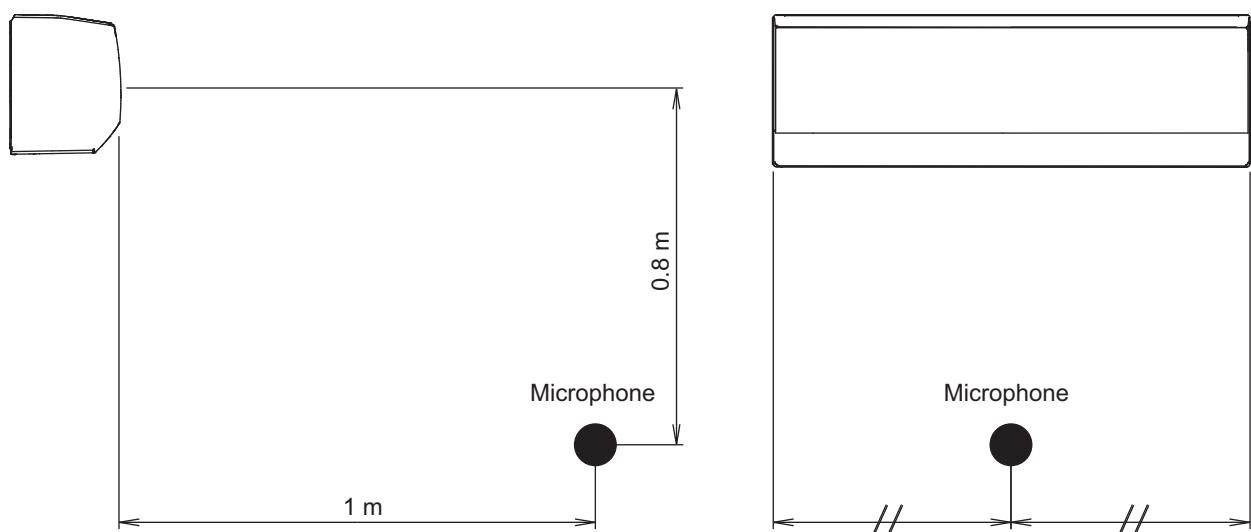

NOTE: Detailed shape of the actual indoor unit might be slightly different from the one illustrated above.

■ Floor type

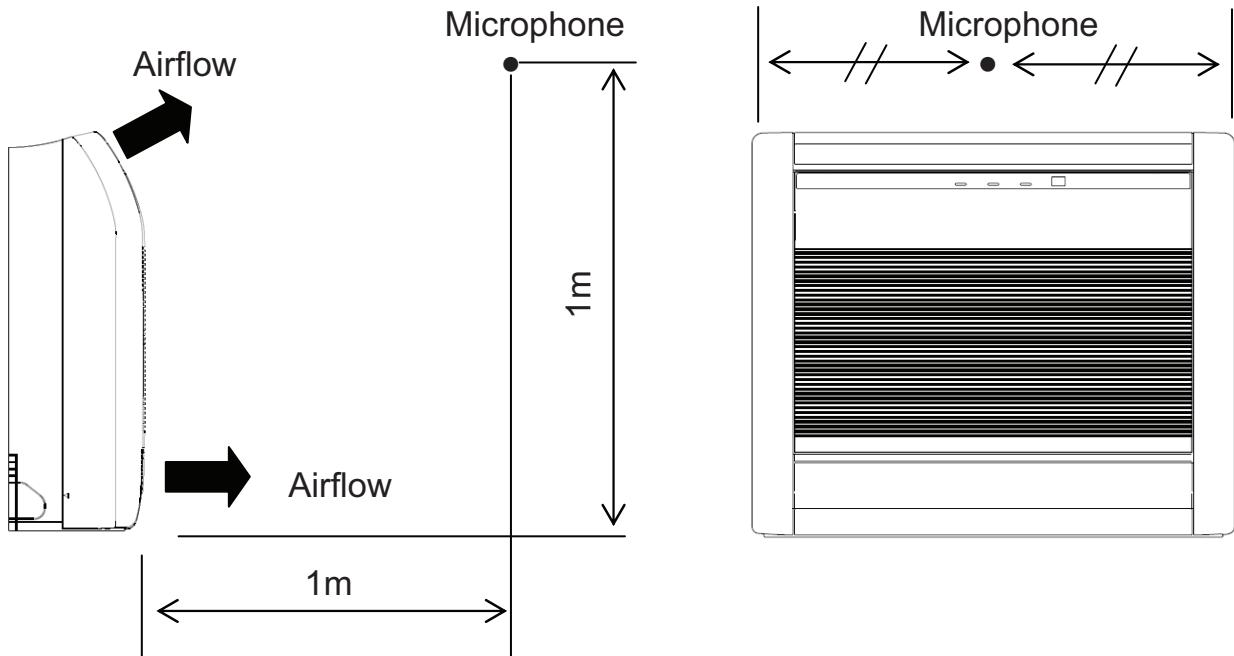

10. Electrical characteristics

		Power supply (50 Hz, 230 V)	Indoor rated		Wiring spec. of connection cable (Indoor unit to outdoor unit)	
Type	Model name	MCA	Input power	FLA	Cross-sectional area	Limited wiring length
		(A)	(W)	(A)	(mm ²)	(m)
Compact cassette	AUXG07KVLA	0.19	18	0.15	1.5	21
	AUXG09KVLA	0.19	18	0.15		
	AUXG12KVLA	0.24	23	0.19		
	AUXG14KVLA	0.28	28	0.22		
Mini duct	ARXG07KSLAP	0.33	33	0.29	1.5	21
	ARXG09KSLAP	0.38	40	0.33		
	ARXG12KSLAP	0.42	47	0.38		
	ARXG14KSLAP	0.67	72	0.58		
Slim duct	ARXG07KLLAP	0.41	33	0.33	1.5	21
	ARXG09KLLAP	0.38	49	0.30		
	ARXG12KLLAP	0.44	58	0.35		
	ARXG14KLLAP	0.64	76	0.51		
Medium static pressure duct	ARXH12KMTAP	0.43	46	0.34	1.5	21
	ARXH14KMTAP	0.62	70	0.49		
Wall mounted	ASHG07KMTB	0.25	23	0.20	1.5	21
	ASHG09KMTB	0.30	27	0.24		
	ASHG12KMTB	0.30	27	0.24		
	ASHG14KMTB	0.38	33	0.30		
Wall mounted	ASHG07KMCC	0.25	23	0.20	1.5	21
	ASHG09KMCC	0.30	27	0.24		
	ASHG12KMCC	0.30	27	0.24		
	ASHG14KMCC	0.38	33	0.30		
Wall mounted	ASHG07KMCE	0.25	23	0.20	1.5	21
	ASHG09KMCE	0.30	27	0.24		
	ASHG12KMCE	0.30	27	0.24		
	ASHG14KMCE	0.38	33	0.30		
Wall mounted	ASHG07KMCF	0.25	23	0.20	1.5	21
	ASHG09KMCF	0.30	27	0.24		
	ASHG12KMCF	0.30	27	0.24		
	ASHG14KMCF	0.38	33	0.30		
Wall mounted	ASHH07KMCG	0.25	23	0.20	1.5	21
	ASHH07KMCG-B					
	ASHH09KMCG	0.30	27	0.24		
	ASHH09KMCG-B					
Wall mounted	ASHH12KMCG	0.30	27	0.24	1.5	21
	ASHH12KMCG-B					
	ASHH14KMCG	0.38	33	0.30		
	ASHH14KMCG-B					
Wall mounted	ASHH07KMCH	0.25	23	0.20	1.5	21
	ASHH07KMCH-B					
	ASHH09KMCH	0.30	27	0.24		
	ASHH09KMCH-B					
Wall mounted	ASHH12KMCH	0.30	27	0.24	1.5	21
	ASHH12KMCH-B					
	ASHH14KMCH	0.38	33	0.30		
	ASHH14KMCH-B					

		Power supply (50 Hz, 230 V)	Indoor rated		Wiring spec. of connection cable (Indoor unit to outdoor unit)	
Type	Model name	MCA	Input power	FLA	Cross-sectional area	Limited wiring length
		(A)	(W)	(A)	(mm ²)	(m)
Wall mounted	ASHG07KETA ASHG07KETA-B	0.25	23	0.20	1.5	21
	ASHG09KETA ASHG09KETA-B	0.30	27	0.24		
	ASHG12KETA ASHG12KETA-B	0.30	27	0.24		
	ASHG14KETA ASHG14KETA-B	0.38	33	0.30		
Wall mounted	ASHG07KETE ASHG07KETE-B	0.25	23	0.20	1.5	21
	ASHG09KETE ASHG09KETE-B	0.30	27	0.24		
	ASHG12KETE ASHG12KETE-B	0.30	27	0.24		
	ASHG14KETE ASHG14KETE-B	0.38	33	0.30		
Wall mounted	ASHG07KETF ASHG07KETF-B	0.25	23	0.20	1.5	21
	ASHG09KETF ASHG09KETF-B	0.30	27	0.24		
	ASHG12KETF ASHG12KETF-B	0.30	27	0.24		
	ASHG14KETF ASHG14KETF-B	0.38	33	0.30		
Wall mounted	ASHG07KGTB ASHG09KGTB	0.25 0.30	23 27	0.20 0.24	1.5	21
	ASHG12KGTB ASHG14KGTB	0.30 0.37	27 33	0.24 0.29		
	ASHG07KGTE ASHG09KGTE	0.25 0.30	23 27	0.20 0.24		
	ASHG12KGTE ASHG14KGTE	0.30 0.37	27 33	0.24 0.29		
Wall mounted	ASHG07KGTF ASHG09KGTF	0.25 0.30	23 27	0.20 0.24	1.5	21
	ASHG12KGTF ASHG14KGTF	0.30 0.37	27 33	0.24 0.29		
	ASHH07KG TG ASHH09KG TG	0.25 0.30	23 27	0.20 0.24		1.5
	ASHH12KG TG ASHH14KG TG	0.30 0.37	27 33	0.24 0.29		
Wall mounted	ASHH07KG TH ASHH09KG TH	0.25 0.30	23 27	0.20 0.24	1.5	21
	ASHH12KG TH ASHH14KG TH	0.30 0.37	27 33	0.24 0.29		
	ASHH05KNCA ASHH07KNCA	0.14 0.15	12 13	0.11 0.12	1.5	21
	ASHH09KNCA ASHH12KNCA	0.24 0.25	21 22	0.19 0.20		

		Power supply (50 Hz, 230 V)	Indoor rated		Wiring spec. of connection cable (Indoor unit to outdoor unit)	
Type	Model name	MCA	Input power	FLA	Cross-sectional area	Limited wiring length
		(A)	(W)	(A)	(mm ²)	(m)
Wall mounted	ASHH05KNCH	0.14	12	0.11	1.5	21
	ASHH07KNCH	0.15	13	0.12		
	ASHH09KNCH	0.24	21	0.19		
	ASHH12KNCH	0.25	22	0.20		
Floor	AGHG09KVCA	0.19	16	0.15	1.5	21
	AGHG12KVCA	0.23	20	0.18		
	AGHG14KVCA	0.25	23	0.20		

MCA: Minimum Circuit Ampacity = Maximum operating current (Full load)

FLA: Full Load Amperes (Fan motor)

11. Safety devices

Indoor unit type	Model name	PCB* fuse	Fan motor thermal protector	Terminal thermal fuse	Float switch
Compact cassette	AUXG07KVLA	250 V, 5 A	Activate: 100 ± 15 °C Fan motor stop Reset: 95 ± 10 °C Fan motor restart	—	○
	AUXG09KVLA				
	AUXG12KVLA				
	AUXG14KVLA				
Mini duct	ARXG07KSLAP	250 V, 5 A	Activate: 135 ± 15 °C Fan motor stop Reset: 105 ± 15 °C Fan motor restart	—	○
	ARXG09KSLAP				
	ARXG12KSLAP				
	ARXG14KSLAP				
Slim duct	ARXG07KLLAP	250 V, 5 A	Activate: 135 ± 15 °C Fan motor stop Reset: 105 ± 15 °C Fan motor restart	—	○
	ARXG09KLLAP				
	ARXG12KLLAP				
	ARXG14KLLAP				
Medium static pressure duct	ARXH12KMTAP	250 V, 5 A	Activate: $135\text{--}150$ °C Fan motor stop Reset: $105\text{--}120$ °C Fan motor restart	—	○
	ARXH14KMTAP				
Wall mounted	ASHG07KMTB	250 V, 3.15 A	Activate: More than 95 °C Fan motor speed down Reset: 95 °C or less Fan motor speed recover	102 °C Off	—
	ASHG09KMTB				
	ASHG12KMTB				
	ASHG14KMTB		Activate: 125 ± 10 °C Fan motor stop Reset: 100 ± 10 °C Fan motor restart		
Wall mounted	ASHG07KMCC	250 V, 3.15 A	Activate: 170^{+25}_{-30} °C Fan motor stop Reset: 145^{+25}_{-30} °C Fan motor restart	—	—
	ASHG09KMCC				
	ASHG12KMCC				
	ASHG14KMCC				
Wall mounted	ASHG07KMCE	250 V, 3.15 A	Activate: 170^{+25}_{-30} °C Fan motor stop Reset: 145^{+25}_{-30} °C Fan motor restart	—	—
	ASHG09KMCE				
	ASHG12KMCE				
	ASHG14KMCE				
Wall mounted	ASHG07KMCF	250 V, 3.15 A	Activate: 170^{+25}_{-30} °C Fan motor stop Reset: 145^{+25}_{-30} °C Fan motor restart	—	—
	ASHG09KMCF				
	ASHG12KMCF				
	ASHG14KMCF				
Wall mounted	ASHH07KMCG	250 V, 3.15 A	Activate: 170^{+25}_{-30} °C Fan motor stop Reset: 145^{+25}_{-30} °C Fan motor restart	—	—
	ASHH07KMCG-B				
	ASHH09KMCG				
	ASHH09KMCG-B				
	ASHH12KMCG				
	ASHH12KMCG-B				
	ASHH14KMCG				
	ASHH14KMCG-B				

Indoor unit type	Model name	PCB* fuse	Fan motor thermal protector	Terminal thermal fuse	Float switch
Wall mounted	ASHH07KMCH	250 V, 3.15 A	Activate: $170 \pm 25 -30$ °C Fan motor stop Reset: $145 \pm 25 -30$ °C Fan motor restart	—	—
	ASHH07KMCH-B				
	ASHH09KMCH				
	ASHH09KMCH-B				
	ASHH12KMCH				
	ASHH12KMCH-B				
Wall mounted	ASHH14KMCH	250 V, 3.15 A	Activate: 110 ± 15 °C Fan motor speed down Reset: 110 ± 15 °C Fan motor speed recover	102 °C Off	—
	ASHH14KMCH-B				
	ASHG07KETA				
	ASHG07KETA-B				
	ASHG09KETA				
Wall mounted	ASHG09KETA-B	250 V, 3.15 A	Activate: 125 ± 10 °C Fan motor stop Reset: 100 ± 10 °C Fan motor restart	102 °C Off	—
	ASHG12KETA				
	ASHG12KETA-B				
	ASHG14KETA				
	ASHG14KETA-B				
Wall mounted	ASHG07KETE	250 V, 3.15 A	Activate: 110 ± 15 °C Fan motor speed down Reset: 110 ± 15 °C Fan motor speed recover	102 °C Off	—
	ASHG07KETE-B				
	ASHG09KETE				
	ASHG09KETE-B				
	ASHG12KETE				
Wall mounted	ASHG12KETE-B	250 V, 3.15 A	Activate: 125 ± 10 °C Fan motor stop Reset: 100 ± 10 °C Fan motor restart	102 °C Off	—
	ASHG14KETE				
	ASHG14KETE-B				
	ASHG07KETF	250 V, 3.15 A	Activate: 110 ± 15 °C Fan motor speed down Reset: 110 ± 15 °C Fan motor speed recover	102 °C Off	—
	ASHG07KETF-B				
Wall mounted	ASHG09KETF				
	ASHG09KETF-B				
	ASHG12KETF				
	ASHG12KETF-B				
	ASHG14KETF				
Wall mounted	ASHG14KETF-B				
	ASHG07KGTB	250 V, 3.15 A	Activate: 110 ± 15 °C Fan motor speed down Reset: 110 ± 15 °C Fan motor speed recover	102 °C Off	—
	ASHG09KGTB				
	ASHG12KGTB				
	ASHG14KGTB				
Wall mounted	ASHG07KGTE	250 V, 3.15 A	Activate: 110 ± 15 °C Fan motor speed down Reset: 110 ± 15 °C Fan motor speed recover	102 °C Off	—
	ASHG09KGTE				
	ASHG12KGTE				
	ASHG14KGTE				

Indoor unit type	Model name	PCB* fuse	Fan motor thermal protector	Terminal thermal fuse	Float switch
Wall mounted	ASHG07KGTF	250 V, 3.15 A	Activate: 110 ± 15 °C Fan motor speed down Reset: 110 ± 15 °C Fan motor speed recover	102 °C Off	—
	ASHG09KGTF		Activate: 125 ± 10 °C Fan motor stop Reset: 100 ± 10 °C Fan motor restart		
	ASHG12KGTF		Activate: 125 ± 10 °C Fan motor stop Reset: 100 ± 10 °C Fan motor restart		
	ASHG14KGTF		Activate: 125 ± 10 °C Fan motor stop Reset: 100 ± 10 °C Fan motor restart		
Wall mounted	ASHH07KG TG	250 V, 3.15 A	Activate: 110 ± 15 °C Fan motor speed down Reset: 110 ± 15 °C Fan motor speed recover	102 °C Off	—
	ASHH09KG TG		Activate: 125 ± 10 °C Fan motor stop Reset: 100 ± 10 °C Fan motor restart		
	ASHH12KG TG		Activate: 125 ± 10 °C Fan motor stop Reset: 100 ± 10 °C Fan motor restart		
	ASHH14KG TG		Activate: 125 ± 10 °C Fan motor stop Reset: 100 ± 10 °C Fan motor restart		
Wall mounted	ASHH07KG TH	250 V, 3.15 A	Activate: 110 ± 15 °C Fan motor speed down Reset: 110 ± 15 °C Fan motor speed recover	102 °C Off	—
	ASHH09KG TH		Activate: 125 ± 10 °C Fan motor stop Reset: 100 ± 10 °C Fan motor restart		
	ASHH12KG TH		Activate: 125 ± 10 °C Fan motor stop Reset: 100 ± 10 °C Fan motor restart		
	ASHH14KG TH		Activate: 125 ± 10 °C Fan motor stop Reset: 100 ± 10 °C Fan motor restart		
Wall mounted	ASHH05KNCA	250 V, 3.15 A	Activate: More than 170 °C Fan motor stop Reset: 145 °C or less Fan motor recover	102 °C Off	—
	ASHH07KNCA		Activate: More than 170 °C Fan motor stop Reset: 145 °C or less Fan motor recover		
	ASHH09KNCA		Activate: More than 170 °C Fan motor stop Reset: 145 °C or less Fan motor recover		
	ASHH12KNCA		Activate: More than 170 °C Fan motor stop Reset: 145 °C or less Fan motor recover		
Wall mounted	ASHH05KNCH	250 V, 3.15 A	Activate: More than 170 °C Fan motor stop Reset: 145 °C or less Fan motor recover	102 °C Off	—
	ASHH07KNCH		Activate: More than 170 °C Fan motor stop Reset: 145 °C or less Fan motor recover		
	ASHH09KNCH		Activate: More than 170 °C Fan motor stop Reset: 145 °C or less Fan motor recover		
	ASHH12KNCH		Activate: More than 170 °C Fan motor stop Reset: 145 °C or less Fan motor recover		
Floor	AGHG09KVCA	250V, 5.0 A	Activate: 150 ± 15 °C Fan motor stop Reset: 120 ± 15 °C Fan motor restart	110 °C Off	—
	AGHG12KVCA		Activate: 150 ± 15 °C Fan motor stop Reset: 120 ± 15 °C Fan motor restart		
	AGHG14KVCA		Activate: 150 ± 15 °C Fan motor stop Reset: 120 ± 15 °C Fan motor restart		

*: Printed Circuit Board

12. External input and output

12-1. Compact cassette type and Medium static pressure duct type

- Compact cassette type

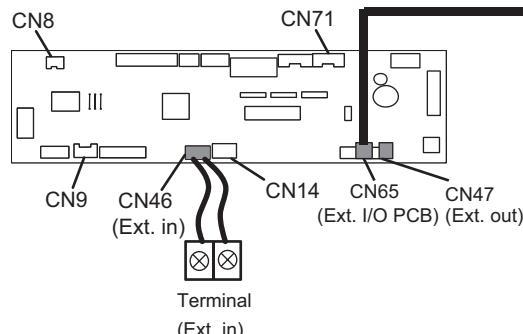


Fig. Indoor unit PCB

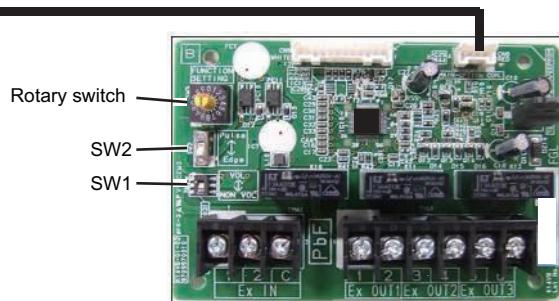


Fig. External Input and Output PCB

- Medium static pressure duct type

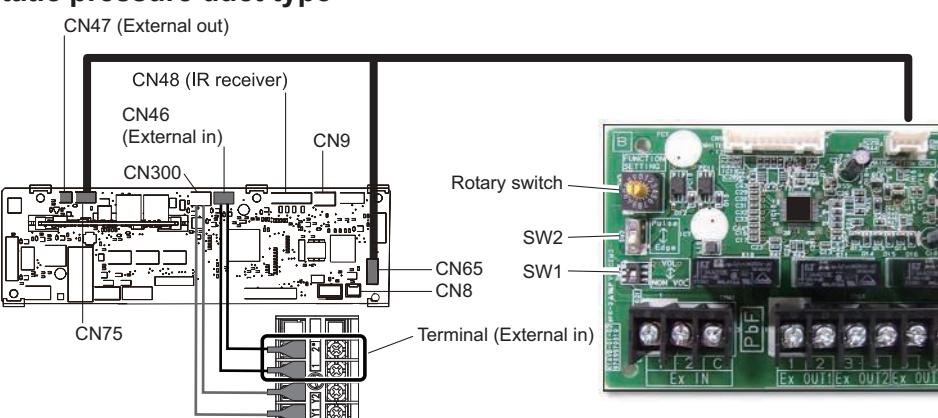


Fig. Indoor unit PCB

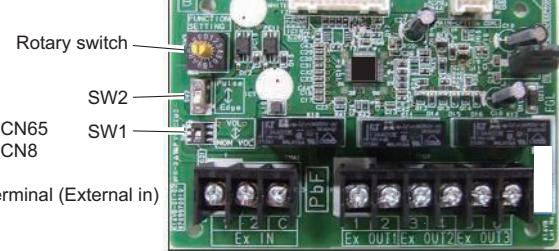


Fig. External Input and Output PCB

Connecting point		Input/Output	Function	Input select	Input signal
Indoor unit	Terminal	Input	Operation/Stop	Dry contact	Edge
			Forced stop		
	CN47	Output	Operation/Stop	—	—
			Error status		
			Indoor unit fan operation status		
			External heater output		
External Input and Output PCB (UTY-XCSX)	Ex IN 1/2	Input	Operation/Stop	Dry contact/Apply voltage	Edge/Pulse
	Ex IN 1		Forced thermostat off		
	Ex OUT 1 Ex OUT 2 Ex OUT 3	Output	Operation/Stop	—	—
			Error status		
			Indoor unit fan operation status		
			External heater output		

NOTE: For details of the switching function, refer to "Setting of external input and output" on page 166.


■ External input

With using external input function, some functions on this product can be controlled from an external device.

- "Operation/Stop" mode or "Forced stop" mode can be selected with function setting of indoor unit.
- A twisted pair cable should be used. Maximum length of cable is 150 m.
- Use an external input and output cable with appropriate external dimension, depending on the number of cables to be installed.
- The wire connection should be separate from the power cable line.

● Indoor unit

Indoor unit functions such as Operation/Stop can be done by using indoor unit terminal.

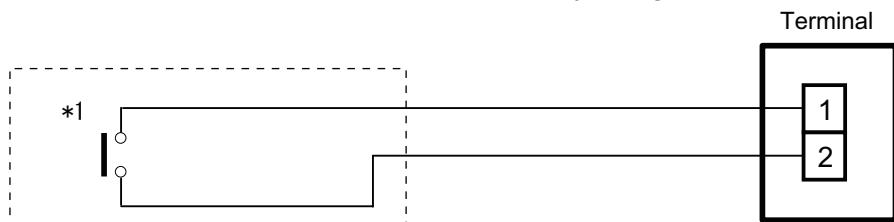

*1: The switch can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

● External Input and Output PCB


The indoor unit Operation/Stop can be set by using the input terminal on the PCB.

• Input select

Use either one of these types of terminal according to the application. (Both types of terminal cannot be used simultaneously.)

– Dry contact


In case of internal power supply, set the slide switch of SW1 to "NON VOL" side.

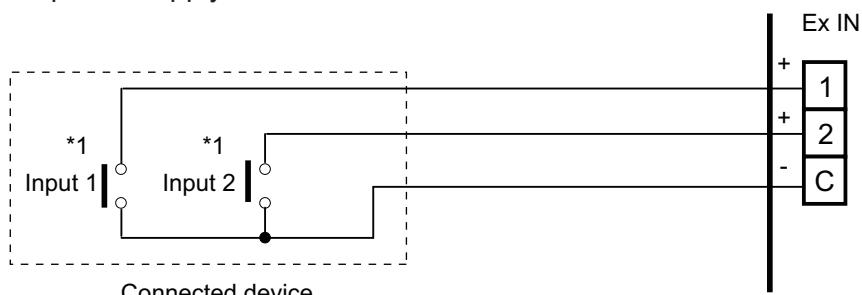

*1: The switches can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

– Apply voltage

In case of external power supply, set the slide switch of SW1 to "VOL" side.

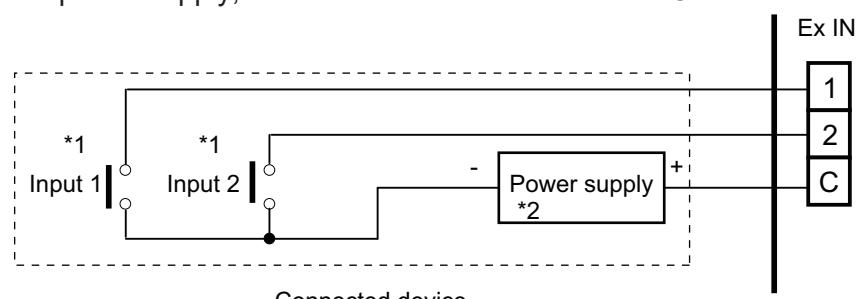

*1: The switches can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

*2: Make the power supply DC 12 V to 24 V, 10 mA or more.

● Input signal type

- **Indoor unit**


Input signal type is only "Edge".



- **External Input and Output PCB**

The input signal type can be selected.

Signal type (edge or pulse) can be switched by the DIP switch 2 (SW2) on the External Input and Output PCB.

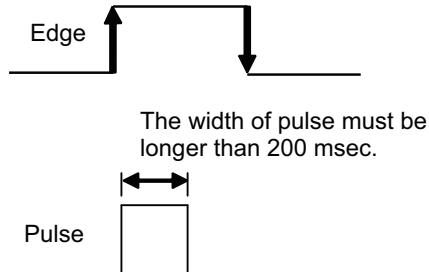

NOTE: The input signal supports the following switch type:

- Edge: Alternate type switch
- Pulse: Momentary type switch


■ External output

Use an external output cable with appropriate external dimension, depending on the number of cables to be installed.

● Indoor unit


- A twisted pair cable (22 AWG) should be used. Maximum length of cable is 25 m.
- Output voltage: High DC 12 V ± 2 V, Low 0 V.
- Permissible current: 50 mA
- For details, refer to "[Setting of external input and output](#)" on page 166.
- **When indicator, etc. are connected directly**

Example: Function setting number 60 is set to "00"

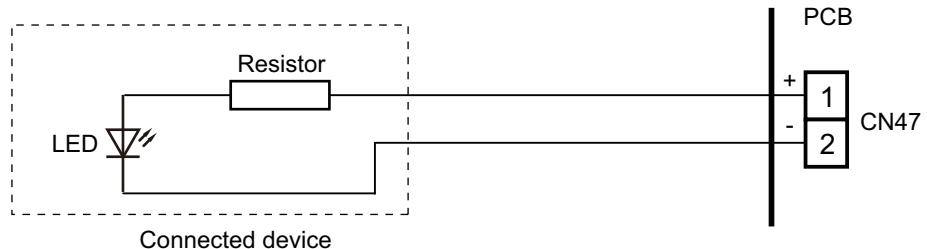


- **When connecting with a device equipped with a power supply**

Example: Function setting number 60 is set to "00"

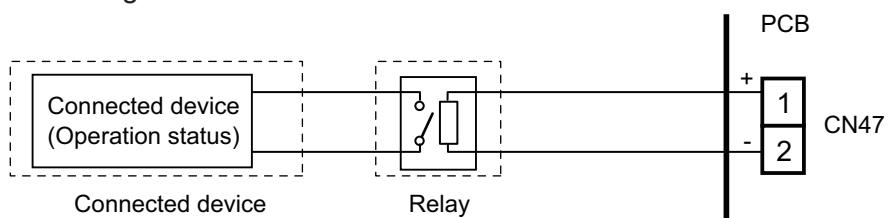

● External Input and Output PCB

- A twisted pair cable (22 AWG) should be used.
- Permissible voltage and current: DC 5 V to 30 V/3 A, AC 30 V to 250 V/3 A
- For details, refer to "[Setting of external input and output](#)" on page 166.

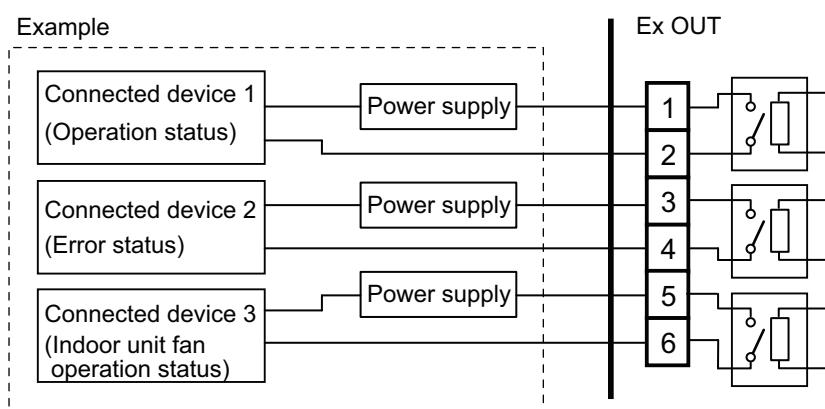

■ Setting of external input and output

- Indoor unit

Input		
Connecting point	Function setting number 46	Function
Terminal	00	Operation/Stop mode 1
	01	(Setting prohibited)
	02	Forced stop mode
	03	Operation/Stop mode 2

Output		
Connecting point	Function setting number 60	Function
CN47	00	Operation/Stop
	01 to 08	(Setting prohibited)
	09	Error status
	10	Indoor unit fan operation status
	11	External heater output

- External Input and Output PCB

Switch setting		Input		Output		
Rotary switch	SW2	Ex IN 1	Ex IN 2	Ex OUT 1	Ex OUT 2	Ex OUT 3
1	Edge	Operation/Stop	Not available	Operation/Stop	Error status	Indoor unit fan operation status
	Pulse	Operation	Stop			
2	Edge*	Forced thermostat off	Not available	Error status	Indoor unit fan operation status	External heater output
3 to 9, A		(Setting prohibited)				
B		Forced thermostat off	Not available	Operation/Stop	Indoor unit fan operation status	External heater output
C		Forced thermostat off	Not available	Operation/Stop	Error status	External heater output
D		Forced thermostat off	Not available	Operation/Stop	Indoor unit fan operation status	Error status

NOTES:


- When the rotary switch is selected to "1", the operation of the terminal input of the indoor unit and the External Input and Output PCB input are the same. The operation content depends on the setting of function setting number 46.
- *: The external input other than "Operation/Stop" is available only when the SW2 is set to "Edge".

■ Details of control input function

● Operation/Stop mode 1


- In the case of "Edge" input

Function setting	External Input and Output PCB		External input	Input signal	Command
	Rotary switch	SW2			
46-00	—	Input of indoor unit	Terminal	Off → On	Operation
				On → Off	Stop
	1	Edge	External Input and Output PCB	Off → On	Operation
				On → Off	Stop

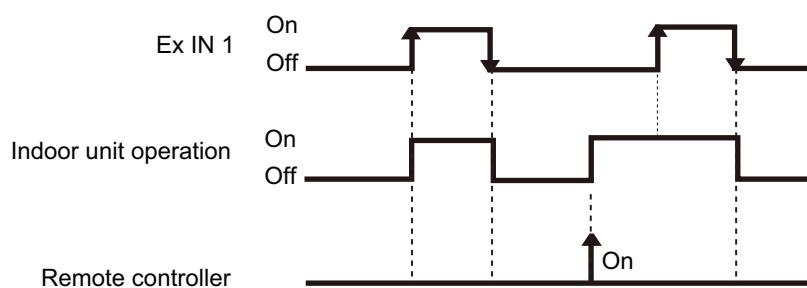

- In the case of "Pulse" input

Function setting	External Input and Output PCB		External input	Input signal	Command
	Rotary switch	SW2			
46-00	1	Pulse	External Input and Output PCB	Ex IN 1 Ex IN 2	Pulse Operation Stop

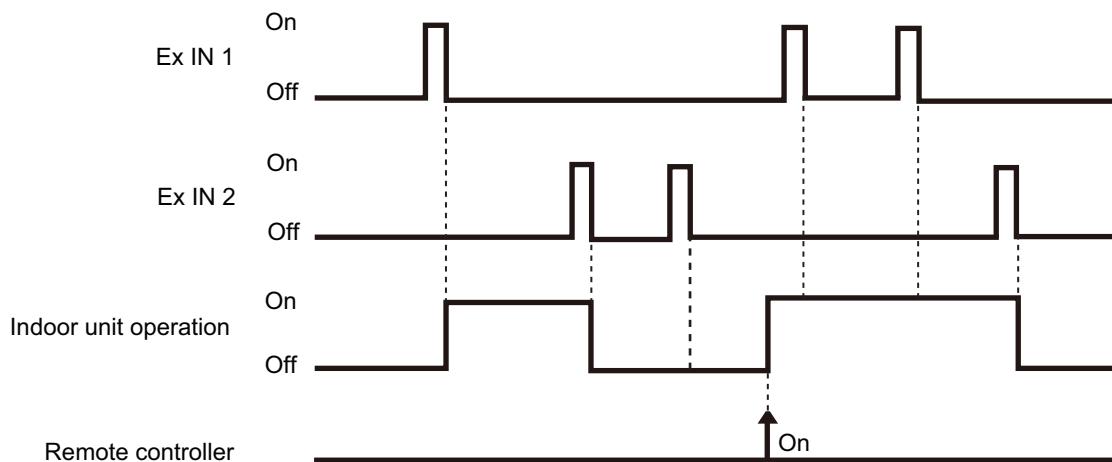


NOTES:

- The last command has priority.
- The indoor units within the same remote controller group operates in the same mode.

● Forced stop


- In the case of "Edge" input

Function setting	External Input and Output PCB		External input	Input signal	Command
	Rotary switch	SW2			
46-02	—	Input of indoor unit	Terminal	Off → On	Forced stop (R.C. disabled)
				On → Off	Normal (R.C. enabled)
	1 Edge	External Input and Output PCB	Ex IN 1	Off → On	Forced stop (R.C. disabled)
				On → Off	Normal (R.C. enabled)

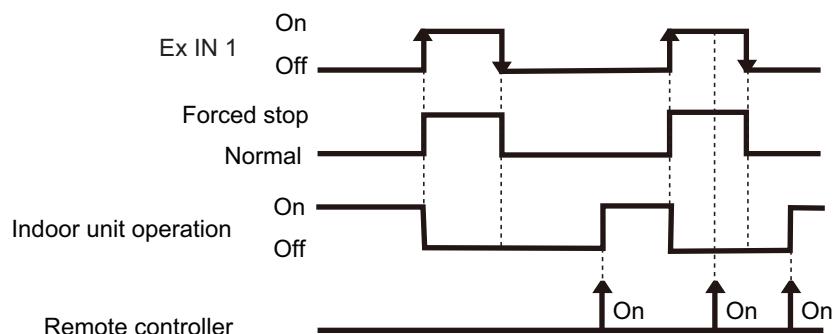

- In the case of "Pulse" input

Function setting	External Input and Output PCB		External input	Input signal	Command
	Rotary switch	SW2			
46-02	1 Pulse	External Input and Output PCB	Ex IN 1	Pulse	Forced stop (R.C. disabled)
					Normal (R.C. enabled)

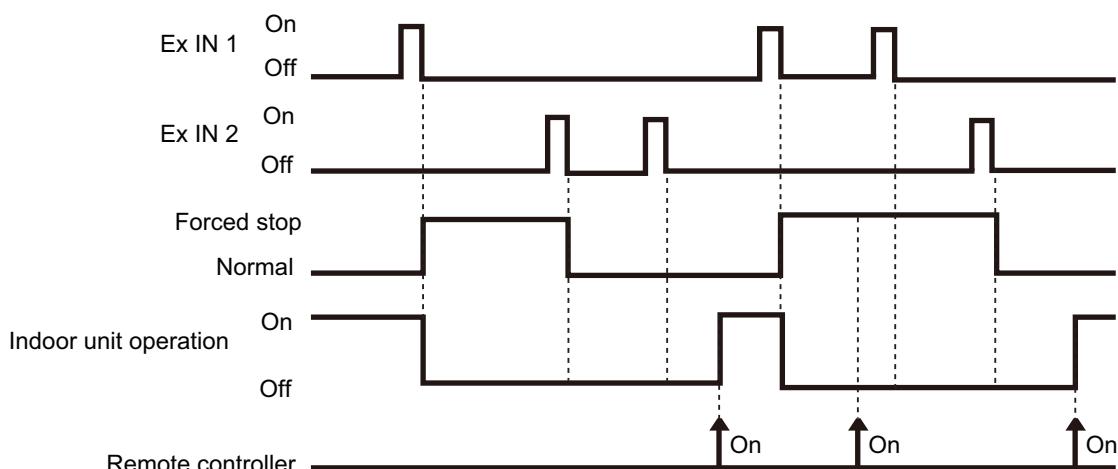


NOTES:

- When the forced stop is triggered, indoor unit stops and Operation/Stop operation by the remote controller is restricted.
- When forced stop function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

● Operation/Stop mode 2


- In the case of "Edge" input

Function setting	External Input and Output PCB		External input	Input signal	Command
	Rotary switch	SW2			
46-03	—	Input of indoor unit	Terminal	Off → On	Operation (R.C. enabled)
				On → Off	Stop (R.C. disabled)
	1 Edge	External Input and Output PCB	Ex IN 1	Off → On	Operation (R.C. enabled)
				On → Off	Stop (R.C. disabled)

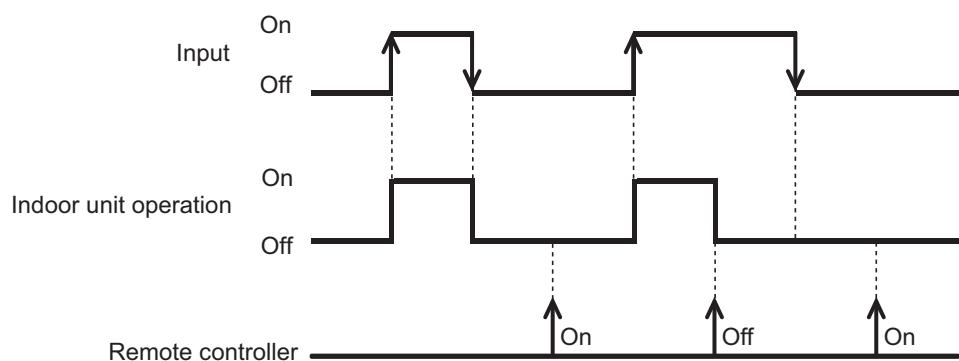

- In the case of "Pulse" input


Function setting	External Input and Output PCB		External input	Input signal	Command
	Rotary switch	SW2			
46-03	1 Pulse	External Input and Output PCB	Ex IN 1	Pulse	Operation (R.C. enabled)
					Stop (R.C. disabled)

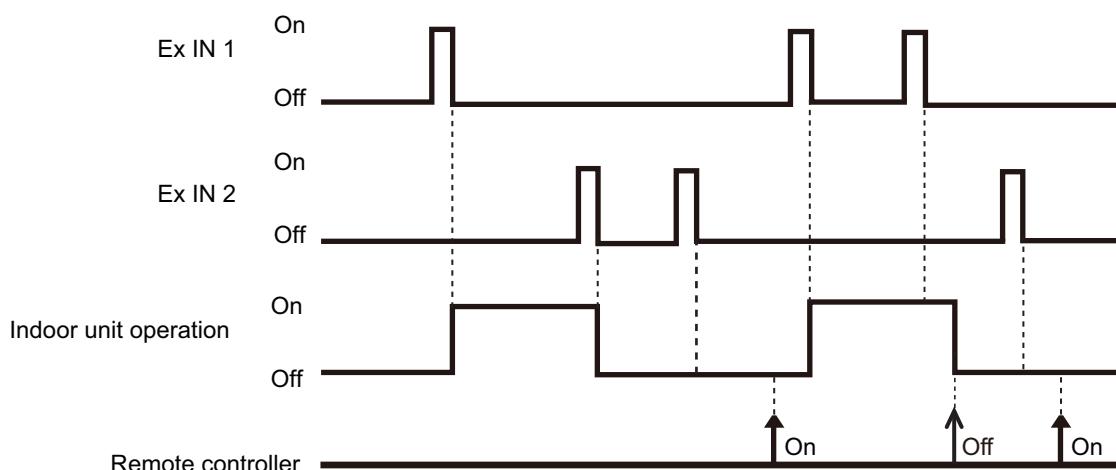

NOTE: When "Operation/Stop" mode 2 function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

● Forced thermostat off

External Input and Output PCB	External input		Input signal	Command
Rotary switch				
2, B, C, D	External Input and Output PCB	Ex IN 1	Off → On	Thermostat off
			On → Off	Normal operation

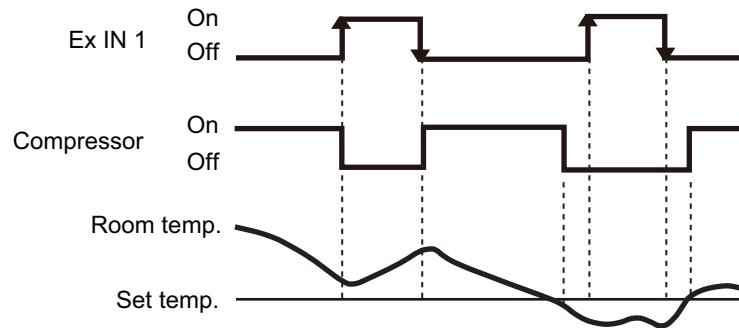


NOTE: When the signal is received from another unit on the refrigerant circuit, there may be a delay in thermostat off function at the unit.

■ Details of control output function

● Operation status

Function setting	External Input and Output PCB	External output		Output signal	Status
	Rotary switch				
60-00	—	Output of indoor unit	CN47	Off → On	Operation
	—			On → Off	Stop
—	1, B, C, D	External Input and Output PCB	Ex OUT 1	Off → On	Operation
	—			On → Off	Stop


The output is low when the unit is stopped.

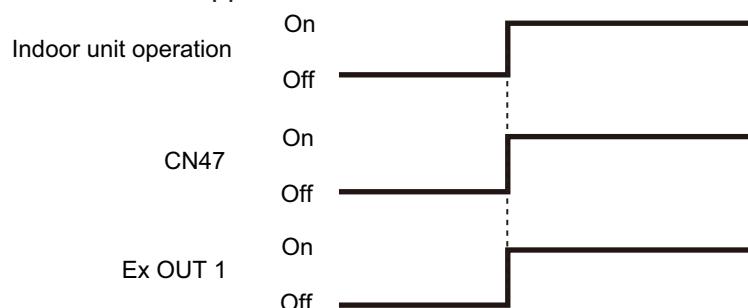

● Error status

Function setting	External Input and Output PCB	External output		Output signal	Status
	Rotary switch				
60-09	—	Output of indoor unit	CN47	Off → On	Error
	—			On → Off	Normal
—	2	External Input and Output PCB	Ex OUT 1	Off → On	Error
	—			On → Off	Normal
—	1, C	External Input and Output PCB	Ex OUT 2	Off → On	Error
	—			On → Off	Normal
—	D	External Input and Output PCB	Ex OUT 3	Off → On	Error
	—			On → Off	Normal


The output is on when an error is generated for the indoor unit.

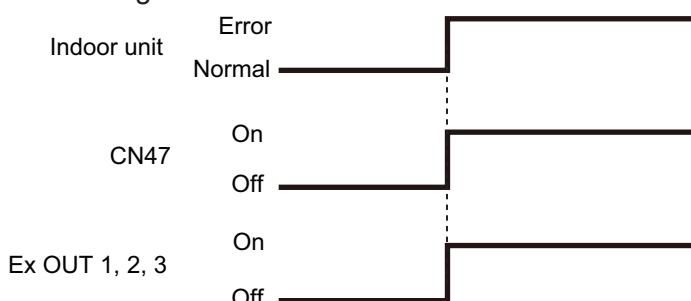

● Indoor unit fan operation status

Function setting	External Input and Output PCB	External output		Output signal	Status
	Rotary switch				
60-10	—	Output of indoor unit	CN47	Off → On	Fan run
—	2, B, D			On → Off	Fan stop
—	1	External Input and Output PCB	Ex OUT 2	Off → On	Fan run
—	—			On → Off	Fan stop


Output signal	Condition
On	The indoor unit fan is operating.
Off	The fan is stopped or during cold air prevention. During thermostat off when in dry mode operation.

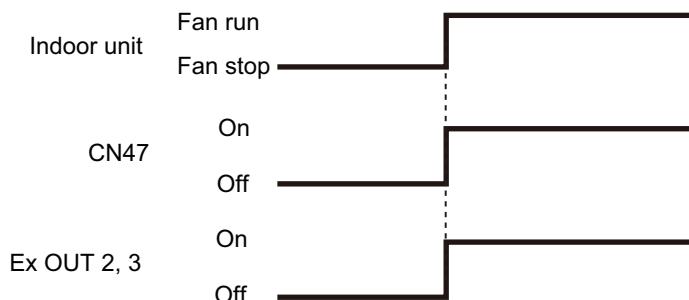

12-2. Mini duct type and Slim duct type

Exterior of the indoor unit PCB and the component location differ by the type of the indoor unit as follows.

- Mini duct type and Slim duct types:

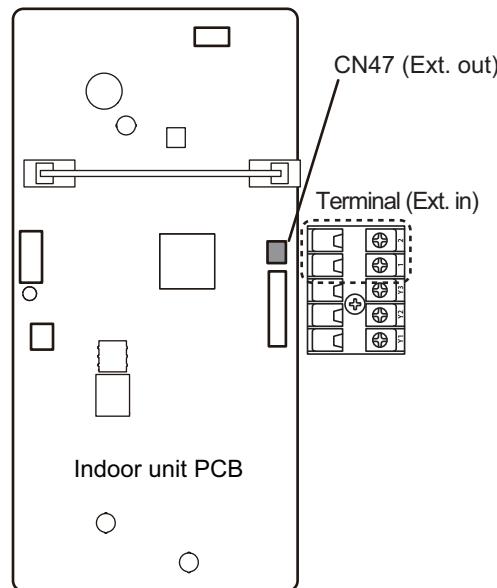


External input and output		Connector	Input select	Input signal	External connect kit (Optional parts)
External input	Operation/Stop Forced stop	Terminal	Dry contact	Edge	—
External output	Operation status	CN47	—	—	UTY-XWZXZG
	Error status				
	Indoor unit fan operation status				
	External heater output				

■ External input

With using external input function, some functions on this product can be controlled from an external device.

- "Operation/Stop" mode or "Forced stop" mode can be selected with function setting of indoor unit.
- A twisted pair cable (22AWG) should be used. Maximum length of cable is 150 m.
- The wire connection should be separate from the power cable line.

Indoor unit functions such as Operation/Stop can be done by using indoor unit terminals.

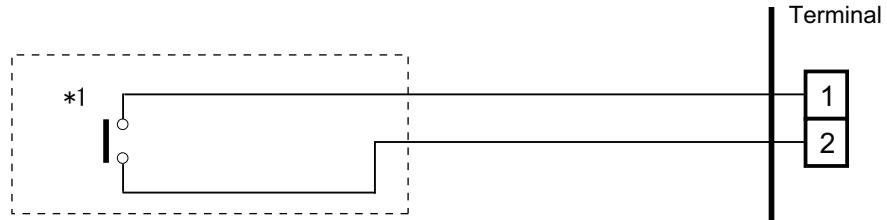

*1: The switch can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.


■ External output

Use an external output cable with appropriate external dimension, depending on the number of cables to be installed.

- A twisted pair cable (22AWG) should be used. Maximum length of cable is 25 m.
- Output voltage: High DC 12 V ± 2 V, Low 0 V.
- Permissible current: 50 mA
- For details, refer to "[Combination of external input and output](#)" on page 175.


● When indicator, etc. are connected directly

Example: Function setting 60 is set to "00"

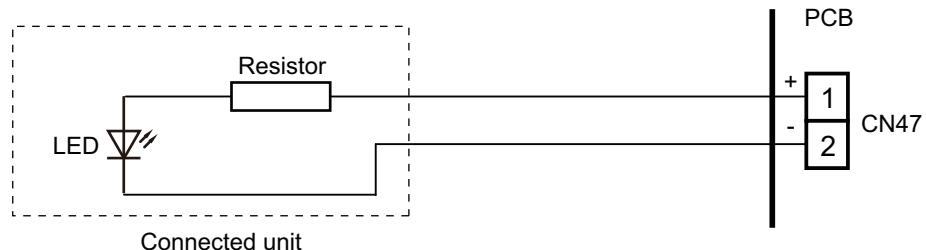

● When connecting with a device equipped with a power supply

Example: Function setting 60 is set to "00"

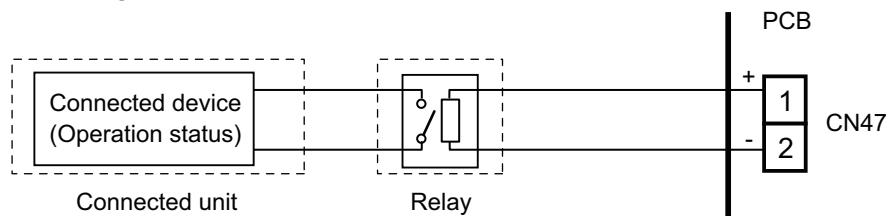

■ Combination of external input and output

By combining the function setting of the indoor unit, you can select various combinations of functions.

Combination examples of external input and output are as follows:

Mode	Function setting	External input	External output
		Terminal	CN47
0	60—00	Operation/Stop	
1—8	60—01 to 60—08	(Setting prohibited)	
9	60—09	Operation/Stop	Error status
10	60—10	Operation/Stop	Indoor unit fan operation status
11	60—11	Operation/Stop	External heater output

NOTE: Input of Operation/Stop depends on the setting of function setting 46.

- 00: Operation/Stop mode 1 (Remote controller enabled)
- 01: (Setting prohibited)
- 02: Forced stop
- 03: Operation/Stop mode 2 (Remote controller disabled)

● Input signal type

- Indoor unit

Input signal type is only "Edge".




■ Details of function

● Control input function

- When function setting is "Operation/Stop" mode 1

Function setting	External input	Input signal	Command
46—00	Terminal	Off → On	Operation
		On → Off	Stop

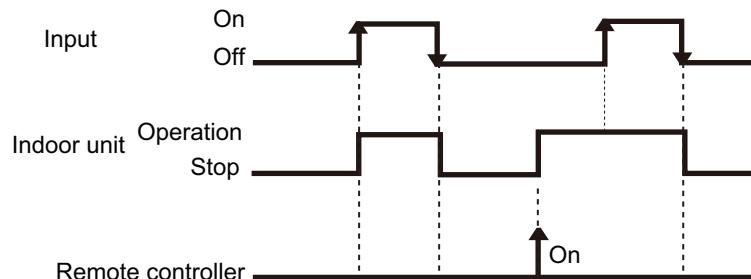


NOTES:

- The last command has priority.
- The indoor units within the same remote controller group operates in the same mode.

- When function setting is "Forced stop" mode

Function setting	External input	Input signal	Command
46—02	Terminal	Off → On	Forced stop
		On → Off	Normal

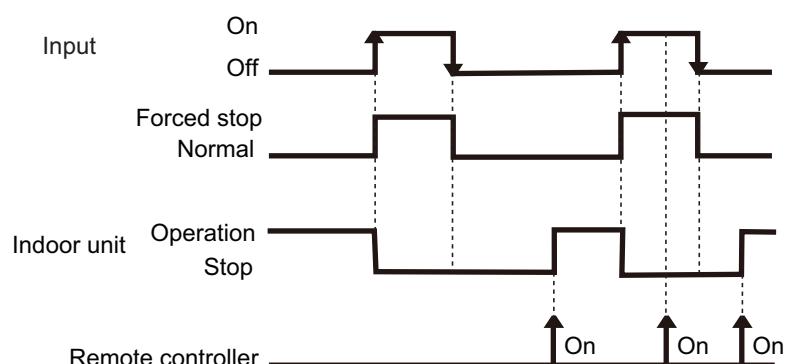


NOTES:

- When the forced stop is triggered, indoor unit stops and Operation/Stop operation by the remote controller is restricted.
- When forced stop function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

- When function setting is "Operation/Stop" mode 2

Function setting	External input	Input signal	Command
46—03	Terminal	Off → On	Operation
		On → Off	Stop (Remote controller disabled)

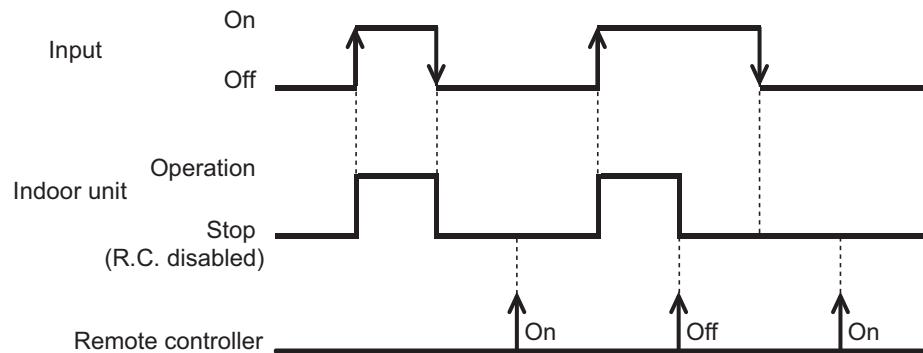


NOTE: When "Operation/Stop" mode 2 function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

● Control output function

Function setting	External output	Output signal	Command
60—00	CN47	Low → High	Operation
		High → Low	Stop


The output is low when the unit is stopped.

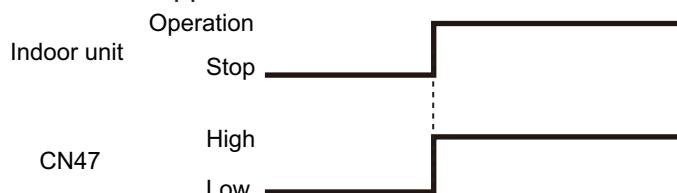

● Error status

Function setting	External output	Output signal	Command
60—09	CN47	Low → High	Error
		High → Low	Normal


The output is ON when an error is generated for the indoor unit.

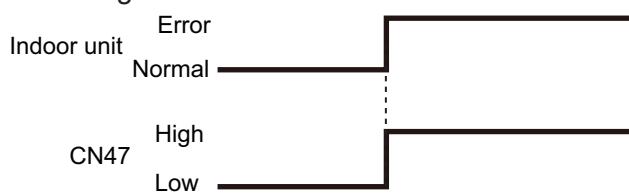

● Indoor unit fan operation status

Function setting	External output	Output signal	Command
60—10	CN47	Low → High	Fan run
		High → Low	Fan stop

Output signal	Condition
On	The indoor unit fan is operating.
Low → High	
Off	The fan is stopped or during cold air prevention.
High → Low	During thermostat off when in dry mode operation.

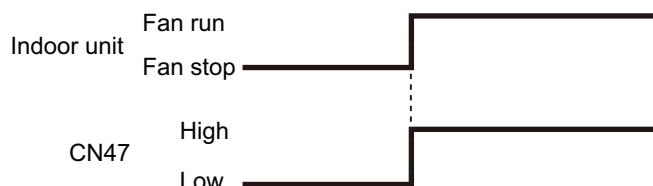

● External heater output


Function setting	External output	Output signal	Command
60—11	CN47	Low → High	Heater on
		High → Low	Heater off

Output signal	Condition
Low → High	Heater turns on as shown in diagram of heating temperature
Off → On	
High → Low	Heater turns off as shown in diagram of heating temperature <ul style="list-style-type: none"> • Other than Heating mode • Error occurred • Forced thermo off • Fan stop protection
On → Off	

Specifications of the signal output performance are as shown as follows:


Example When set temperature (T_s) is set at 22 °C;

- And room temperature (T_r) increase above 12 °C, signal output is on.
- And T_r increase above 21 °C, signal output is off.
- And T_r decrease below 19 °C, signal output is on.
- And T_r decrease below 10 °C, signal output is off.

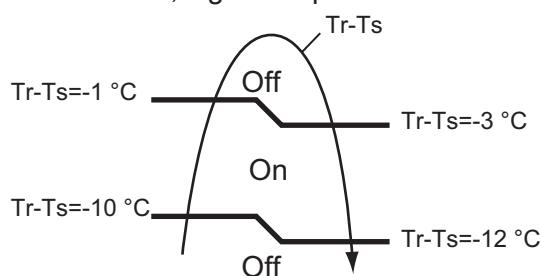

The output also turns off in defrost operation.

12-3. Wall mounted type (KGTB, KETA, and KETA-B)

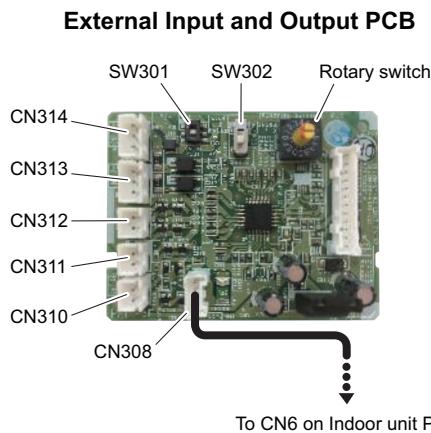

PCB	External input	External output	Connector	Input select	Input signal			
External input and output (UTY-XCSXZ2)	Operation/Stop	-	CN313/ CN314	Dry contact/ Apply voltage	Edge/Pulse			
	Forced stop							
	Forced thermostat off	-	CN313	Edge				
	-		CN310 CN311 CN312					
	Operation status							
	Error status							
	Indoor unit fan operation status							

NOTE: KETA, KETA-B: External Input and Output PCB cannot be used with WLAN Adapter simultaneously.

■ External input

With using external input function, some functions on this product can be controlled from an external device.

- "Operation/Stop" mode or "Forced stop" mode can be selected with function setting of indoor unit.
- A twisted pair cable should be used. Maximum length of cable is 150 m.
- The wire connection should be separate from the power cable line.

● External Input and Output PCB


The indoor unit Operation/Stop can be set by using the input connector on the PCB.

• Input select:

Use either one of these types of connectors according to the application. (Both types of connectors cannot be used simultaneously.)

– Dry contact


In case of internal power supply, set the slide switch of SW301 to "NON VOL" side.

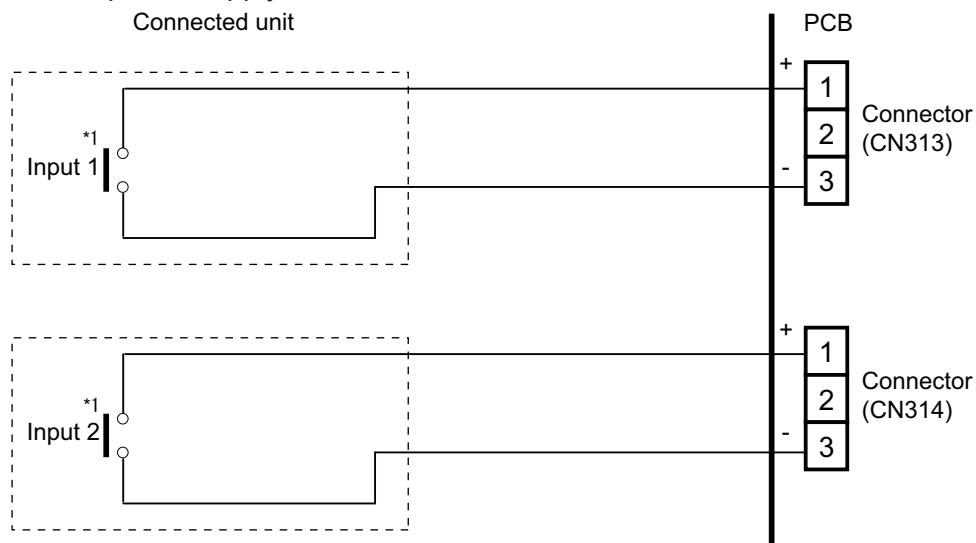

*1: The switches can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

– Apply voltage

In case of external power supply, set the slide switch of SW301 to "VOL" side.

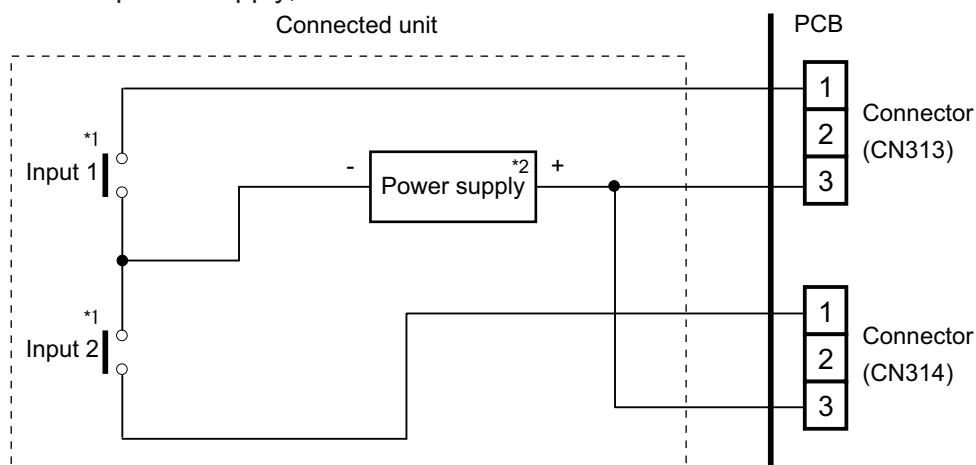

*1: The switches can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.


*2: Make the power supply DC 12 to 24 V, 10 mA or more.

■ External output

Use an external output cable with appropriate external dimension, depending on the number of cables to be installed.


● External Input and Output PCB

- A twisted pair cable (22AWG) should be used. Maximum length of cable is 25 m.
- Output voltage: High DC 12 V±2 V, Low 0 V.
- Permissible current: 50 mA
- For details, refer to "Combination of external input and output" on page 182.
- When indicator or other components are connected directly:**
Example: Function setting 60 is set to "00".

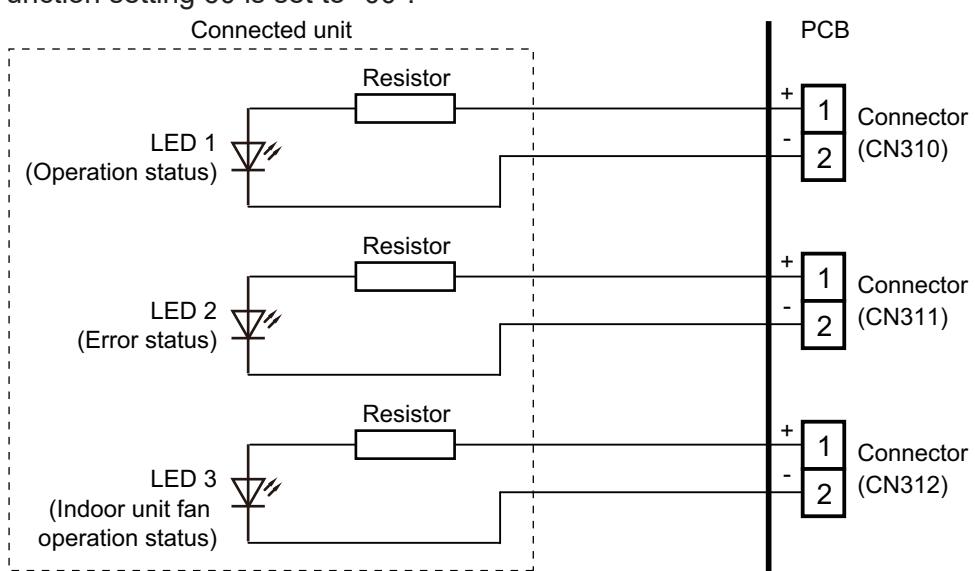

- When connecting with a device equipped with a power supply:**

Example: Function setting 60 is set to "00".

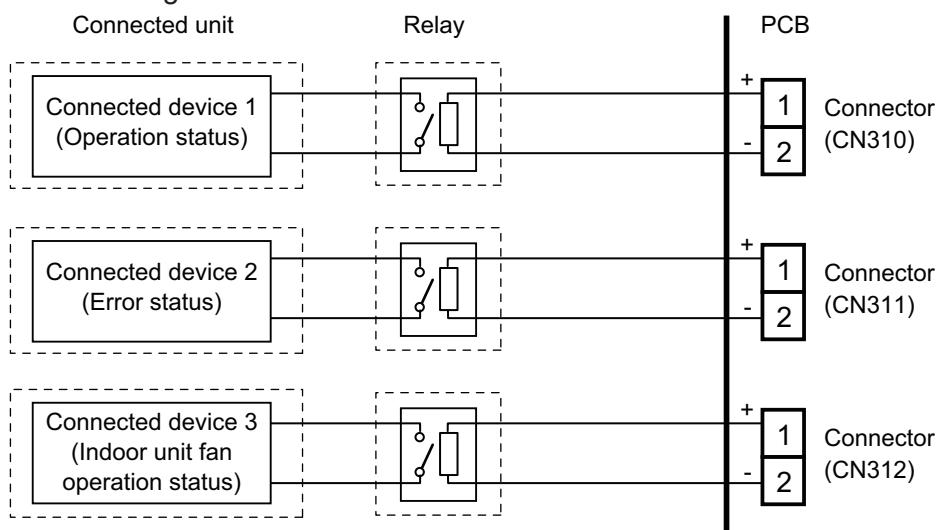

■ Combination of external input and output

By combining the function setting of the indoor unit and rotary switch setting of the External Input and Output PCB, you can select various combinations of functions.

Combination examples of external input and output are as follows:

Mode	Function setting	External Input and Output PCB (Rotary SW)	External input		
			External Input and Output PCB		
			CN313	CN314	Signal type
0-1	60-00	1	Operation/Stop	Not available	Edge
			Operation	Stop	Pulse
0-2	60-00	2	Forced Thermostat OFF	Not available	Edge
1—8	60-01 to 60-08	3 - 9, A	(Setting prohibited)		
9	60-09	B	Forced Thermostat OFF	Not available	Edge
10	60-10	C	Forced Thermostat OFF	Not available	Edge
11	60-11	D	Forced Thermostat OFF	Not available	Edge

Mode	Function setting	External Input and Output PCB (Rotary SW)	External output		
			External Input and Output PCB		
			CN310	CN311	CN312
0-1	60-00	1	Operation/Stop	Error status	Indoor unit fan operation status
0-2	60-00	2	Error status	Indoor unit fan operation status	Not available
1—8	60-01 to 60-08	3 - 9, A	(Setting prohibited)		
9	60-09	B	Operation/Stop	Indoor unit fan operation status	Not available
10	60-10	C	Operation/Stop	Error status	Not available
11	60-11	D	Operation/Stop	Indoor unit fan operation status	Error status

NOTE: Input of Operation/Stop depends on the setting of function setting 46.

00: Operation/Stop mode 1 (Remote controller enabled)

01: (Setting prohibited)

02: Forced stop


03: Operation/Stop mode 2 (Remote controller disabled)

● Input signal type

External Input and Output PCB:

The input signal type can be selected.

Signal type (edge or pulse) can be switched by the DIP switch SW302 on the External Input and Output PCB.

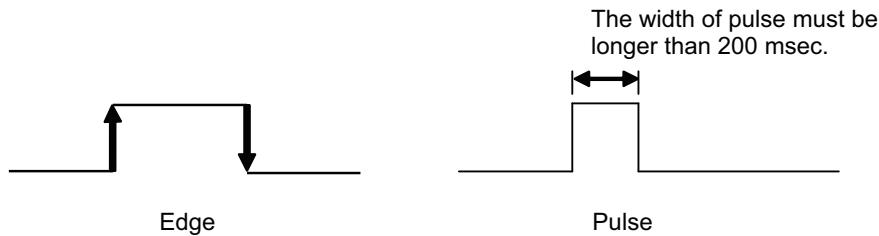


■ Details of function

● Control input function


- When function setting is "Operation/Stop" mode 1
 - In the case of "Edge" input:

Function setting /	Rotary SW on External Input and Output PCB	External input		Input signal	Command
46—00	60—00 / 1	External Input and Output PCB	CN313	Off → On	Operation
				On → Off	Stop

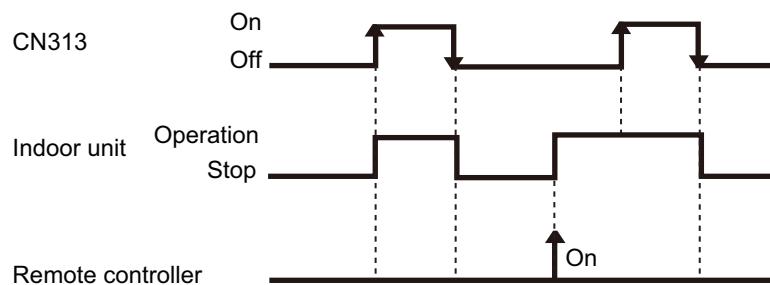

- In the case of "Pulse" input:

Function setting /	Rotary SW on External Input and Output PCB	External input		Input signal	Command
46—00	60—00 / 1	External Input and Output PCB	CN313	Pulse	Operation
				Pulse	Stop

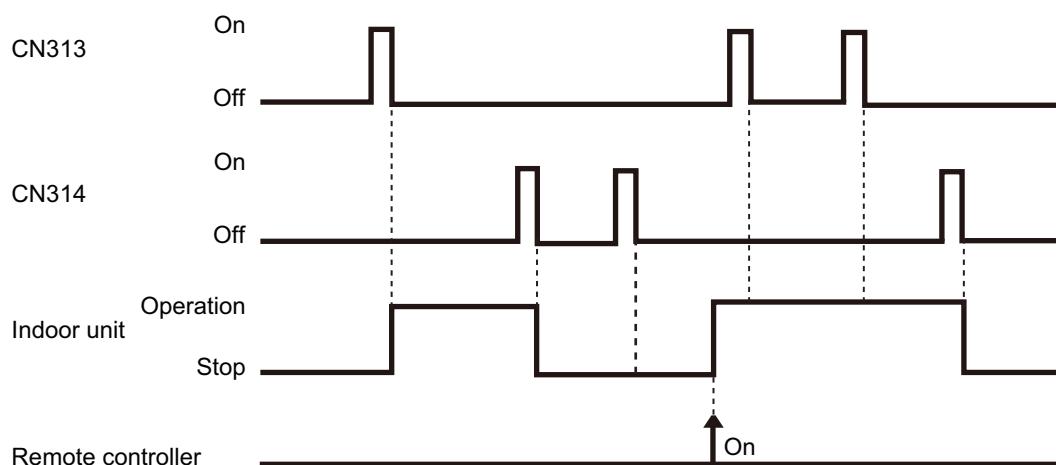


NOTES:

- The last command has priority.
- The indoor units within the same remote controller group operate in the same mode.

- When function setting is "Forced stop" mode


- In the case of "Edge" input:

Function setting /	Rotary SW on External Input and Output PCB	External input		Input signal	Command
46-02	60-00 / 1	External Input and Output PCB	CN313	Off → On	Forced stop
				On → Off	Normal

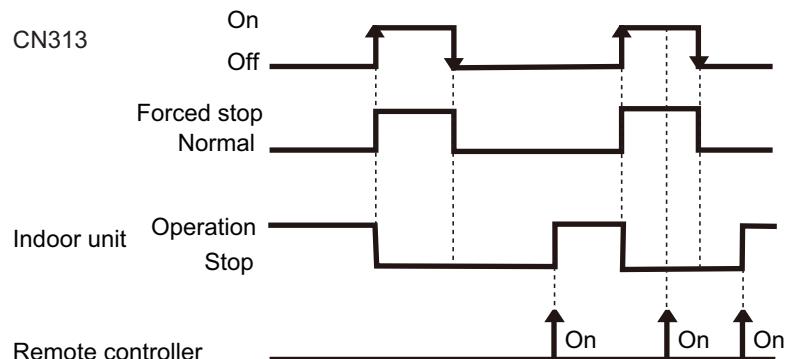

- In the case of "Pulse" input:

Function setting /	Rotary SW on External Input and Output PCB	External input		Input signal	Command
46-02	60-00 / 1	External Input and Output PCB	CN313	Pulse	Forced stop
			CN314	Pulse	Normal

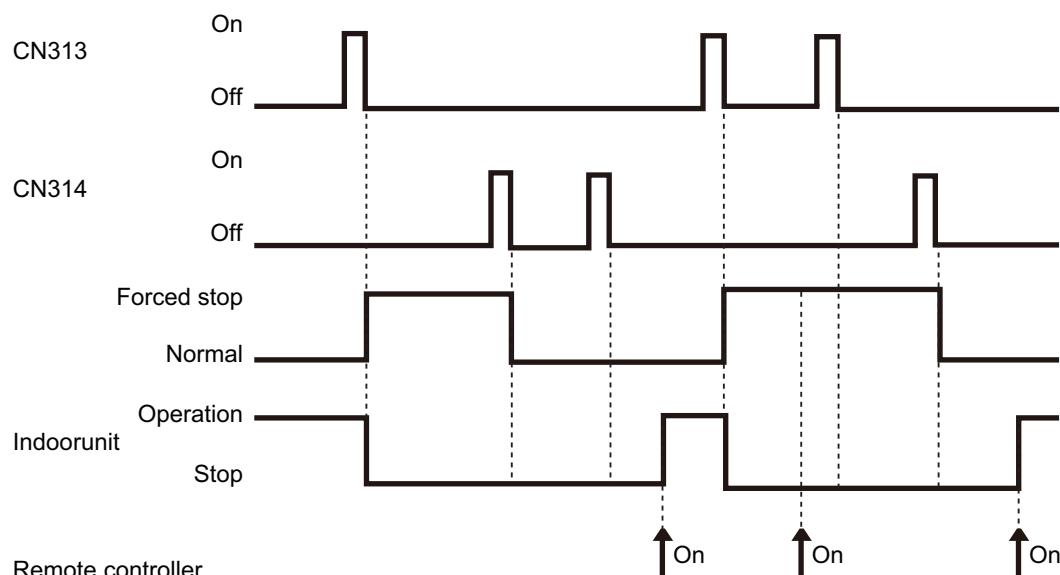


NOTES:

- When the forced stop is triggered, indoor unit stops and Operation/Stop operation by the remote controller is restricted.
- When forced stop function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

- When function setting is "Operation/Stop" mode 2


- In the case of "Edge" input:

Function setting /	Rotary SW on External Input and Output PCB	External input		Input signal	Command
46—03	60—00 / 1	External Input and Output PCB	CN313	Off → On	Operation
				On → Off	Stop (Remote controller disabled)

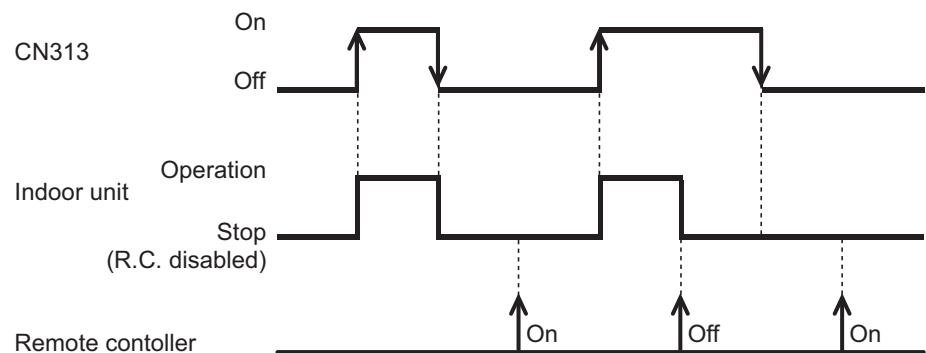

- In the case of "Pulse" input:


Function setting /	Rotary SW on External Input and Output PCB	External input		Input signal	Command
46—03	60—00 / 1	External Input and Output PCB	CN313	Pulse	Operation
			CN314	Pulse	Stop (Remote controller disabled)

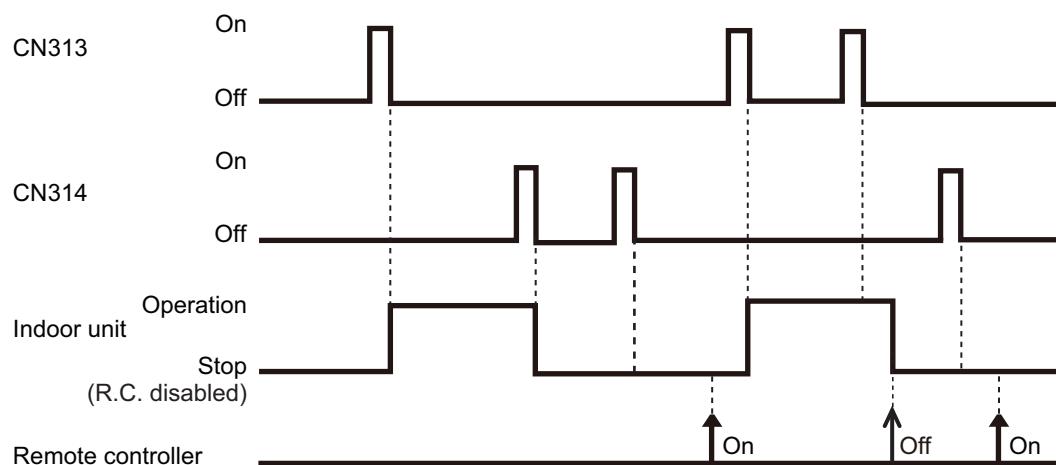

NOTE: When "Operation/Stop" mode 2 function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

- Forced thermostat off function

Function setting /	Rotary SW on External Input and Output PCB	External input		Input signal	Command
60—00 / 2 60—09 / B 60—10 / C	External Input and Output PCB	CN313	Off → On	Thermostat off	
			On → Off	Normal operation	

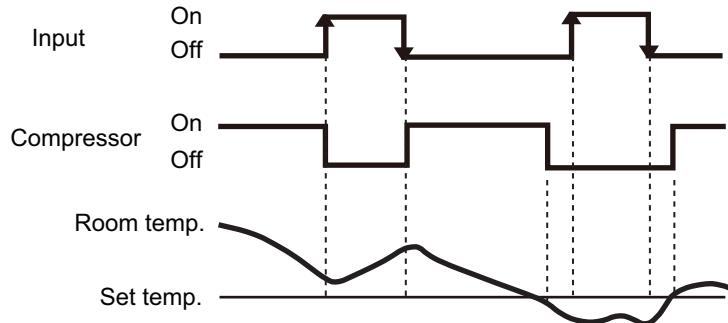


NOTE: When the signal is received from another unit on the refrigerant circuit, there may be a delay in thermostat off function at the unit.

● Control output function

- Operation/Stop status

Function setting /	Rotary SW on External Input and Output PCB	External output		Output signal	Command
	60—00 / 1	External Input and Output PCB		CN310	Off → On On → Off
					Operation Stop


The output is low when the unit is stopped.

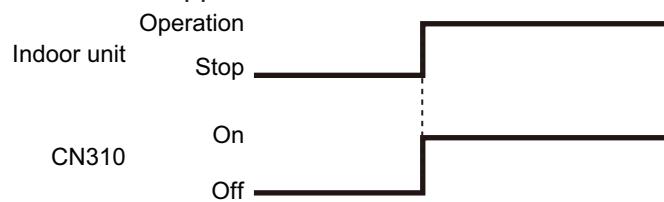

- Error status

Function setting /	Rotary SW on External Input and Output PCB	External output		Output signal	Command
	60—00 / 1	External Input and Output PCB		CN311	Off → On On → Off
					Error Normal


The output is ON when an error is generated for the indoor unit.

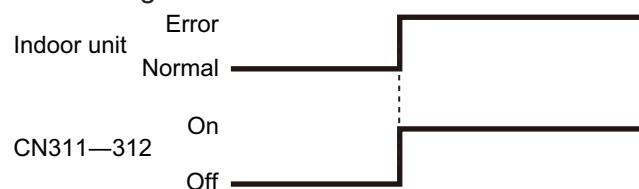

- Indoor unit fan operation status

Function setting /	Rotary SW on External Input and Output PCB	External output		Output signal	Command
	60—00 / 1	External Input and Output PCB		CN312	Off → On On → Off

Output signal	Condition
On Low → High	The indoor unit fan is operating.
Off High → Low	The fan is stopped or during cold air prevention. During thermostat off when in dry mode operation.

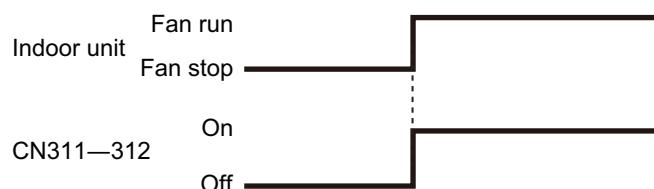

12-4. Wall mounted type (KMTB and KMCC)

With using external input and output functions, this product can be operated inter-connectedly with an external device.

Connector	Input	Output	Remarks
CNA01	Control input	—	See external input/output settings for details.
CNB01	—	Operation status output	
CNB02	—	Error status output	

■ External input

With using external input function, some functions on this product can be controlled from an external device.

- “Operation/Stop” mode can be selected with function setting of indoor unit.
- A twisted pair cable (22AWG) should be used. Maximum length of cable is 150 m.
- The wire connection should be separate from the power cable line.


● Control input (Operation/Stop or Forced stop)

The air conditioner can be remotely operated by means of the following on-site work.

Unit operation is started at the following contents by adding the contact input of a commercially available on/off switch to a connector on the external control PCB and turning it on.


Unit operation	Initial setting after power is on	Starting mode other than initial setting
Operation mode	Auto changeover	Mode at previous operation
Set temperature	24 °C	Temperature at previous operation
Airflow mode	AUTO	Mode at previous operation
Air direction (swing)	Standard air direction (swing: off)	Air direction at previous operation

- Circuit diagram example

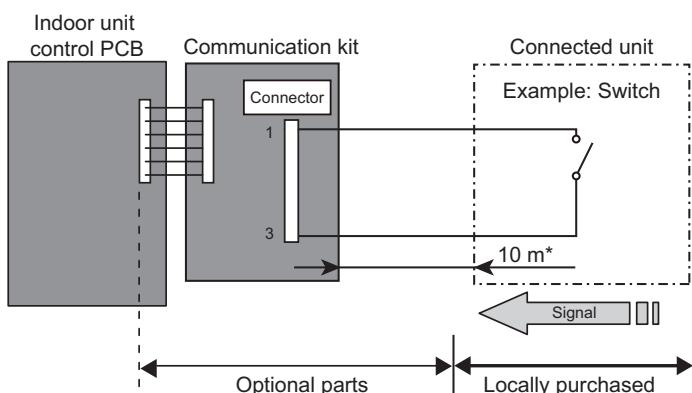


- Contact capacity: DC 24 V or more, 10 mA or more.
- *: Make the distance from the PCB to the connected unit within 10 m.
- Use non-polar relays and switches.


- When function setting is "Operation/Stop" mode

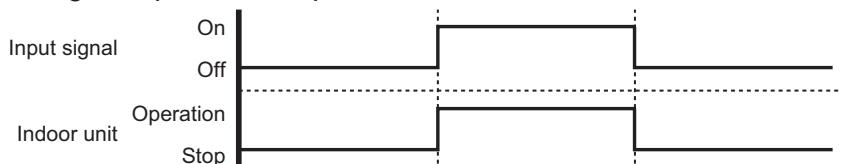

- When function setting is "Forced stop" mode

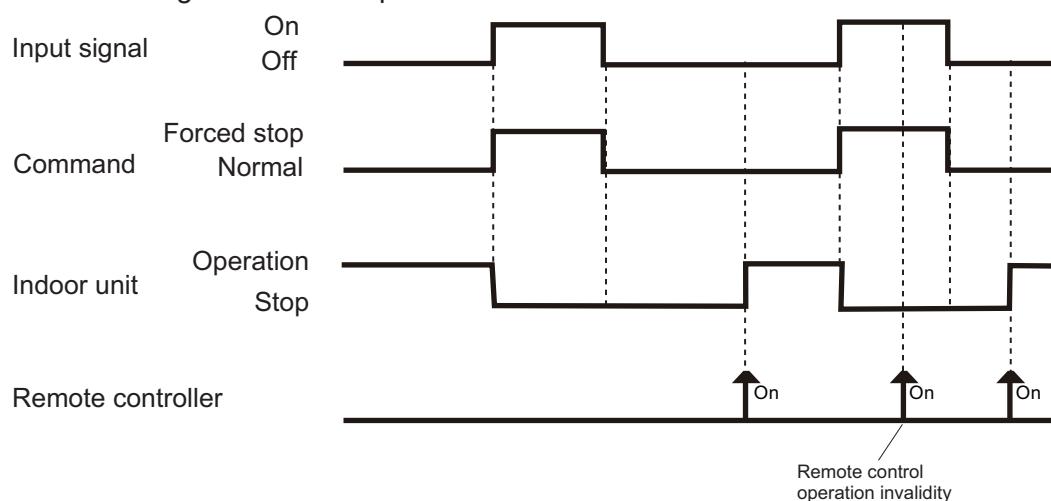


- When function setting is "Operation/Stop" mode 2

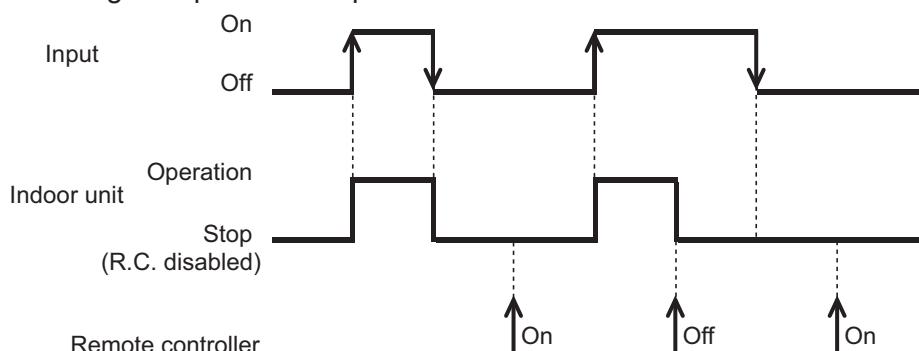

NOTE: When "Operation/Stop" mode 2 function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

- Optional part

Part name	Model name	Exterior
External Connect Kit	UTY-XWZXZ5	External input wire 
Communication Kit	UTY-TWBXF2	

* For operating the external function, the wall mounted type requires the communication kit in addition to the wire (UTY-XWZXZ5).


■ External output

With using external output function, operating status of this product can be transmitted to the external device, and also, this product can be inter-connected with the external device.


● Operation status output

Air conditioner operation status signal can be output.

- **Circuit diagram example:**

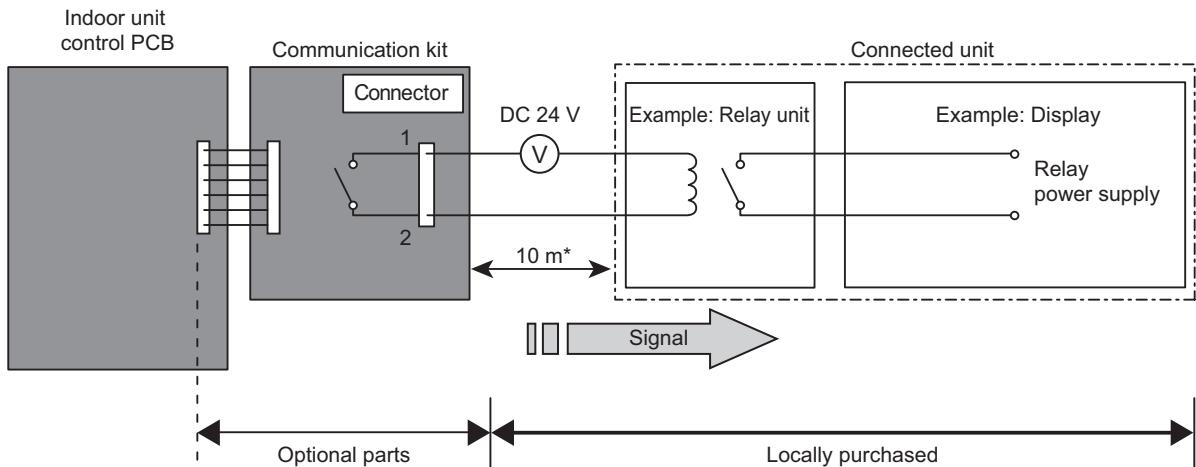

- *: Make the distance from the PCB to the connected unit within 10 m.
- Relay spec: Max. DC 24 V, 10 mA to less than 500 mA.

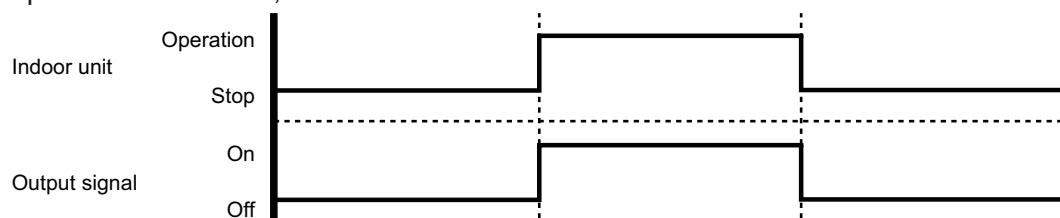

- **Optional part:**


Part name	Model name	Exterior
External Connect Kit	UTY-XWZXZ5	External output wire
Communication Kit	UTY-TWBXF2	

* For operating the external function, the wall mounted type requires the communication kit in addition to the wire (UTY-XWZXZ5).


● Error status output

Air conditioner error status signal can be output.

- **Circuit diagram example:**

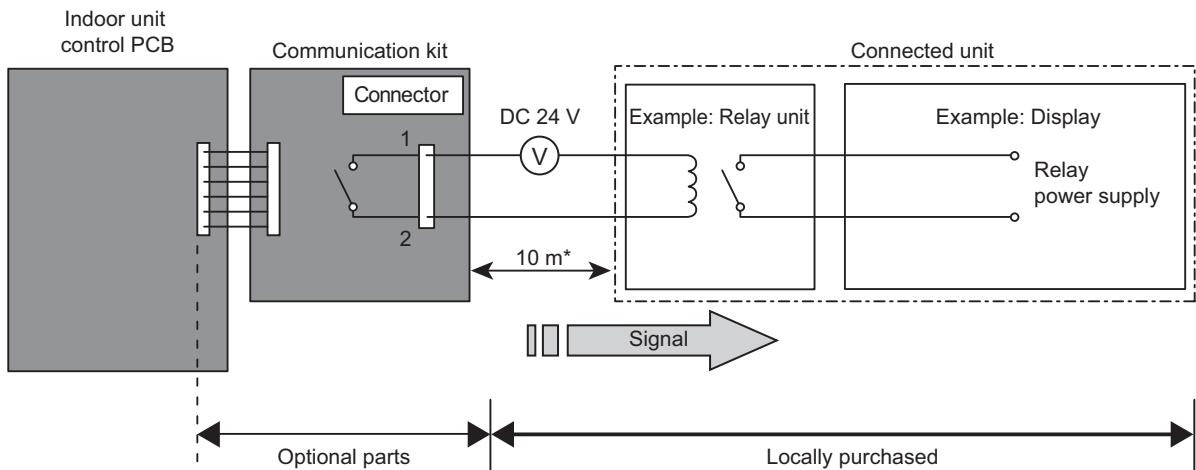

- *: Make the distance from the PCB to the connected unit within 10 m.
- Relay spec: Max. DC 24 V, 10 mA to less than 500 mA.

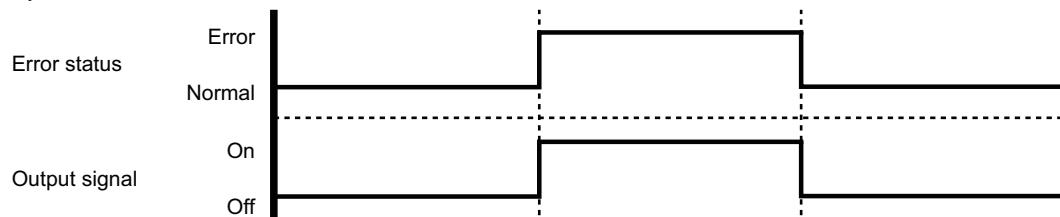


- **Optional part:**

Part name	Model name	Exterior
External Connect Kit	UTY-XWZXZ5	External output wire
Communication Kit	UTY-TWBXF2	

* For operating the external function, the wall mounted type requires the communication kit in addition to the wire (UTY-XWZXZ5).

12-5. Wall mounted type (KMCE, KMCF, KMCG, KMCG-B, KMCH, KMCH-B, KETE, KETE-B, KETF, KETF-B, KGTE, KGTF, KGTG, and KGTH)

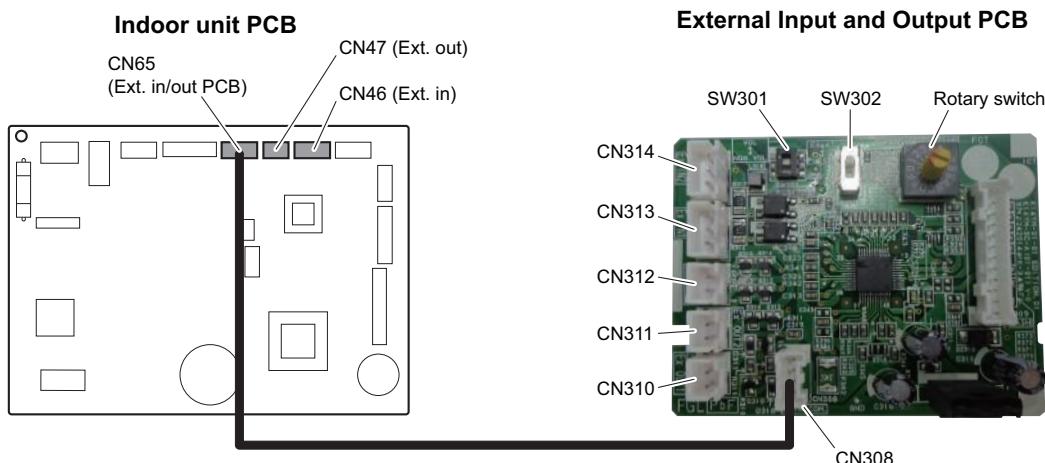

PCB	External input	External output	Connector	Input select	Input signal
Indoor unit	Operation/Stop	—	CN46	Dry contact	Edge
	Forced stop				
	—	Operation status	CN47	—	—
		Error status			
		Indoor unit fan operation status			
External Input and Output PCB (UTY-XCSXZ2)	Operation/Stop	—	CN313/CN314	Dry contact/Apply voltage	Edge/Pulse
	Forced stop				
	Forced thermostat off	—	CN313	—	Edge
	CN310/CN311/CN312				
					Operation status
					Error status
					Indoor unit fan operation status


■ External input

With using external input function, some functions on this product can be controlled from an external device.

- "Operation/Stop" mode or "Forced stop" mode can be selected with function setting of indoor unit.
- A twisted pair cable should be used. Maximum length of cable is 150 m.
- The wire connection should be separate from the power cable line.

● Indoor unit

Indoor unit functions such as Operation/Stop can be done by using indoor unit connectors.

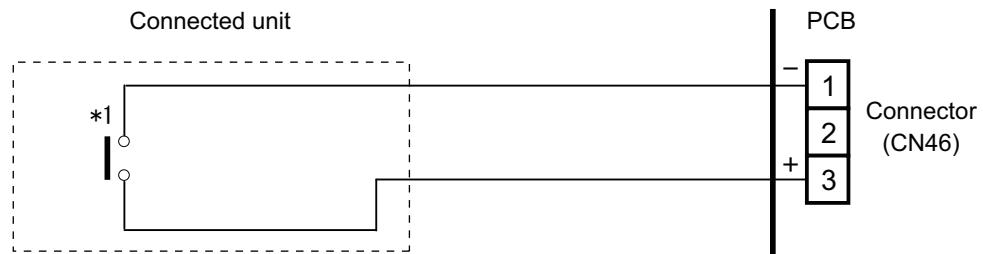

*1: The switch can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

● External Input and Output PCB


The indoor unit Operation/Stop can be set by using the input connector on the PCB.

• Input select:

Use either one of these types of connectors according to the application. (Both types of connectors cannot be used simultaneously.)

- Dry contact


In case of internal power supply, set the slide switch of SW301 to "NON VOL" side.

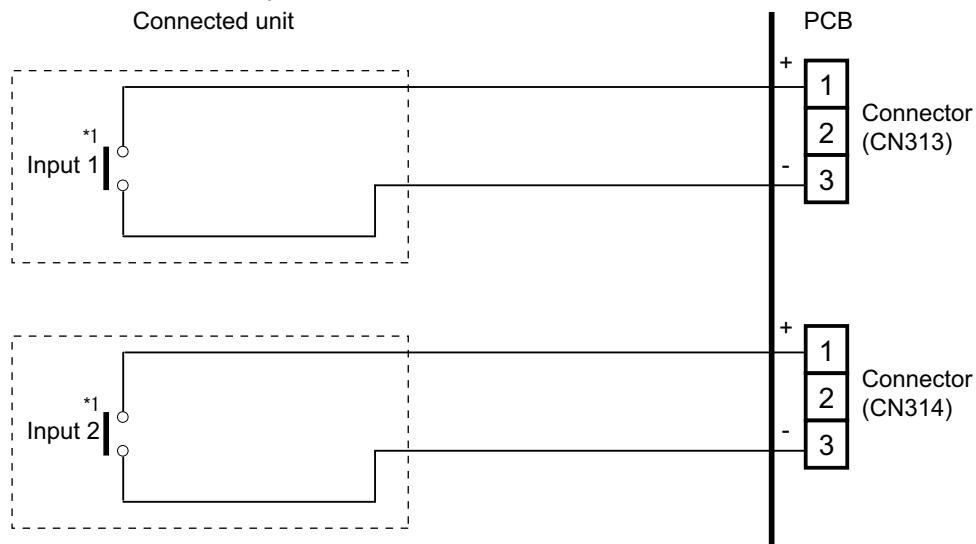

*1: The switches can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

- Apply voltage

In case of external power supply, set the slide switch of SW301 to "VOL" side.

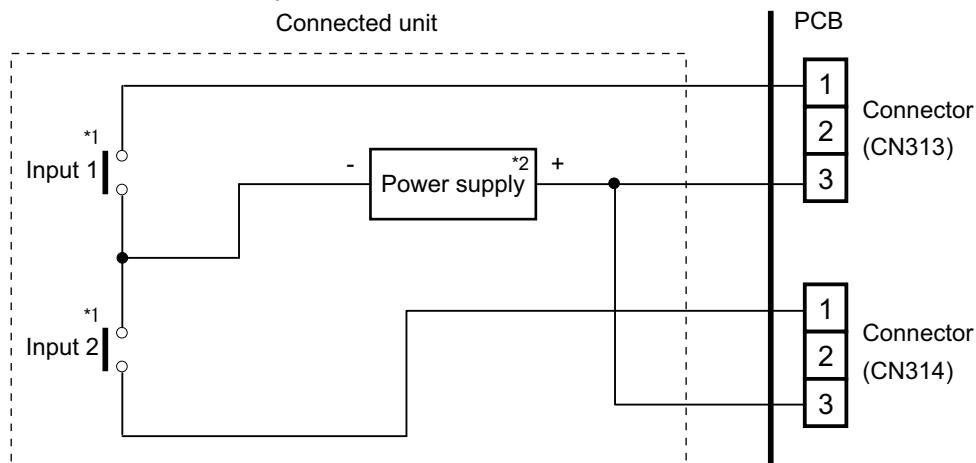

*1: The switches can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

*2: Make the power supply DC 12 to 24 V, 10 mA or more.

■ External output


Use an external output cable with appropriate external dimension, depending on the number of cables to be installed.

● Indoor unit

- A twisted pair cable should be used. Maximum length of cable is 25 m.
- Output voltage: High DC 12 V ± 2 V, Low 0 V.
- Permissible current: 50 mA
- For details, refer to "Combination of external input and output" on page 199


● When indicator or other components are connected directly

Example: Function setting 60 is set to "00"

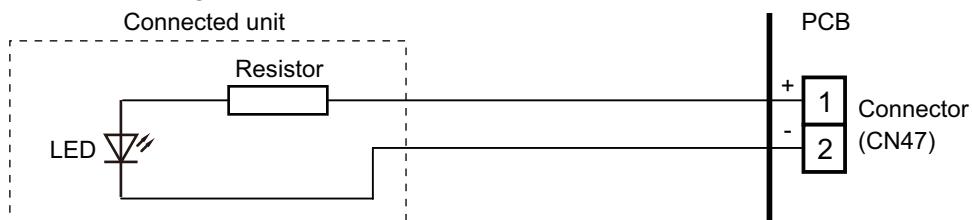

● When connecting with a device equipped with a power supply

Example: Function setting 60 is set to "00"

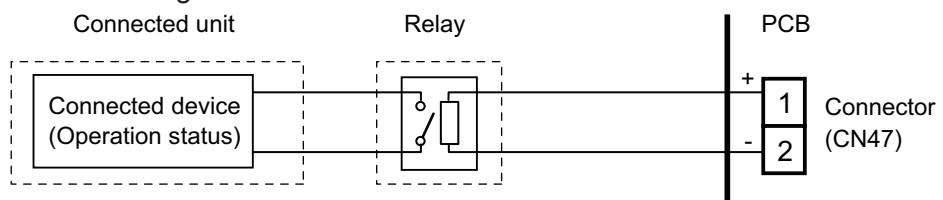


● External Input and Output PCB

- A twisted pair cable should be used. Maximum length of cable is 25 m.
- Output voltage: High DC 12 V±2 V, Low 0 V.
- Permissible current: 50 mA
- For details, refer to "Combination of external input and output" on page 199


- When indicator or other components are connected directly:**

Example: Rotary SW on External Input and Output PCB is set to "1".

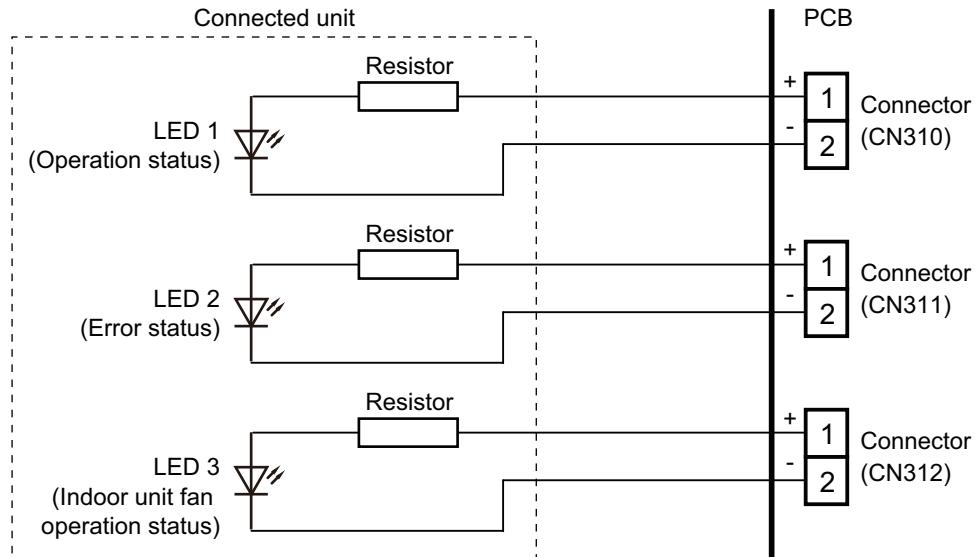

- When connecting with a device equipped with a power supply:**

Example: Rotary SW on External Input and Output PCB is set to "1".

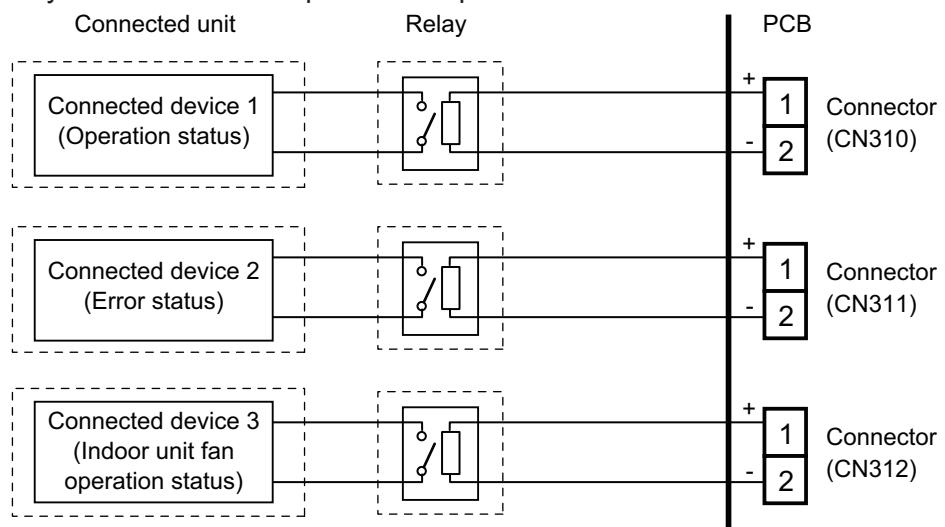

■ Combination of external input and output

By combining the function setting of the indoor unit and rotary switch setting of the External Input and Output PCB, you can select various combinations of functions.

Combination examples of external input and output are as follows:

Mode	Function setting	Rotary SW	External input			
			Indoor unit		External Input and Output PCB	
			CN46	CN313	CN314	
0-1	60—00	1	Operation/Stop mode1 (Function setting 46-00) or Forced stop (Function setting 46-02) or Operation/Stop mode2 (Function setting 46-03)	Operation/Stop	Not available	
0-2				Operation	Stop	
1—8	60-01—08	3—9, A	(Setting prohibited)			
9	60-09	B	Operation/Stop mode1 (Function setting 46-00) or Forced stop (Function setting 46-02) or Operation/Stop mode2 (Function setting 46-03)	Forced thermostat OFF	Not available	
10	60-10	C				
11	60-11	D	(Setting prohibited)			

Mode	Function setting	Rotary SW	External output			
			Indoor unit		External Input and Output PCB	
			CN47	CN310	CN311	CN312
0-1	60-00	1	Operation/Stop	Operation/Stop	Error status	Indoor unit fan operation status
0-2	60-00	2	Operation/Stop	Error status	Indoor unit fan operation status	Not available
1—8	60-01—08	3—9, A	(Setting prohibited)			
9	60-09	B	Error status	Operation/Stop	Indoor unit fan operation status	Not available
10	60-10	C	Indoor unit fan operation status		Error status	
11	60-11	D	(Setting prohibited)			

NOTE: Input of Operation/Stop depends on the setting of function setting 46.

00: Operation/Stop mode 1 (Remote controller enabled)

01: (Setting prohibited)

02: Forced stop


03: Operation/Stop mode 2 (Remote controller disabled)

● Input signal type

External Input and Output PCB:

The input signal type can be selected.

Signal type (edge or pulse) can be switched by the DIP switch SW302 on the External Input and Output PCB.

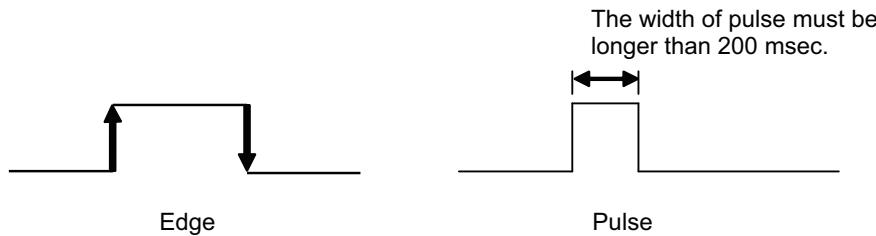


■ Details of function

● Control input function


- When function setting is “Operation/Stop” mode 1
 - In the case of “Edge” input:

Function setting	Rotary SW on External Input and Output PCB	External input		Input signal	Command
46-00	1	External Input and Output PCB	CN313	Off → On	Operation
				On → Off	Stop

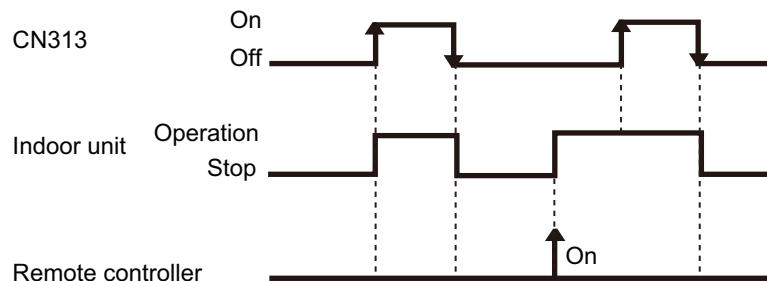

- In the case of “Pulse” input:

Function setting	Rotary SW on External Input and Output PCB	External input		Input signal	Command
46-00	1	External Input and Output PCB	CN313	Pulse	Operation
				CN314	Stop

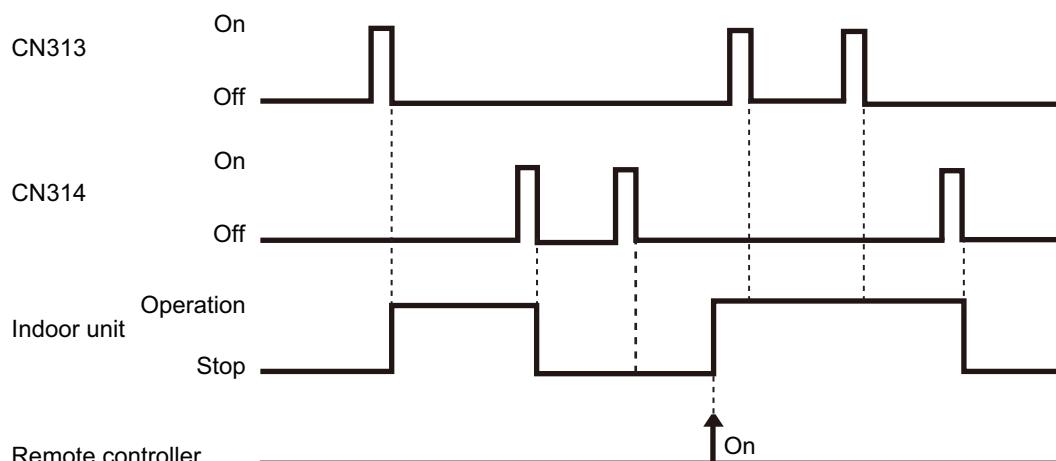


NOTES:

- The last command has priority.
- The indoor units within the same remote controller group operates in the same mode.

- When function setting is “Forced stop” mode


- In the case of “Edge” input:

Function setting	Rotary SW on External Input and Output PCB	External input		Input signal	Command
46-02	1	External Input and Output PCB	CN313	Off → On	Forced stop
				On → Off	Normal

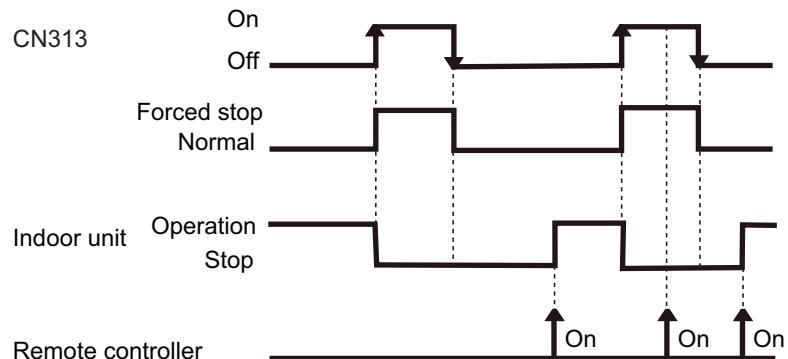

- In the case of “Pulse” input:

Function setting	Rotary SW on External Input and Output PCB	External input		Input signal	Command
46-02	1	External Input and Output PCB	CN313	Pulse	Forced stop
			CN314	Pulse	Normal

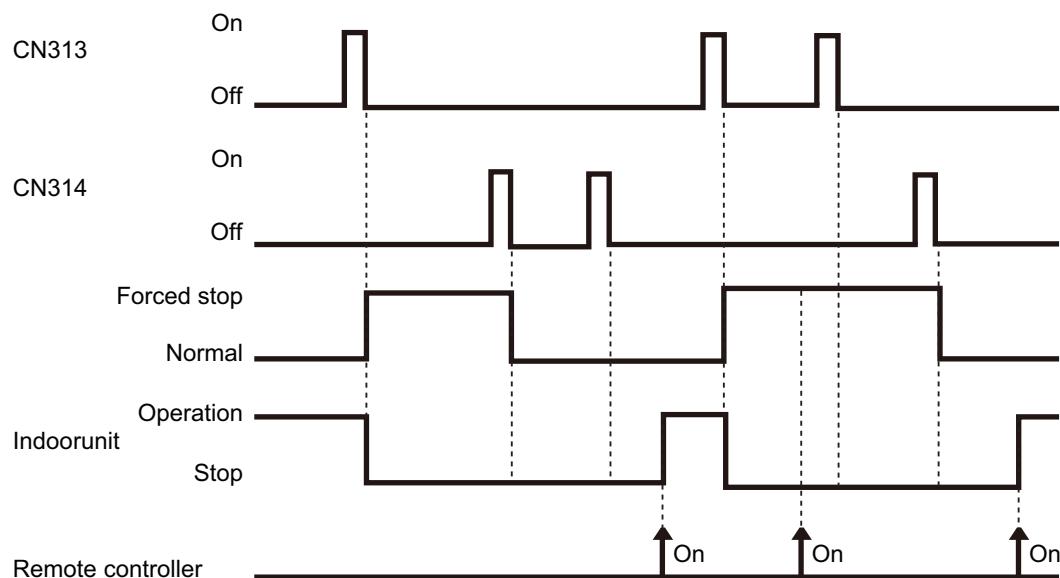

NOTES:

- When the forced stop is triggered, indoor unit stops and Operation/Stop operation by the remote controller is restricted.
- When forced stop function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

- When function setting is “Operation/Stop” mode 2


- In the case of “Edge” input:

Function setting	Rotary SW on External Input and Output PCB	External input		Input signal	Command
46-03	1	External Input and Output PCB	CN313	Off → On	Operation
				On → Off	Stop (Remote controller disabled)

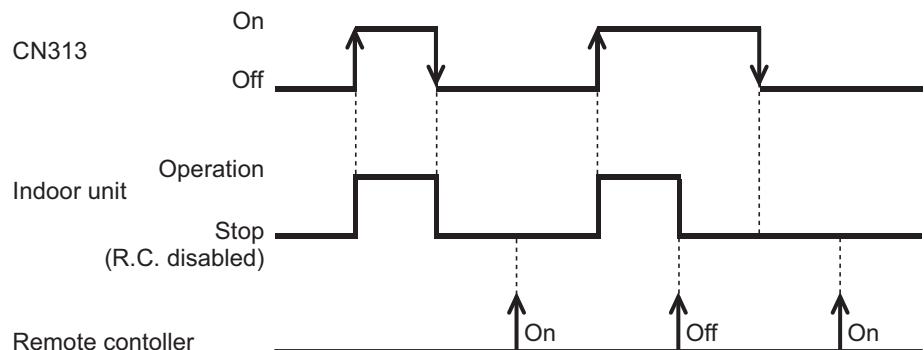

- In the case of “Pulse” input:


Function setting	Rotary SW on External Input and Output PCB	External input		Input signal	Command
46-03	1	External Input and Output PCB	CN313	Pulse	Operation
			CN314	Pulse	Stop (Remote controller disabled)

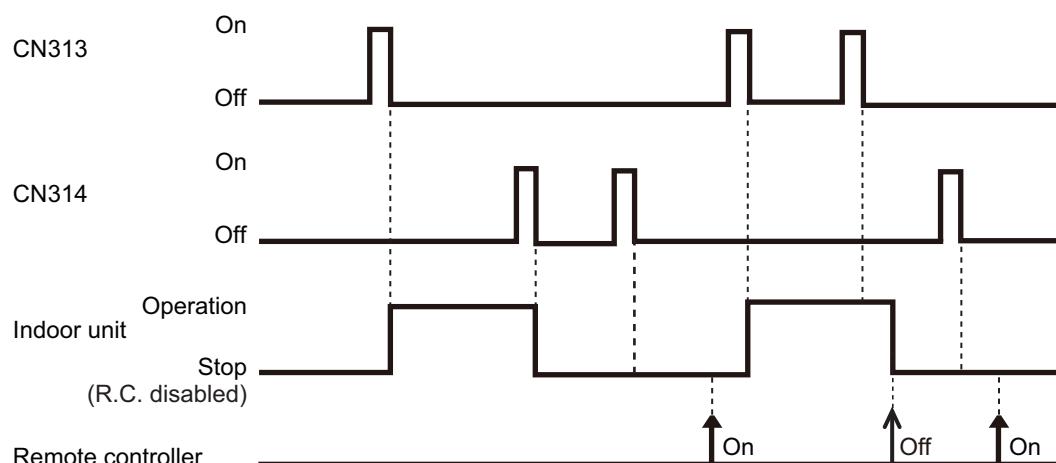

NOTE: When “Operation/Stop” mode 2 function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

- Forced thermostat off function

Function setting / Rotary SW on External Input and Output PCB	External input		Input signal	Command
60-00 / 2 60-09 / B 60-10 / C	External Input and Output PCB	CN313	Off → On	Thermostat off
			On → Off	Normal operation

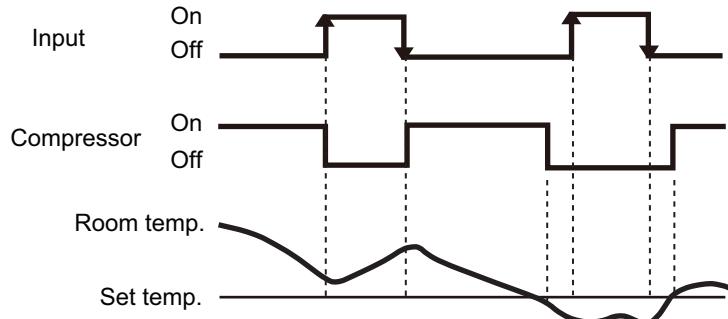


NOTE: When the signal is received from another unit on the refrigerant circuit, there may be a delay in thermostat off function at the unit.

● Control output function

- Operation/Stop status

Function setting / Rotary SW on External Input and Output PCB	External output		Output signal	Command
60-00 / 1	Output of indoor unit	CN47	Off → On	Operation
60-00 / 2			On → Off	Stop
60-00 / 1	External Input and Output PCB	CN310	Off → On	Operation
60-09 / B			On → Off	Stop
60-10 / C		CN310	Off → On	Operation
60-11 / D			On → Off	Stop


The output is low when the unit is stopped.

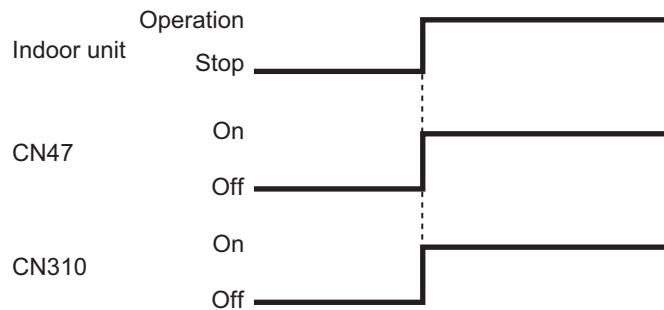

- Error status

Function setting / Rotary SW on External Input and Output PCB	External output		Output signal	Command
60-09 / B	Output of indoor unit	CN47	Off → On	Error
60-00 / 2			On → Off	Normal
60-00 / 1	External Input and Output PCB	CN310	Off → On	Error
60-10 / C			On → Off	Normal
60-11 / D		CN311	Off → On	Error
			On → Off	Normal
		CN312	Off → On	Error
			On → Off	Normal


The output is ON when an error is generated for the indoor unit.

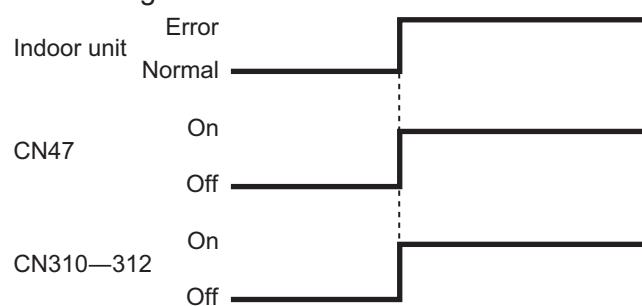


- Indoor unit fan operation status

Function setting / Rotary SW on External Input and Output PCB	External output		Output signal	Command
60-10 / C	Output of indoor unit	CN47	Off → On	Fan run
60-00 / 2 60-09 / B 60-11 / D	External Input and Output PCB	CN311	On → Off	Fan stop
			Off → On	Fan run
60-00 / 1		CN312	On → Off	Fan stop
			Off → On	Fan run

Output signal	Condition
On Low → High	The indoor unit fan is operating.
Off High → Low	The fan is stopped or during cold air prevention. During thermostat off when in dry mode operation.

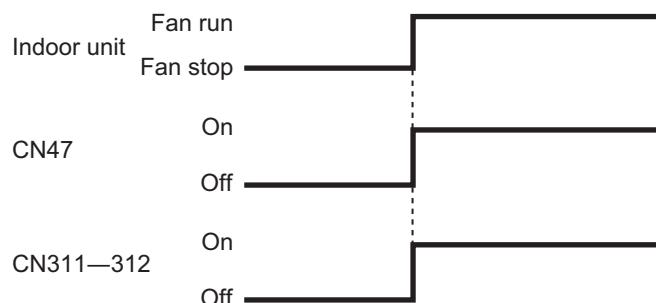

12-6. Floor type

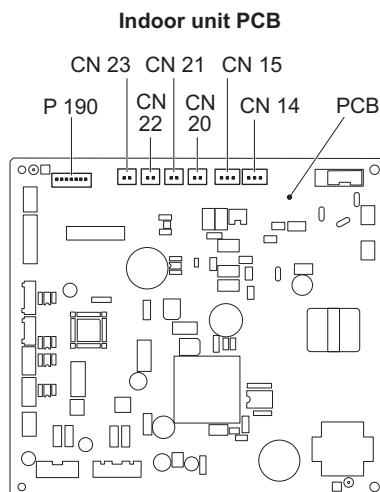

PCB	External input	External output	Connector	Input signal
Indoor unit	Operation/Stop	—	CN14	Edge
	Forced stop			
	Forced thermostat off		CN15	
	—	Operation status	CN20/CN21/ CN22/CN23	—
		Error status		
		Indoor unit fan operation status		
		External heater output		


■ External input

With using external input function, some functions on this product can be controlled from an external device.

- “Operation/Stop” mode can be selected with function setting of indoor unit.
- A twisted pair cable (22AWG) should be used. Maximum length of cable is 150 m.
- The wire connection should be separate from the power cable line.

● Indoor unit

Indoor unit functions such as Operation/Stop can be done by using indoor unit connectors.

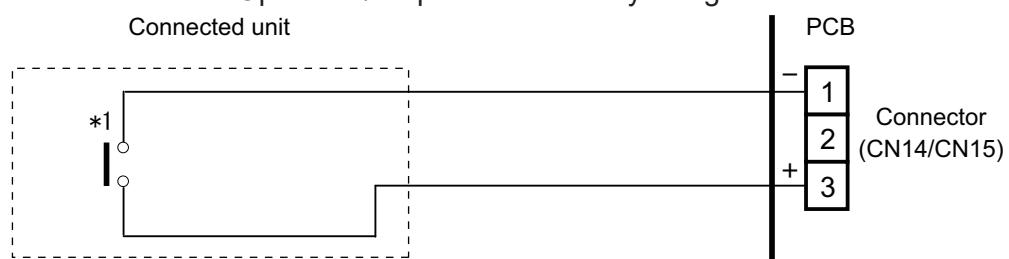

*1: The switch can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

■ External output


Use an external output cable with appropriate external dimension, depending on the number of cables to be installed.

● Indoor unit

- A twisted pair cable (22AWG) should be used. Maximum length of cable is 25 m .
- Output voltage: High DC 12 V ± 2 V, Low 0 V.
- Permissible current: 50 mA
- For details, refer to Chapter 12-6-3. "Combination of external input and output" on page 209.


● When indicator or other components are connected directly

Example: Function setting 60 is set to "00"

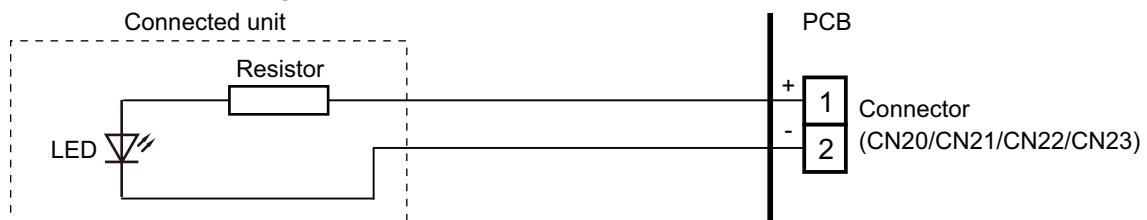

● When connecting with a device equipped with a power supply

Example: Function setting 60 is set to "00"

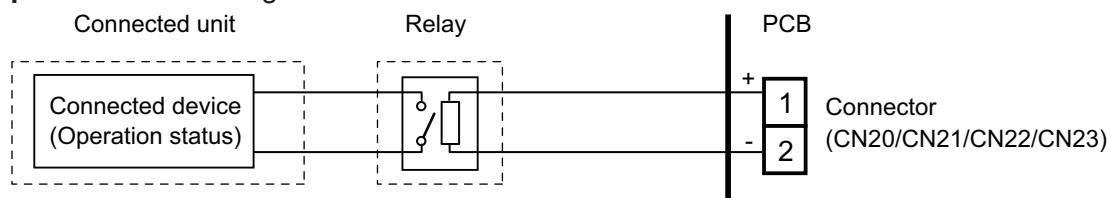

■ Combination of external input and output

By combining the function setting of the indoor unit, you can select various combinations of functions.

Combination examples of external input and output are as follows:

Mode	Function setting	External input	
		Indoor unit	
		CN14	CN15
0	60-00	Operation/Stop (Function setting 46-00) or Forced stop (Function setting 46-02)	Forced thermostat Off
9	60-09		Forced thermostat Off
10	60-10		Forced thermostat Off
11	60-11		Forced thermostat Off
12	60-12		Forced thermostat Off

Mode	Function setting	External output			
		Indoor unit			
		CN20	CN21	CN22	CN23
0	60-00	Operation/Stop	Error status	Indoor unit fan operation status	External heater output
9	60-09	Error status	Operation/Stop	Indoor unit fan operation status	External heater output
10	60-10	Indoor unit fan operation status	Operation/Stop	Error status	External heater output
11	60-11	External heater output	Operation/Stop	Indoor unit fan operation status	Error status

NOTE: Input of Operation/Stop depends on the setting of function setting 46.

- 00: Operation/Stop mode 1 (Remote controller enabled)
- 01: (Setting prohibited)
- 02: Forced stop
- 03: Operation/Stop mode 2 (Remote controller disabled)

● Input signal type

• Indoor unit

Input signal type is only "Edge".




■ Details of function

● Control input function


- When function setting is "Operation/Stop" mode 1
 - In the case of "Edge" input

Mode	Function setting		External input	Input signal	Command
0	46-00	—	Input of indoor unit	CN14	Off → On Operation
		60-00			On → Off Stop
	60-00	—		CN15	Off → On Operation
		—		CN15	On → Off Stop

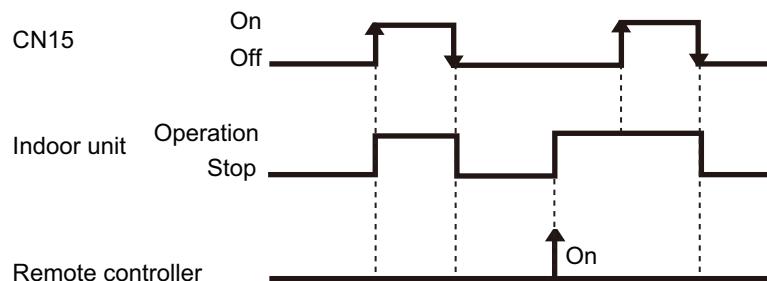


- When function setting is "Forced stop" mode
 - In the case of "Edge" input

Mode	Function setting		External input	Input signal	Command
0	46-02	—	Input of indoor unit	CN14	Off → On Forced stop
		60-00			On → Off Normal
	60-00	—		CN15	Off → On Forced stop
		—		CN15	On → Off Normal

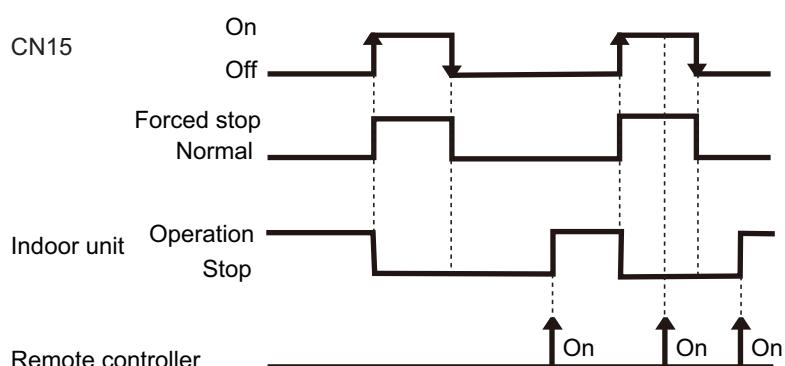

- When function setting is "Operation/Stop" mode 2
 - In the case of "Edge" input

Mode	Function setting		External input		Input signal	Command
0	46-03	—	Input of indoor unit	CN14	Off → On	Operation
		60-00			On → Off	Stop (Remote controller disabled)
	60-00	—		CN15	Off → On	Operation
		—			On → Off	Stop (Remote controller disabled)

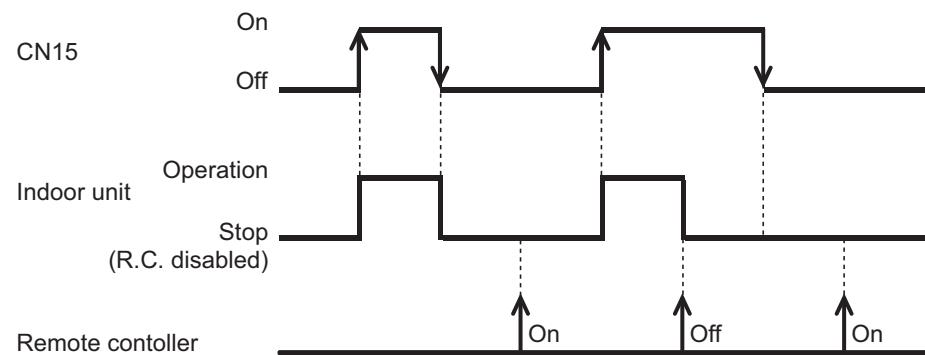


● Control output function

- Operation/Stop status

Mode	Function setting	External output		Output signal	Command
0	60-00	Output of indoor unit	CN15	Low → High	Operation
0				High → Low	Stop
0	60-00		CN20	Off → On	Operation
0				On → Off	Stop


The output is low when the unit is stopped.

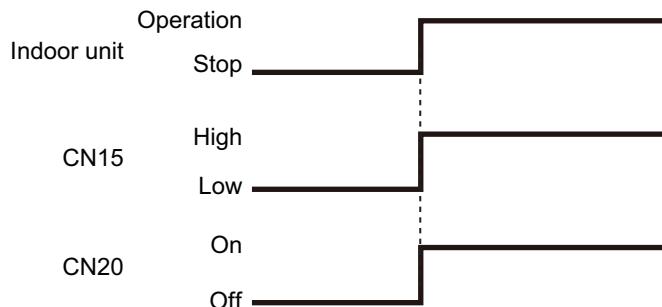

- Error status

Mode	Function setting	External output		Output signal	Command
9	60-09	Output of indoor unit	CN15	Low → High	Error
0				High → Low	Normal
0	60-00		CN21	Off → On	Error
0				On → Off	Normal


The output is ON when an error is generated for the indoor unit.

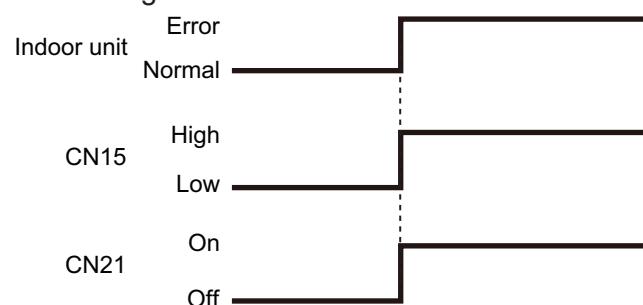

- Indoor unit fan operation status

Mode	Function setting	External output		Output signal	Command
10	60-10	Output of indoor unit	CN15	Low → High	Fan run
0	60-00		CN22	High → Low	Fan stop
				Off → On	Fan run
				On → Off	Fan stop

Output signal	Condition
On Low → High	The indoor unit fan is operating.
Off High → Low	The fan is stopped or during cold air prevention. During thermostat off when in dry mode operation.

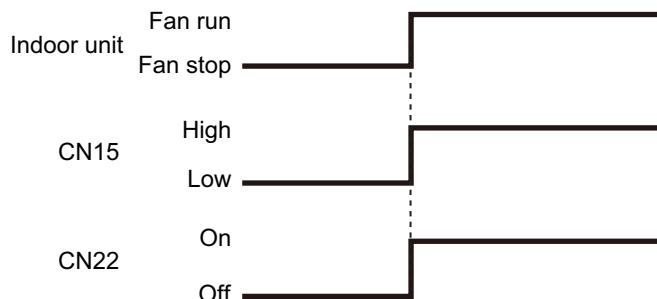

- Setpoint Attainment status


NOTE: This function is valid only when function setting 96 is set to "01" (Primary unit) or "02" (Secondary unit).

When the room temperature does not reach the setpoint at a room due to the lower cooling performance caused by external factor such as the outdoor temperature change, signal is output to tell the attainment status of setpoint.

Mode	Function setting	External output		Output signal	Command
12	60-12	Output of indoor unit	CN15	On → Off	Normal
				Off → On	Setpoint Attainment

Output signal	Condition
Off	Reached the setpoint. ($Tr \leq Tsa + 0.5^{\circ}C$)
On	Unreached the setpoint. ($Tr > Tsa + 2.5^{\circ}C$) However, even if the setpoint unreached, the signal will not be output for 7 minutes after power is turned on.

When performing the server room control, both of the primary unit and secondary unit output the setpoint attainment status if any of the unit is outputting alternative operation command.

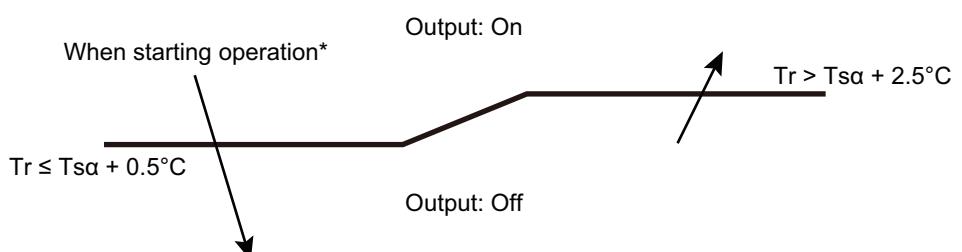


*: When starting operation or resetting, judges the zone to descending direction.

● External heater output

- **Installation configuration of individual connection**

External heating device is installed individually. (No use of indoor unit fan)

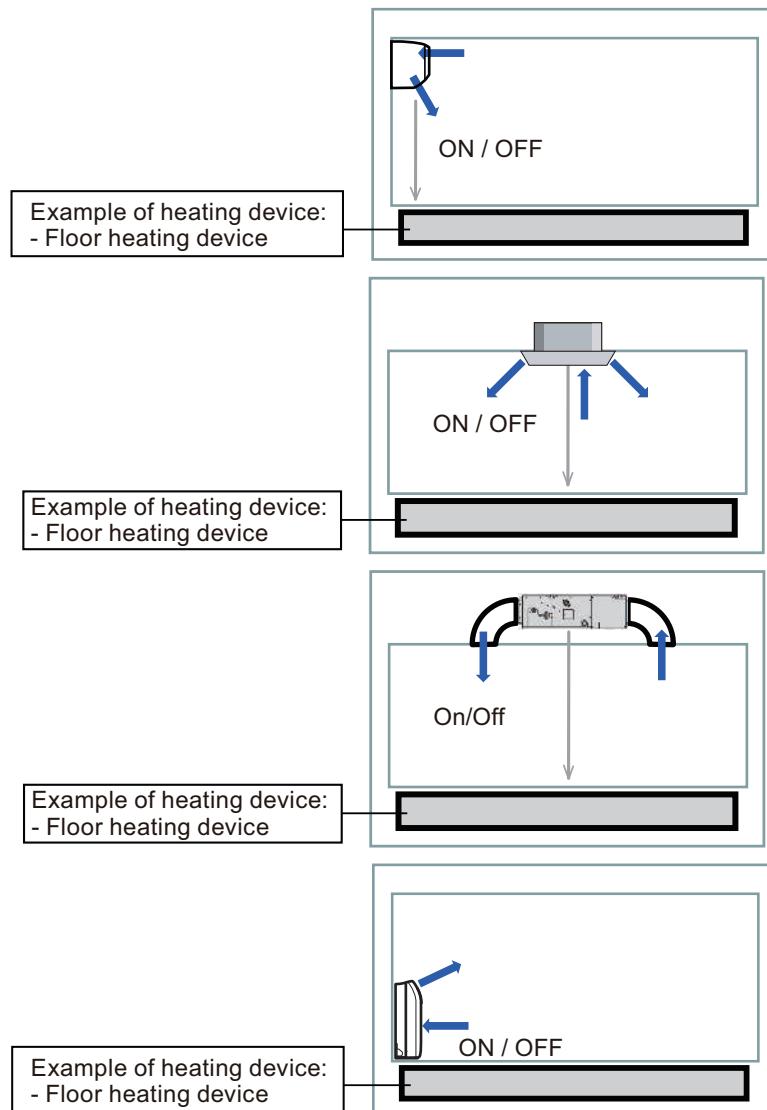


⚠ WARNING

- Design and install external heater appropriately with considering its protection.
- Inappropriate designing and installation of external heater may cause a fire by emitted heat from the external heater.
- Fujitsu General Ltd. is not responsible for inappropriate designing or installation of external heating device.


- Auxiliary heater control 1

Operation	Condition
Heater on	Heater is on as shown in following diagram of heating temperature.
Heater off	<ul style="list-style-type: none"> Heater is off as shown in following diagram of heating temperature. Other than heating mode Error occurred Forced thermostat off Fan stop protection


- Temperature of heater on (Thon): Adjustable by function number 62 (Operating temperature switching of external heaters).
- All control temperatures will shift by adjusting “Thon”.

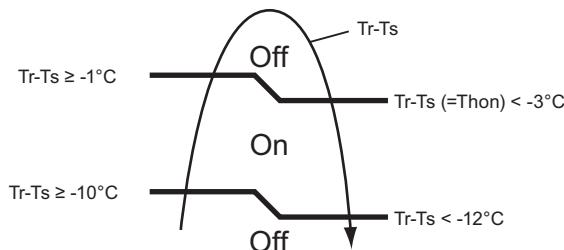

Tr: Room temperature
Ts: Set temperature
Thon: Heater on temperature

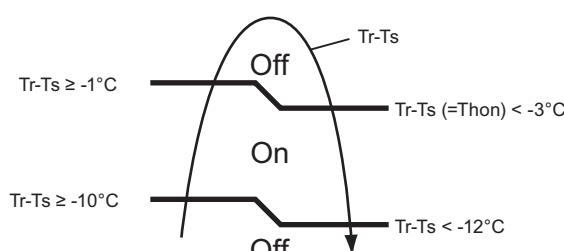

Tr: Room temperature
Ts: Set temperature
Thon: Heater on temperature

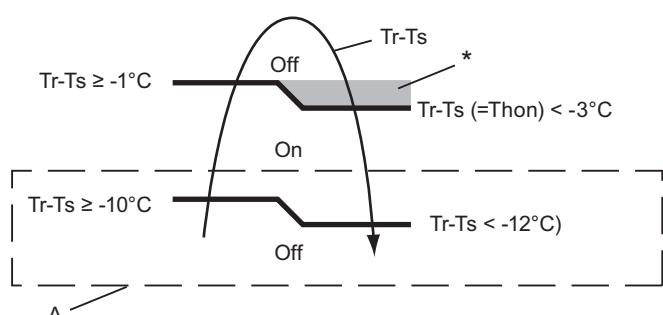

Tr: Room temperature
Ts: Set temperature
Thon: Heater on temperature

*: When room temperature stays in this zone for a specific time, auxiliary heater is turned on. For details, refer to function number 71.

Example: When set temperature (Ts) is 22°C (Factory setting),

- and room temperature (Tr) increases above 12°C, signal output is on.
- and room temperature (Tr) increases above 21°C, signal output is off.
- and room temperature (Tr) decreases below 19°C, signal output is on.
- and room temperature (Tr) decreases below 10°C, signal output is off.

13. Group connection


NOTE: Group control cannot be used together with WLAN Adapter.

Installation procedure for group control system:

A number of indoor units can be operated at the same time using a single remote controller.


NOTE: When different type of indoor units (such as wall mounted type and cassette type, cassette type and duct type, or other combinations) are connected using group control system, some functions may no longer be available.

1. Connect up to 16 indoor units in a system.

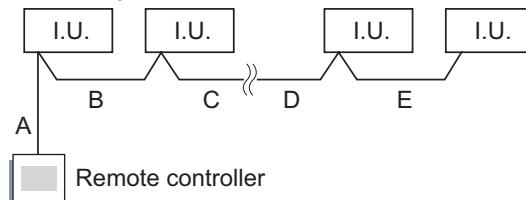


A, B, C, D, E: Remote controller cable		
Wiring length limitation	UTY-RVRG	$A + B + C + D + E \leq 70 \text{ m}$
	Other than UTY-RVRG	$A + B + C + D + E \leq 500 \text{ m}$

Example of wiring method

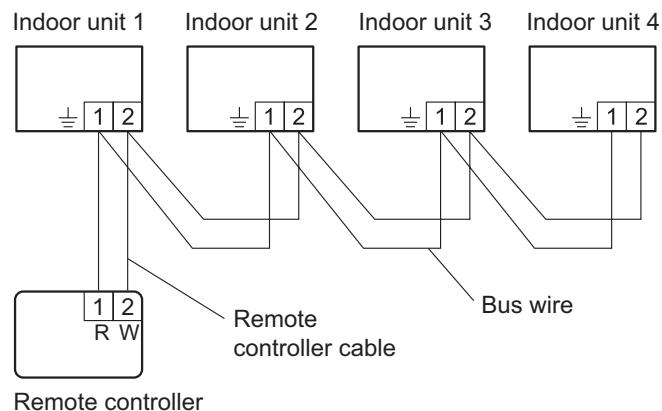

Example of wiring method

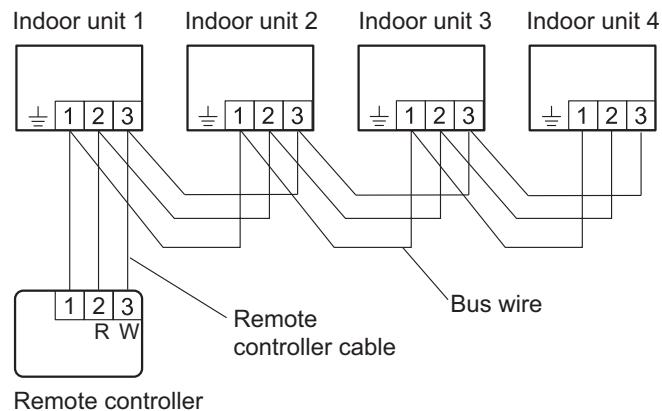

2. Set the remote controller address. (Function setting)


- Addresses will be automatically set when initially starting up this unit. In such a case, do not change the remote controller address for the indoor unit, and keep it at the initial setting of "00".
- Only set addresses manually when using different numbers for addresses. Set the remote controller address of each indoor unit using the function setting. (Refer to "Remote controller address setting" in ["Contents of function setting" on page 319.](#))

NOTES:


- Do not use the same setting value.
- Setting is reflected after the power is turned on again.
Also set the remote controller address for the remote controller. For details, refer to the remote controller installation manual.

NOTE: In manual setting, connect up to 15 indoor units in a system.

Example of wiring method

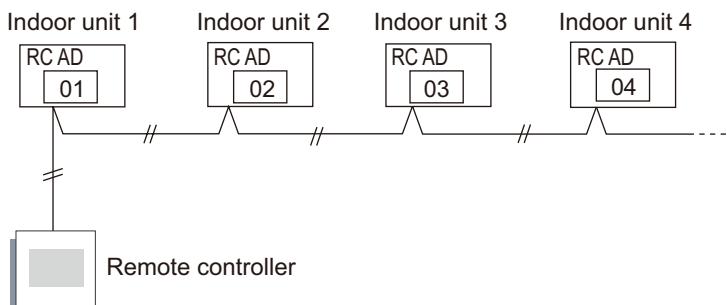

Example of wiring method

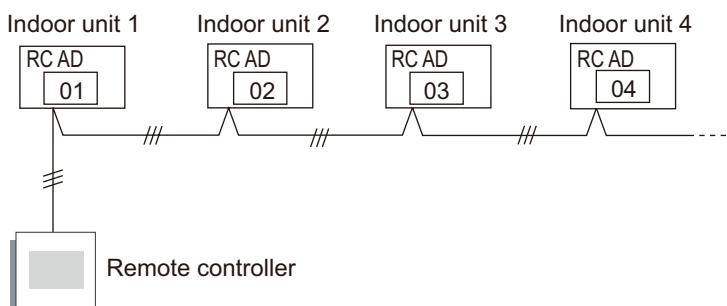


14. Remote controller

14-1. Wireless remote controller (AR-REW4E, AR-REM4E, AR-REB1E, and AR-REJ1E)


■ Overview

AR-REW4E

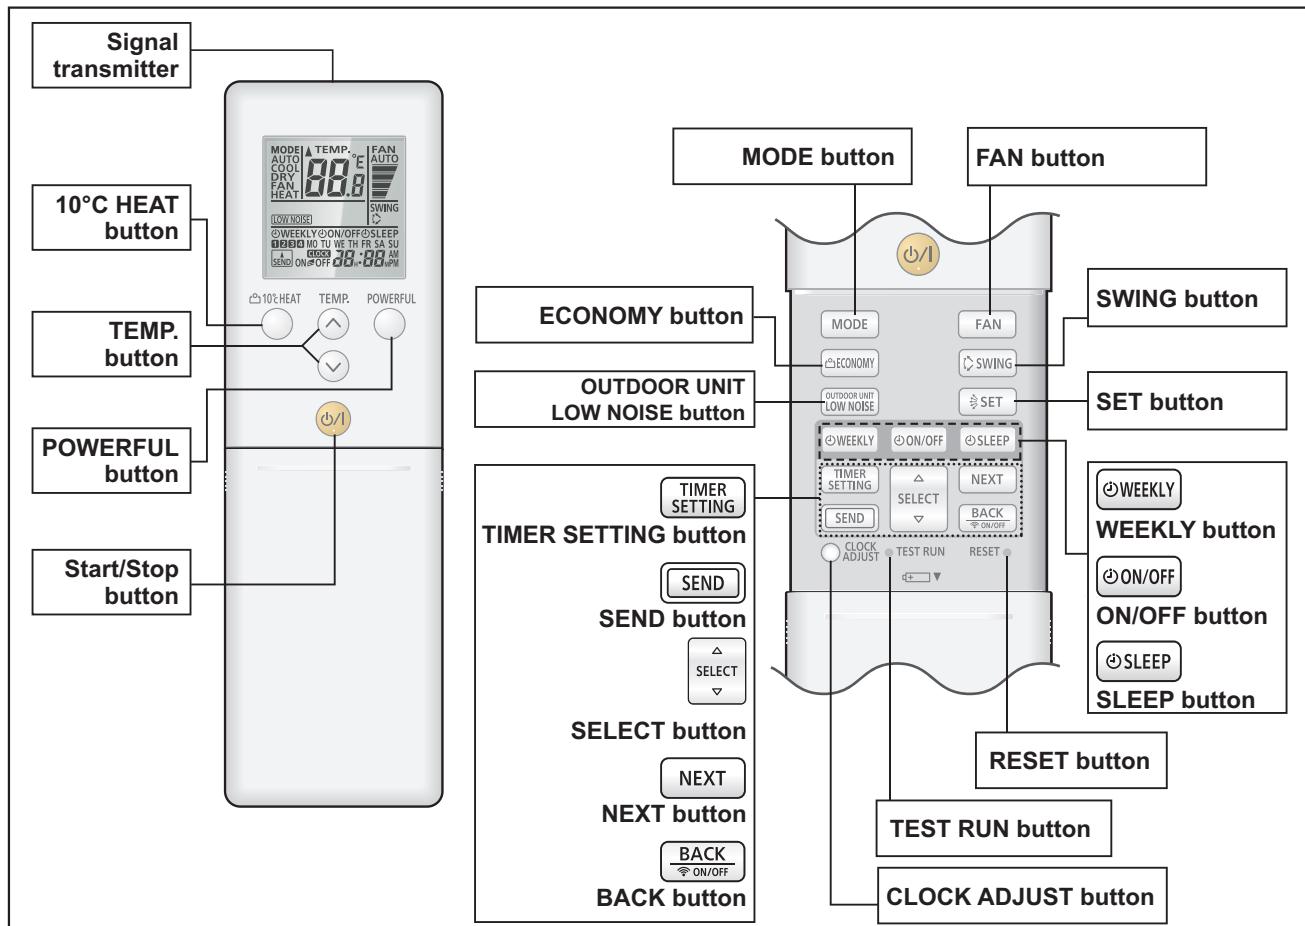


NOTE: Functions may differ by type of the indoor unit. For details, refer to the operation manual.

Display panel

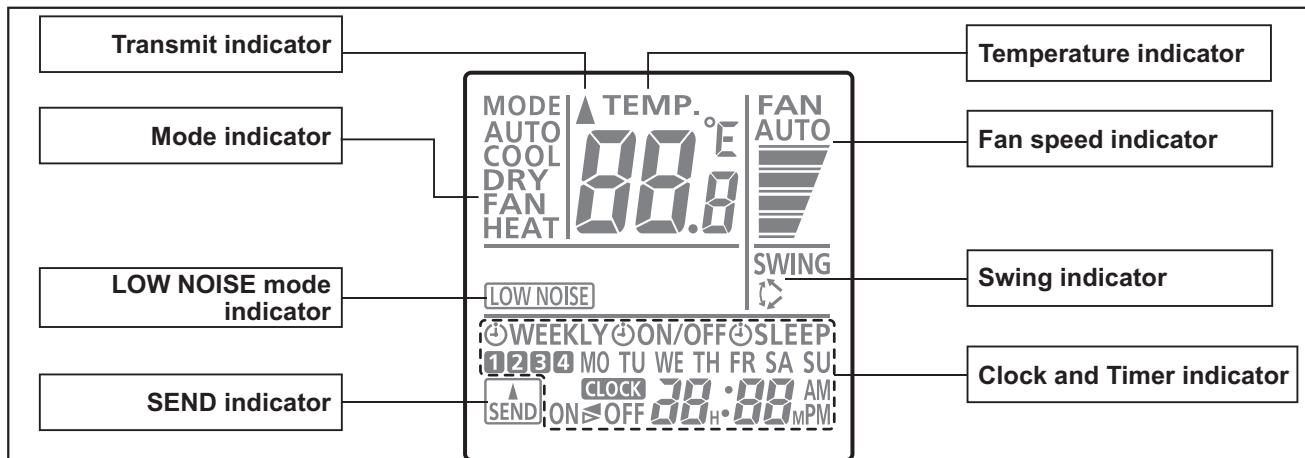


To facilitate explanation, the accompanying illustration has been drawn to show all possible indicators; in actual operation, however, the display will only show those indicators appropriate to the current operation.

AR-REM4E

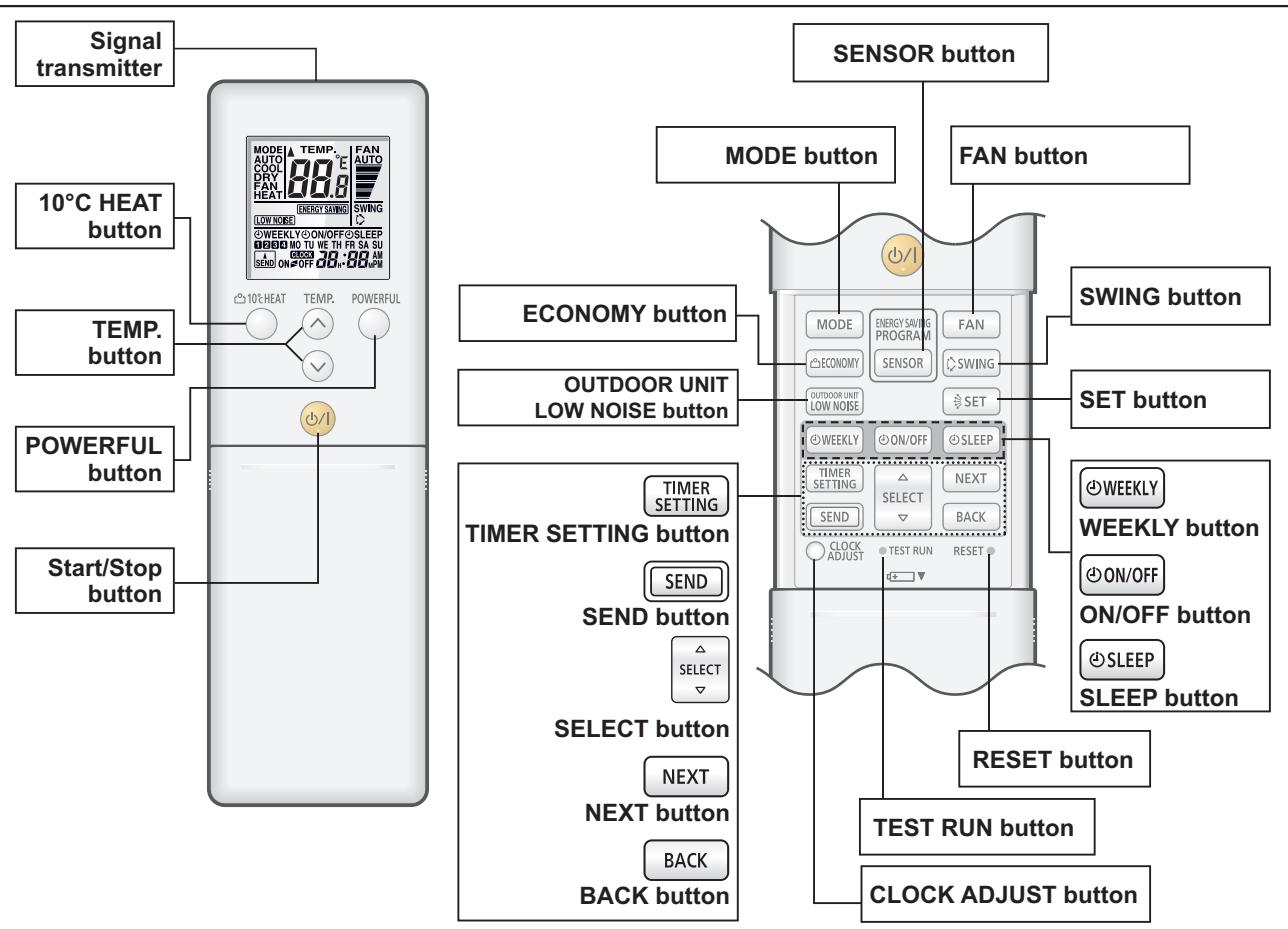


NOTE: Functions may differ by type of the indoor unit. For details, refer to the operation manual.

Display panel

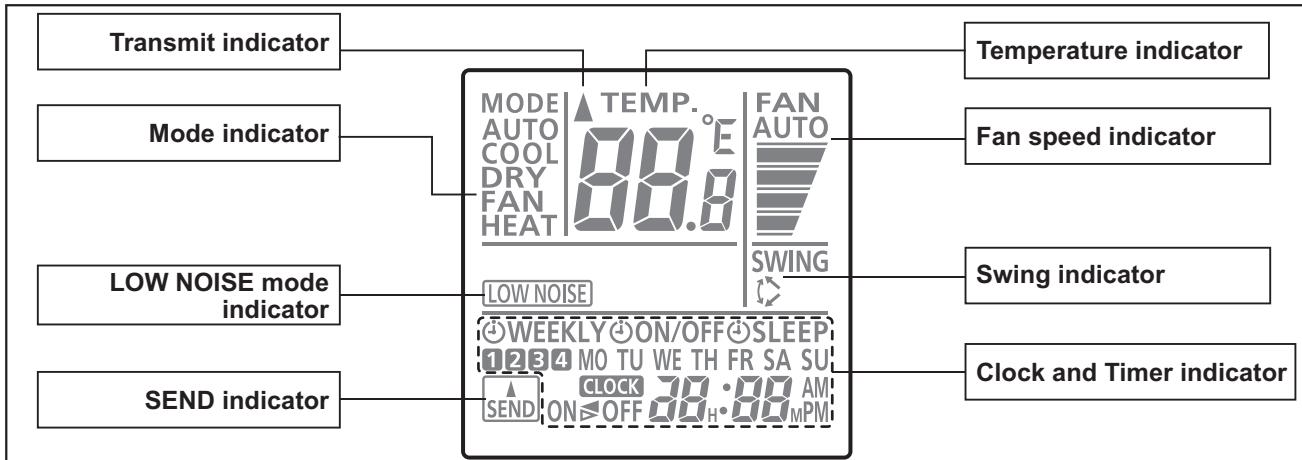


To facilitate explanation, the accompanying illustration has been drawn to show all possible indicators; in actual operation, however, the display will only show those indicators appropriate to the current operation.

AR-REB1E

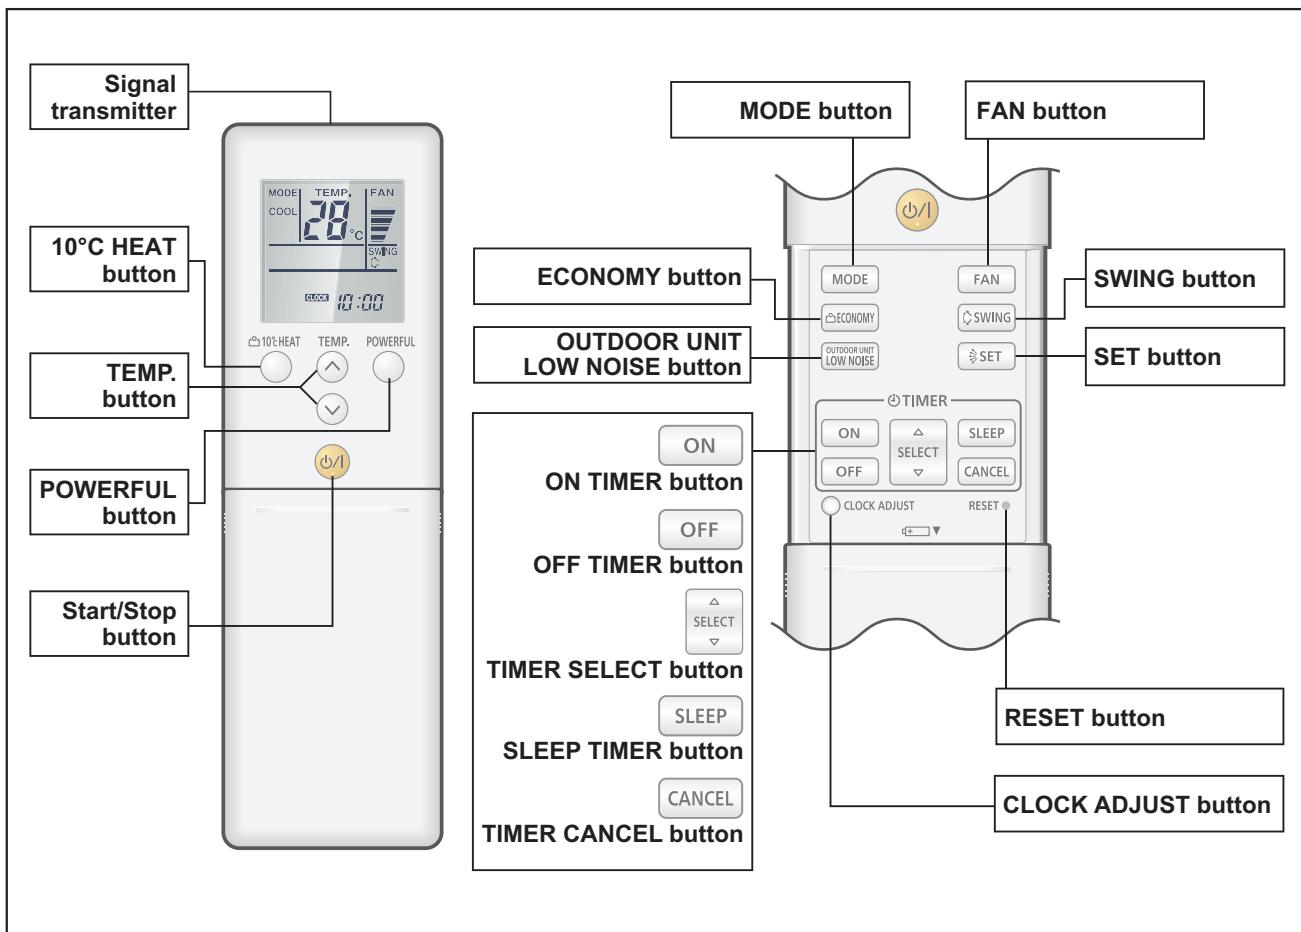


NOTE: Functions may differ by type of the indoor unit. For details, refer to the operation manual.

Display panel

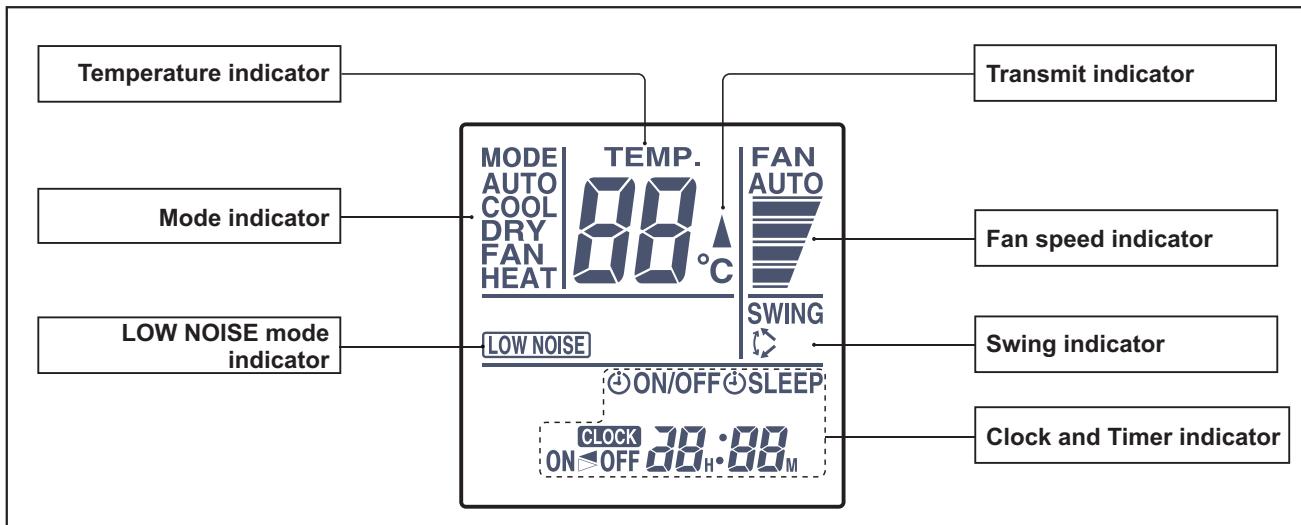


To facilitate explanation, the accompanying illustration has been drawn to show all possible indicators; in actual operation, however, the display will only show those indicators appropriate to the current operation.

AR-REJ1E

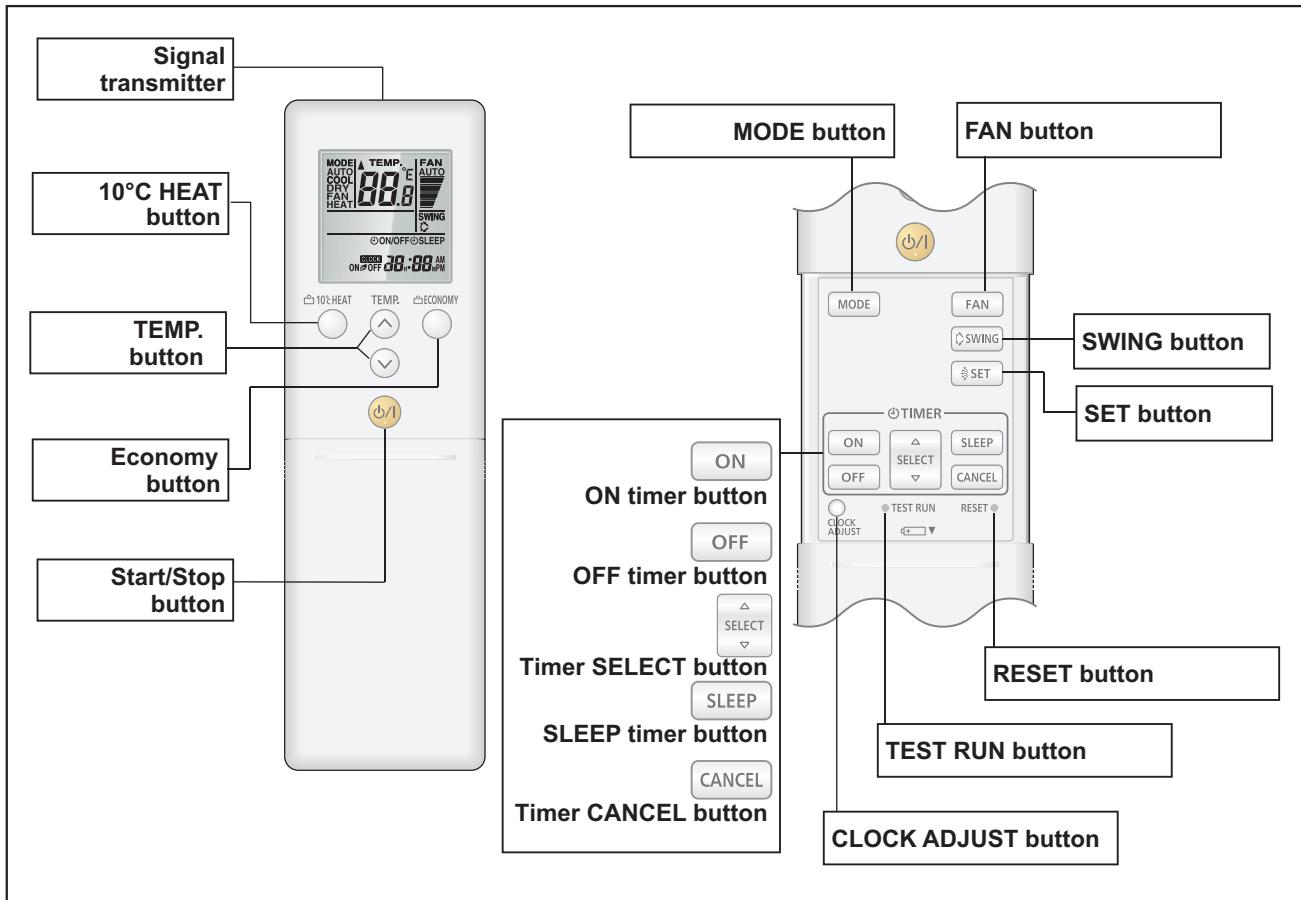

NOTE: Functions may differ by type of the indoor unit. For details, refer to the operation manual.

Display panel

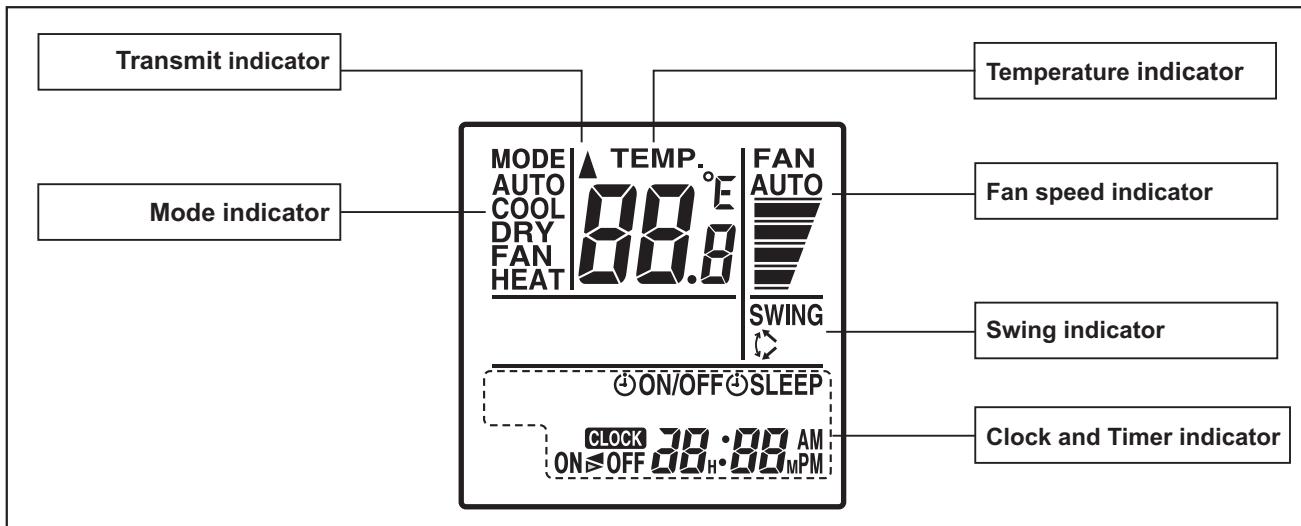


To facilitate explanation, the accompanying illustration has been drawn to show all possible indicators; in actual operation, however, the display will only show those indicators appropriate to the current operation.

■ Specifications

● Controller


Unit: mm

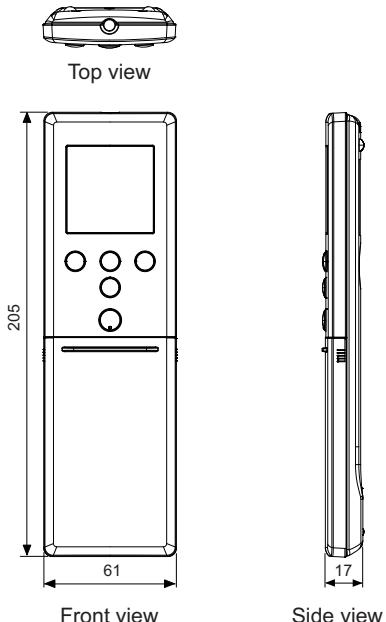

Size (H × W × D)	mm	205 × 61 × 17
Weight	g	124 (without batteries)

● Holder


Unit: mm

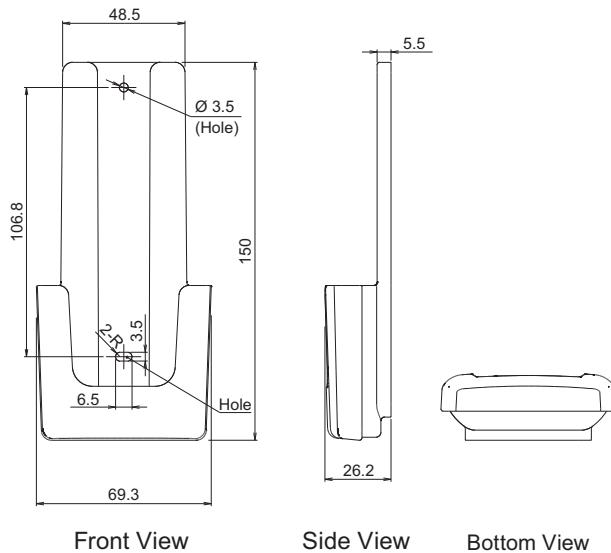

Size (H × W × D)	mm	150 × 69.3 × 26.2
Weight	g	27


14-2. Wireless remote controller (AR-REW3E)

■ Overview

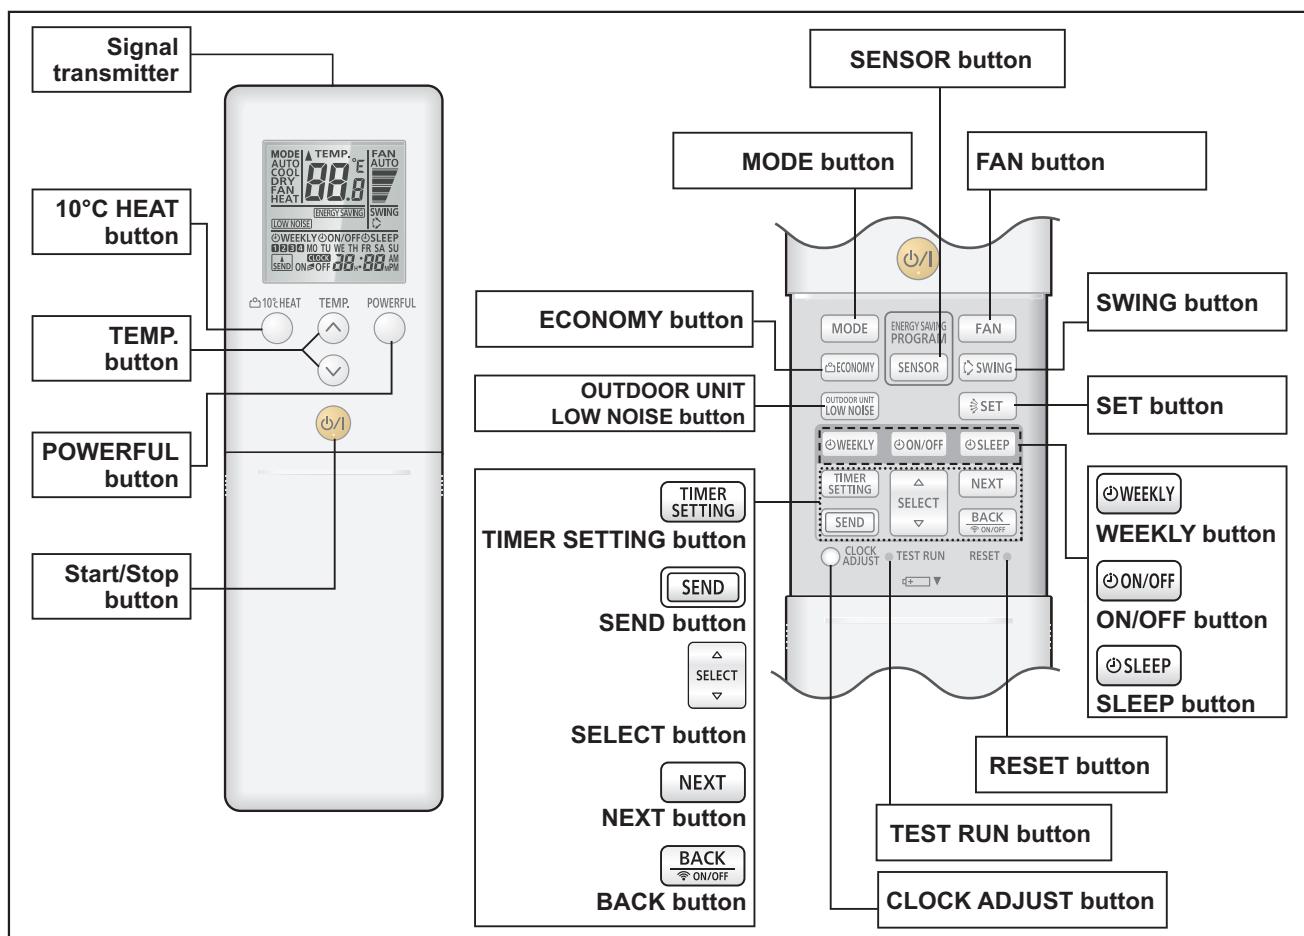

NOTE: Functions may differ by type of the indoor unit. For details, refer to the operation manual.

Display panel

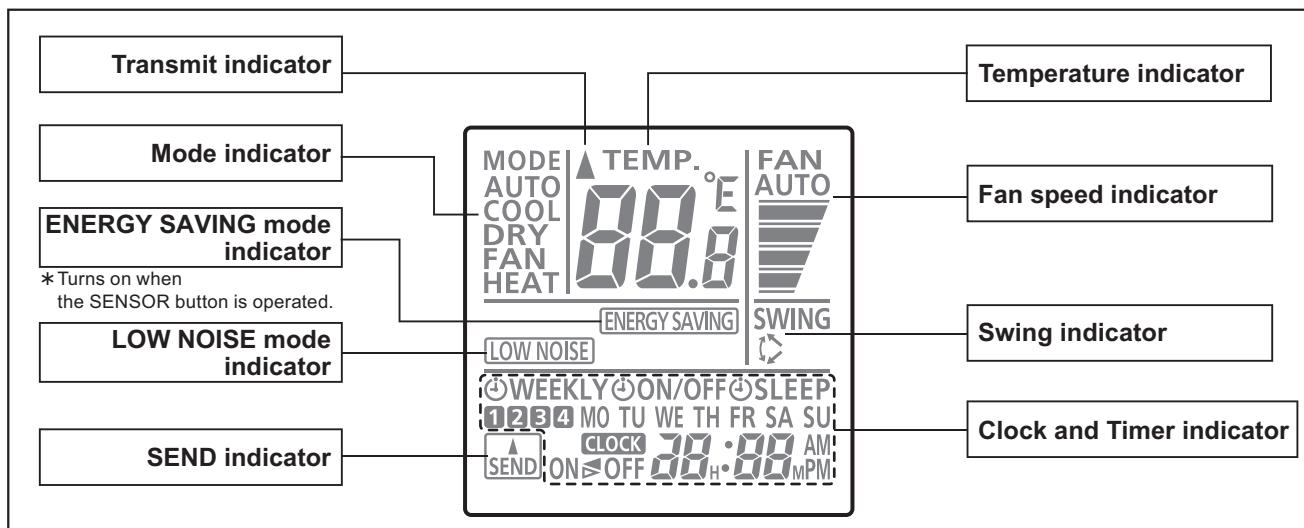


To facilitate explanation, the accompanying illustration has been drawn to show all possible indicators; in actual operation, however, the display will only show those indicators appropriate to the current operation.

■ Specifications

● Controller


Unit: mm

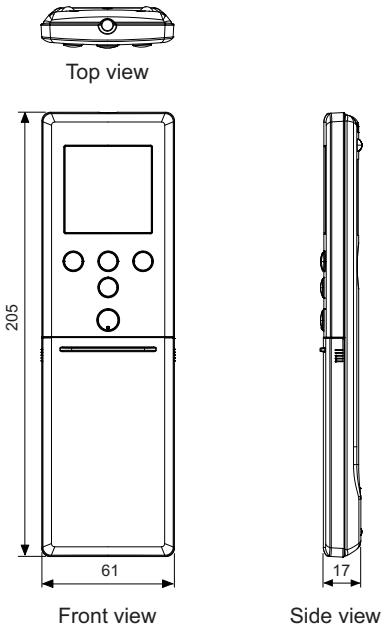

Size (H × W × D)	mm	205 × 61 × 17
Weight	g	124 (without batteries)

● Holder


Unit: mm

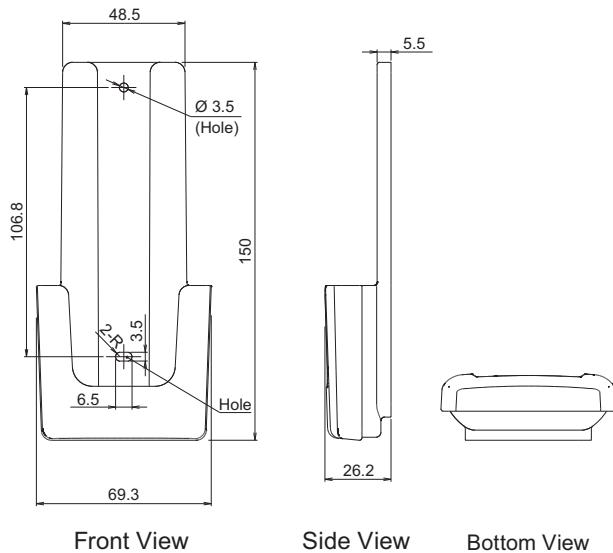

Size (H × W × D)	mm	150 × 69.3 × 26.2
Weight	g	27


14-3. Wireless remote controller (AR-REM7E)

■ Overview

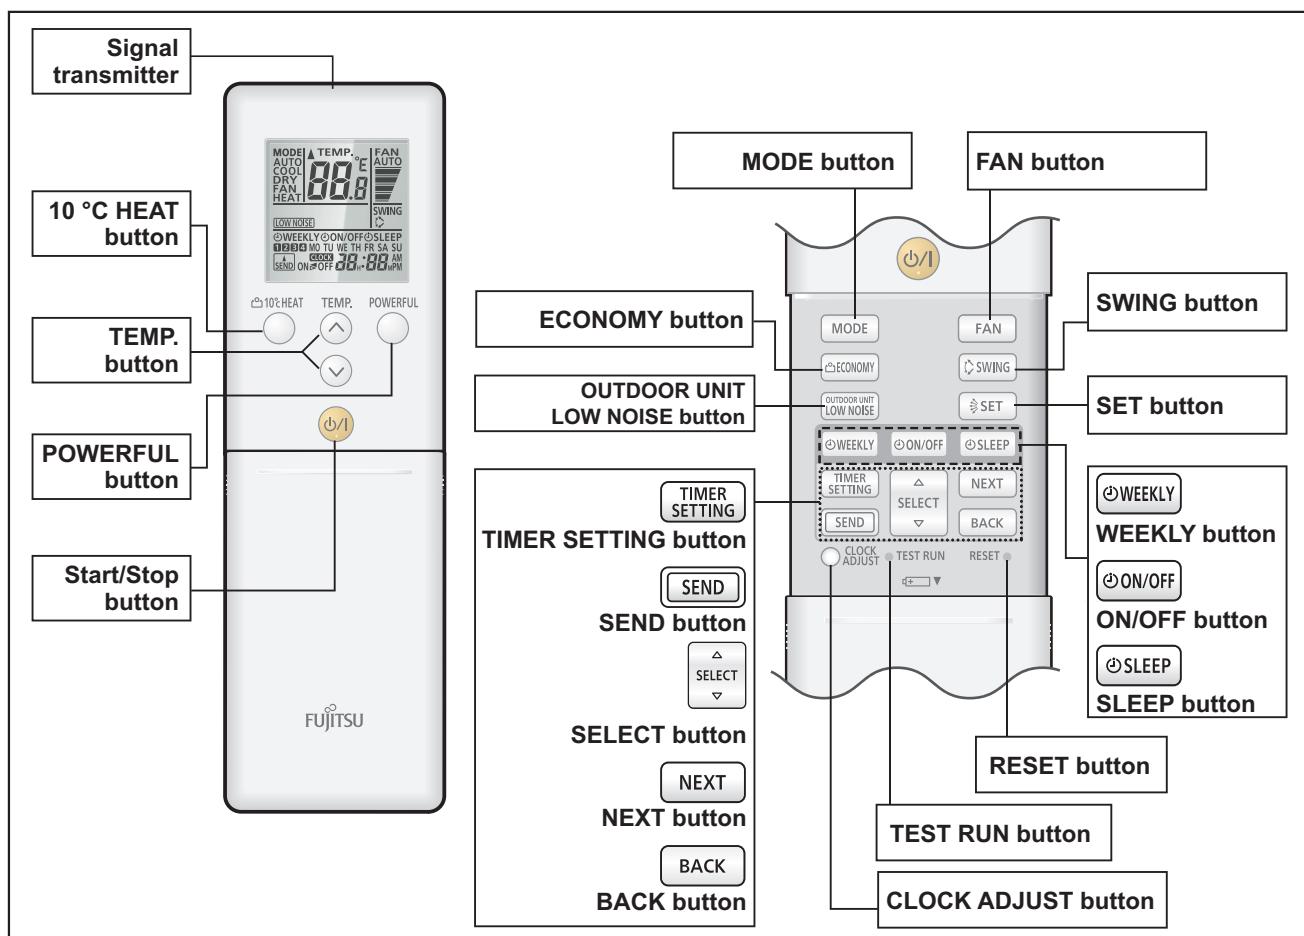

NOTE: Functions may differ by type of the indoor unit. For details, refer to the operation manual.

Display panel

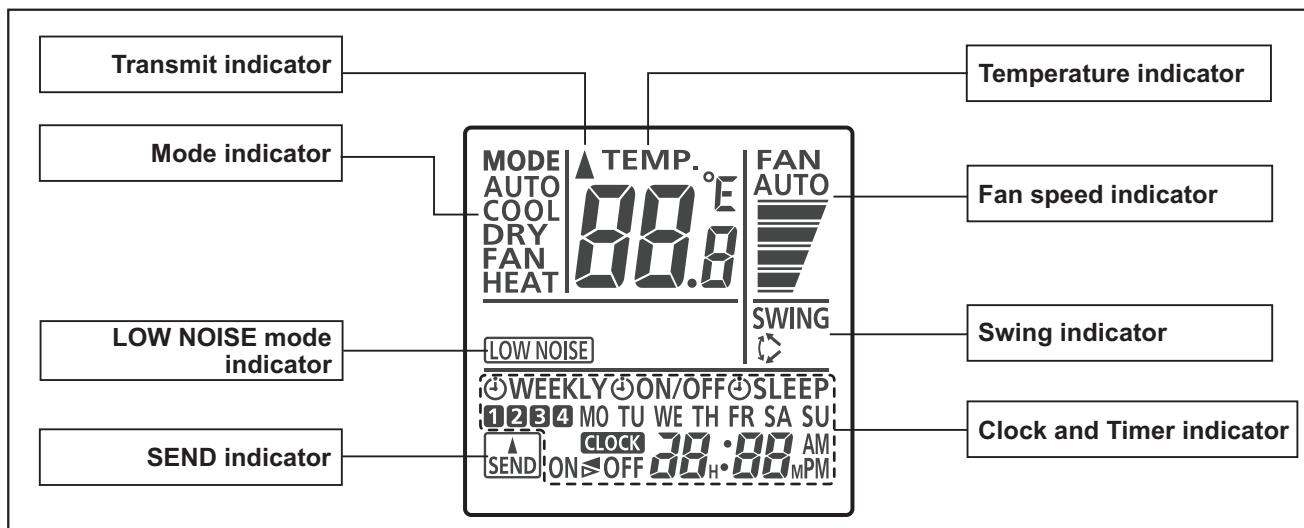


To facilitate explanation, the accompanying illustration has been drawn to show all possible indicators; in actual operation, however, the display will only show those indicators appropriate to the current operation.

■ Specifications

● Controller


Unit: mm

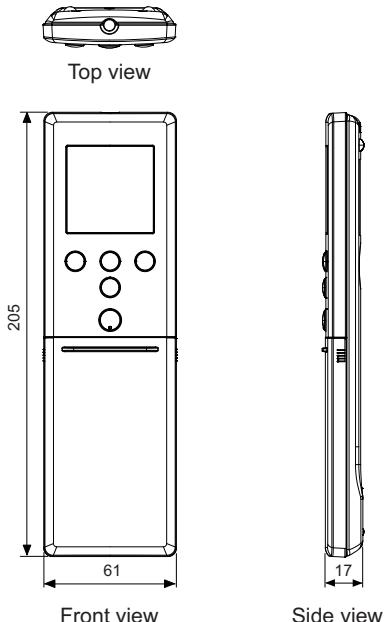

Size (H × W × D)	mm	205 × 61 × 17
Weight	g	124 (without batteries)

● Holder


Unit: mm

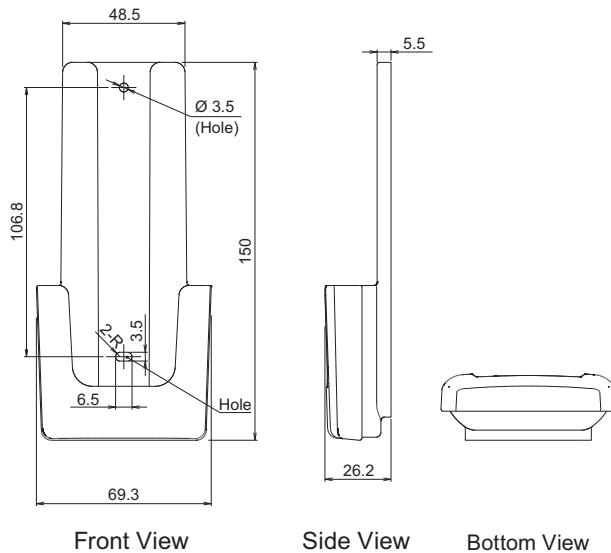


Size (H × W × D)	mm	150 × 69.3 × 26.2
Weight	g	27

14-4. Wireless remote controller (AR-RMB1E and AR-RMB1E-B)

■ Overview

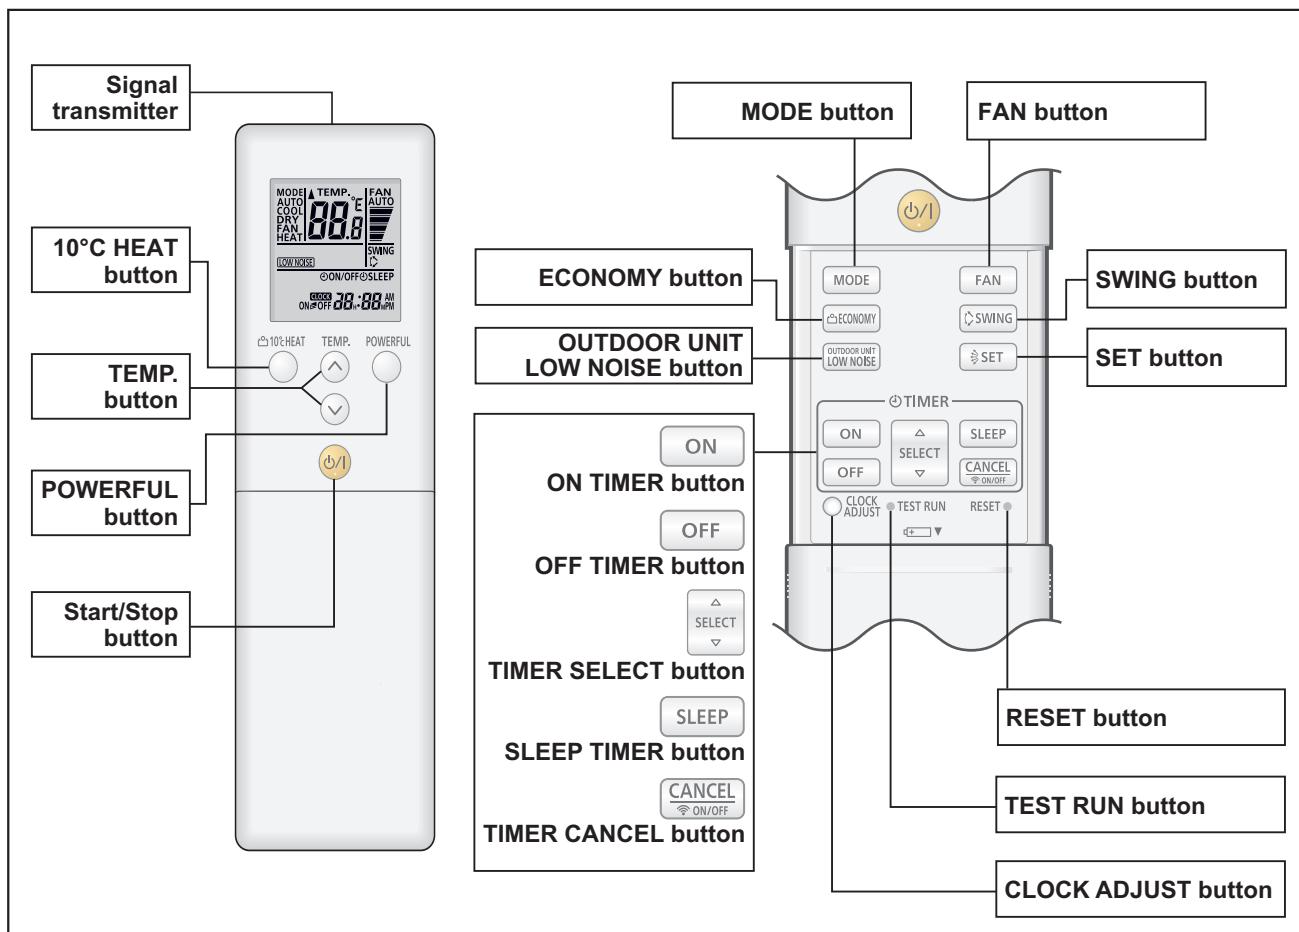

NOTE: Functions may differ by type of the indoor unit. For details, refer to the operation manual.
Display panel

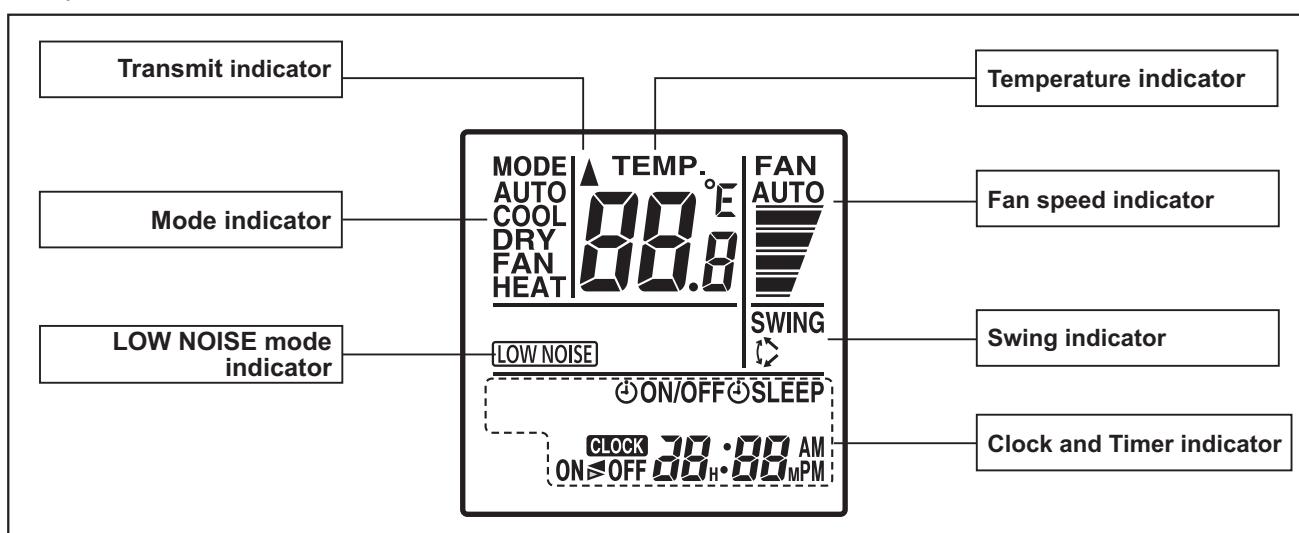


To facilitate explanation, the accompanying illustration has been drawn to show all possible indicators; in actual operation, however, the display will only show those indicators appropriate to the current operation.

■ Specifications

● Controller


Unit: mm

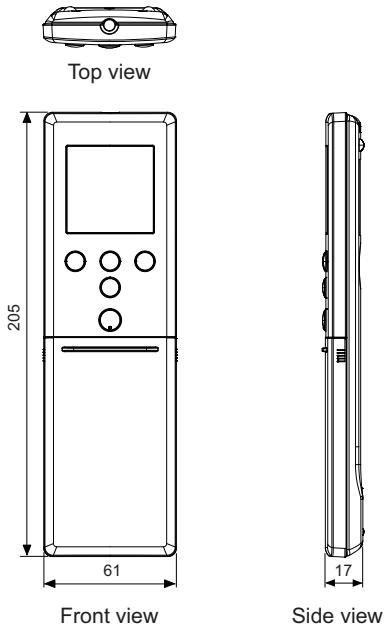

Size (H × W × D)	mm	205 × 61 × 17
Weight	g	124 (without batteries)

● Holder


Unit: mm

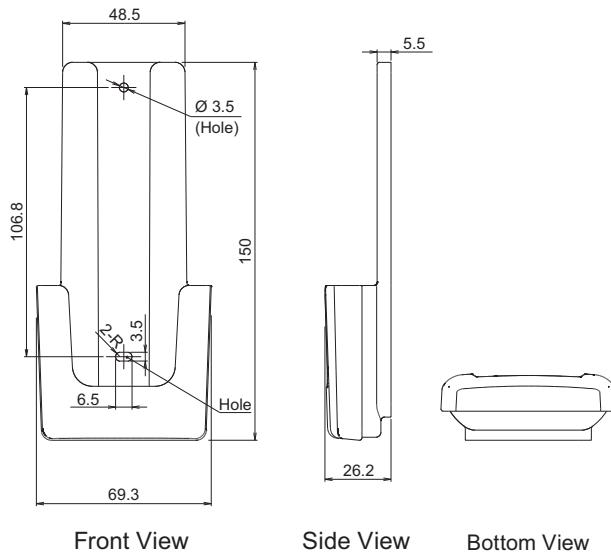

Size (H × W × D)	mm	150 × 69.3 × 26.2
Weight	g	27


14-5. Wireless remote controller (UTY-LNTG: Optional part) and IR receiver kit with Wireless remote controller (UTY-LBTGM: Optional part)

■ Overview

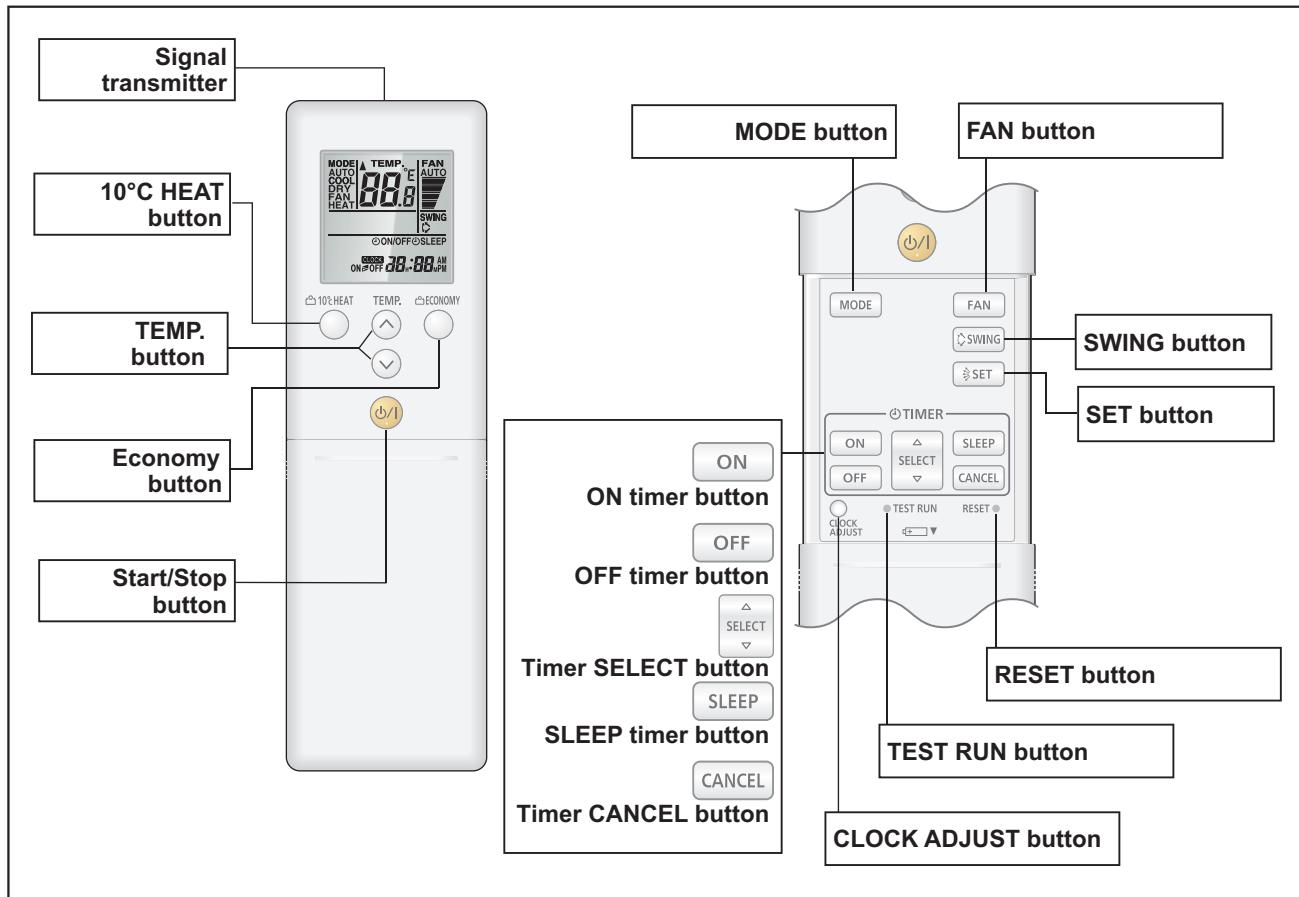

NOTE: Functions may differ by type of the indoor unit. For details, refer to the operation manual.

Display panel

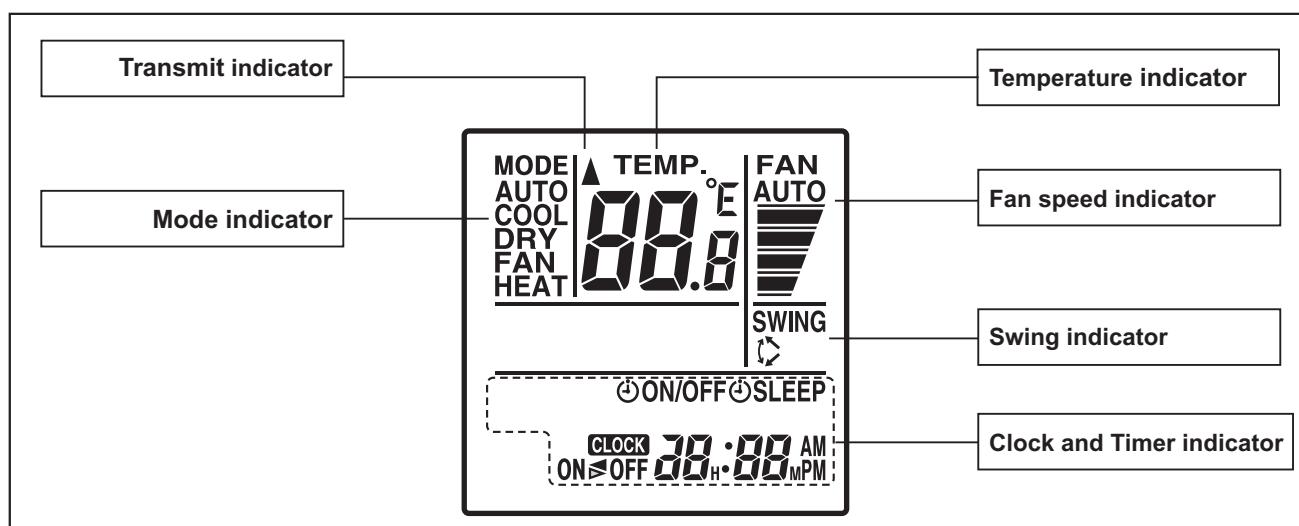


To facilitate explanation, the accompanying illustration has been drawn to show all possible indicators; in actual operation, however, the display will only show those indicators appropriate to the current operation.

■ Specifications

● Controller


Unit: mm

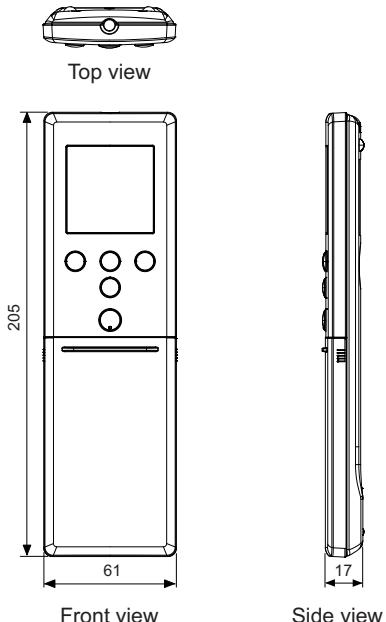

Size (H × W × D)	mm	205 × 61 × 17
Weight	g	124 (without batteries)

● Holder


Unit: mm

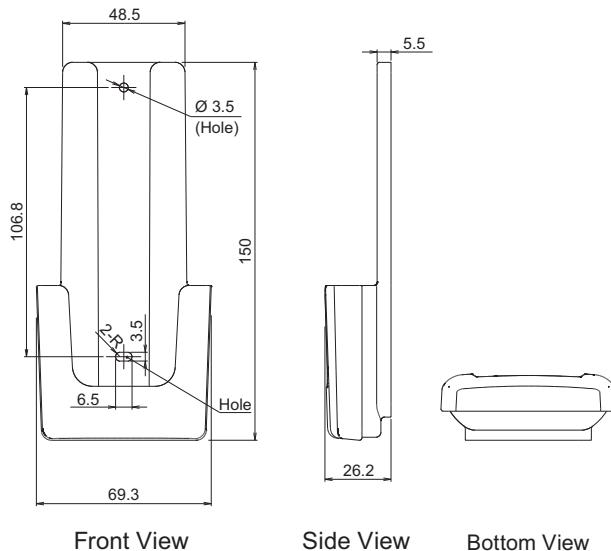

Size (H × W × D)	mm	150 × 69.3 × 26.2
Weight	g	27

● IR receiver (UTY-LBTGM)


Unit: mm

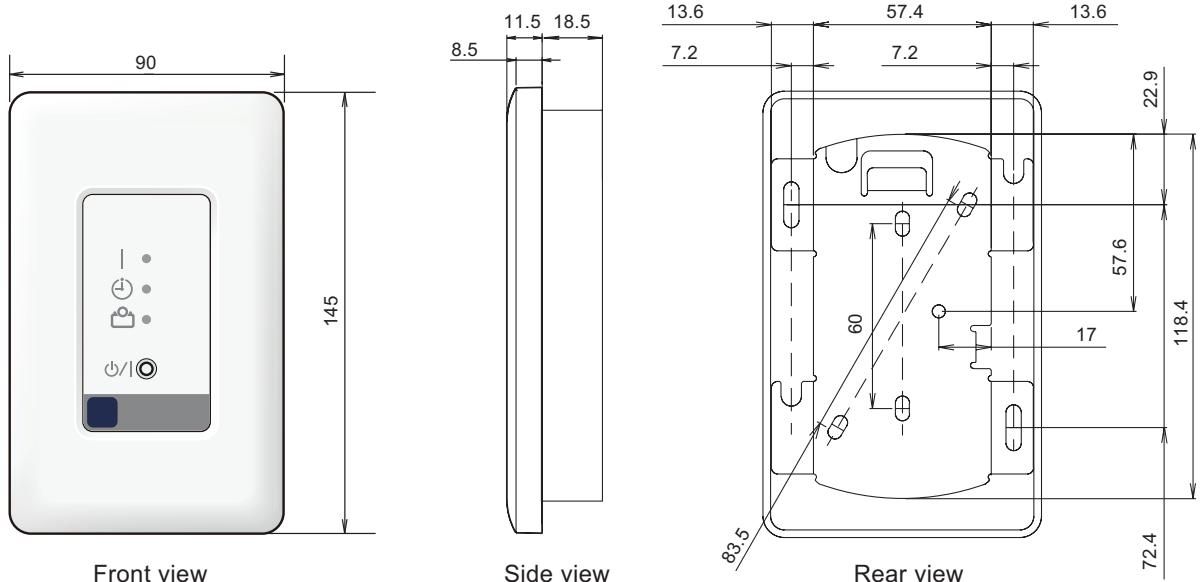


Size (H × W × D)	mm	145 × 90 × 30
Weight	g	150

14-6. Wireless remote controller (AR-RPF4E)

■ Overview

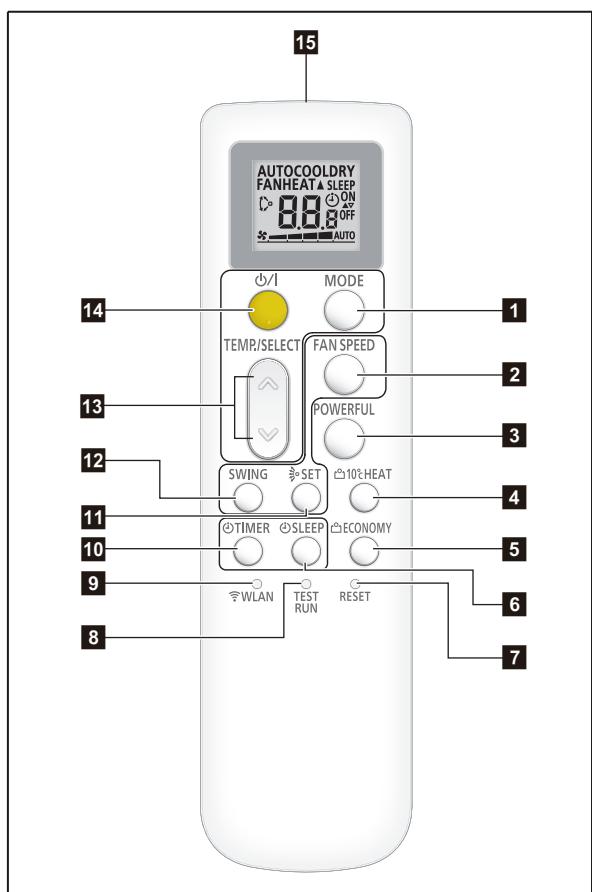

Display panel

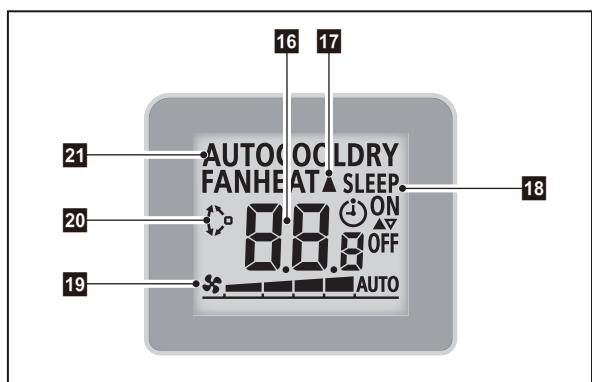

NOTES:

- Functions may differ by type of the indoor unit. For details, refer to the operation manual.
- This figure depicts all indicators that the remote controller can display on the screen for the functional explanation.
In actual operation, the remote controller shows only the indicators that are appropriate for the current process.

1 MODE button

- Switches operation mode (AUTO, COOL, DRY, FAN, and HEAT).
- Starts/ends the remote controller custom code (max. 4 types) change.

2 FAN SPEED button

- Press the FAN SPEED button while the air conditioner is operating, to control fan speed.

3 POWERFUL button

4 10 °C HEAT button

5 ECONOMY button

6 SLEEP TIMER button

7 RESET button

8 TEST RUN button

- Used only when installing the air conditioner, and should not be used under normal conditions, as it will cause the indoor unit's thermostat malfunction.
- If this button is pressed during normal operation, the indoor unit will switch to test operation mode, and the operation indicator lamp and the timer indicator lamp on the indoor unit will begin to flash simultaneously.
- To stop the test operation mode, press the START/STOP button. Then, the air conditioner stops the operation.

NOTE: If the service check mode starts unintentionally and “- -” appears on the remote controller display, press the START/STOP button to end this operation.

9 WLAN button

- Starts the wireless LAN setting.

10 TIMER button

11 SET button (Up/down airflow)

12 SWING button

13 TEMP./SELECT button

- Adjusts the setting temperature.
- Adjusts the value of the timer settings.
- Sets the remote controller code.

14 START/STOP button

15 Signal transmitter

16 Temperature and time indicator

- Displays set temperature.
- In timer setting, it displays the timer time. After finishing the timer setting, set temperature will reappear.

17 Signal transmit indicator

18 Timer mode indicator

19 Fan speed indicator


20 Swing indicator

21 Operating mode indicator

■ Specifications

● Controller


Unit: mm

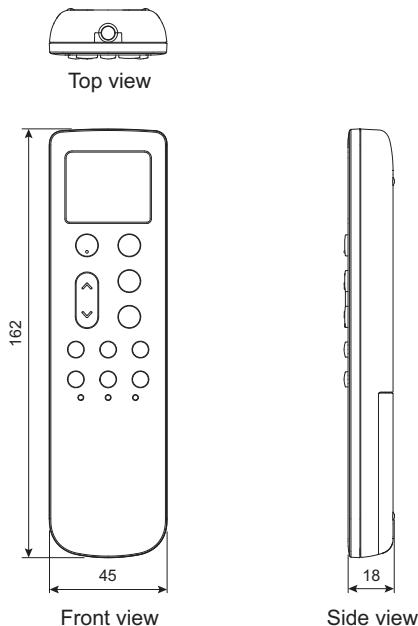

Size (H × W × D)	mm	162 × 45 × 18
Weight	g	65.5 (without batteries)

● Holder


Unit: mm

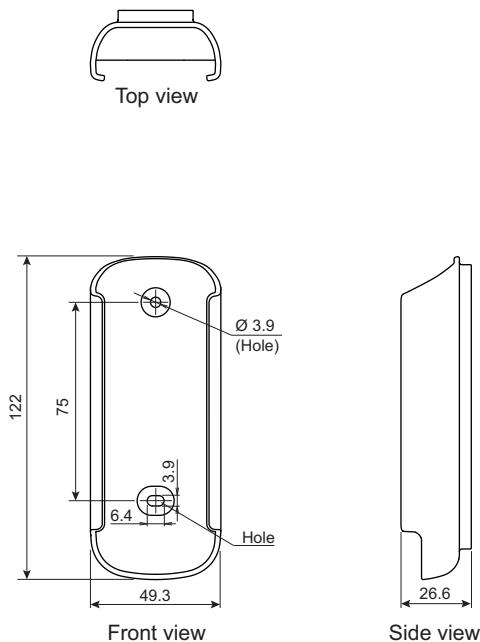


Size (H × W × D)	mm	122 × 49.3 × 26.6
Weight	g	23.5

14-7. Wired remote controller (UTY-RNNGM: Optional part)

■ Overview

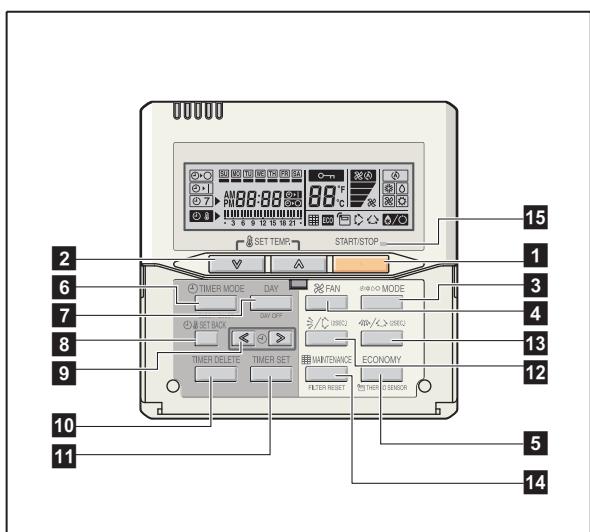

Display panel

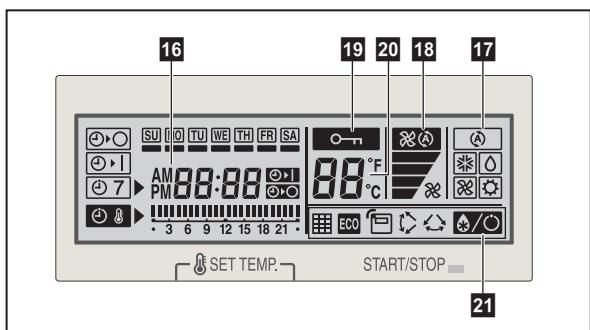


NOTE: Functions may differ by type of the indoor unit. For details, refer to the operation manual.

- 1 START/STOP button**
Starts and stops operation.
- 2 SET TEMP. button**
Selects the setting temperature.
- 3 MODE button**
Selects the operating mode (AUTO , HEAT , FAN , COOL , and DRY).
- 4 FAN button**
Selects the fan speed AUTO , QUIET , LOW , MED , and HIGH .
- 5 ECONOMY (THERMO SENSOR) button**
Turns the economy-efficient mode on and off.
- 6 TIMER MODE (CLOCK ADJUST) button**
Selects the timer mode (off timer, on timer, and weekly timer). Sets the current time.
- 7 DAY (DAY OFF) button**
Temporarily cancels one day timer.
- 8 SET BACK button**
Selects the set back timer.
- 9 Set time button**
Pressed to set time.
- 10 TIMER DELETE button**
Deletes the weekly timer schedule.
- 11 TIMER SET button**
Sets the date, hour, minute, and on-off time.
- 12 Vertical airflow direction and swing button**
Push for 2 seconds to change the swing mode.
- 13 Horizontal airflow direction and swing button**
Push for 2 seconds to change the swing mode.
- 14 FILTER RESET button**
- 15 Operation lamp**
Lights during operation and when the timer is on.
- 16 Timer and clock indicator**
- 17 Operation mode indicator**
- 18 Fan speed indicator**
- 19 Operation lock indicator**
- 20 Temperature indicator**
- 21 Function indicators**
 - Defrost indicator
 - Thermo sensor indicator
 - Economy indicator
 - Vertical swing indicator
 - Horizontal swing indicator
 - Filter indicator

■ System diagram


1 remote controller: **2 remote controllers:**

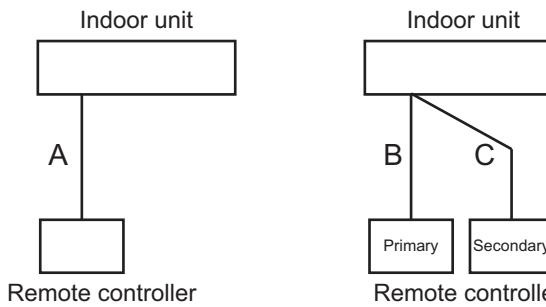

A, B, C: Remote controller cable
A ≤ 500 m; B + C ≤ 500 m


■ Electrical wiring

1 remote controller:

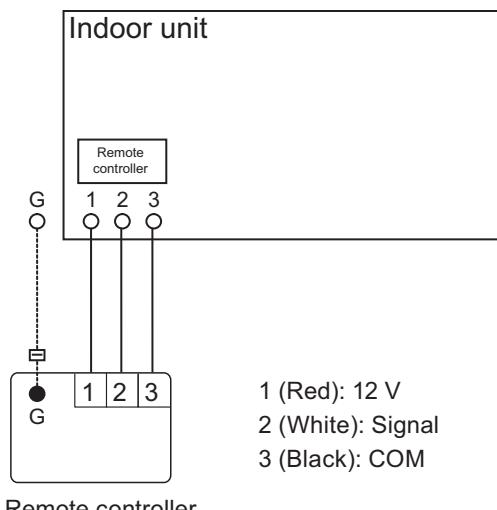

Remote controller

2 remote controllers:

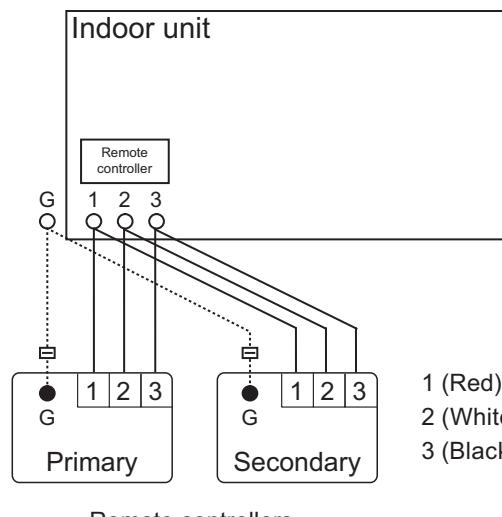


Remote controllers

1 (Red): 12 V
2 (White): Signal
3 (Black): COM

1 (Red): 12 V
2 (White): Signal
3 (Black): COM

■ Specifications

Dimensions and other specifications on the wired remote controller are as follows.

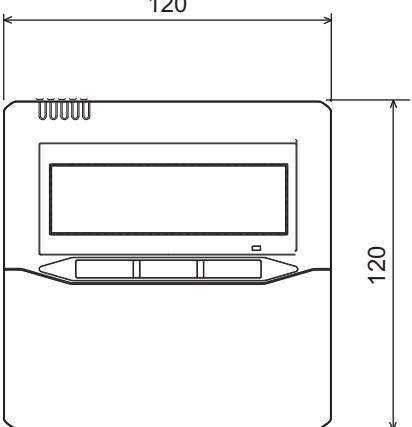			Unit: mm
	Front view		Side view
Size (H × W × D)	mm		120 × 120 × 18
Weight	g		160
Cable length (accessory)	m		10
Power	V		12

● Wiring specifications


Use	Cable size	Wire type	Remarks
Remote controller cable	0.33 mm ² (22 AWG)	Polar 3-core	Use sheathed PVC cable.

■ Installation

Connection pattern of wired remote controller varies by the type of the connected indoor unit.

● When connecting to terminal block (for Compact cassette, Slim duct, and Mini duct types)

Connect the end of remote controller cable directly to the exclusive terminal block.

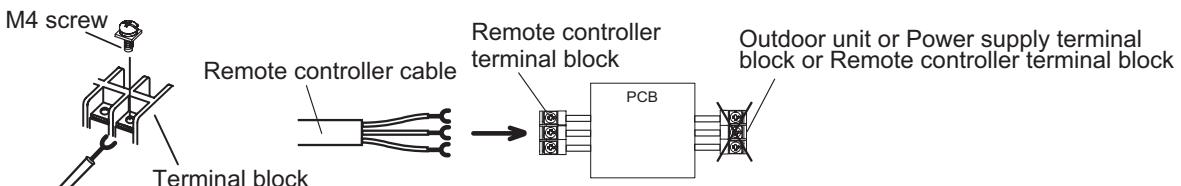


NOTE: It may be failed if it is connected to the outdoor unit or the terminal block for power supply.

● When connecting to Communication Kit (for KM models in Wall mounted type)

When connecting the remote controller to optional Communication Kit, follow the procedures mentioned below.

1. Modify the remote controller cable as follows:


- Use a tool to cut off the terminal on the end of the remote controller cable and then remove the insulation from the cut end of the cable as shown in following figure.
- Connect the remote controller cable and connecting cable as shown in following figure.
- Be sure to insulate the connection between the cables.

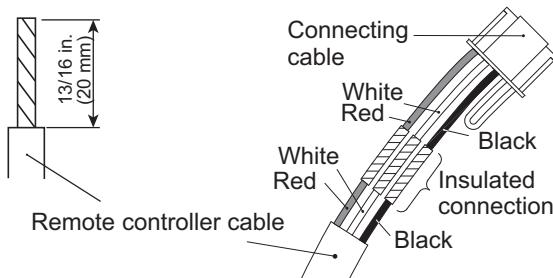

2. Connect the remote controller cable.

- Connect the cable made in step 1. to the terminal^{*1} of optional Communication Kit.
- Connect the cable from the terminal^{*2} of Communication Kit to the indoor unit PCB.

^{*1}: CNC01 on UTY-TWBXF2
^{*2}: CND01 on UTY-TWBXF2

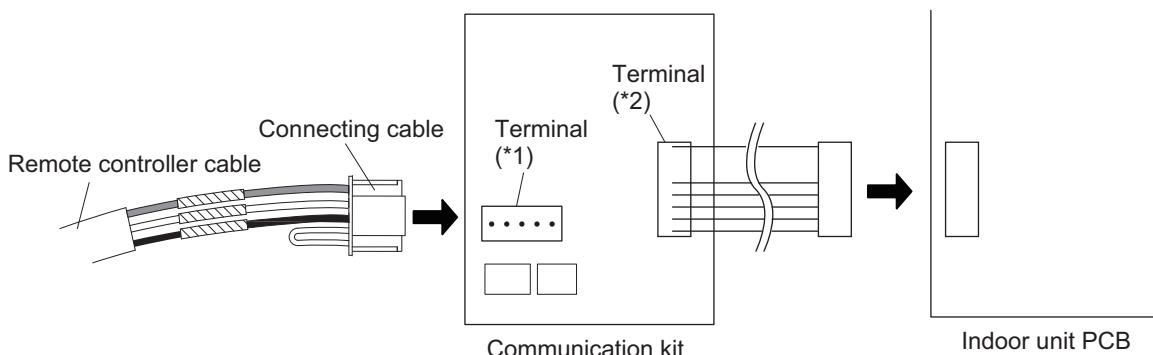

■ Required optional parts

Required optional parts for connecting the wired remote controller to the wall mounted type are as follows.


Part name	Model name
External Connect Kit	UTY-XWZXZ5
Communication Kit	UTY-TWBXF2

14-8. Wired Remote Controller (UTY-RVRG : Optional part)



- Easy finger touch operation with LCD panel.
- Screen with anti-fingerprint coating
- Various information display (Room temp., Operation mode, Set temp. Fan speed, Timer)
- Control up to 16 indoor units
- Corresponds to 3 different languages (English, French, Spanish)

■ Overview

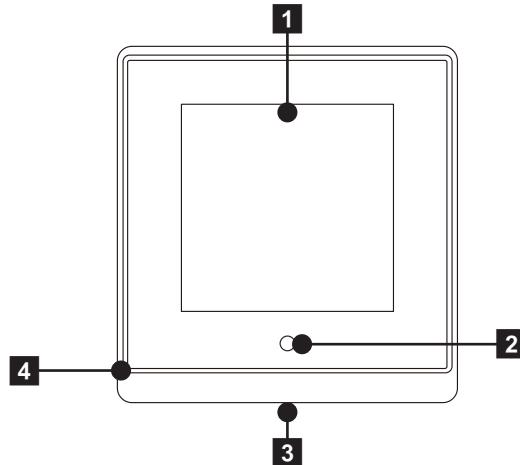

1 Touch screen

It can be operated by tapping or swiping.

NOTE: Operate with your finger or stylus pen (not included). Do not touch the screen with a hard or sharp object as it may cause a malfunction.

2 Ambient light sensor


Detects the brightness around the controller.

3 Operation lamp

Lights while the indoor units is operating. Blinks when an error occurs.

4 Remote temperature sensor (inside)

Detects the temperature around the controller.

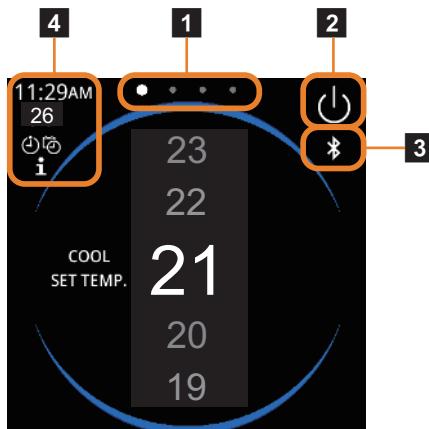Temperature setting screen**1 Page indicator**

Shows the order of pages and displayed page.

2 Operation On/Off button


Tap to start operation or stop the air conditioner.

3 Bluetooth icon

Displays when Bluetooth is enabled.

4 Information area


The displayed contents differ depending on the screen and settings.

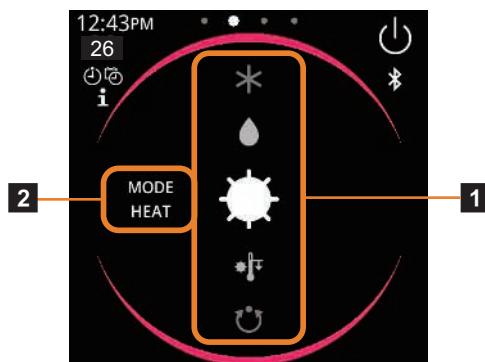Operation mode setting screen**1 Operation mode setting area**

Swipe up or down to select the operation mode.

2 Operation mode

The operation mode of the air conditioner is displayed.

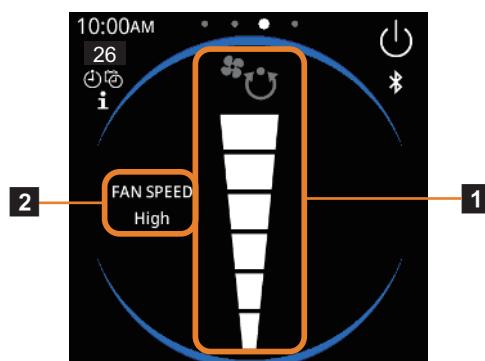
Fan speed setting screen**1 Fan speed setting area**

Swipe up or down to set the fan speed.

is AUTO.

2 Fan speed

Displays the set fan speed.

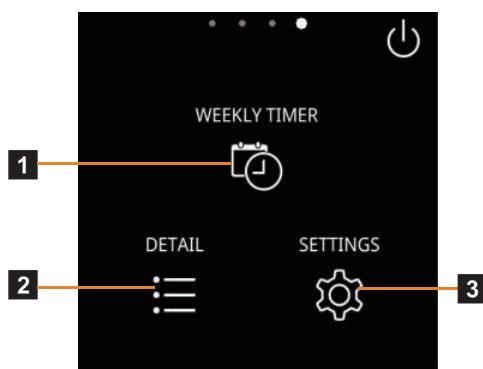Other setting screen**1 WEEKLY TIMER****2 DETAIL**

For details of the settings, refer to the *OPERATION MANUAL* for this product.

3 SETTINGS


For details of the settings, refer to the *OPERATION MANUAL* for this product.

NOTE: To display settings screen, it is necessary to enter the admin password.

■ System diagrams

- **Multiple remote control**

Up to 2 remote controllers can be used to operate the indoor units.

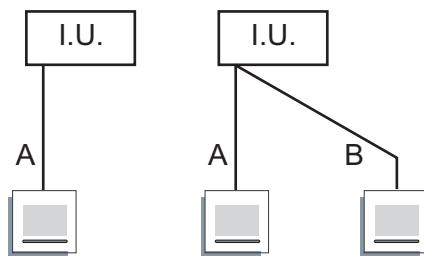

- Remote controller
 - A: UTY-RVRG
 - B: Other than UTY-RVRG (2-wire type only)
- Remote controller cable
 - A, B ≤ 70 m

NOTES:

- Only one UTY-RVRG is connectable in either connection pattern.
- Multiple installation method described above is prohibited to combine with 3-wired type remote controller.

- Maximum connectable number of remote controller (2-wire type)**

Maximum connectable number of remote controller (2-wire type) is limited by cable size and maximum cable length.

When using only remote controller other than UTY-RVRG				
Cable size (S)		Total cable length (L)		
AWG	mm ²	L ≤ 100 m	100 m < L ≤ 250 m	250 m < L ≤ 500 m
16	1.25	2	2	2
18	0.75 (1.25 > S ≥ 0.75)	2	2	2
20	0.5 (0.75 > S ≥ 0.5)	2	2	2
22	0.3 (0.5 > S ≥ 0.3)	2	1	1


When using UTY-RVRG only				
Cable size (S)		Total cable length (L)		
AWG	mm ²	L ≤ 70 m	70 m < L	—
16	1.25	1	—	—
18	0.75 (1.25 > S ≥ 0.75)	1	—	—
20	0.5 (0.75 > S ≥ 0.5)	1	—	—
22	0.3 (0.5 > S ≥ 0.3)	1	—	—

When a combination use of UTY-RVRG and the remote controller other than UTY-RVRG					
Cable size (S)		Total cable length (L)			
AWG	mm ²	L ≤ 70 m		70 m < L	
		UTY-RVRG	Other than UTY-RVRG	UTY-RVRG	Other than UTY-RVRG
16	1.25	1	1	—	—
18	0.75 (1.25 > S ≥ 0.75)	1	1	—	—
20	0.5 (0.75 > S ≥ 0.5)	1	1	—	—
22	0.3 (0.5 > S ≥ 0.3)	1	1	—	—


NOTE: A junction box might be necessary depending on the number of the connected remote controller, wiring conditions between the indoor unit and the remote controller, and so on. .

■ Electrical wiring


1 remote controller:

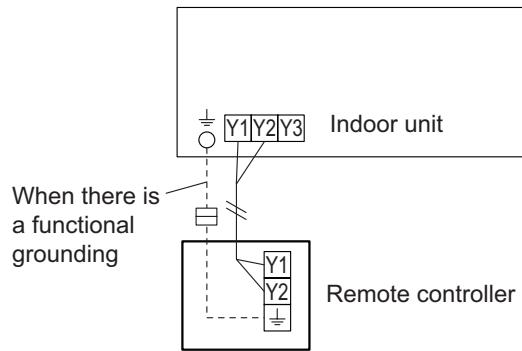


2 remote controllers:

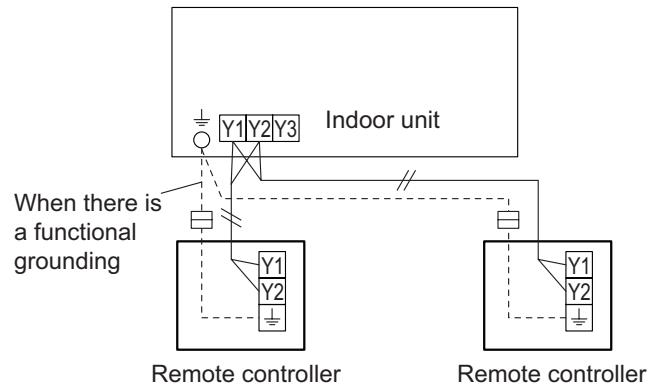

Group control:

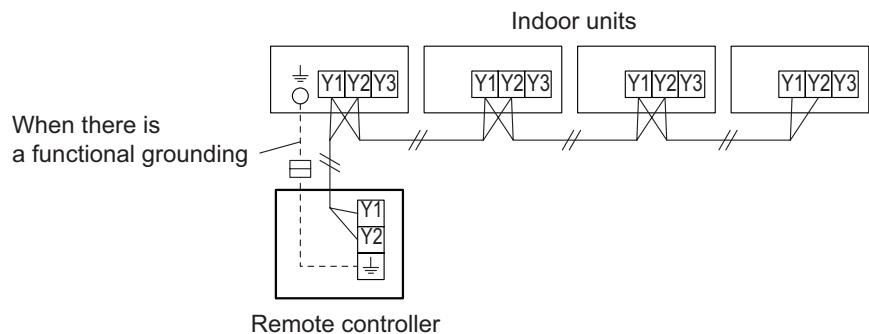


■ Dimensions

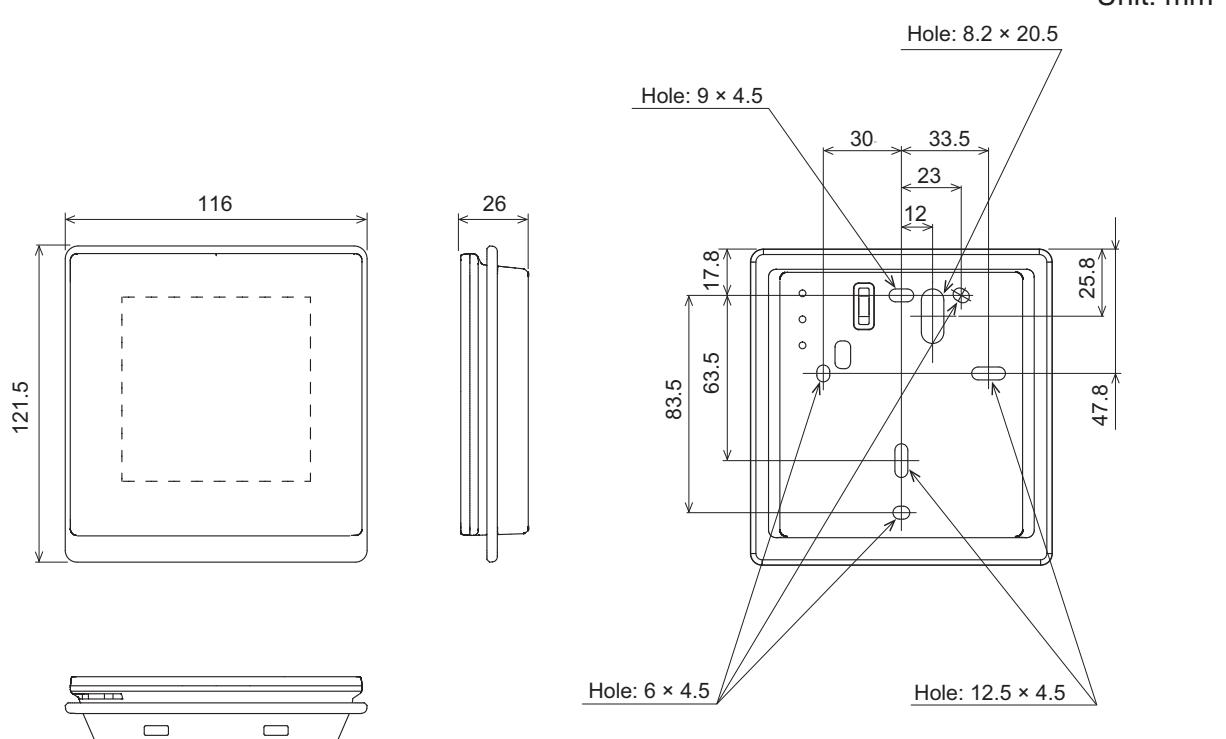

■ Installation space

- This product cannot be installed in a wall.
- Even when you install a remote controller to one of a switch box and the surface of a wall, secure the space shown in following figure. When there is insufficient space, there may be remote controller sensor misdetections and remote controller may be difficult.

Unit: mm

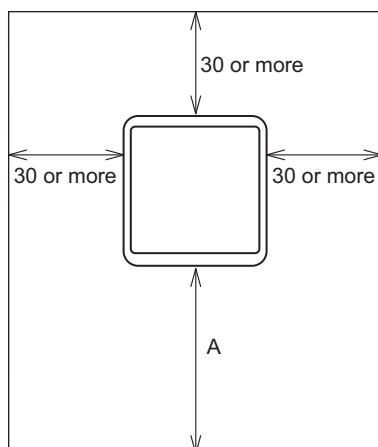


A: Secure enough space where a flat-blade screwdriver to take off a case can be inserted.

■ Installation


For details of installation, refer to the *INSTALLATION MANUAL* for this product.

- **Connector removal**

Open the front case and remove the connector of the remote controller cable from the connector of the PCB on the front case (back side).

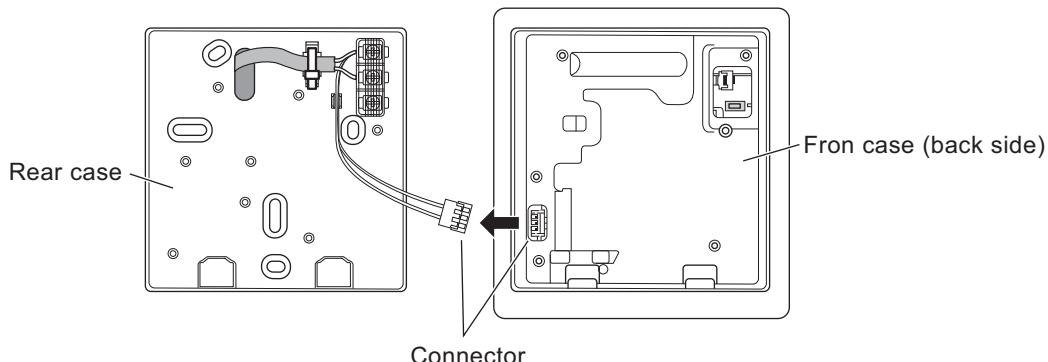

- **Switch setting**

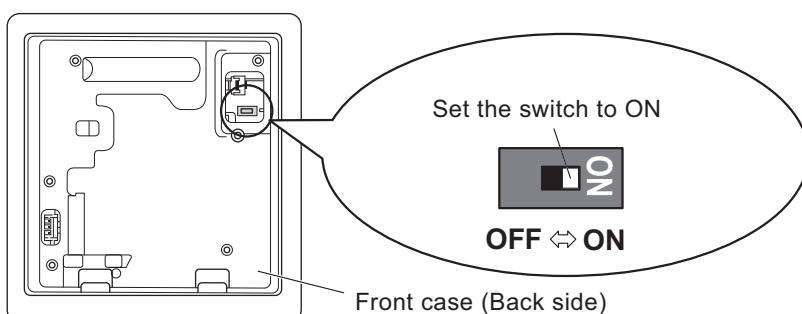

The switch performs the enabling/disabling of the backup function by the internal battery.


Before using this product, always set the switch to ON.

NOTES:


- When the power is turned on without setting the switch to ON, the set data by menu operation is erased and cause erroneous operation.
- The switch is set to OFF when shipped from the factory to prevent consumption of the charge.

- Rear case installation**



- When attaching to switch box:**

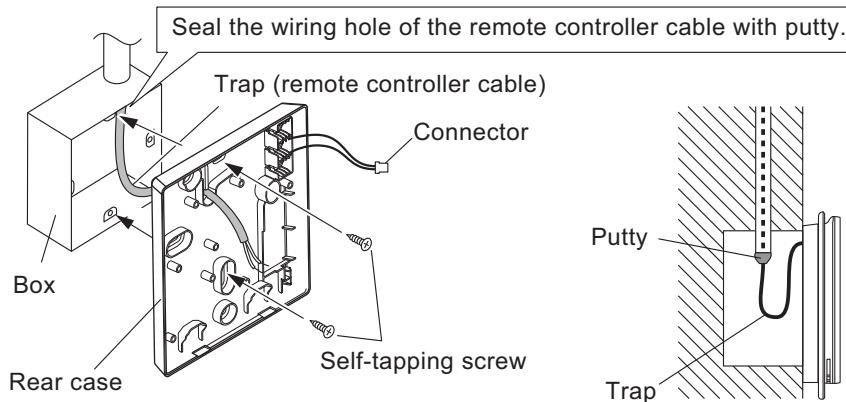

- When attaching to the wall directly:**

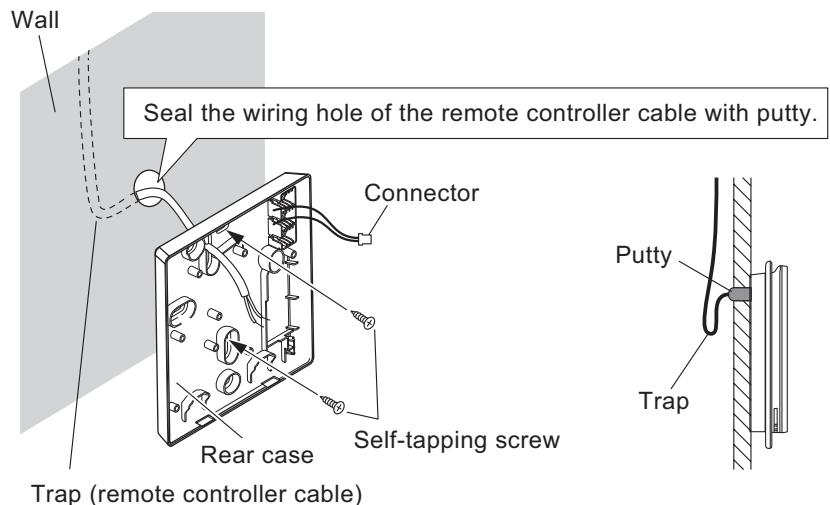


- When routing the cable on-wall:**

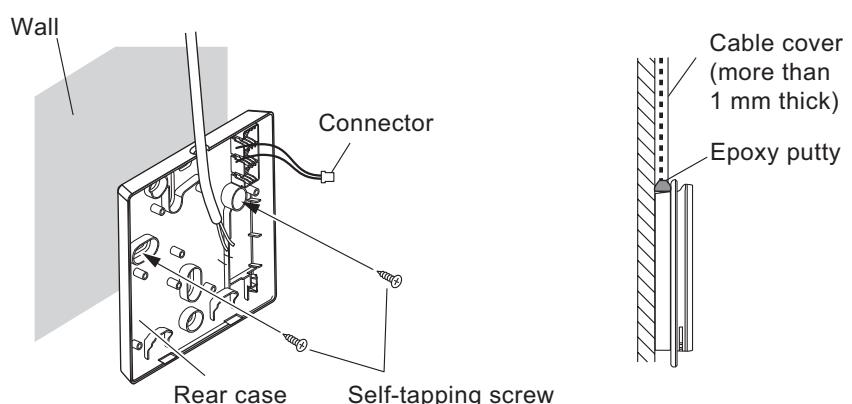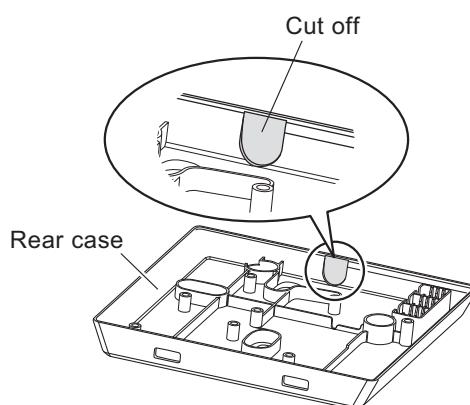


- **Remote controller cable connection**

- Fasten the outside covering of the connection cable with the cable tie.

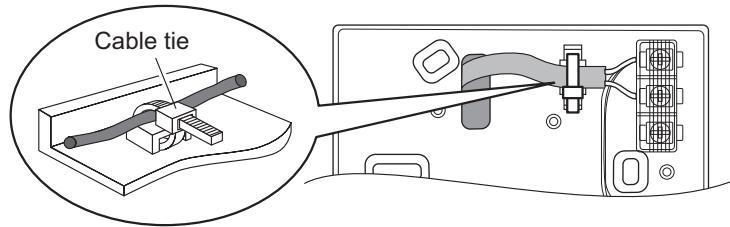

- Connect the connector of the remote controller cable to the connector of the PCB on the front case (back side).

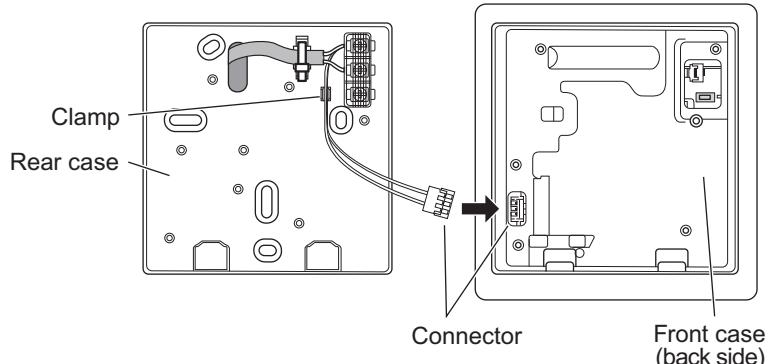

⚠ CAUTION

- Strip length must be specified dimension.
- Insert the cable deeply into the terminal.
- After the cable is inserted, check that the cable is not pulled out.
- Select a flexible cable that does not break the cable sheath even if you bind it with a cable tie around the cable sheath.
- Be careful to avoid breaking the cable by over-tightening the cable tie.

■ Specifications

Input voltage	V	DC 12
Power consumption	W	Max. 1.0
Display	4-inch TFT LCD (480 × 480 pixels) with touch screen	
Usage temperature range	°C	0 to 40
Usage humidity range	%	20 to 90 (no condensation)
Storage temperature range	°C	-10 to 60
Storage humidity range	%	20 to 90 (no condensation)
Dimensions (H × W × D)	mm	121.5 × 116 × 26
Weight	g	225


● Wiring specifications

Use	Cable size	Wire type	Remarks
Remote controller cable	0.33 to 1.25 mm ² (22 to 16 AWG)	Non polar 2-core	Use sheathed twist pair cable.*


*: Use shielded cable (locally purchased) in accordance with the regional cable standard.

14-9. Wired remote controller (UTY-RLRG: Optional part)

■ Overview

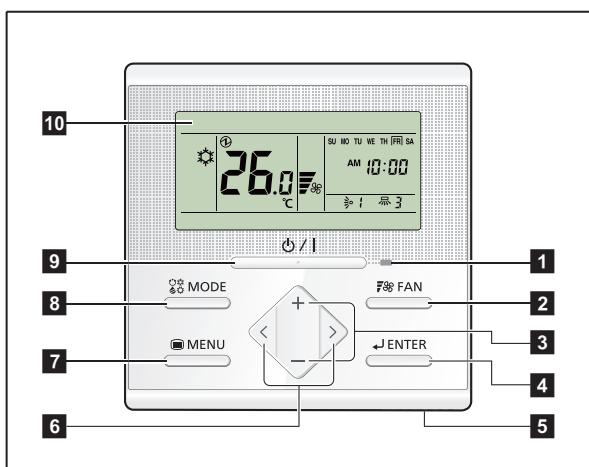

Display panel

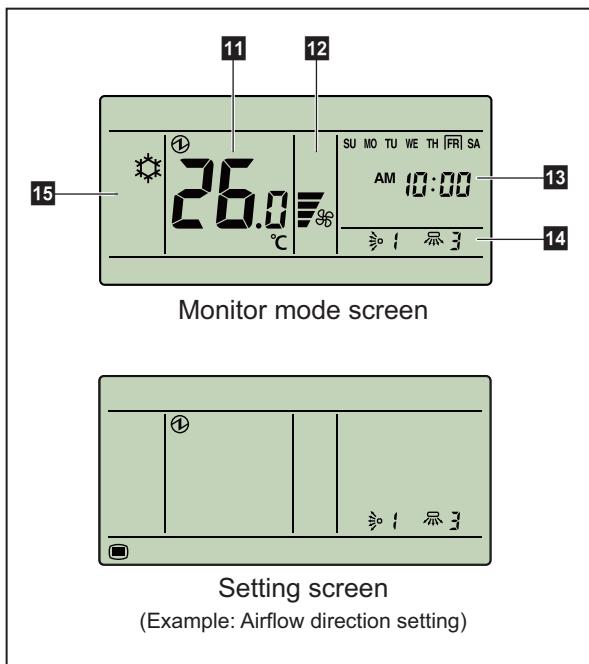

NOTE: For individual icons in Setting screen and related functions, refer to the operation manual.

1 LED lamp (Operation indicator)

Lights while the indoor unit is operating. Blinks when an error occurred.

2 FAN button

Each time the button is pressed, fan speed switches as follows:



3 +, - buttons (Set temperature buttons)

Used to adjust temperature in Monitor mode screen.

+ button: Raise

- button: Lower

In Setting screen, used to select the setting items.

NOTE: When the operation mode is set to FAN, the temperature cannot be adjusted.

4 ENTER button

Used to enter setting items and settings.

5 Room temperature sensor (inside)

Senses ambient temperature of unit.

6 <, > buttons

Used to select setting items during the setting item selection screen is displayed.

7 MENU button

Used to display the setting item selection screen.

8 MODE button

Each time the button is pressed, operation mode switches as follows:



9 On/Off button

Starts or stops the operation.

NOTE: On/Off button cannot be operated at screens other than the Monitor mode screen.

10 Display panel

Displays Monitor mode screen or Setting screen.

Monitor mode screen is home screen of this controller, and the basic operation is performed in this screen.

In Setting screen, several settings are adjustable.

11 Temperature indicator

12 Fan speed indicator


13 Clock indicator

14 Airflow direction indicator

15 Operation mode indicator

■ System diagram


1 remote controller: **2 remote controllers:**

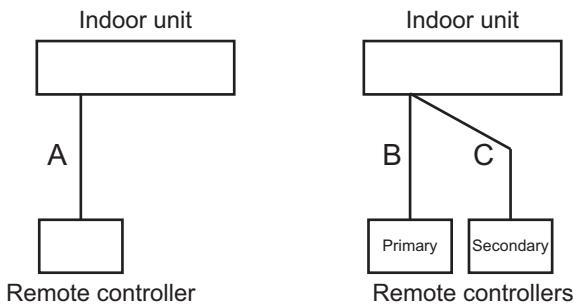


A, B, C: Remote controller cable
 $A \leq 500\text{ m}; B + C \leq 500\text{ m}$

■ Electrical wiring


1 remote controller:

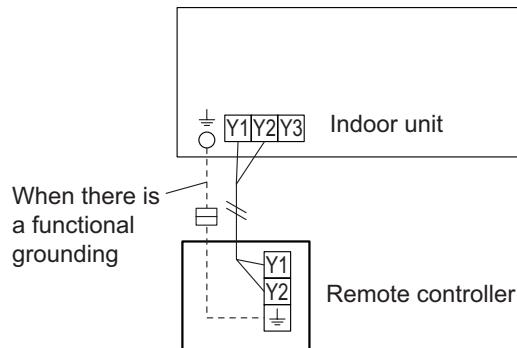

2 remote controllers:

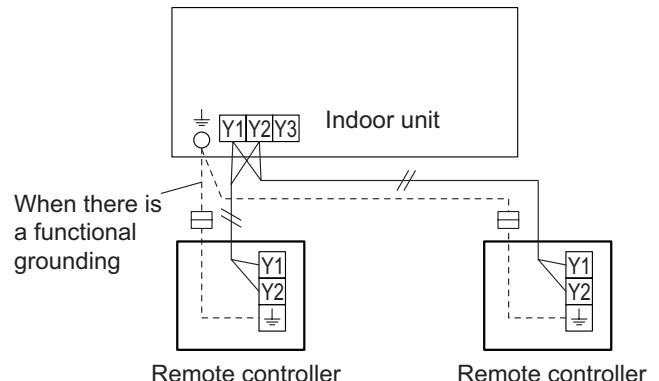


Group control:

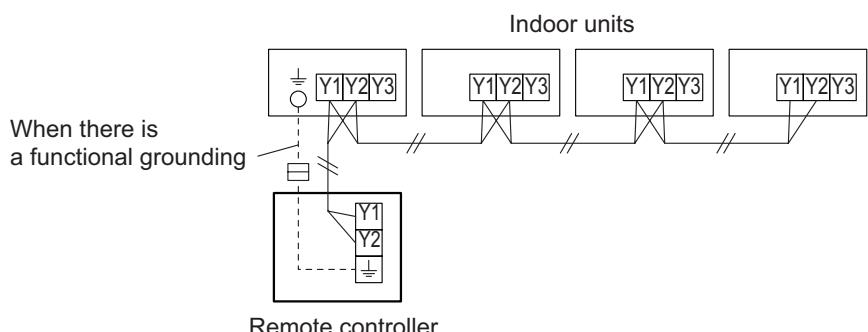

NOTE: Group connection with Polar 3-wired remote controller is not allowed.

■ Specifications

Dimensions and other specifications on the wired remote controller are as follows.

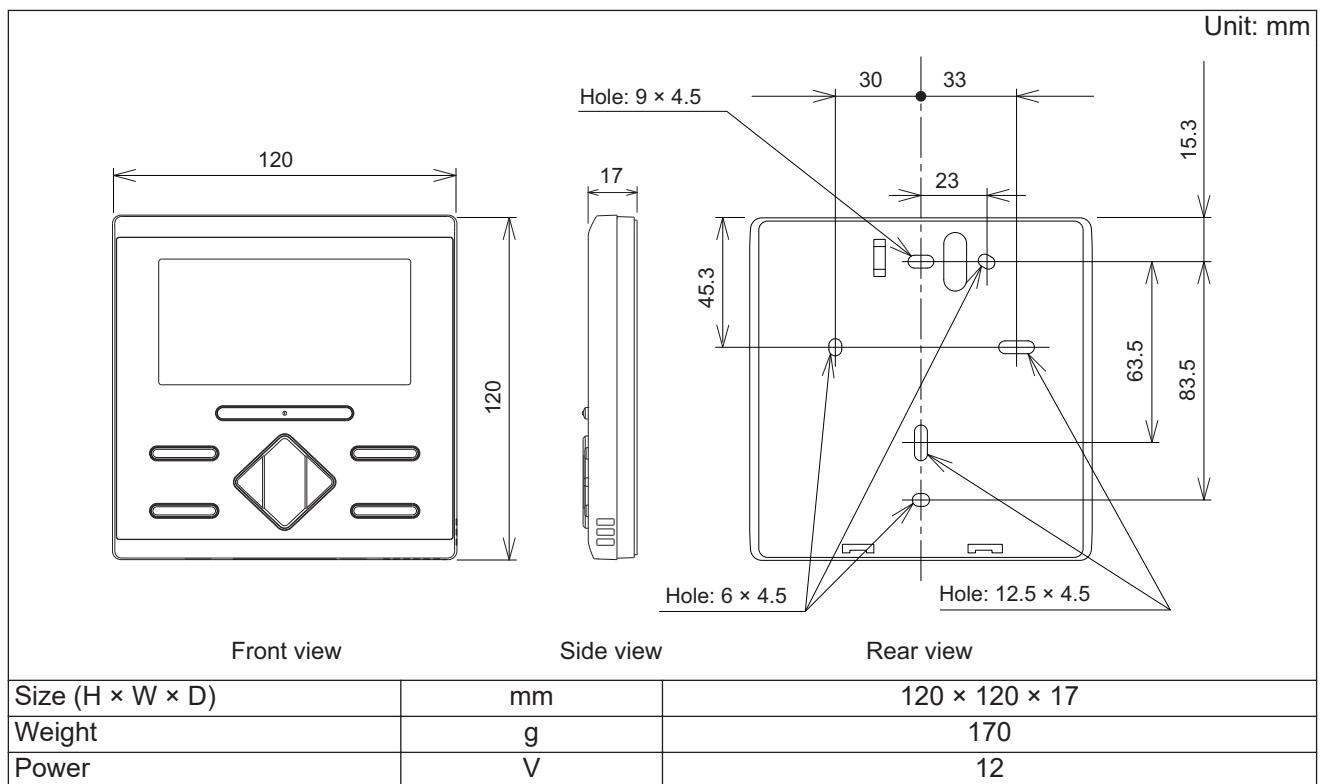


● Wiring specifications

Use	Cable size	Wire type	Remarks
Remote controller cable	0.33 to 1.25 mm ²	Non-polar 2-core, Twisted pair	Use sheathed PVC cable.

■ Installation

Connect the end of remote controller cable directly to the exclusive terminal block.

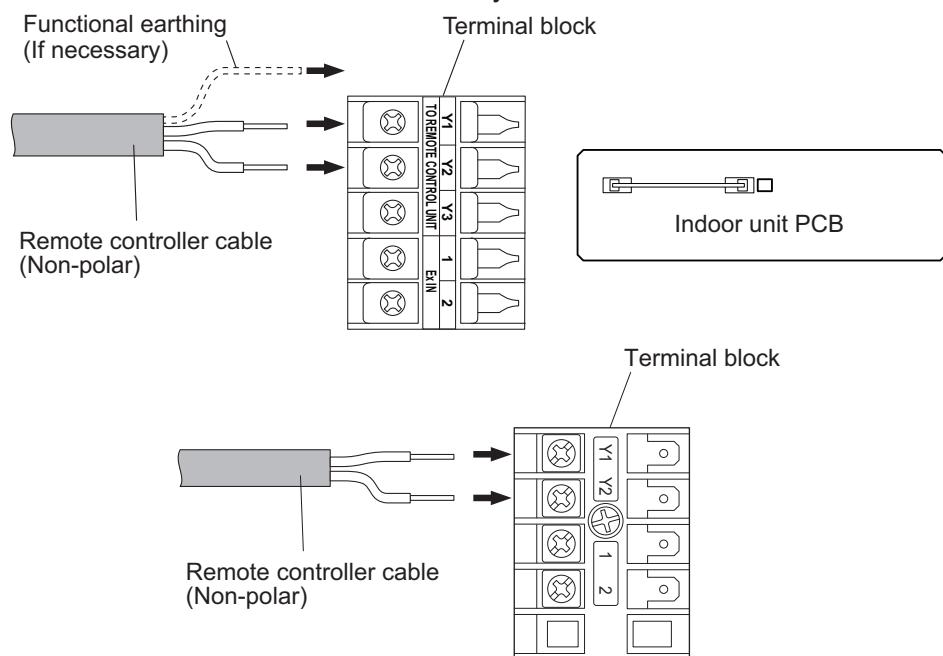


NOTES:

- The detailed shape and the layout of the terminal block and the PCB vary depending on the indoor unit type.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.

14-10. Wired remote controller (UTY-RVNGM: Optional part)


■ Overview

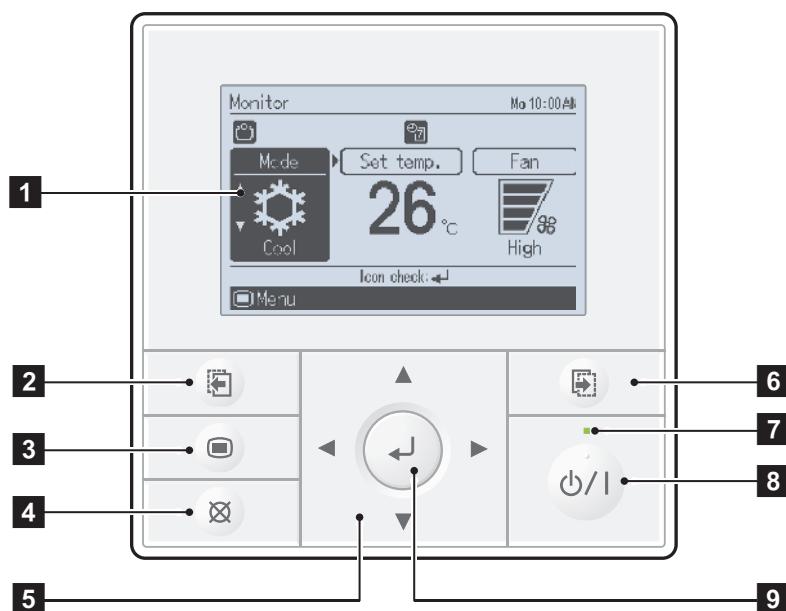

- 1** Display panel (with backlight)
- 2** Screen switch button (Left)
- 3** Menu button
- 4** Cancel button
- 5** Cursor button
- 6** Screen switch button (Right)
- 7** Power indicator
- 8** On/off button
- 9** Enter button


■ System diagram

1 remote controller: **2 remote controllers:**

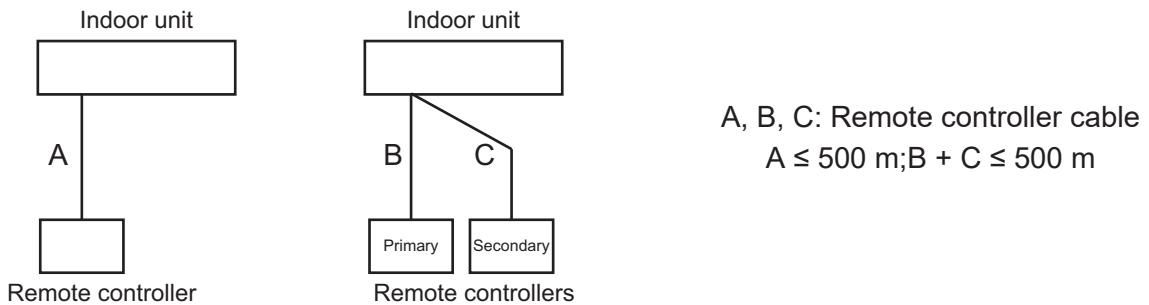


■ Electrical wiring

1 remote controller:

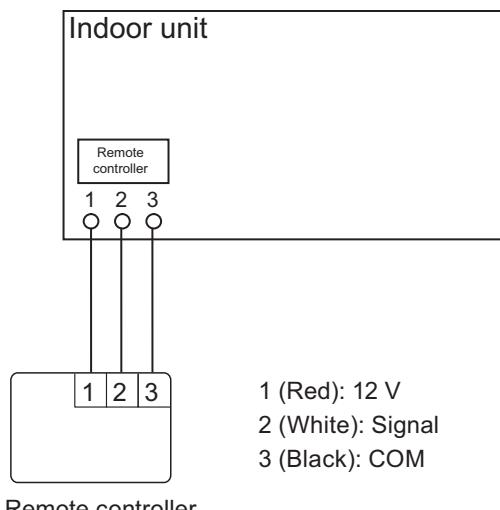


2 remote controllers:

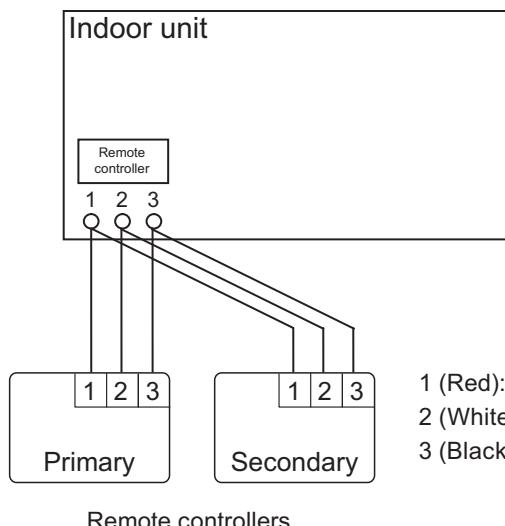

■ Controller combination

As for the combined usage of the controller, refer to following figures.

● Good

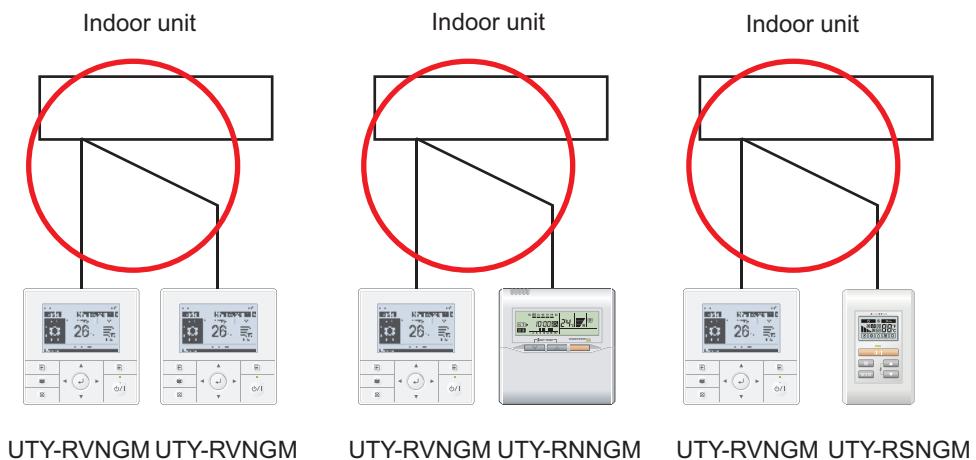

■ Specifications

Unit: mm

Front view
Side view


Size (H × W × D)	mm	120 × 120 × 21.3
Weight	g	220

● Wiring specifications

Use	Cable size	Wire type	Remarks
Remote controller cable	0.33 mm ²	Polar 3 core	Use sheathed PVC cable.

■ Installation (Remote control main unit)

Installation space:

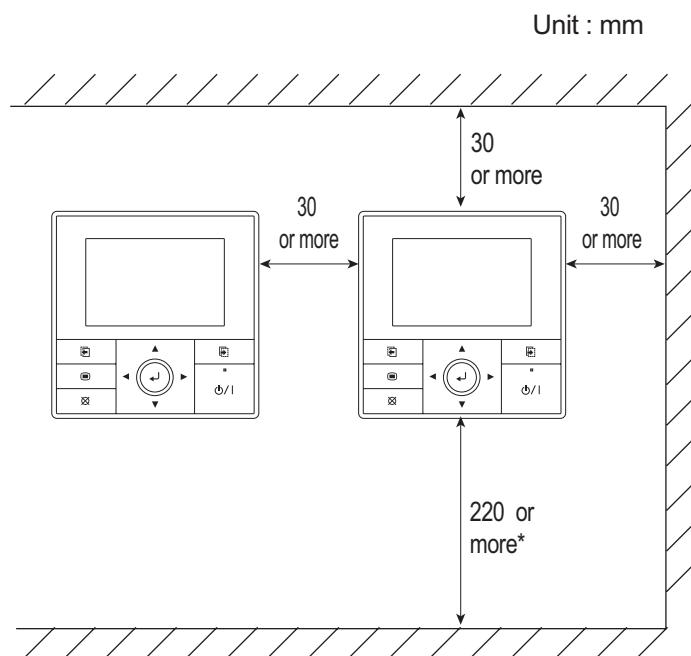


NOTE: Secure enough space where a flat-blade screwdriver to remove the case can be inserted.


Installation procedures:

1. Process the remote controller cable.

Unit : mm

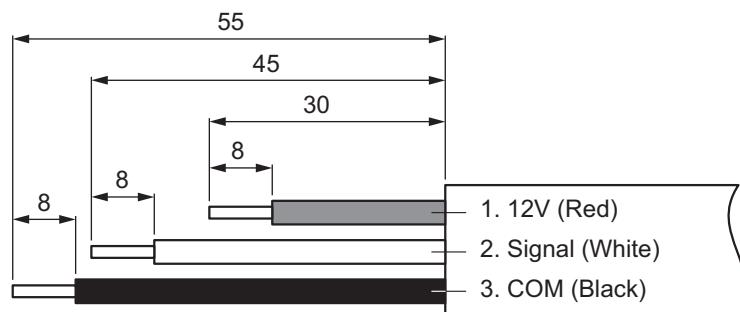


2. Insert the flat-blade screwdriver and twist it slightly to separate the front case and rear case.

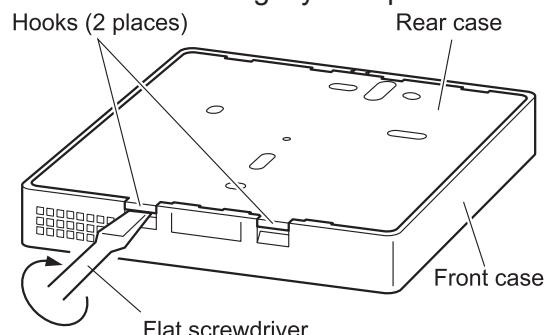

3. Attach the remote controller.


• When attaching to switch box:

- Seal the wiring hole of the remote controller cable.
- Put a remote controller cable through the hole of the rear case.
- Fix the rear case by securing it with attached screws (2 places).

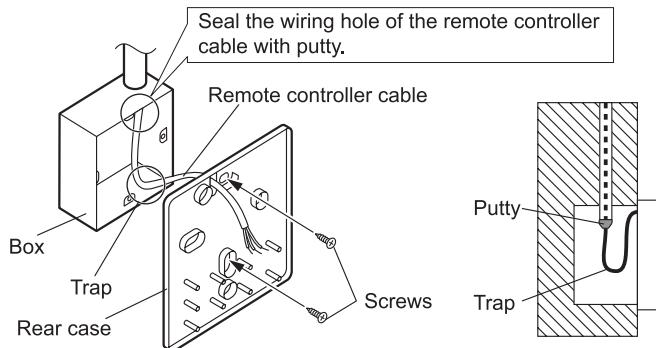


• When attaching to the wall directly:

- Seal the wiring hole of the remote controller cable.
- Put a remote controller cable through the back hole of the rear case of the main body.
- Fix the rear case by securing it with attached screws (2 places).

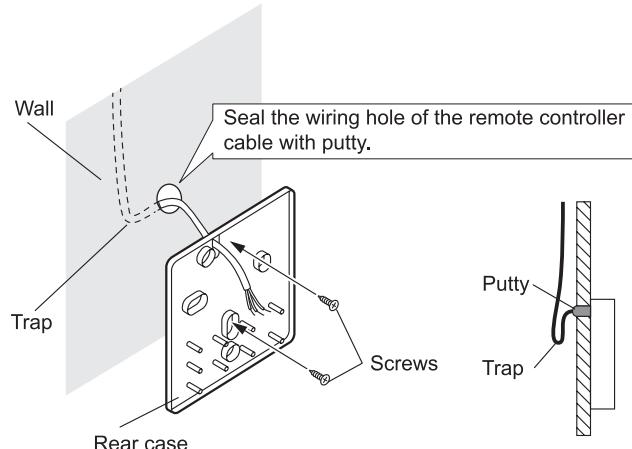


• When routing the cable on-wall:

- Cut off the cable guide of the front case with using a knife or a nipper.
- Deburr the edge of the cable guide.

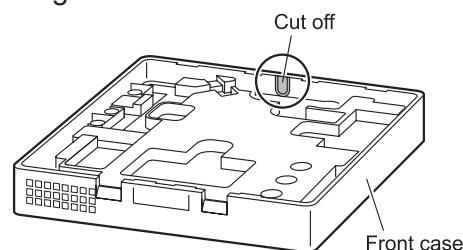


- Fix the rear case by securing it with attached screws (2 places).

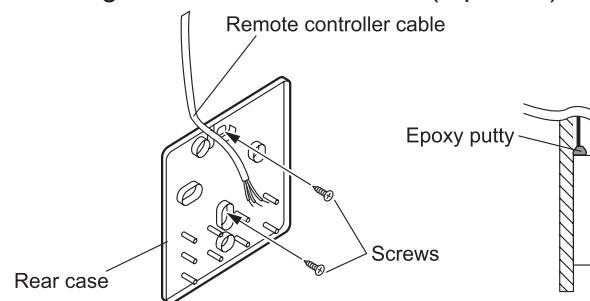


4. Connect the cable to the terminals on the front case.
 Fix the cable together with the sheath with the cable tie. Cut off the excess cable tie.

Tightening torque	
Terminal screw	0.8 to 1.2 N·m

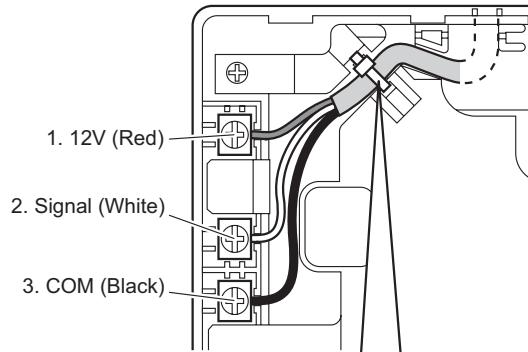

To avoid an excessive tension or pressure to the terminal block, fix the remote controller cable with the cable tie properly.


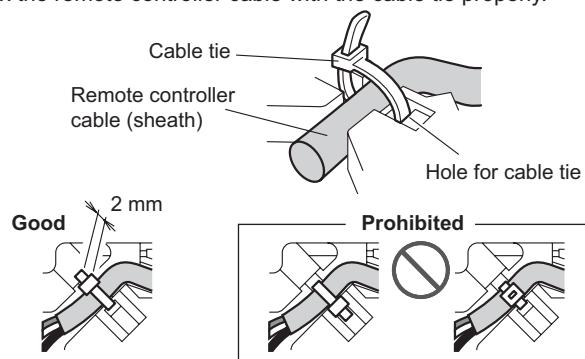


⚠ CAUTION

- Be careful to avoid breaking the cable by over-tightening the cable tie.
- When connecting the remote controller cables, do not over-tighten the screws.

5. Attach the front case.

- Insert after adjusting upper part of front case.
- When insert the front case, do not pinch the cable.

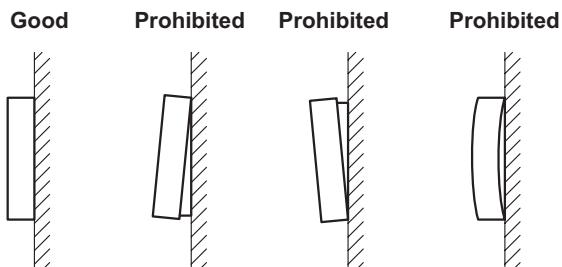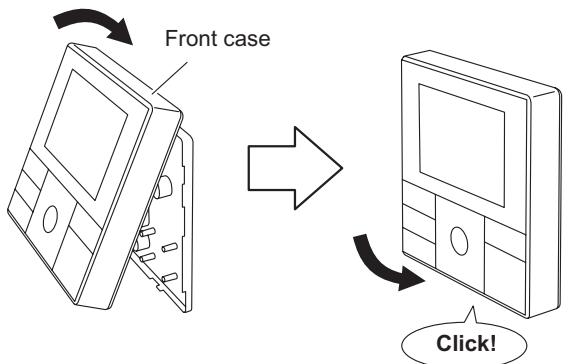

⚠ CAUTION


Insert the upper case firmly. If improperly attached, it will cause the upper case to fall off.

■ Installation

Connection pattern of wired remote controller varies by the type of the connected indoor unit.

● When connecting to terminal block (for Compact cassette, Slim duct, and Mini duct types)

Connect the end of remote controller cable directly to the exclusive terminal block.

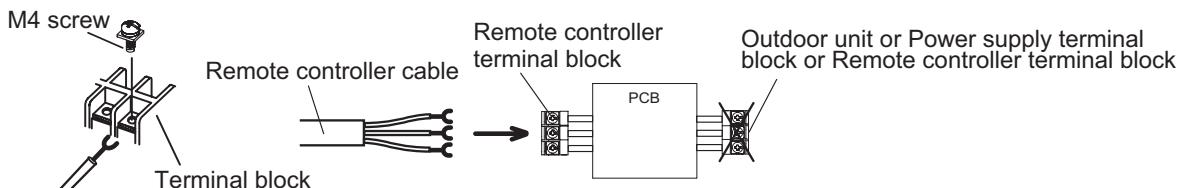


NOTE: It may be failed if it is connected to the outdoor unit or the terminal block for power supply.

● When connecting to Communication Kit (for KM models in Wall mounted type)

When connecting the remote controller to optional Communication Kit, follow the procedures mentioned below.

1. Modify the remote controller cable as follows:


- Use a tool to cut off the terminal on the end of the remote controller cable and then remove the insulation from the cut end of the cable as shown in following figure.
- Connect the remote controller cable and connecting cable as shown in following figure.
- Be sure to insulate the connection between the cables.

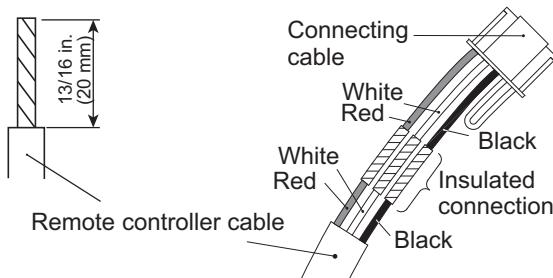

2. Connect the remote controller cable.

- Connect the cable made in step 1. to the terminal^{*1} of optional Communication Kit.
- Connect the cable from the terminal^{*2} of Communication Kit to the indoor unit PCB.

^{*1}: CNC01 on UTY-TWBXF2
^{*2}: CND01 on UTY-TWBXF2

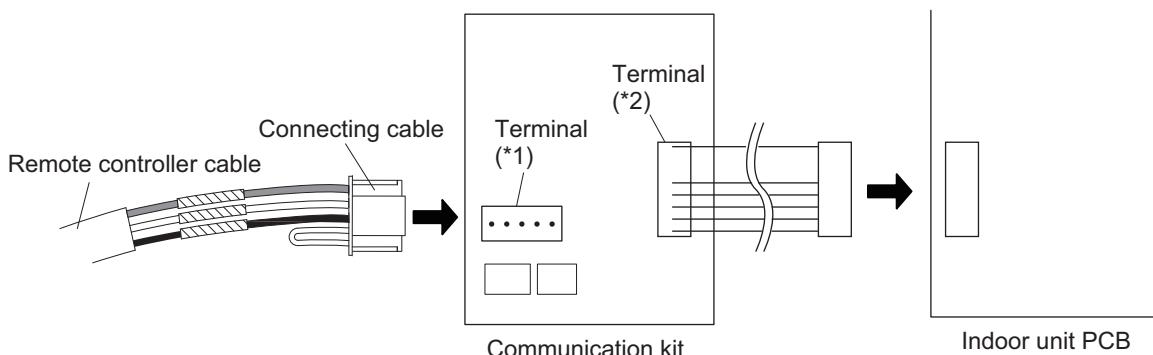


■ Required optional parts

Required optional parts for connecting the wired remote controller to the wall mounted type are as follows.


Part name	Model name
External Connect Kit	UTY-XWZXZ5
Communication Kit	UTY-TWBXF2

14-11. Wired remote controller (UTY-RNRGZ*: Optional part)

■ Overview

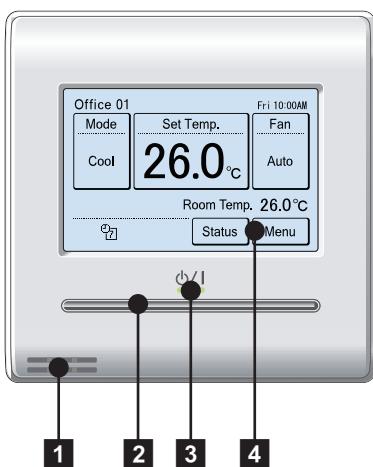

Display panel

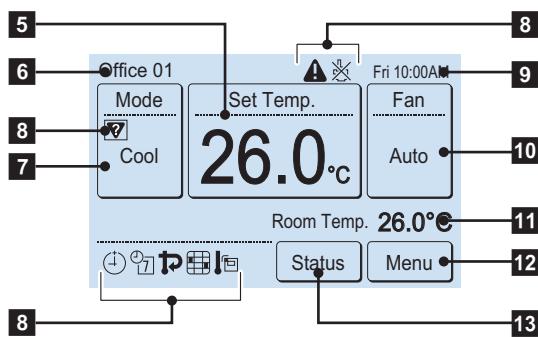

1 Remote temperature sensor (inside)

2 On/off button

Operable only while displaying the "Monitor mode" screen.

3 LED lamp (operation indicator)

4 Touch panel display

5 Set temperature

Operating temperature can be set.

6 Remote controller group name

7 Mode

Operation mode can be set.

8 Status icons

9 Clock

10 Fan

Fan speed can be set.

11 Room temperature

12 Menu

Various settings can be set.


13 Status

Status of the indoor unit and error can be checked.

NOTE: Functions may differ by type of the indoor unit. For details, refer to the operation manual.

■ System diagram


1 remote controller: **2 remote controllers:**

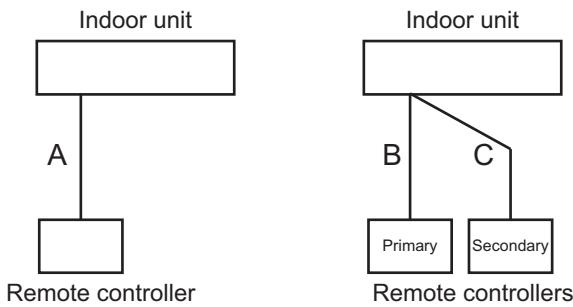


A, B, C: Remote controller cable
A ≤ 500 m; B + C ≤ 500 m

■ Electrical wiring


1 remote controller:

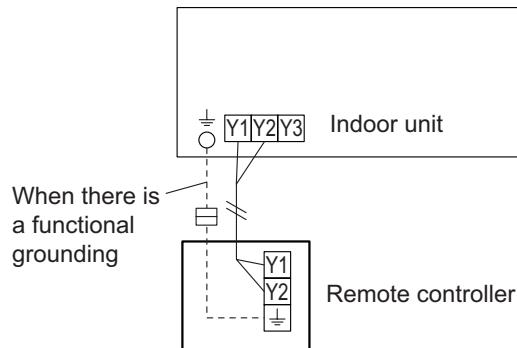

2 remote controllers:

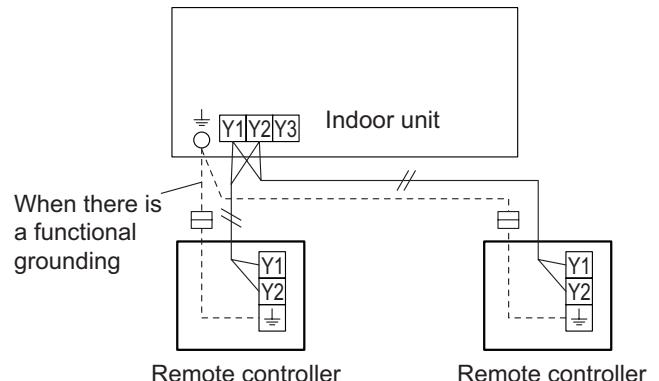

Group control:

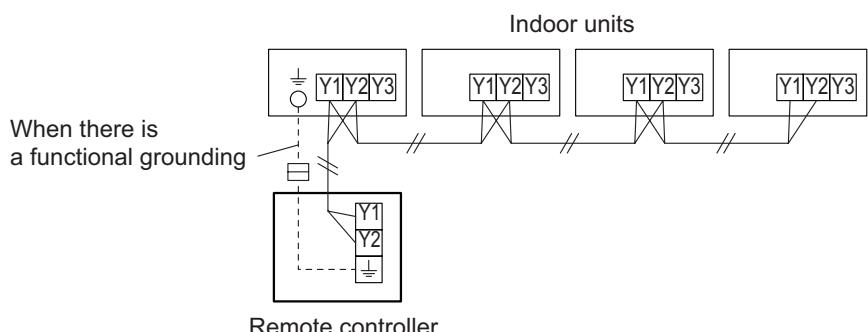


NOTE: Group connection with Polar 3-wired remote controller is not allowed.

■ Specifications

Dimensions and other specifications on the wired remote controller are as follows.

Unit: mm

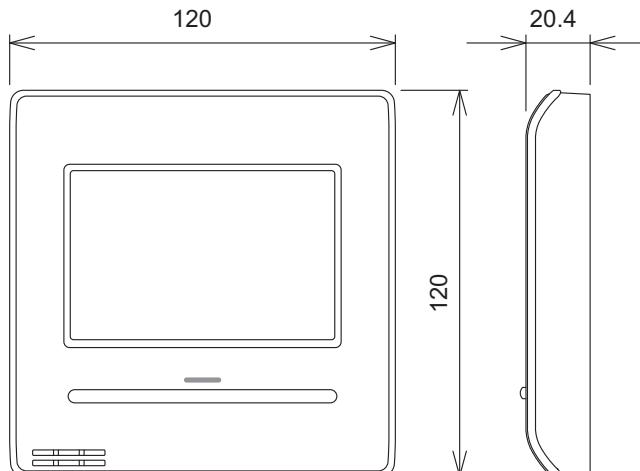

Model name	UTY-RNRGZ*	
------------	------------	--


Display	3.8-inch FSTN LCD (255 × 160 dots) with touch panel	
Dimensions (H × W × D)	mm	120 × 120 × 20.4
Weight	g	220
Input voltage	V	DC 12
Power consumption	W	Max. 0.3
Usage temperature range	°C	0 to 40
Usage humidity range	%	20 to 90 (no condensation)
Storage temperature range	°C	-10 to 60
Storage humidity range	%	20 to 90 (no condensation)


● Wiring specifications

Use	Cable size	Wire type	Remarks
Remote controller cable	0.33 to 1.25 mm ²	Non-polar 2-core, Twisted pair	Use sheathed PVC cable.

■ Installation

Connect the end of remote controller cable directly to the exclusive terminal block.

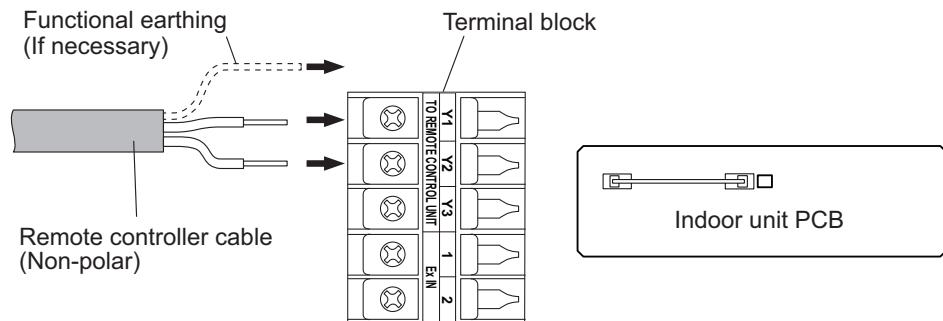


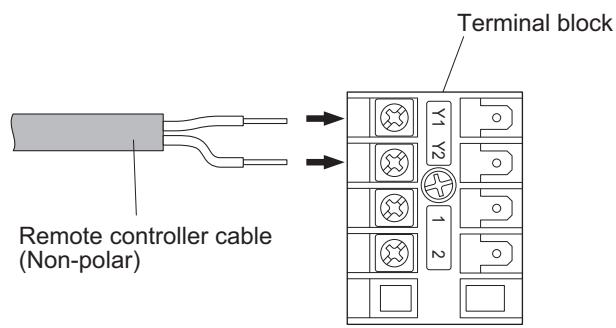**NOTES:**

- The detailed shape and the layout of the terminal block and the PCB vary depending on the indoor unit type.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.

14-12. Wired remote controller (UTY-RCRGZ1: Optional part)


■ Overview

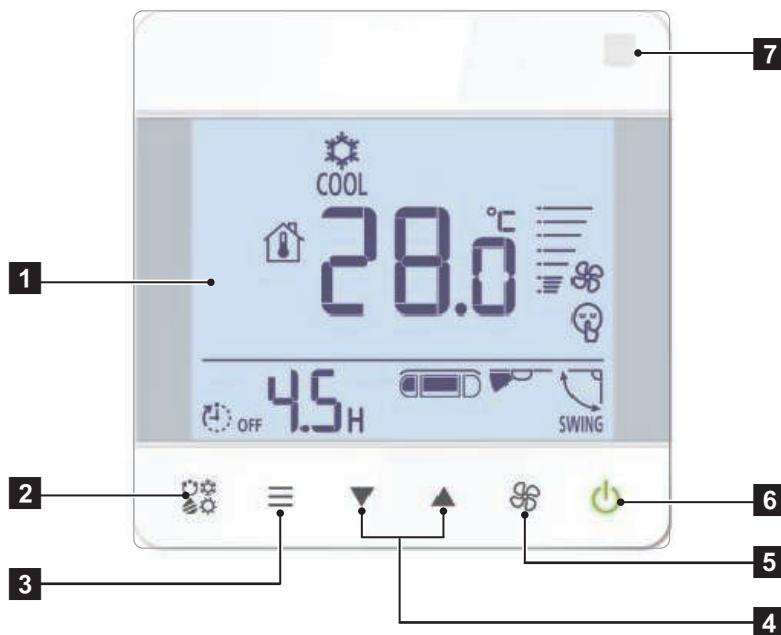

- 1** Display panel
- 2** MODE button
- 3** Menu button
- 4** ▼, ▲ buttons (Set temperature buttons)
- 5** FAN button
- 6** On/off button
- 7** Wireless remote controller signal receiving section

■ System diagrams


- Single remote control



Remote controller cable

$A \leq 500$ m

■ Electrical wiring

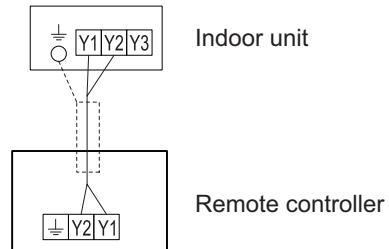

■ Specifications

Unit: mm

Front View: Width 86, Height 86.

Side View: Depth 32.

Rear View: Two mounting holes (Hole x 2) for M4 screws.

Size (H × W × D)	mm	86 × 86 × 32
Weight	g	135

● Wiring specifications

Use	Cable size	Wire type	Remarks
Remote controller cable	0.33 to 1.25 mm ² (22 to 16 AWG)	Non polar 2-core	Use sheathed twist pair cable.*

*: Use shielded cable (locally purchased) in accordance with the regional cable standard.

■ Installation


• Connection pattern

NOTE: Connection pattern is different according to type of Indoor unit.

Indoor unit type	Connection pattern
All cassette type	Pattern A
All duct type	Pattern A
Compact floor type	Pattern A
Wall mounted type	Pattern B

• Pattern A

1. Connect the end of remote controller cable directly to the exclusive terminal block.
2. Set the DIP switch (SW1) to "2WIRE" on the PCB of the indoor unit.

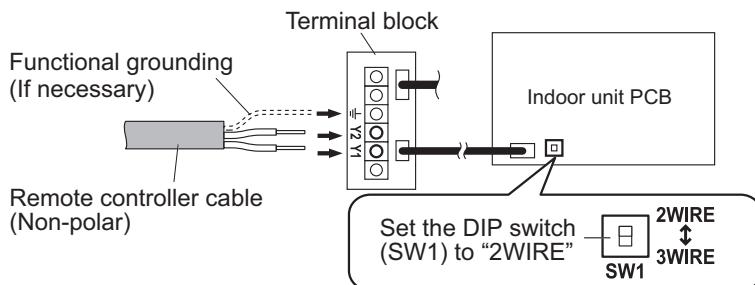


NOTES:


- Layout of terminal block and PCB is varies depending on the type of indoor unit.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.

- Pattern B**


1. Use a tool to cut off the terminal on the end of the remote controller cable, and then remove the insulation from the cut end of the cable as shown below.




2. Connect the remote controller cable and connecting cable as shown below. Be sure to insulate the connection between the cables.

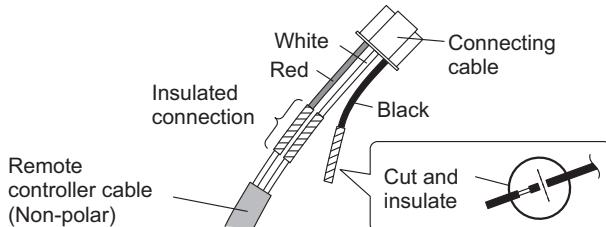

3. Connect the remote controller cable to the connecting cable, and insert it to the connector. Set the DIP switch (SW1) to "2WIRE" on the PCB of the indoor unit.

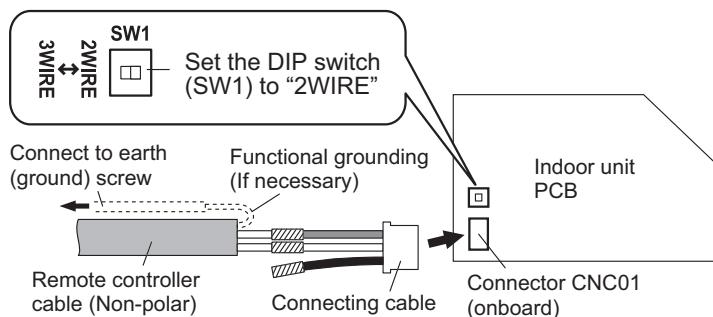


NOTE: Layout of terminal block and PCB is varies depending on the type of indoor unit.

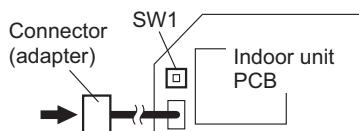


14-13. Simple remote controller (UTY-RSNGM: Optional part)

■ Overview

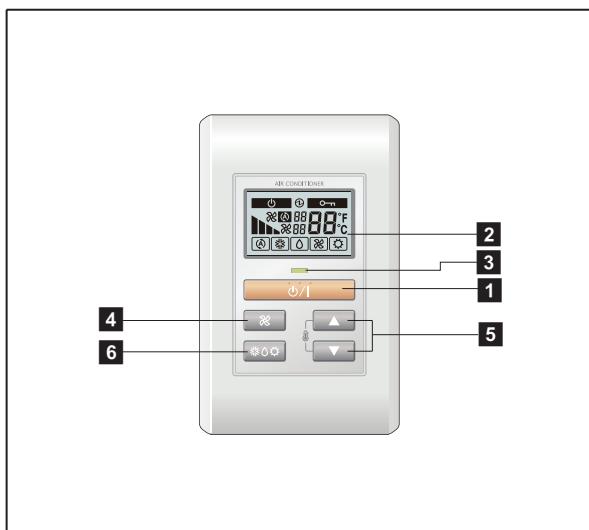

Display panel

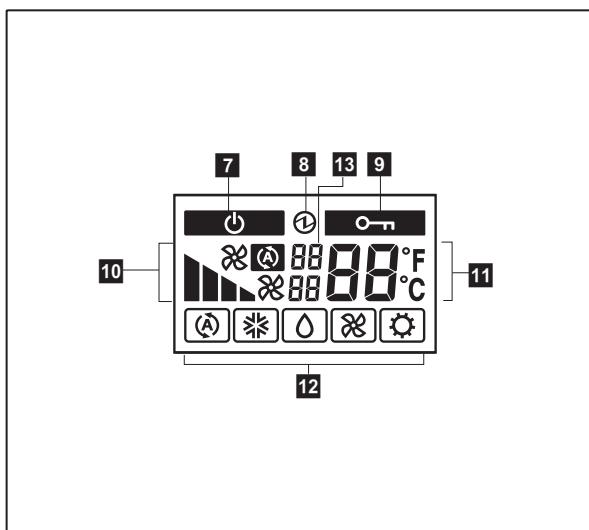

1 START/STOP button

Starts and stops operation.

2 Display backlight button

Lights during operation.

3 Operation lamp

Lights during operation.

4 FAN button

Selects the fan speed (AUTO A° , HIGH H° , MED M° , LOW L° , and QUIET Q°).

5 SET TEMP. button

Selects the setting temperature.

6 MODE button

Selects the operating mode (AUTO A° , COOL C° , DRY D° , FAN F° , HEAT H°).

7 Standby indicator

Indicates during the oil recovery and defrosting operation.

8 Power source indicator

Indicates the main power is on.

9 Central control indicator

Indicates when function is locked.

10 Fan speed indicator

Deletes the weekly timer schedule.

11 Set temperature

- Indicates error history number in error code history display mode.
- Indicates indoor unit address in address display mode.


12 Operating mode indicator

13 Indicator

- Upper:
 - Indicates the error code in error code history display mode and in self diagnosis mode.
 - Indicates the refrigerant system address in address display mode.
- Lower: Indicates the remote controller address in error code history display mode, address display mode, and self diagnosis mode.

■ System diagram


1 remote controller: **2 remote controllers:**

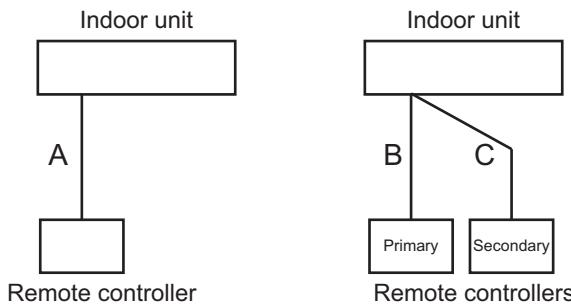

A, B, C: Remote controller cable
A ≤ 500 m; B + C ≤ 500 m

■ Electrical wiring


1 remote controller:

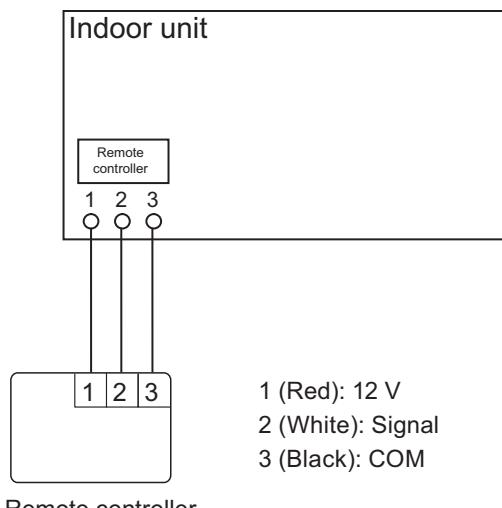

1 (Red): 12 V
2 (White): Signal
3 (Black): COM

Remote controller

2 remote controllers:

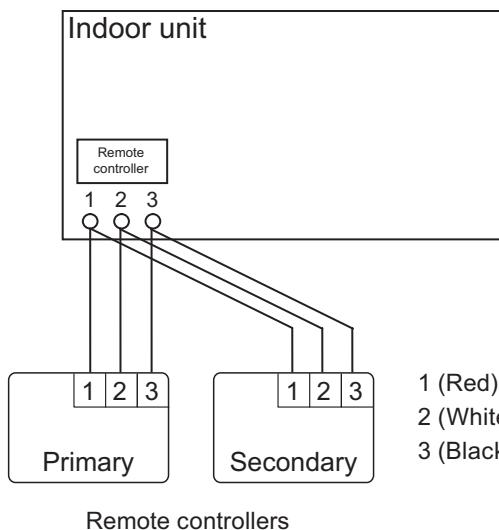


1 (Red): 12 V
2 (White): Signal
3 (Black): COM

Remote controllers

■ Specifications

Dimensions and other specifications on the wired remote controller are as follows.

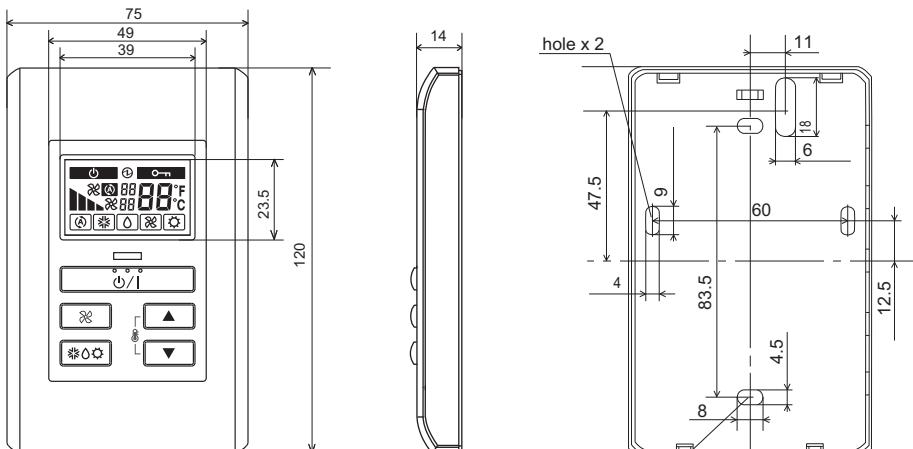

Unit: mm

Front View	Side View	Rear View
Size (H × W × D) mm		120 × 75 × 14
Weight g		90
Cable length (accessory) m		10
Power V		12

● Wiring specifications


Use	Size	Wire type	Remarks
Remote controller cable	0.33 mm ²	Polar 3 core	Use sheathed PVC cable.

■ Installation

Connection pattern of wired remote controller varies by the type of the connected indoor unit.

● When connecting to terminal block (for Compact cassette, Slim duct, and Mini duct types)

Connect the end of remote controller cable directly to the exclusive terminal block.

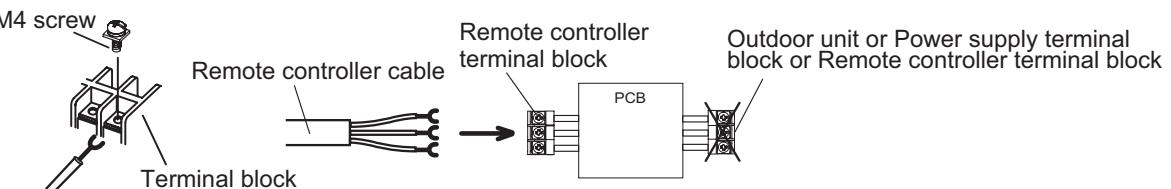


NOTE: It may be failed if it is connected to the outdoor unit or the terminal block for power supply.

● When connecting to Communication Kit (for KM models in Wall mounted type)

When connecting the remote controller to optional Communication Kit, follow the procedures mentioned below.

1. Modify the remote controller cable as follows:


- Use a tool to cut off the terminal on the end of the remote controller cable and then remove the insulation from the cut end of the cable as shown in following figure.
- Connect the remote controller cable and connecting cable as shown in following figure.
- Be sure to insulate the connection between the cables.

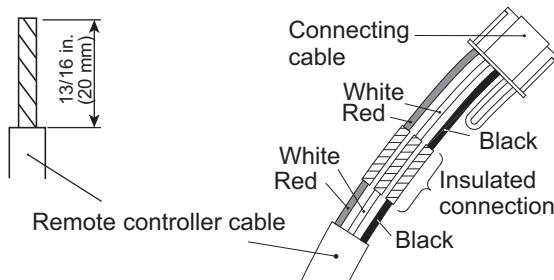

2. Connect the remote controller cable.

- Connect the cable made in step 1. to the terminal^{*1} of optional Communication Kit.
- Connect the cable from the terminal^{*2} of Communication Kit to the indoor unit PCB.

^{*1}: CNC01 on UTY-TWBXF2
^{*2}: CND01 on UTY-TWBXF2

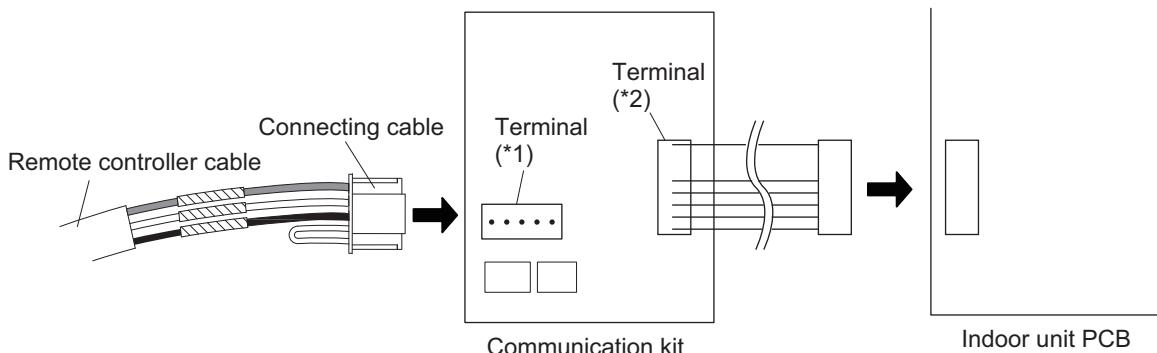


■ Required optional parts

Required optional parts for connecting the wired remote controller to the wall mounted type are as follows.


Part name	Model name
External Connect Kit	UTY-XWZXZ5
Communication Kit	UTY-TWBXF2

14-14. Simple remote controller (UTY-RSRG and UTY-RHRG: Optional parts)

■ Overview

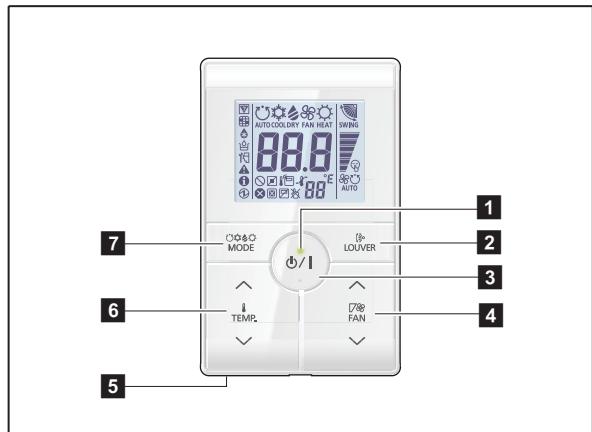

Display panel

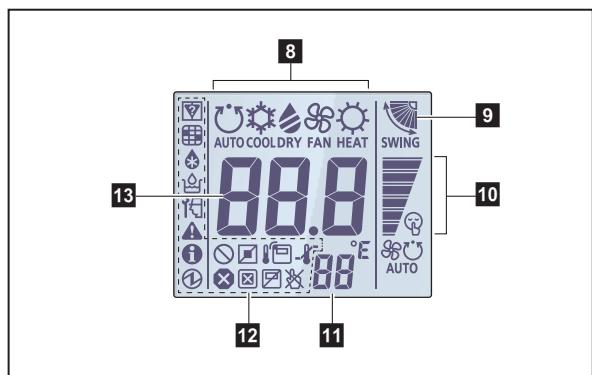

¹: Available only for UTY-RSR.

*²: Not available for a heat pump model unless it is set up as an administrative indoor unit.

*³: Not available for a heat pump model.

*⁴: Not available for a cooling-only model.

*⁵: Set the function setting of the indoor unit accordingly.

*⁶: During address display mode.

1 LED lamp

Lights during operation.

2 Louver button

Adjusts the airflow direction.

3 START/STOP button

Starts and stops operation.

4 FAN control button

Switches the fan speed as follows:



5 Room temperature sensor (inside)

Senses ambient temperature of unit.

6 Set temperature button

Selects the setting temperature. (18—30 °C [COOL], 10—30 °C [HEAT])

7 Operation mode button*¹

Switches the operation mode as follows:



8 Operating mode indicator

9 Airflow direction indicator

10 FAN speed indicator

11 Remote controller address indicator

12 Status icons

Mode mismatch

Filter sign *⁵

Defrost operation

Oil recovery operation

Under maintenance

Error

Special state

Conducting electricity

Emergency stop

Operation controlled

Forced stop

Remote controller sensor is enabled *⁵

Central controlled

Setting temperature range is enabled


Operation prohibited

13 Set temperature

Indicates indoor unit address. *⁶


■ System diagram

1 remote controller: **2 remote controllers:**

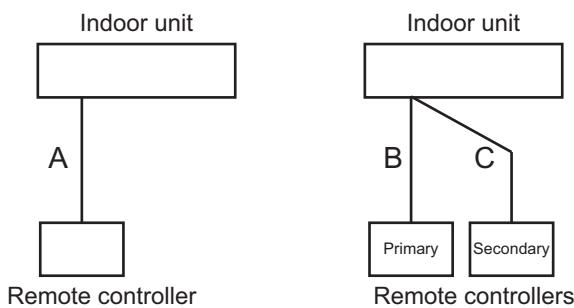


■ Electrical wiring


1 remote controller:

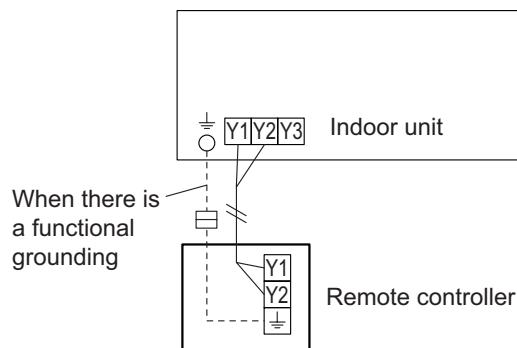

2 remote controllers:

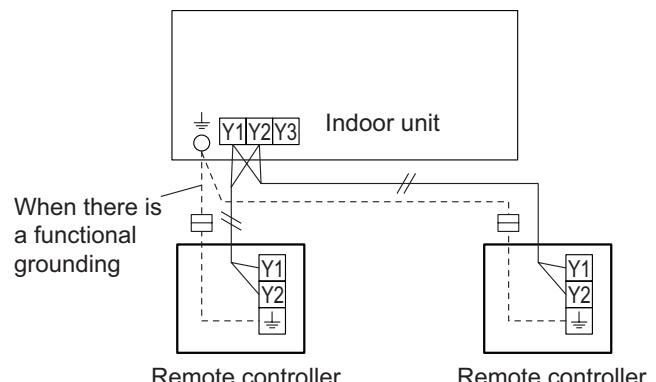


Group control:

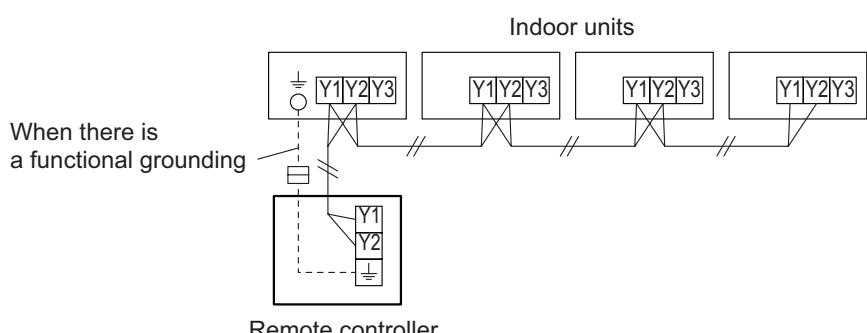

NOTE: Group connection with Polar 3-wired remote controller is not allowed.

■ Specifications

Dimensions and other specifications on the wired remote controller are as follows.

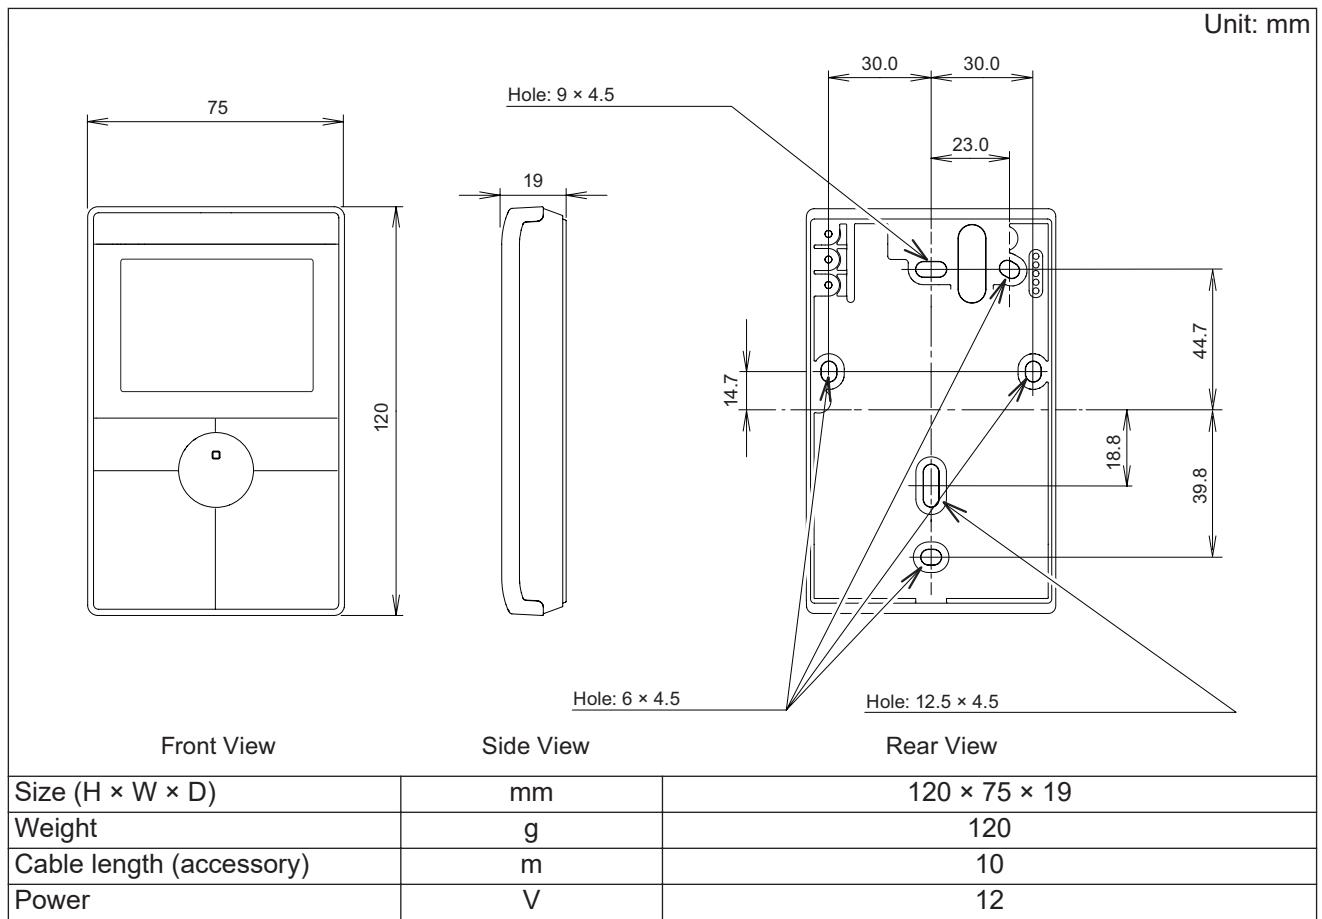


● Wiring specifications

Use	Cable size	Wire type	Remarks
Remote controller cable	0.33 to 1.25 mm ²	Non-polar 2-core, Twisted pair	Use sheathed PVC cable.

■ Installation

Connect the end of remote controller cable directly to the exclusive terminal block.

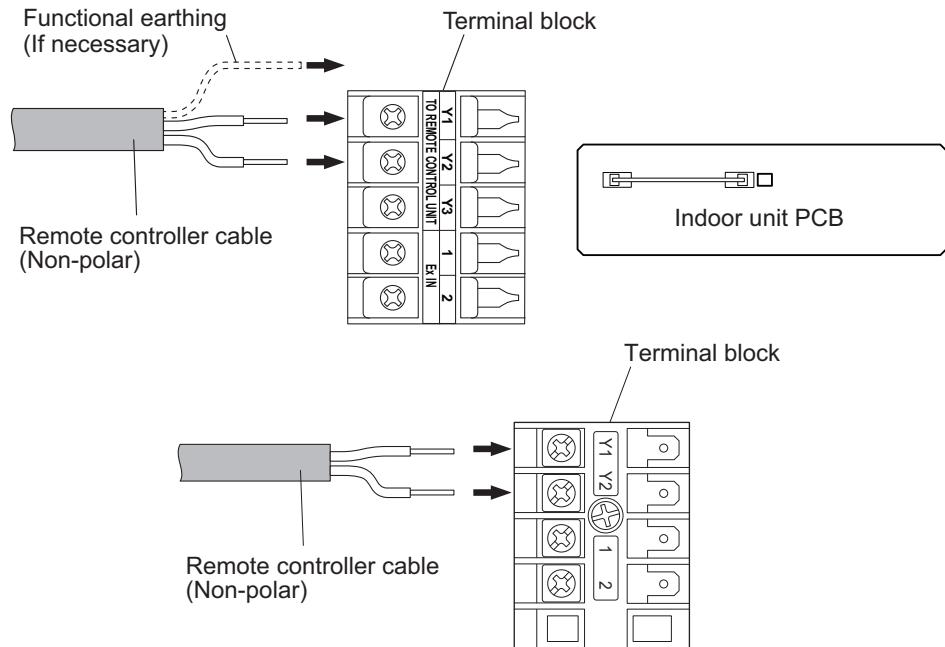

NOTES:

- The detailed shape and the layout of the terminal block and the PCB vary depending on the indoor unit type.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.

15. Function settings

To adjust the functions of this product according to the installation environment, various types of function settings are available.

NOTE: Incorrect settings can cause a product malfunction.

15-1. Compact cassette, Mini duct, Slim duct types indoor unit (setting by DIP switch)


By using some components on the PCB, you can change the function settings.

Related components on the PCB and the applicable settings:

Component			Setting content
DIP switch	SW100	1	Remote controller address setting
		2	
		3	
		4	
	SW101	1	Drainage function setting
		2	Auto louver grille setting
		3	Fan delay setting

■ Component location

Components on the indoor unit main PCB used for the function settings are located as shown in the following figure.

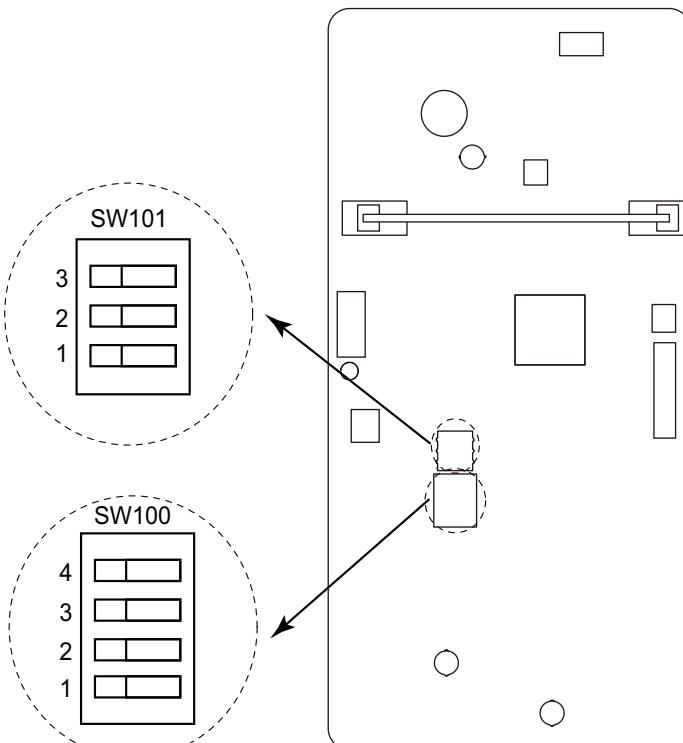


■ DIP switch setting

- SW100: Remote controller address setting**

When operating a number of indoor units by using a wired remote controller, DIP switch setting for assigning unit number to each indoor unit is required.

The slide switches are normally set to make the unit number 00.

Remote controller address	Switch number				Factory setting
	1	2	3	4	
00	OFF	OFF	OFF	OFF	♦
01	ON	OFF	OFF	OFF	
02	OFF	ON	OFF	OFF	
03	ON	ON	OFF	OFF	
04	OFF	OFF	ON	OFF	
05	ON	OFF	ON	OFF	
06	OFF	ON	ON	OFF	
07	ON	ON	ON	OFF	
08	OFF	OFF	OFF	ON	
09	ON	OFF	OFF	ON	
10	OFF	ON	OFF	ON	
11	ON	ON	OFF	ON	
12	OFF	OFF	ON	ON	
13	ON	OFF	ON	ON	
14	OFF	ON	ON	ON	
15	ON	ON	ON	ON	

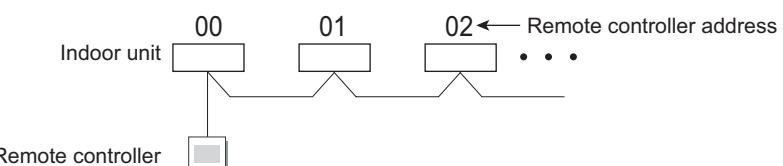

- SW101-Switch 1: Drainage function setting**

Switch 1	Drainage function	Factory setting
ON	Disabled	
OFF	Enabled	♦

- SW101-Switch 2: Auto louver grille setting**

When Auto Louver Grille Kit (optional parts) is attached, set to "Enabled".

Switch 2	Auto louver grille setting	Factory setting
ON	Enabled	
OFF	Disabled	♦

- SW101-Switch 3: Fan delay setting**

When the indoor unit is stopped while operating in conjunction with auxiliary heater, the indoor unit fan operation will continue for 1 minute.

Switch 3	Fan delay	Factory setting
ON	Enabled	
OFF	Disabled	♦

15-2. Medium static pressure duct type


By using some components on the PCB, you can change the function settings.

Related components on the PCB and the applicable settings

Component	Setting content	
DIP switch101	1	Drainage function setting
	2	Setting change prohibited
	3	Fan delay setting
	4	Setting change prohibited

● Component location

Components on the indoor unit main PCB used for the function settings are located as shown in the following figure.

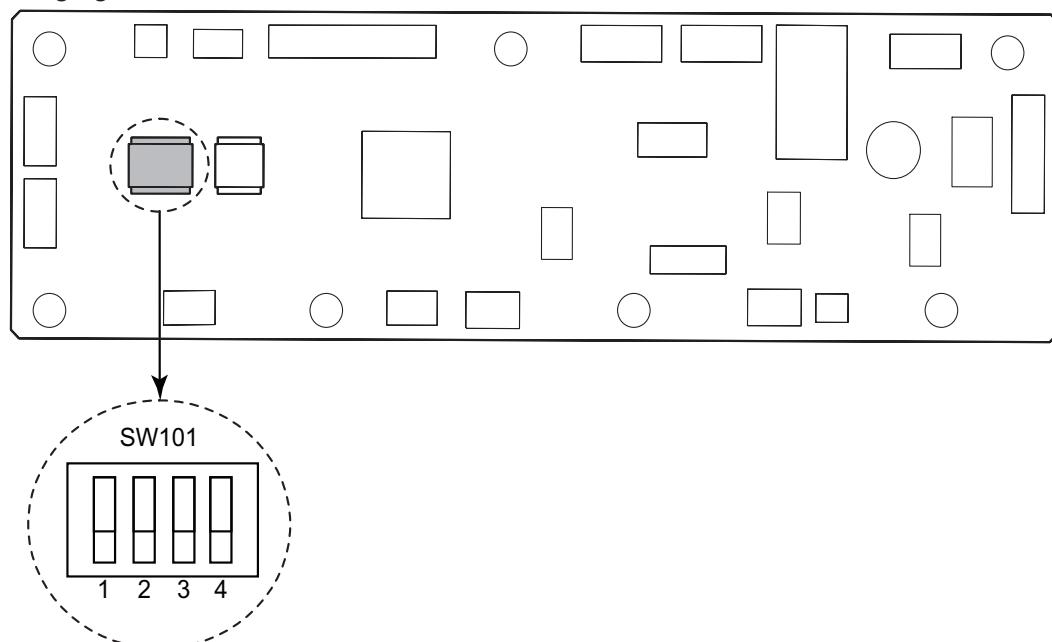

● DIP switch setting

- Switch 1: Drainage function setting (SW101)

Switch 1	Drainage function	Factory setting
ON	Disabled	
OFF	Enabled	♦

- Switch 2: Setting change prohibited (SW101)

- Switch 3: Fan delay setting (SW101)

When the indoor unit is stopped while operating in conjunction with auxiliary heater, the indoor unit fan operation will continue for 1 minute.

Switch 3	Fan delay	Factory setting
ON	Enabled	
OFF	Disabled	♦

- Switch 4: Setting change prohibited (SW101)

15-3. Indoor unit (setting by wireless remote controller)

⚠ CAUTION

This setting changes the function settings used to control the indoor unit according to the installation conditions. Incorrect settings can cause a product malfunction.

- After the power is turned on, perform the “Function setting” according to the installation conditions using the remote controller.
- The settings may be selected between the following two: Function number or Setting number.
- Settings will not be changed if invalid numbers or setting numbers are selected.

■ Preparation


Before connecting the power supply of the indoor unit, reconfirm following items:

- Piping air tightness test and vacuuming have been performed firmly.
- There is no wiring mistake. Then, connect the power supply of the indoor unit.

■ AR-REM4E (for Wall mounted type KGTB), AR-REW3E (for Wall mounted type KGTE, KGTF, KGTG, and KGTH), AR-REW4E (for Wall mounted type KETA[-B], KETE[-B], and KETF[-B]), and AR-REM7E (for Floor type)

● Button name and function


During address setting mode, indoor unit reject the any operation command from remote controller.

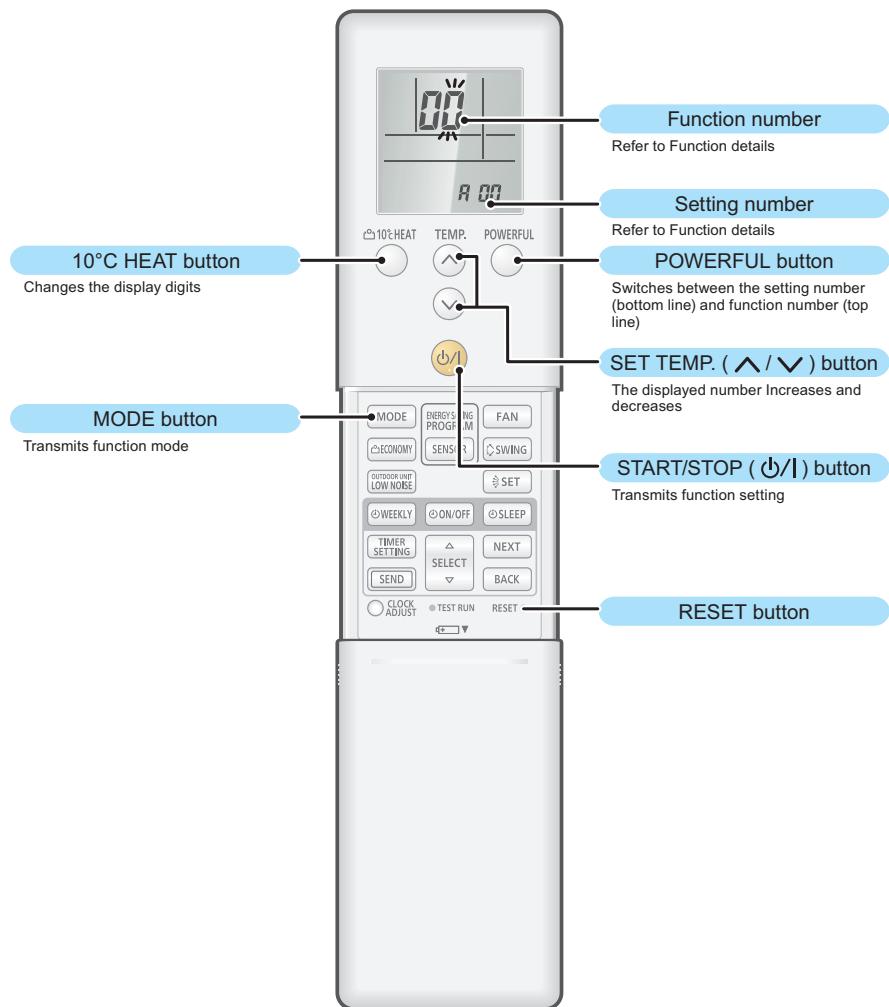

NOTE: The number of buttons varies by the remote controller model.

● Function setting procedure

1. Connect the power supply of the outdoor unit.
2. To enter the function setting mode, while holding down the POWERFUL and TEMP. \wedge button, press the RESET button.

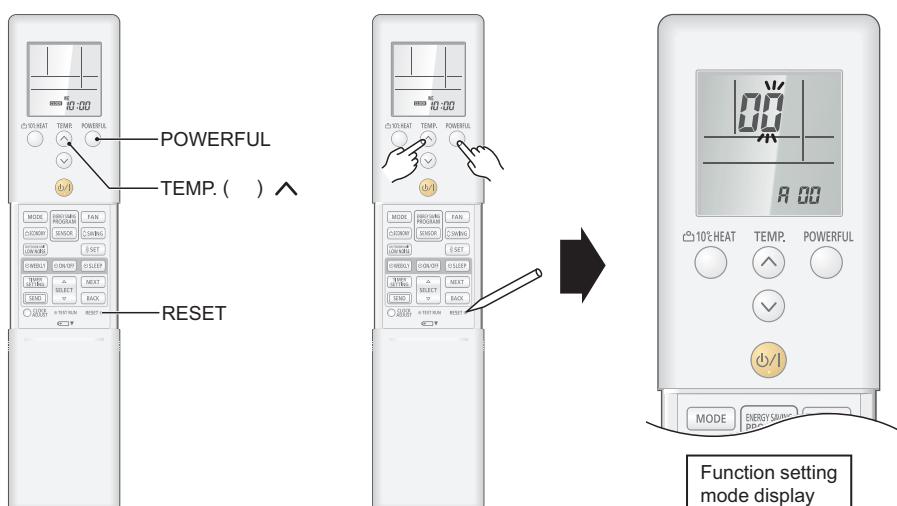


3. Select the function number by pressing the \wedge or the \vee buttons. Each time the 10°C HEAT button is pressed, it switches between the right digit and the left digit.




4. Proceed to the setting number by pressing the POWERFUL button. (To return to the function number selection, press the POWERFUL button again.)




5. Select the function number by pressing the \wedge or the \vee button. Each time the 10°C HEAT button is pressed, it switches between the right digit and the left digit.

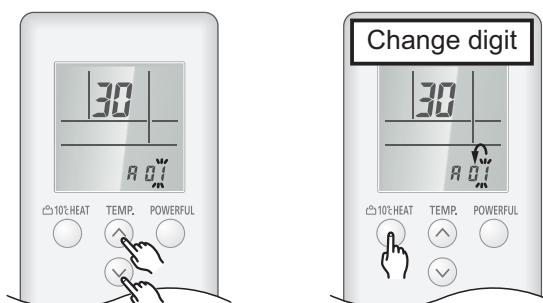

6. Press the MODE button once to transmit the function mode information.

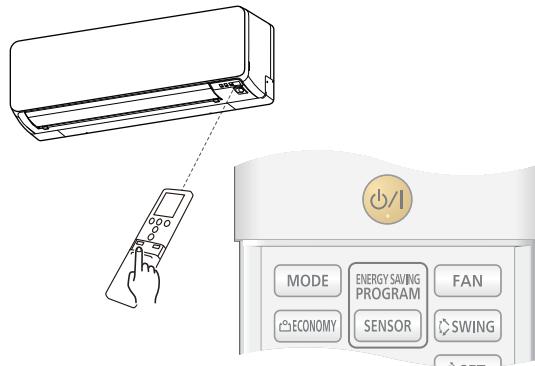


7. Press the \odot/I button once to transmit the function setting information. 2 short beeps will be emitted from the indoor unit when the signal is received correctly. If wrong code is set, no beep sound will be emitted.

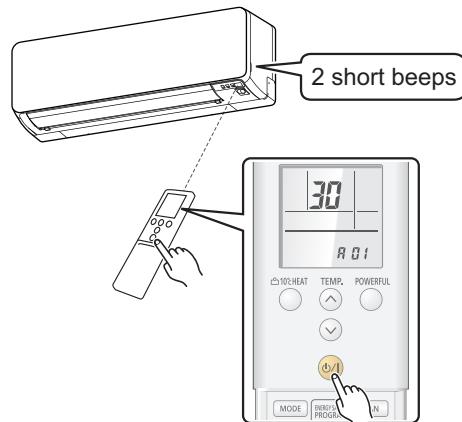


NOTE: Press \odot/I button within 30 seconds after pressing MODE button.

For the function details, refer to Chapter 15-6. "[Function details](#)" on page 319.

8. Exit the function setting mode by pressing the RESET button.

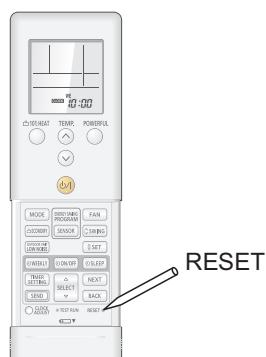

● Setting up each indoor unit

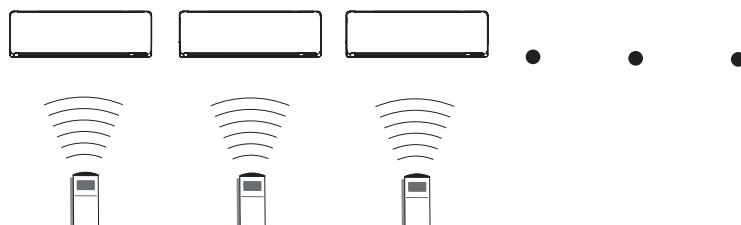

Repeat step from 1. to 8. to set up each indoor unit. If the custom code is other than "R", steps from 1. to 2. and 8. need to be performed.

● Resetting the power after setting up all indoor units

Important:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
 - After the 2 minutes has passed, power can be restored.
 - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

Once the RESET button is pressed on the remote controller, the operation mode will be set to the AUTO MODE.

Adjust the operation mode to either cooling or heating before starting the operation of the air conditioner.

NOTE: If custom code other than "R" is set, the remote control must be set accordingly to the indoor unit setting.

● Remote controller custom code setting

Custom code setting of wireless remote controller needs to be same as the setting of the indoor unit. When you change the custom code setting of the wireless remote controller, do as follows:

1. Press the START/STOP button until only the clock is displayed on the display.




2. Press the MODE button for at least 5 seconds to display the current custom code (initially set to A).



3. Press the TEMP. " ^ " or the " v " button to change the custom code between A → b → c → d.



4. Press the MODE button again to return to the clock display. The custom code will be changed.

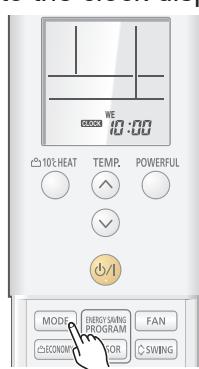


- If no buttons are pressed within 30 seconds after the custom code is displayed, the system returns to the original clock display. In this case, start again from step 1.
- The air conditioner custom code is set to A prior to shipment.
- If you do not know the air conditioner custom code setting, try each of the custom codes (A → b → c → d) until you find the code which operates the air conditioner.

■ AR-REB1E (for Wall mounted type KMCC) and AR-RMB1E(-B) (for Wall mounted type KMCE, KMCF, KMCG, KMCG-B, KMCH, and KMCH-B)


● Button name and function

During address setting mode, indoor unit reject the any operation command from remote controller.

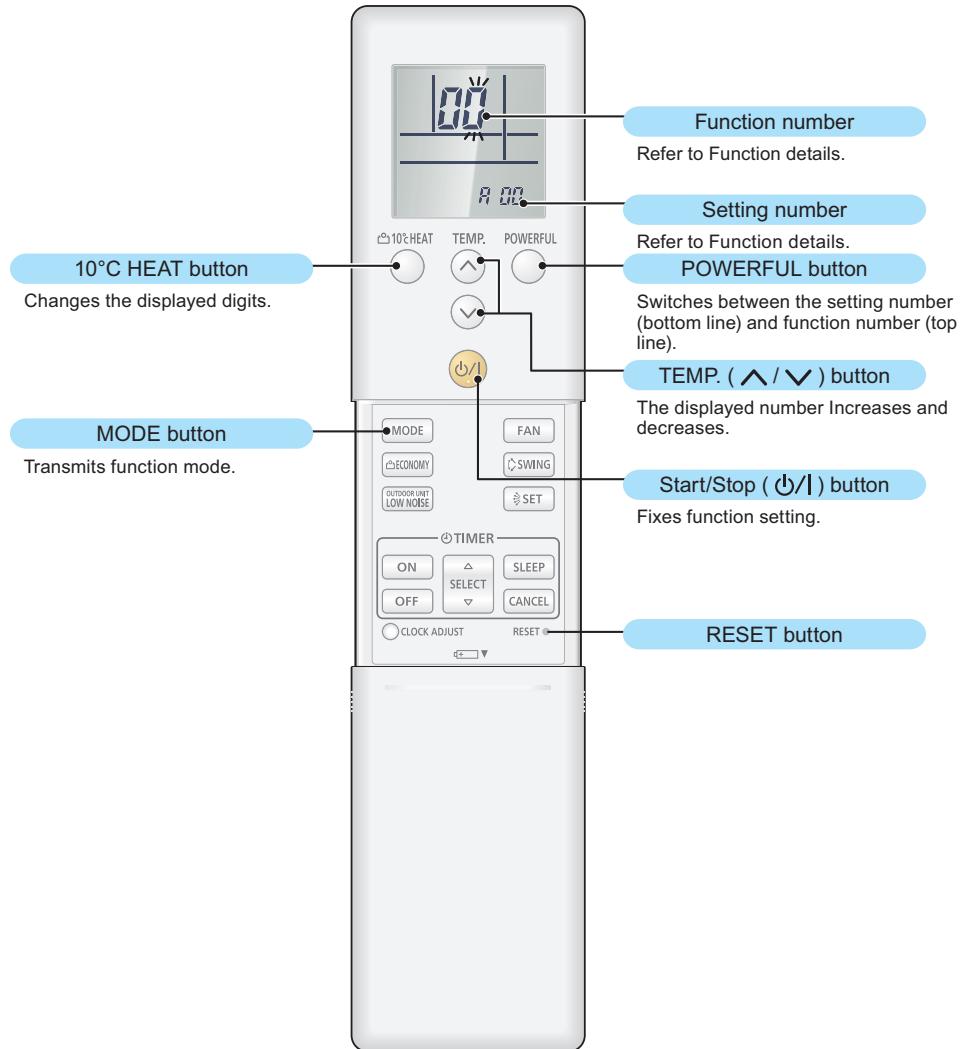

● Function setting procedure

1. Connect the power supply of the outdoor unit.
2. To enter the function setting mode, while holding down the POWERFUL and SET TEMP. \wedge buttons, press the RESET button.

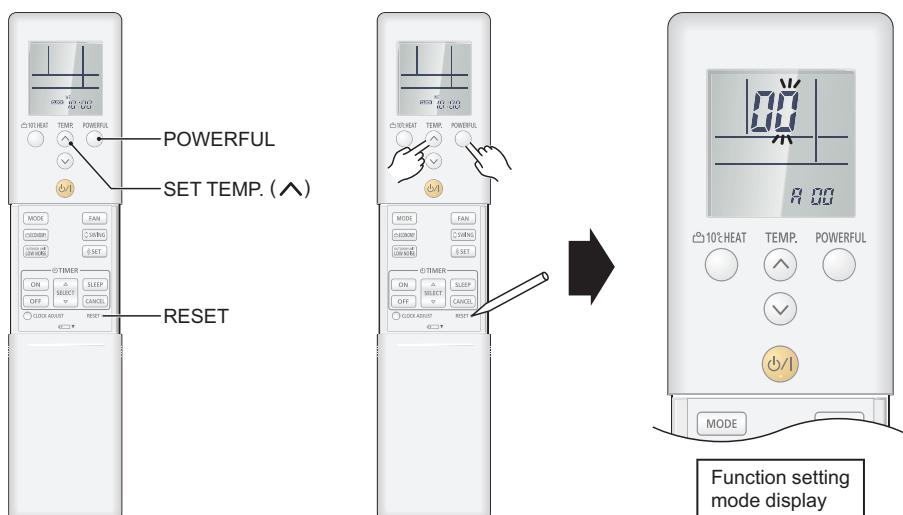


3. Select the function number by pressing the \wedge or the \vee buttons. Each time the 10°C HEAT button is pressed, it switches between the right digit and the left digit.




4. Proceed to the setting number by pressing the POWERFUL button. (To return to the function number selection, press the POWERFUL button again.)




5. Select the function number by pressing the \wedge or the \vee button. Each time the 10°C HEAT button is pressed, it switches between the right digit and the left digit.

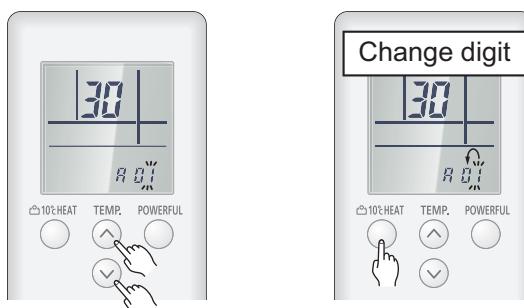

6. Press the MODE button once to transmit the function mode information.

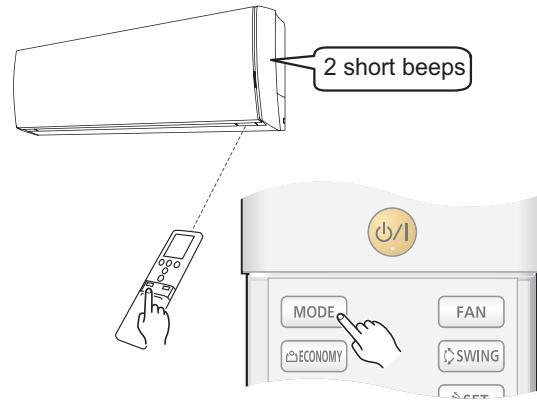


7. Press the D/I button once to transmit the function setting information. 2 short beeps will be emitted from the indoor unit when the signal is received correctly. If wrong code is set, no beep sound will be emitted.

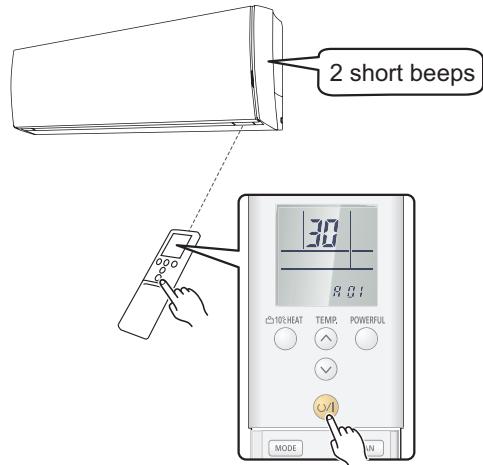


NOTE: Press D/I button within 30 seconds after pressing MODE button.

For the function details, refer to Chapter 15-6. "[Function details](#)" on page 319.

8. Exit the function setting mode by pressing the RESET button.

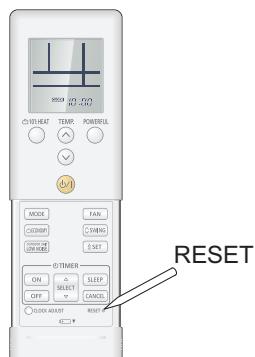

● Setting up each indoor unit

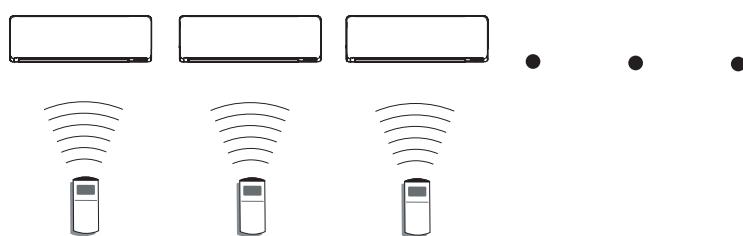

Repeat step from 1. to 8. to set up each indoor unit. If the custom code is other than "A", steps from 1. to 2. and 8. need to be performed.

● Resetting the power after setting up all indoor units

Important:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
 - After the 2 minutes has passed, power can be restored.
 - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

Once the RESET button is pressed on the remote controller, the operation mode will be set to the AUTO MODE.

Adjust the operation mode to either cooling or heating before starting the operation of the air conditioner.

NOTE: If custom code other than "R" is set, the remote control must be set accordingly to the indoor unit setting.

● Remote controller custom code setting

Custom code setting of wireless remote controller needs to be same as the setting of the indoor unit. When you change the custom code setting of the wireless remote controller, do as follows:

1. Press the START/STOP button until only the clock is displayed on the display.



2. Press the MODE button for at least 5 seconds to display the current custom code (initially set to A).



3. Press the SET TEMP. "▲" or the "▼" button to change the custom code between $\text{A} \rightarrow \text{B} \rightarrow \text{C} \rightarrow \text{D}$.



4. Press the MODE button again to return to the clock display. The custom code will be changed.




- If no buttons are pressed within 30 seconds after the custom code is displayed, the system returns to the original clock display. In this case, start again from step 1.
- The air conditioner custom code is set to A prior to shipment.
- If you do not know the air conditioner custom code setting, try each of the custom codes ($\text{A} \rightarrow \text{B} \rightarrow \text{C} \rightarrow \text{D}$) until you find the code which operates the air conditioner.

■ UTY-LNTG (for Compact cassette type) or AR-REJ1E (included in UTY-LBTGM for Duct type)


● Button name and function

During address setting mode, indoor unit reject the any operation command from remote controller.

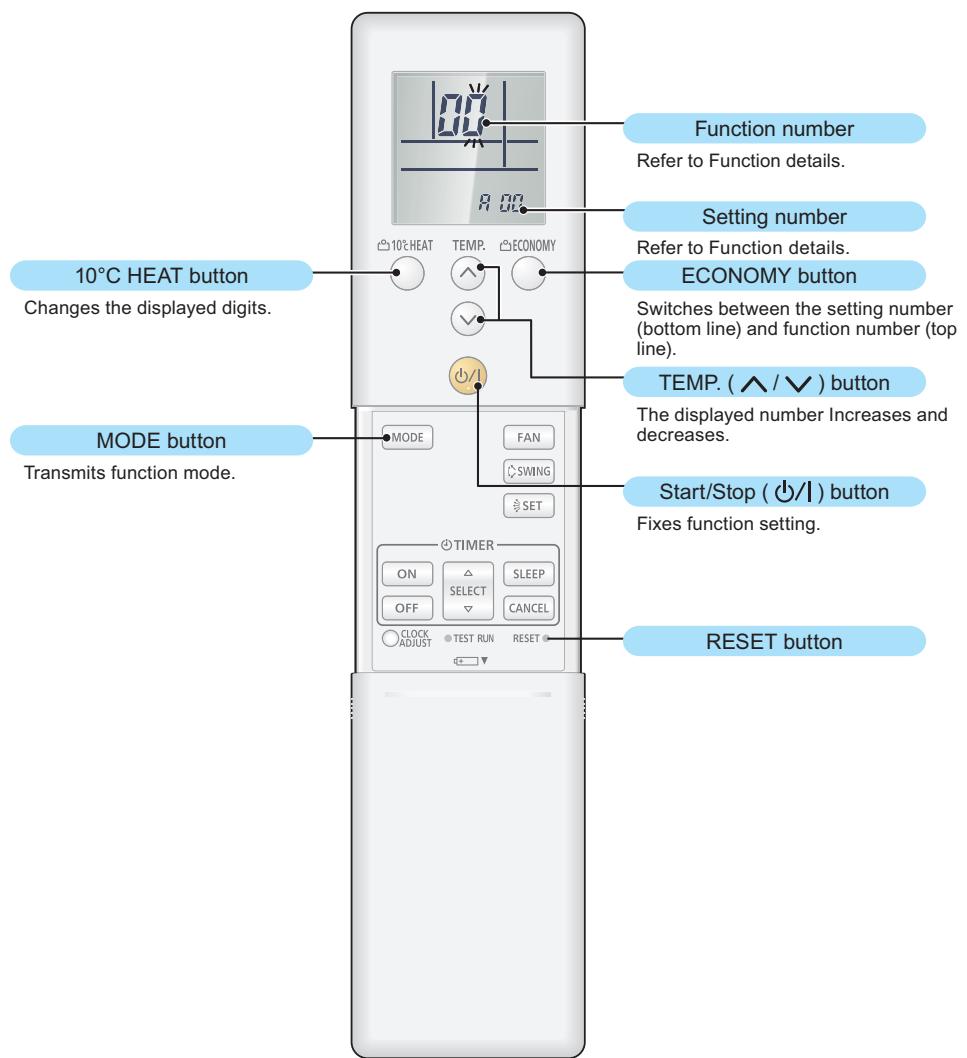

● Function setting procedure

1. Connect the power supply of the outdoor unit.
2. To enter the function setting mode, while holding down the ECONOMY and TEMP. \wedge buttons, press the RESET button.

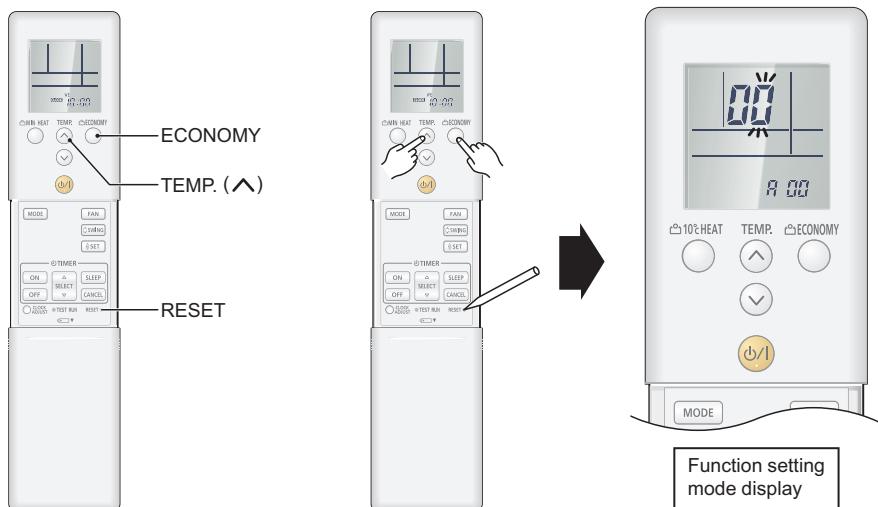


3. Select the function number by pressing the \wedge or the \vee buttons. Each time the 10°C HEAT button is pressed, it switches between the right digit and the left digit.




4. Proceed to the setting number by pressing the ECONOMY button. (To return to the function number selection, press the ECONOMY button again.)




5. Select the function number by pressing the \wedge or the \vee button. Each time the 10°C HEAT button is pressed, it switches between the right digit and the left digit.

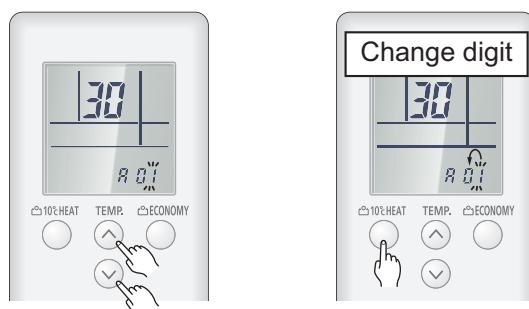

6. Press the MODE button once to transmit the function mode information.

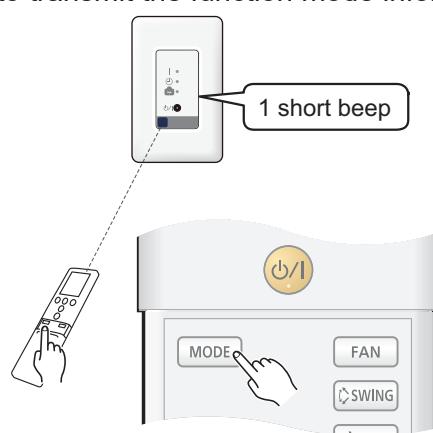


7. Press the \odot/I button once to transmit the function setting information. 1 short beep will be emitted from the indoor unit or the IR receiver when the signal is received correctly. If wrong code is set, no beep sound will be emitted.

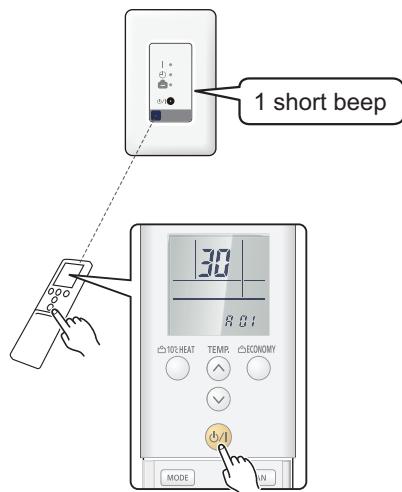


NOTE: Press \odot/I button within 30 seconds after pressing MODE button.

For the function details, refer to Chapter 15-6. "[Function details](#)" on page 319.

8. Exit the function setting mode by pressing the RESET button.

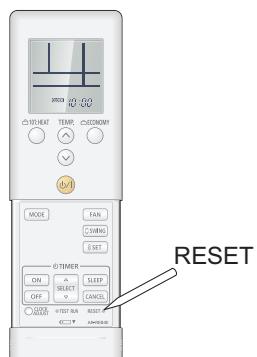

● Setting up each indoor unit

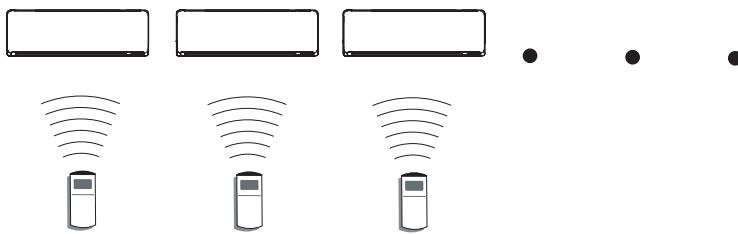

Repeat step from 1. to 8. to set up each indoor unit. If the custom code is other than "H", steps from 1. to 2. and 8. need to be performed.

● Resetting the power after setting up all indoor units

Important:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
 - After the 2 minutes has passed, power can be restored.
 - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

Once the RESET button is pressed on the remote controller, the operation mode will be set to the AUTO MODE.

Adjust the operation mode to either cooling or heating before starting the operation of the air conditioner.

NOTE: If custom code other than "H" is set, the remote control must be set accordingly to the indoor unit setting.


● Remote controller custom code setting

Custom code setting of wireless remote controller needs to be same as the setting of the indoor unit. When you change the custom code setting of the wireless remote controller, do as follows:

1. Press the START/STOP button until only the clock is displayed on the display.




2. Press the MODE button for at least 5 seconds to display the current custom code (initially set to A).

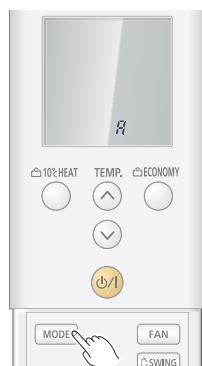

3. Press the TEMP. " ^ " or the " v " button to change the custom code between $\text{A} \rightarrow \text{B} \rightarrow \text{C} \rightarrow \text{D}$.



4. Press the MODE button again to return to the clock display. The custom code will be changed.

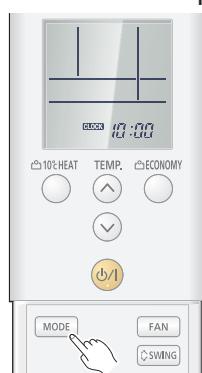

- If no buttons are pressed within 30 seconds after the custom code is displayed, the system returns to the original clock display. In this case, start again from step 1.
- The air conditioner custom code is set to A prior to shipment.
- If you do not know the air conditioner custom code setting, try each of the custom codes ($\text{A} \rightarrow \text{B} \rightarrow \text{C} \rightarrow \text{D}$) until you find the code which operates the air conditioner.


■ AR-RPF4E (for Wall mounted type KNCA and KNCH)

The function number and the associated setting value are displayed on the LCD of the remote controller. Follow the instructions written in the local setup procedure supplied with the remote controller, and select appropriate setting according to the installation environment.

Before connecting the power supply of the indoor unit, reconfirm following items:

- Piping air tight test and vacuuming have been performed firmly.
- There is no wiring mistake.

Then, connect the power supply of the indoor unit.

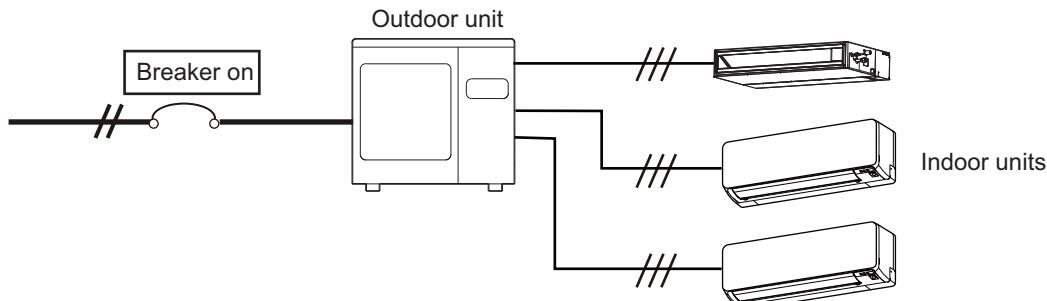

Entering function setting mode:

While pressing the FAN SPEED button and TEMP./SELECT (\wedge) button simultaneously, press the RESET button to enter the function setting mode.

STEP 1: Setting the remote controller custom code

Use the following steps to select the custom code of the remote controller. (Note that the air conditioner cannot receive a custom code if the air conditioner has not been set for the custom code.)

The custom codes that are set through this process are applicable only to the signal in the function setting.

For details on how to set the custom codes through the normal process, refer to "[Custom code setting on AR-RPF4E](#)" on page 298.

1. Press the TEMP./SELECT (\wedge) (\vee) buttons to change the custom code between $\text{A} \rightarrow \text{B} \rightarrow \text{C} \rightarrow \text{D}$. Match the code on the display to the air conditioner custom code. (Initially set to A .) If the custom code does not need to be selected, press the MODE button, and proceed to **STEP 2**.
2. Press the MODE button to accept the custom code, and proceed to **STEP 2**.



NOTES:

- The air conditioner custom code is set to A prior to shipment.
- The remote controller resets to custom code A when the batteries on the remote controller are replaced. If you use a custom code other than code A , reset the custom code after replacing the batteries.
- If you do not know the air conditioner custom code setting, try each of the custom codes ($\text{A} \rightarrow \text{B} \rightarrow \text{C} \rightarrow \text{D}$) until you find the code that operates the air conditioner.

STEP 2: Selecting the function number and setting value

1. Press the TEMP./SELECT (\wedge) (\vee) buttons to select the function number. To switch between the left and right digits, press the MODE button.
2. Press the FAN SPEED button to proceed the setting value. To return the function number selection, press the FAN SPEED button again.
3. Press the TEMP./SELECT (\wedge) (\vee) buttons to select the setting value. To switch between the left and right digits, press the MODE button.
4. Press the TIMER button, and when the indoor unit beeps, press the \odot/I (START/STOP) button to confirm the settings.
5. Press the RESET button to cancel the function setting mode.
6. After completing the function setting, be sure to disconnect the power supply and then reconnect it.



⚠ CAUTION

- After disconnecting the power supply, wait 30 seconds or more before reconnecting it. The function setting will not become active unless the power supply is disconnected and then reconnected.
- When using a custom code other than H , press RESET and then press and hold MODE again for 5 seconds or more to set the custom code.

● Custom code setting on AR-RPF4E

To interconnect the air conditioner and the wireless remote controller, assignment of the custom code for the wireless remote controller is required.

NOTE: Air conditioner cannot receive a signal if the air conditioner has not been set for the custom code.

When 2 or more air conditioners are installed in a room, and the remote controller is operating an air conditioner other than the one you wish to set, change the custom code of the remote controller to operate only the air conditioner you wish to set. (4 selections possible.)

Confirm the setting of the remote controller custom code and the function setting. If these do not match, the remote controller cannot be used to operate for the air conditioner.

1. Press the \odot/I (START/STOP) button until the indicators on the remote controller turn off.
2. Press the MODE button for at least 5 seconds to display the current custom code. (Initially set to A .)
3. Press the TEMP./SELECT (\wedge) (\vee) buttons to change the custom code between $A \rightarrow B \rightarrow C \rightarrow D$. Match the code on the display to the air conditioner custom code. (Initially set to A .)
4. Press the MODE button again to return to the original display. The custom code will be changed.



To set custom code B , C , or D , perform same procedures for each code.

NOTES:

- If no button is pressed within 30 seconds after the custom code is displayed, the system returns to the original display. In this case, start again from step 1.
- The air conditioner custom code is set to A prior to shipment. To change the custom code, contact your retailer.
- If you do not know the assigned code for the air conditioner, try each of the custom code ($A \rightarrow B \rightarrow C \rightarrow D$) until you find the code which operates the air conditioner.

15-4. Indoor unit (setting by wired remote controller)

- The function settings of the control of the indoor unit can be changed by this procedure according to the installation conditions. Incorrect settings can cause the indoor unit malfunction.
- After the power is turned on, perform the “Function setting” according to the installation conditions using the remote controller.
- The settings may be selected between the following two: Function number or Setting number.
- Settings will not be changed if invalid numbers or setting numbers are selected.
- This function cannot be used on the secondary units.

■ Preparation


Before connecting the power supply of the indoor unit, reconfirm following items:

- Piping air tightness test and vacuuming have been performed firmly.
- There is no wiring mistake. Then, connect the power supply of the indoor unit.

■ UTY-RNNGM

● Button name and function

During address setting mode, indoor unit reject the any operation command from remote controller.

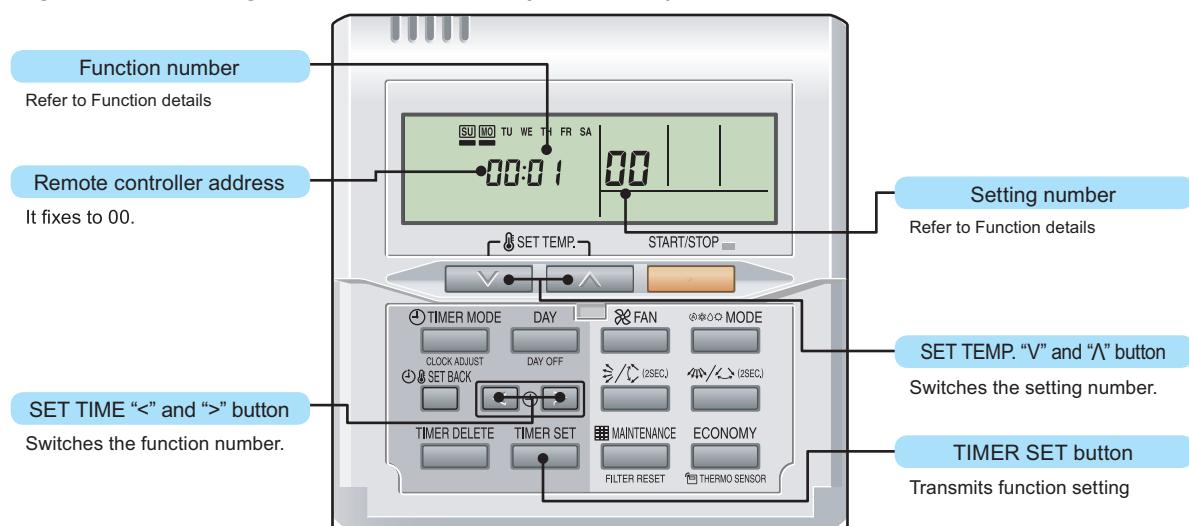


● Function setting procedure


1. Connect the power supply of the outdoor unit.

2. Switch to the function setting mode.


To enter the function setting mode, hold down the 3 buttons of SET TEMP. V, SET TEMP. Λ, and FAN at the same time for 5 seconds or longer.

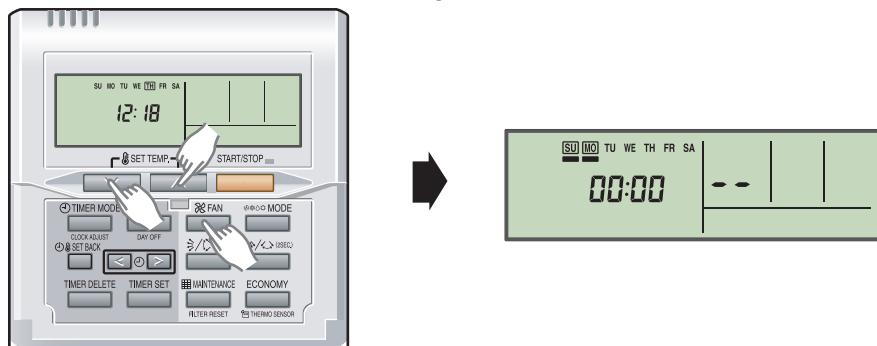

3. Select the function number by pressing the SET TIME < or the SET TIME > button.

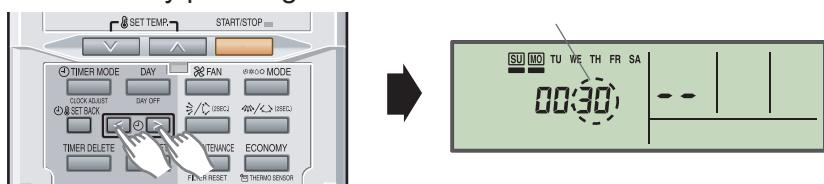


4. Select the setting number by pressing the SET TEMP. Λ or the SET TEMP. V button.
The display flashes during setting number selection.

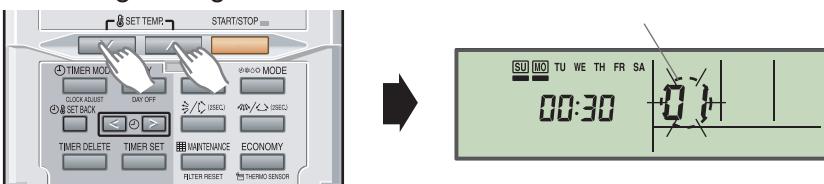


5. Confirm the setting by pressing the TIMER SET button.

The data will be transferred to the indoor unit.

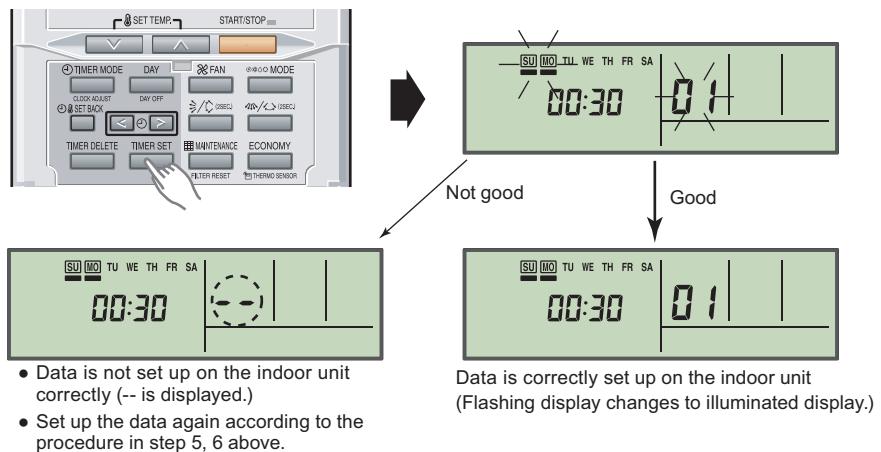

Function details: Refer to Chapter 15-6. "Function details" on page 319.

6. Exit the function setting mode by holding 3 buttons of SET TEMP. ▼, SET TEMP. ▲ and FAN at the same time.

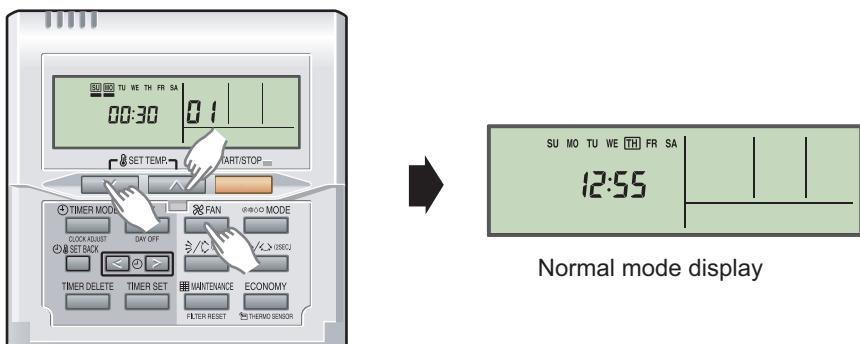

If no button is pressed within 60 seconds after buttons mentioned above are pressed, it will automatically exit the function setting mode.

If you exit the function setting mode unintentionally during setting, enter the mode again according to the procedure in step 2.

● Setting up each indoor unit

Repeat the procedures from step 1 to 6, and set up the indoor units requiring function setting.

● Resetting the power after setting up function of all indoor units

NOTES:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
 - After the 2 minutes has passed, power can be restored.
 - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

■ UTY-RLRG

● Setting procedure by using wired remote controller

The function number and the associated setting value are displayed on the LCD of the remote controller. Follow the instructions written in the local setup procedure supplied with the remote controller, and select appropriate setting according to the installation environment.


Before connecting the power supply of the indoor unit, reconfirm following items:

- Piping air tightness test and vacuuming have been performed firmly.


- There is no wiring mistake.

- Connect the power supply.


- To activate the address setting mode, hold down the three buttons of "MENU", "<", and "ENTER" at the same time for 2 seconds or longer. Menu 2 setting screen is displayed.

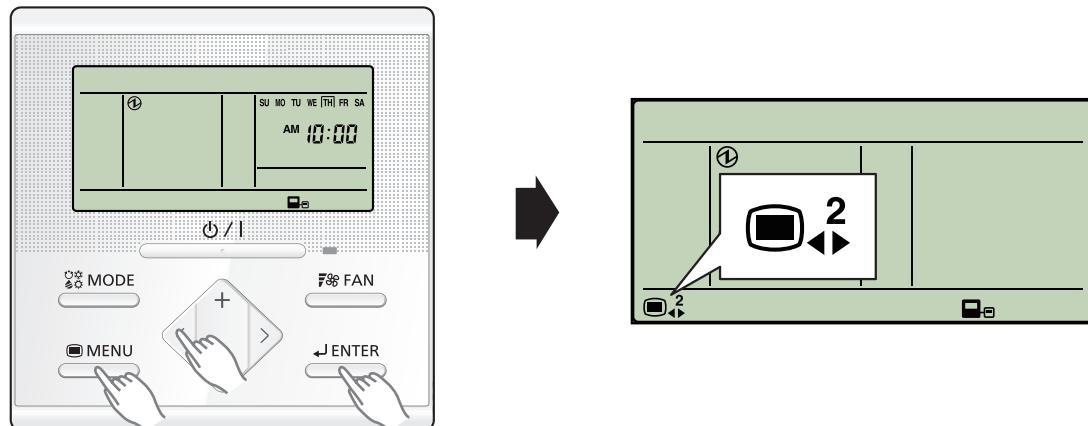

- Select the "13" in Menu 2 settings. Then press the "ENTER" button.

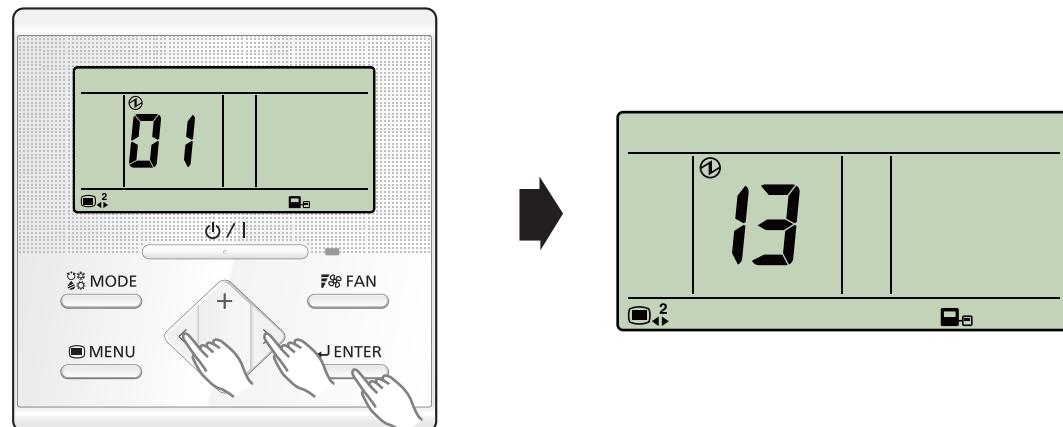


- Pressing the "+" or "-" button, select a remote controller address (select the indoor unit you want to operate). Then press the "ENTER" button.

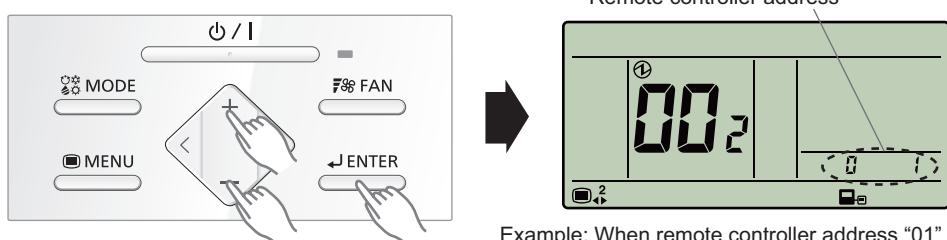


Example: When remote controller address "01" is selected.

5. Pressing the "+" or "-" button, to select the function number. Then press the "ENTER" button.

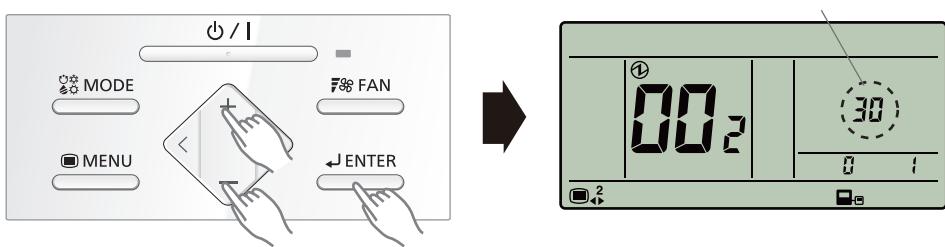

6. Pressing the "+" or "-" button, to select the setting number. Then press the "ENTER" button.

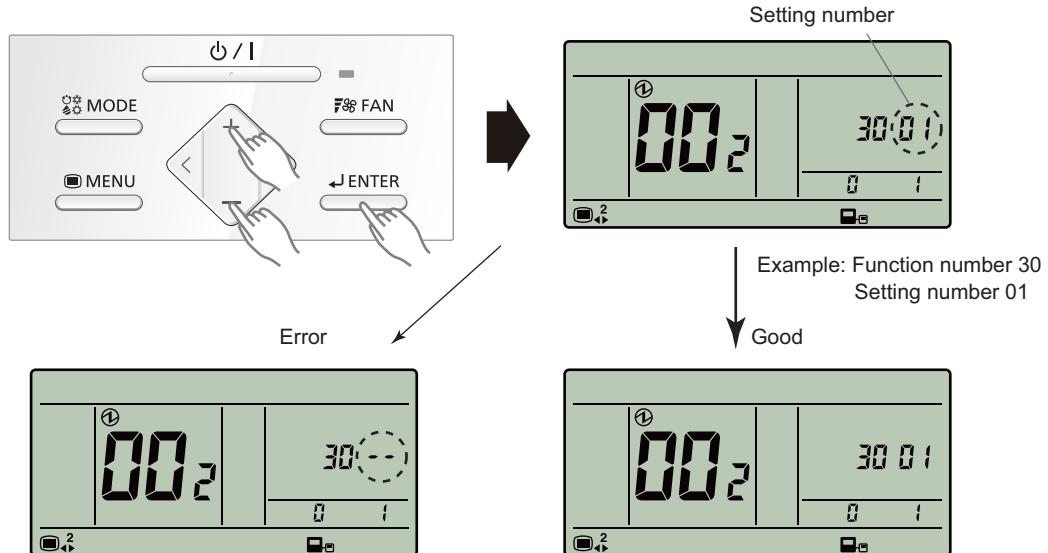

- When the data was not set up on the indoor unit ("--" is displayed.)

- Set up the data again.

- When the data was normally set up on the indoor unit.

Pressing the "ENTER" button to return to the address selection screen.

If setting has been completed, pressing the "MENU" button to return to the Menu 2 item selection screen.

● Setting up each indoor unit

Repeat the procedure from step 1 to 6, and set up the indoor units requiring function setting.

● Resetting the power after setting up function of all indoor units

NOTES:


- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
 - After the 2 minutes has passed, power can be restored.
 - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

■ UTY-RVNGM


● Function setting procedure

1. Connect the power supply of the outdoor unit.
2. Switch to the function setting mode.


When [Menu button] is pressed twice while "Monitor" screen is displayed, it switches to the "Submenu" screen. If [Menu button] is pressed while the "Submenu" screen is displayed, the display returns to the "Monitor" screen.

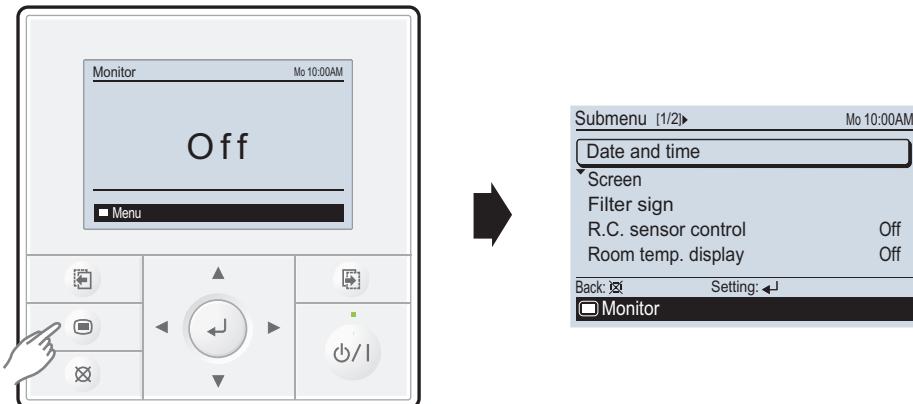


Press the [Screen switch button (Left)] and [Screen switch button (Right)] simultaneously for 5 seconds to switch to "Service" screen.

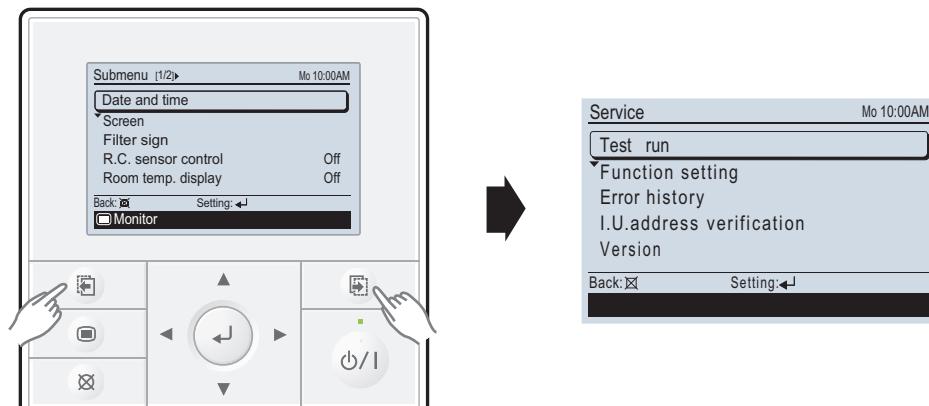


Select [Function setting] with pressing the [Cursor button (Up/Down)], and press the [Enter button].

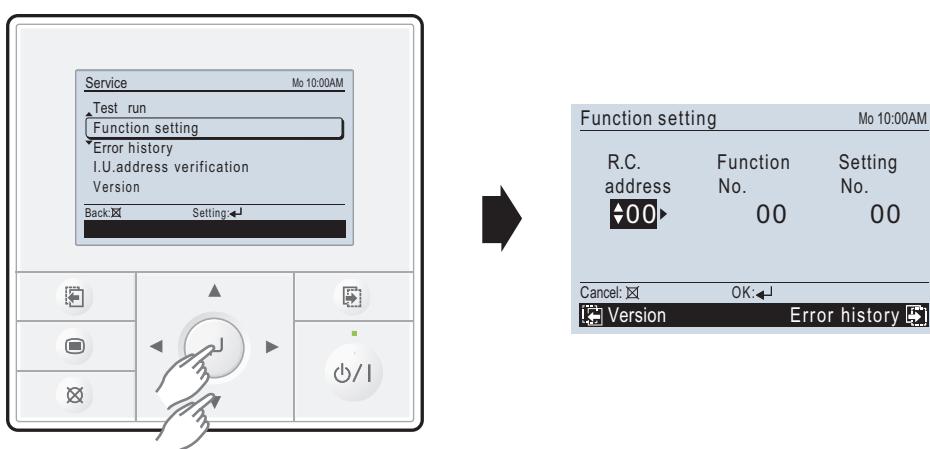


3. Select the [Function No.] with pressing the [Cursor button (Left/Right)], and select the Function No. to be set with pressing the [Cursor button (Up/Down)].

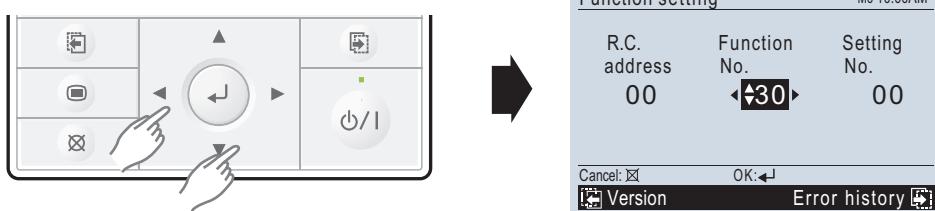

4. Select the [Setting No.] with pressing the [Cursor button (Left/Right)], and select the Setting No. to be set with pressing the [Cursor button (Up/Down)].

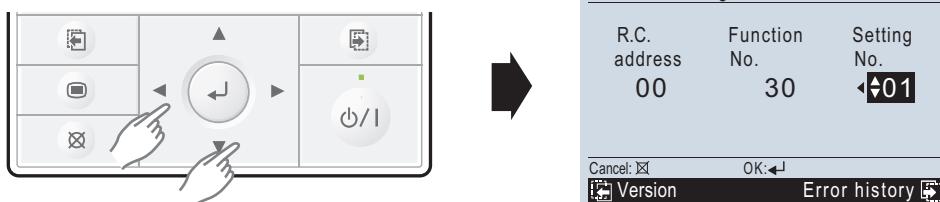


5. Pressing the [Enter button], confirm the setting.
The data will be transferred to the indoor unit.

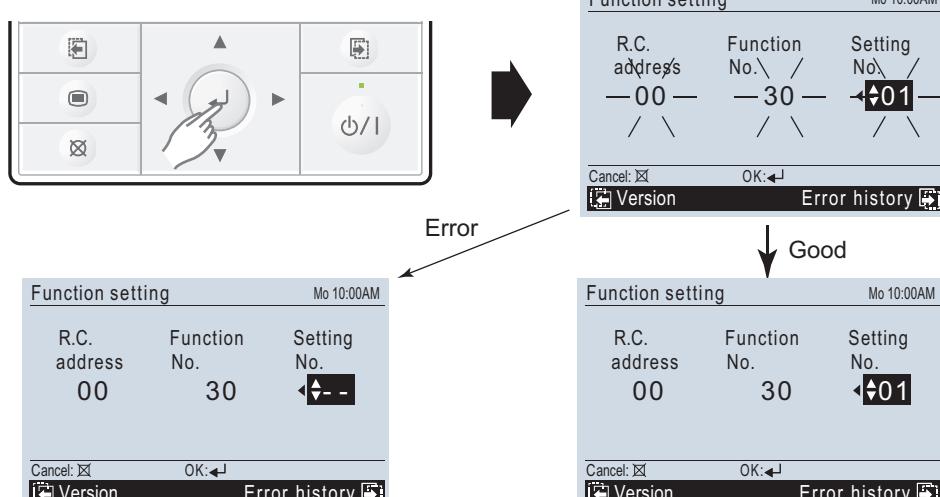

Function details: Refer to Chapter 15-6. "[Function details](#)" on page 319.

6. When [Cancel button] is pressed twice while “Function setting” screen is displayed, it switches to the “Submenu” screen.

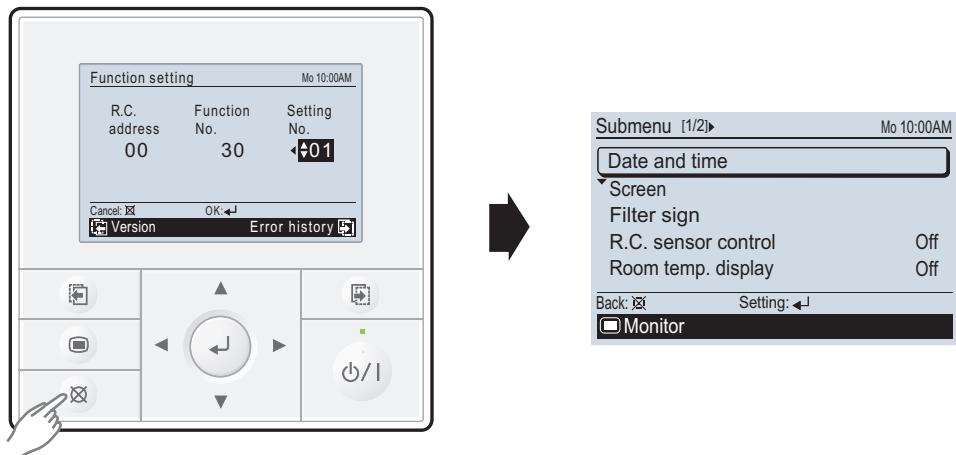

If no button is pressed within 60 seconds after buttons mentioned above are pressed, it will automatically exit the function setting mode.

If you exit the function setting mode unintentionally during setting, enter the mode again according to the procedure in step 2.

● Setting up each indoor unit

Repeat the procedures from step 1 to 6, and set up the indoor units requiring function setting.

● Resetting the power after setting up function of all indoor units

NOTES:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
 - After the 2 minutes has passed, power can be restored.
 - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.


■ UTY-RNRGZ*

● Setting procedure by using wired remote controller

The function number and the associated setting value are displayed on the LCD of the remote controller. Follow the instructions written in the local setup procedure supplied with the remote controller, and select appropriate setting according to the installation environment.


Before connecting the power supply of the indoor unit, reconfirm following items:

- Piping air tightness test and vacuuming have been performed firmly.
 - There is no wiring mistake.
1. Connect the power supply.
 2. When the “Function Setting” on the “Maintenance” screen is touched, the “Installer Password Verification” screen is displayed. After enter the installer password, and touch the “OK”, “Function Setting” screen is displayed.

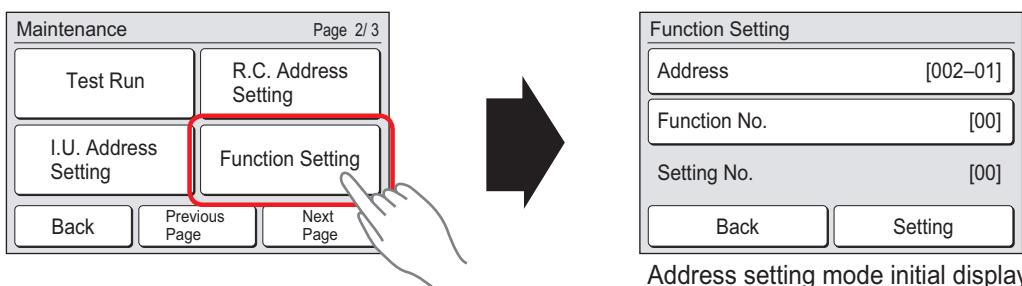


Address setting mode initial display

3. Touch the “Address” on the “Function Setting” screen.

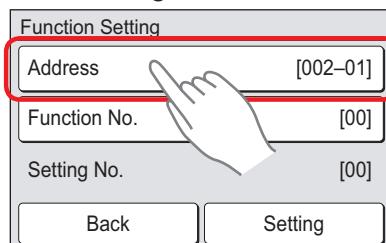


4. “Address” screen is displayed. Select the address of the indoor unit whose function number is to be set by touching ▲ or ▼. When setting at all the indoor units, touch “All”.

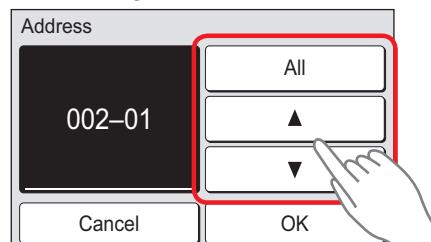


When the “OK” is touched, the display returns to the “Function Setting” screen.

5. Touch the “Function No.” on the “Function Setting” screen.

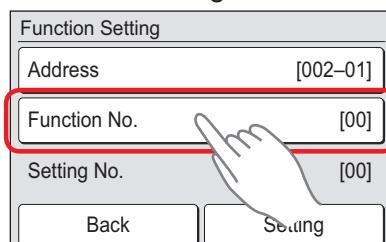


6. “Function No.” screen is displayed. Set the “Function No.” with ▲ or ▼.

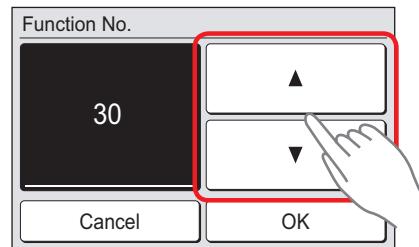


When the “OK” is touched, the display returns to the “Function Setting” screen.

7. Touch the “Function No.” on the “Function Setting” screen.

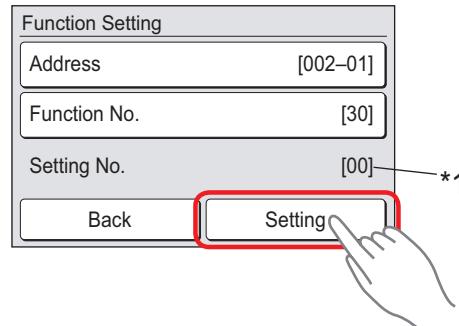

NOTE: *1: When “All” is chosen by “5”, and different set up “Setting No.” from two or more indoor units, “-” is displayed on “Setting No.”.


8. Setting screen of “Setting No.” is displayed. Set the “Function No.” with ▲ or ▼.

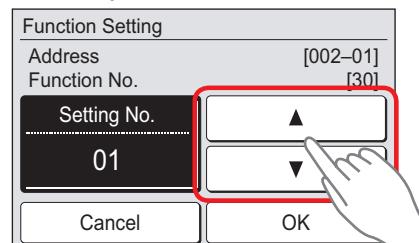


Example: Function number: 30, Setting Number: 01

When the “OK” is touched, the “Function Setting” verification screen is displayed.

9. Touch the “Yes” of the verification screen.

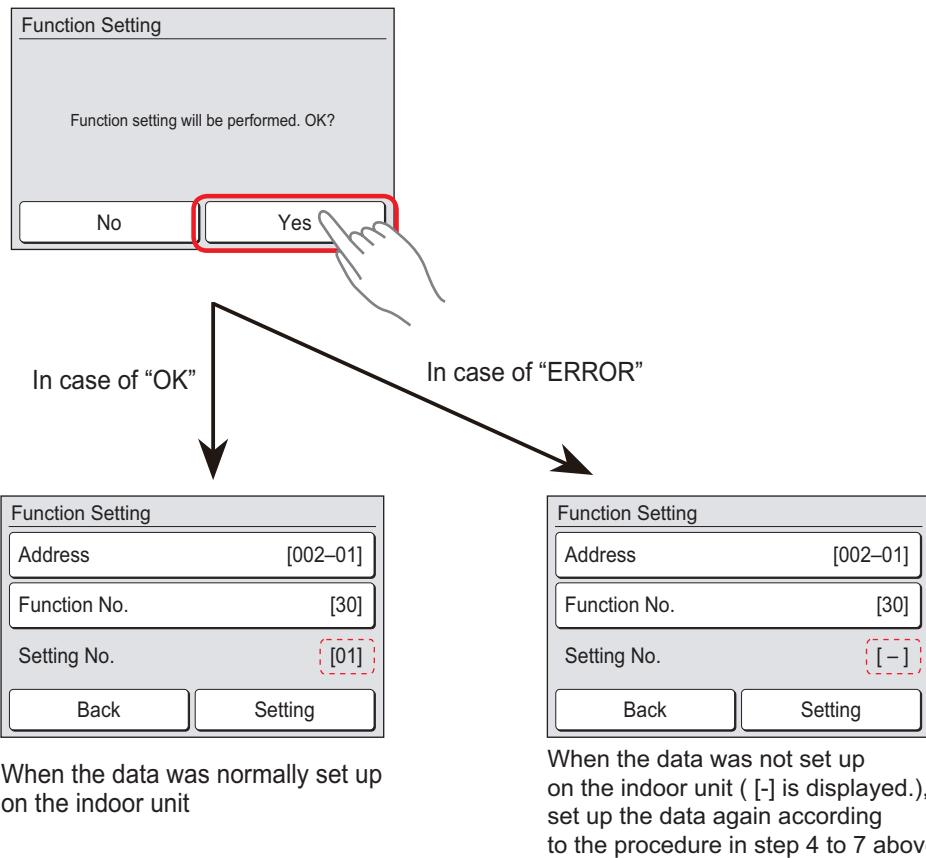

10. When the “Back” on the “Function Setting” screen is touched, the display returns to the “Maintenance” screen.

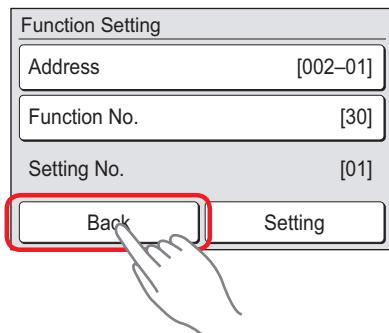

● Setting up each indoor unit

Repeat the procedure from step 1 to 6, and set up the indoor units requiring function setting.

● Resetting the power after setting up function of all indoor units

NOTES:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
 - After the 2 minutes has passed, power can be restored.
 - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

■ UTY-RVRG**● Function setting procedure**


1. Tap the menu as shown below.




Enter the Admin password.

Enter the Installer password.


2. Tap "Address" on the Function Setting screen.

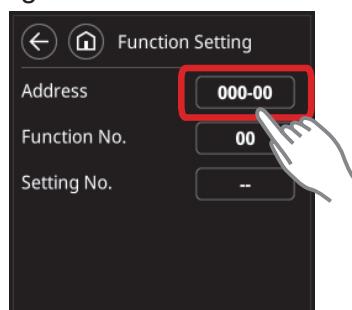


3. Pull-down window of indoor unit address is displayed. Select the address of the indoor unit whose function number is to be set.

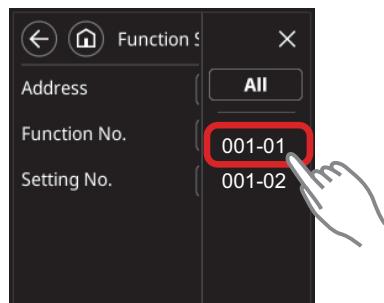


4. Tap "Function No." on the Function Setting screen.

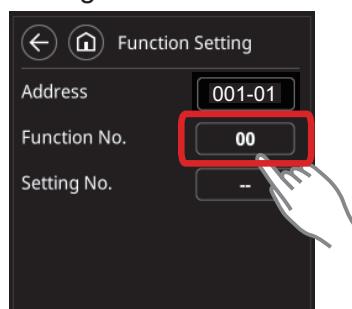


5. Pull-down window of Function No. is displayed. Set the Function No to be set.

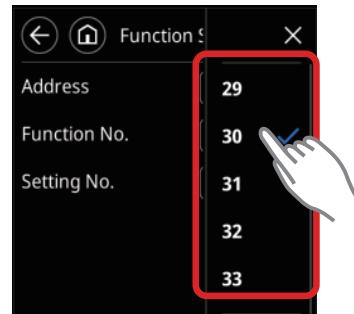


6. Tap "Setting No." on the Function Setting screen.

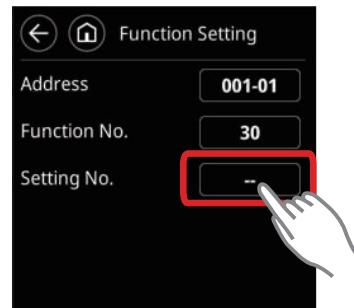

7. Pull-down window of "Setting No." is displayed. Set the Setting No.

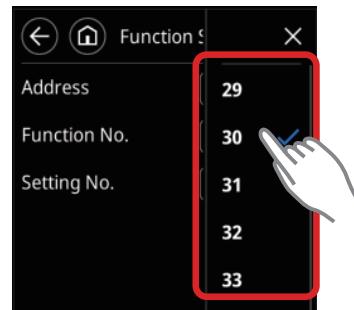

8. Tap "Set" on the verification screen.

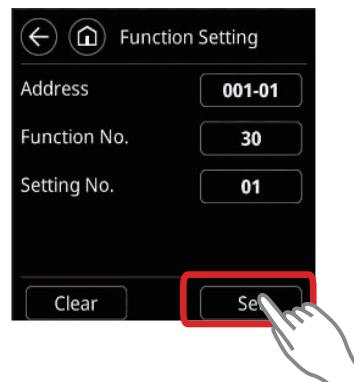

Tap to return to the Initial Setting screen.

15-5. Indoor unit (setting by simple remote controller)

- The function settings of the control of the indoor unit can be changed by this procedure according to the installation conditions. Incorrect settings can cause the indoor unit malfunction.
- After the power is turned on, perform the “Function setting” according to the installation conditions using the remote controller.
- The settings may be selected between the following two: Function number or Setting number.
- Settings will not be changed if invalid numbers or setting numbers are selected.
- This function cannot be used on the secondary units.

■ Preparation


Before connecting the power supply of the indoor unit, reconfirm following items:

- Piping air tightness test and vacuuming have been performed firmly.
- There is no wiring mistake. Then, connect the power supply of the indoor unit.

■ UTY-RSNGM

● Button name and function


During address setting mode, indoor unit reject the any operation command from remote controller.

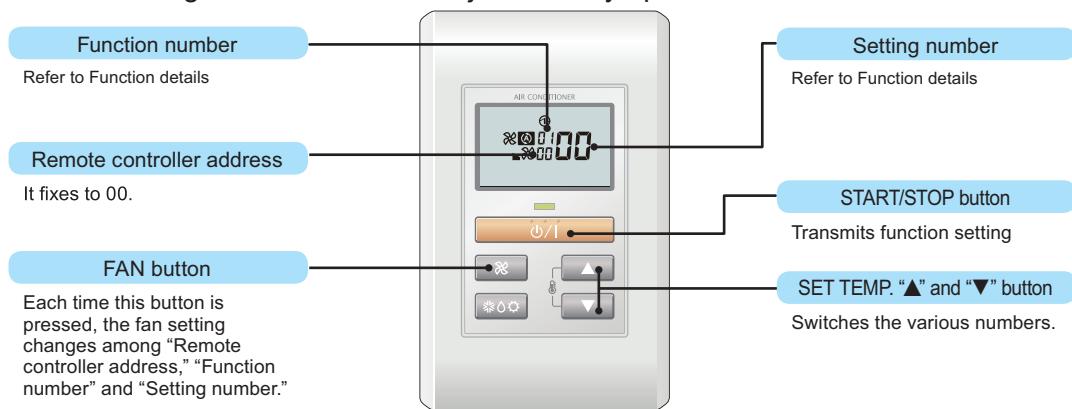

● Function setting procedure


1. Connect the power supply of the outdoor unit.
2. Switch to the function setting mode.

To enter the function setting mode, hold down the 3 buttons of SET TEMP. ▲, SET TEMP. ▼ and FAN at the same time for 5 seconds or longer.


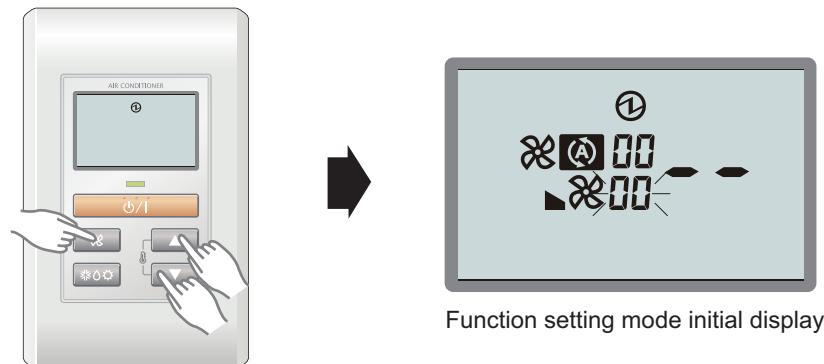


3. Press the FAN button.

The Function number indicator flashes. Then, press either the SET TEMP. ▲ button or the SET TEMP. ▼ button to set up the function number.

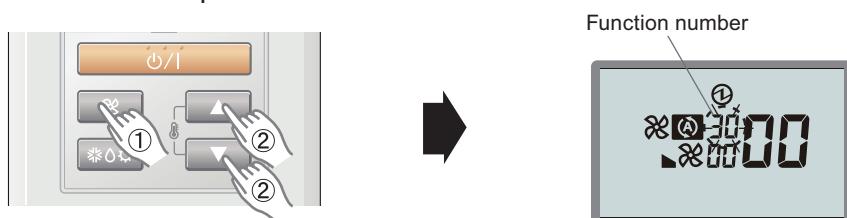


4. Select the setting number by pressing the SET TEMP. ▲ or SET TEMP. ▼ button.
The setting number indicator flashes during setting number selection.

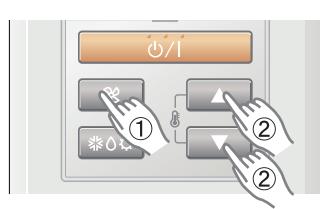


Example) Function number : 30, Setting number : 01

5. Confirm the setting by pressing the TIMER SET button.
The data will be transferred to the indoor unit.



Good




- Data is not set up on the indoor unit correctly (-- is displayed.)
- Set up the data again according to the procedure in step 3, 4 above.



Data is correctly set up on the indoor unit.

Function details: Refer to Chapter 15-6. "Function details" on page 319.

6. Exit the function setting mode by pressing the 3 buttons of SET TEMP. ▲, SET TEMP. ▼, and FAN at the same time for 5 seconds or longer.
After exiting the function setting mode, the display returns to the normal mode.



Normal mode display

If no button is pressed within 60 seconds after buttons mentioned above are pressed, it will automatically exit the function setting mode.

If you exit the function setting mode unintentionally during setting, enter the mode again according to the procedure in step 2.

● Setting up each indoor unit

Repeat the procedures from step 1 to 6, and set up the indoor units requiring function setting.

● Resetting the power after setting up function of all indoor units

NOTES:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
 - After the 2 minutes has passed, power can be restored.
 - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

■ UTY-RSRG/UTY-RHRG

● Setting procedure by using wired remote controller


The function number and the associated setting value are displayed on the LCD of the remote controller. Follow the instructions written in the local setup procedure supplied with the remote controller, and select appropriate setting according to the installation environment.

Before connecting the power supply of the indoor unit, reconfirm following items:


- Piping air tightness test and vacuuming have been performed firmly.
- There is no wiring mistake.

NOTE: Set only one Master remote controller.


1. Connect the power supply.
2. With "Monitor mode" screen displayed, press and hold the SET TEMP. \wedge button and FAN \vee button simultaneously for at least 2 seconds.

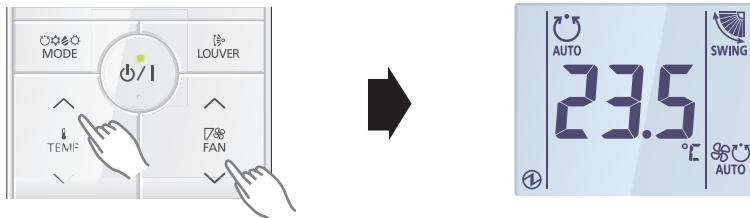

3. The Menu 1 screen is displayed. Press and hold the SET TEMP. \wedge button at least 2 seconds. Setting mode selection screen is displayed.

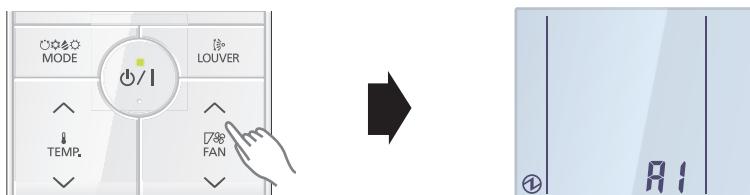


4. Press the SET TEMP. \wedge or SET TEMP. \vee button to select F1 (Menu 2-F1) setting mode or F2 (Menu 2-F2) setting mode.

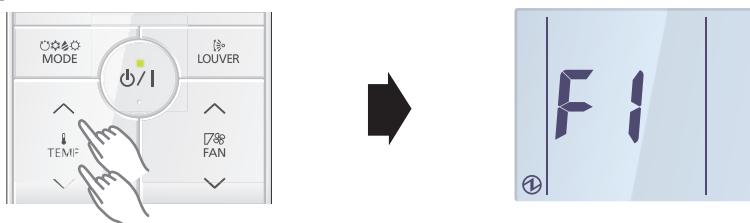


F1: Initial settings mode

F2: Maintenance settings mode


5. Press the \odot/I button. Setting item selection screen is displayed. (Item No. is displayed.)

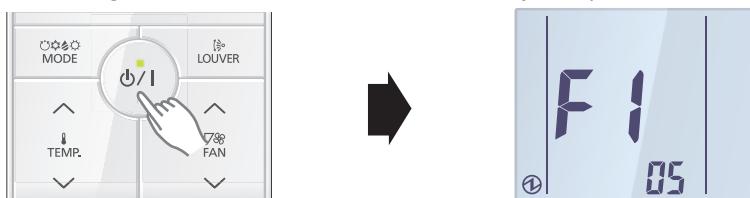


6. Select the item number to be set with the SET TEMP. \wedge or SET TEMP. \vee button, and press the \odot/I button to switch to the setting screen.

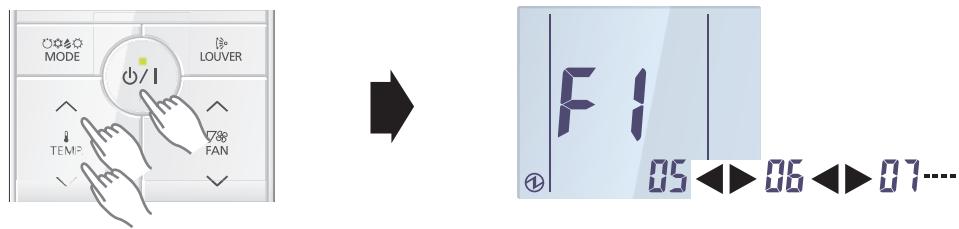


7. Select the "13" in Menu 2-F1 settings. Then, press the \odot/I button.

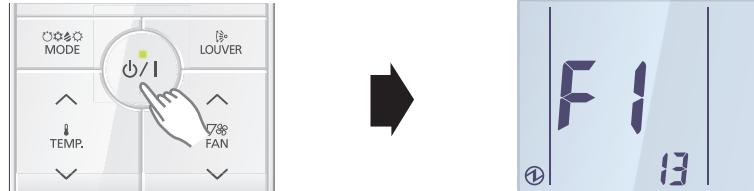


8. Select the 2-wire remote controller address with the SET TEMP. \wedge or SET TEMP. \vee button. Then press the \odot/I button.

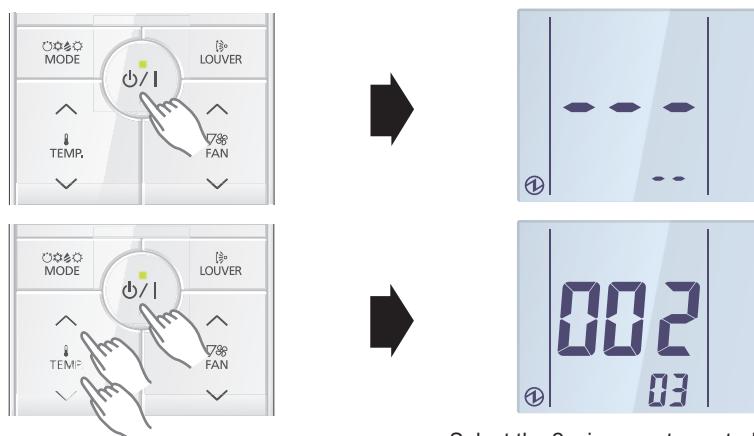


9. Set the function number with the SET TEMP. \wedge or SET TEMP. \vee button. Then press the \odot/I button.

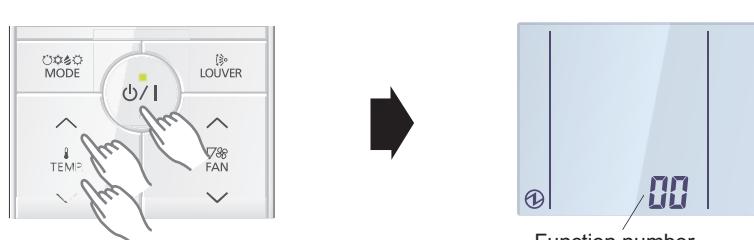


10. Set the setting number with the SET TEMP. \wedge or SET TEMP. \vee button. Then press the \odot/I button.

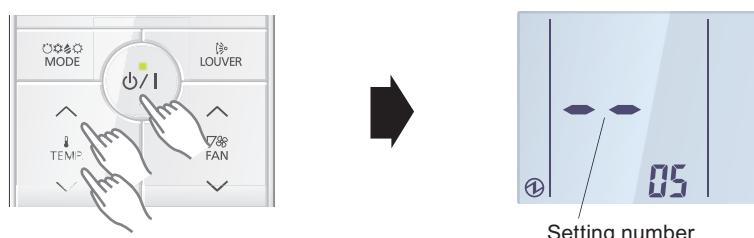

11. Setting results are displayed after data transmission.

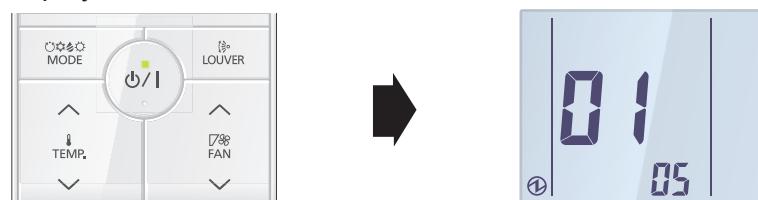

12. Press the \odot/I button to return to the 2-wire remote controller address selection screen of step 9. If setting has been completed, press the FAN \checkmark button to return to the Menu 2-F1 item selection screen.



● Setting up each indoor unit

Repeat the procedure from step 1 to 6, and set up the indoor units requiring function setting.

● Resetting the power after setting up function of all indoor units

NOTES:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
 - After the 2 minutes has passed, power can be restored.
 - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

15-6. Function details

■ Contents of function setting

Each function setting listed in this section is adjustable in accordance with the installation environment.

NOTE: Setting will not be changed if invalid numbers or setting values are selected.

● Function setting list

	Function no.	Functions	Compact cassette	Mini duct	Slim duct	Medium static pressure duct	Floor
1)	00	Remote controller address setting	—	—	—	—	—
2)	11	Filter sign	●	●	●	●	●
3)	20	Ceiling height	●	—	—	—	—
4)	22	Outlet directions	●	—	—	—	—
5)	26	Static pressure	—	●	●	●	—
6)	30/31	Room temperature control for indoor unit sensor	●	●	●	●	●
7)	35/36	Room temperature control for wired remote controller sensor	●	●	●	●	—
8)	40	Auto restart	●	●	●	●	●
9)	42	Room temperature sensor switching	●	●	●	●	●
10)	44	Remote controller custom code	●	●	●	●	●
11)	46	External input control	●	●	●	●	●
12)	48	Room temperature sensor switching (Aux.)	●	●	●	●	—
13)	49	Indoor unit fan control for energy saving for cooling	●	●	●	●	—
14)	60	Switching functions for external output terminal	●	●	●	●	●
15)	68	Auto mode type	—	—	—	●	—
16)	69	Deadband value	—	—	—	●	—

	Function no.	Functions	Wall mounted				
			KMCC	KMCE	KMCF	KMCG (-B)	KMCH (-B)
1)	00	Remote controller address setting	•	—	—	—	—
2)	11	Filter sign	•	•	•	•	•
3)	20	Ceiling height	—	—	—	—	—
4)	22	Outlet directions	—	—	—	—	—
5)	26	Static pressure	—	—	—	—	—
6)	30/31	Room temperature control for indoor unit sensor	•	•	•	•	•
7)	35/36	Room temperature control for wired remote controller sensor	•	•	•	•	•
8)	40	Auto restart	•	•	•	•	•
9)	42	Room temperature sensor switching	•	•	•	•	•
10)	44	Remote controller custom code	•	•	•	•	•
11)	46	External input control	•	•	•	•	•
12)	48	Room temperature sensor switching (Aux.)	•	•	•	•	•
13)	49	Indoor unit fan control for energy saving for cooling	•	•	•	•	•
14)	60	Switching functions for external output terminal	•	•	•	•	•

	Function no.	Functions	Wall mounted				
			KETA (-B)	KETE (-B)	KETF (-B)	KGTB	KGTE
1)	00	Remote controller address setting	•	—	—	•	—
2)	11	Filter sign	•	•	•	•	•
3)	20	Ceiling height	—	—	—	—	—
4)	22	Outlet directions	—	—	—	—	—
5)	26	Static pressure	—	—	—	—	—
6)	30/31	Room temperature control for indoor unit sensor	•	•	•	•	•
7)	35/36	Room temperature control for wired remote controller sensor	•	•	•	•	•
8)	40	Auto restart	•	•	•	•	•
9)	42	Room temperature sensor switching	•	•	•	•	•
10)	44	Remote controller custom code	•	•	•	•	•
11)	46	External input control	•	•	•	•	•
12)	48	Room temperature sensor switching (Aux.)	•	•	•	•	•
13)	49	Indoor unit fan control for energy saving for cooling	•	•	•	•	•
14)	60	Switching functions for external output terminal	—	•	•	•	•

	Function no.	Functions	Wall mounted				
			KGTF	KGTG	KGTH	KNCA	KNCH
1)	00	Remote controller address setting	—	—	—	—	—
2)	11	Filter sign	●	●	●	●	●
3)	20	Ceiling height	—	—	—	—	—
4)	22	Outlet directions	—	—	—	—	—
5)	26	Static pressure	—	—	—	—	—
6)	30/31	Room temperature control for indoor unit sensor	●	●	●	●	●
7)	35/36	Room temperature control for wired remote controller sensor	●	●	●	—	—
8)	40	Auto restart	●	●	●	●	●
9)	42	Room temperature sensor switching	●	●	●	—	—
10)	44	Remote controller custom code	●	●	●	●	●
11)	46	External input control	●	●	●	—	—
12)	48	Room temperature sensor switching (Aux.)	●	●	●	—	—
13)	49	Indoor unit fan control for energy saving for cooling	●	●	●	●	●
14)	60	Switching functions for external output terminal	●	●	●	—	—

1) Remote controller address setting (for Wall-mounted type only)

NOTES:

- Because this setting is normally done automatically when 2-wire-type wired remote controller is installed, setting is unnecessary.
- This setting is configurable only by wireless remote controller, but not configurable by Polar 3-wired remote controller.

Multiple indoor units can be operated by using one wired remote controller.

Set the unit number of each indoor unit.

Function number	Setting value	Setting description	Factory setting
00	00	Unit no. 0	◆
	01	Unit no. 1	
	02	Unit no. 2	
	03	Unit no. 3	
	04	Unit no. 4	
	05	Unit no. 5	
	06	Unit no. 6	
	07	Unit no. 7	
	08	Unit no. 8	
	09	Unit no. 9	
	10	Unit no. 10	
	11	Unit no. 11	
	12	Unit no. 12	
	13	Unit no. 13	
	14	Unit no. 14	
	15	Unit no. 15	

NOTES:

- When connecting Polar 3-wired remote controller, set the remote controller address in the order of 0, 1, 2,, and 15.
- When different type of indoor units (such as wall mounted type and cassette type, cassette type and duct type, or other combinations) are connected using group control system, some functions may no longer be available.

2) Filter sign

Select appropriate intervals for displaying the filter sign on the indoor unit according to the estimated amount of dust in the air of the room.

If the indication is not required, select "No indication" (03).

Function number	Setting value	Setting description	Factory setting
11	00	Standard	
	01	Long interval	
	02	Short interval	
	03	No indication	◆

Setting description	Compact cassette	Medium static pressure duct	Mini duct	Slim duct	Wall mounted
Standard	2,500 hours		400 hours		
Long interval	4,400 hours		1,000 hours		
Short interval	1,250 hours		200 hours		

3) Ceiling height (for Compact cassette type only)

Select the appropriate ceiling height according to the place of installation.

Function number	Setting value	Setting description	Factory setting
20	00	Standard	◆
	01	High ceiling	

For the specific height for each setting value, refer to "Installation space" in Chapter 4. "[Dimensions](#)" on page 29.

NOTE: The ceiling height values are for the 4-way outlet. Do not change this setting in the 3-way outlet mode.

7,000 or 9,000 Btu/h models cannot be installed in high ceilings. Do not change this setting.

4) Outlet directions (for Compact cassette type only)

Select the appropriate number of outlet directions according to the installation conditions.

Function number	Setting value	Setting description	Factory setting
22	00	4-way	◆
	01	3-way	

5) Static pressure (for Mini duct type, Slim duct type, and Medium static pressure duct type)

Select the appropriate static pressure according to the installation conditions.

For mini duct type:

Function number	Setting value	Setting description	Factory setting
26	00	0 Pa	
	01	10 Pa	
	02	20 Pa	
	03	30 Pa	
	04	40 Pa	
	05	50 Pa	
	31	Standard (10 Pa: 07; 09; 12 models, 15 Pa: 14 models)	♦

NOTES:

- Range of static pressure is different by model. 07, 09, 12 models are 0 to 30 Pa. 14 model are 0 to 50 Pa.
- Setting number in 07, 09, 12 models is “04 to 30”: Operation is same as that “03”.
- Setting number in 14 model is “06 to 30”: Operation is same as that “05”.
- Setting number value cannot be set to 32 or more.

For slim duct type:

Function number	Setting value	Setting description	Factory setting
26	00	0 Pa	
	01	10 Pa	
	02	20 Pa	
	03	30 Pa	
	04	40 Pa	
	05	50 Pa	
	06	60 Pa	
	07	70 Pa	
	08	80 Pa	
	09	90 Pa	
	31	Standard (25 Pa)	♦

For medium static pressure duct type:

Function number	Setting value	Setting description	Factory setting
26	03	30 Pa	
	04	40 Pa	
	05	50 Pa	
	06	60 Pa	
	07	70 Pa	
	08	80 Pa	
	09	90 Pa	
	10	100 Pa	
	11	110 Pa	
	12	120 Pa	
	13	130 Pa	
	14	140 Pa	
	15	150 Pa	
	31	Standard (40 Pa)	♦
	32	Automatic airflow adjustment	

NOTE: If the static pressure is set above maximum range, the setting is same as the maximum.

For example, The setting “160 Pa” (16) to “300 Pa” (30) is same as “150 Pa” (15).

6) Room temperature control for indoor unit sensor

NOTE: If the remote sensor unit option is selected, perform this setting.

Depending on the installed environment, correction of the room temperature sensor may be required. Select the appropriate control setting according to the installed environment.

The temperature of the room temperature sensor is corrected as follows:

$$\text{Corrected temp.} = \text{Temp. of the room temp. sensor} - \text{Correction temp. value}$$

Example of correction:

When the temperature of the room temp. sensor is 26°C and the setting value is "03" (-1.0°C), corrected temp. will be 27°C (26°C - [-1.0°C]).

The temperature correction values show the difference from the Standard setting "00" (manufacturer's recommended value).

Function number	Setting value	Setting description	Factory setting
30 (For cooling)	31 (For heating)	00	Standard setting
		01	No correction 0.0°C
		02	-0.5°C
		03	-1.0°C
		04	-1.5°C
		05	-2.0°C
		06	-2.5°C
		07	-3.0°C
		08	-3.5°C
		09	-4.0°C
		10	+0.5°C
		11	+1.0°C
		12	+1.5°C
		13	+2.0°C
		14	+2.5°C
		15	+3.0°C
		16	+3.5°C
		17	+4.0°C

More cooling
Less heating

Less cooling
More heating

7) Room temperature control for wired remote controller sensor (for other than Floor type and KN models in Wall-mounted type)

Depending on the installed environment, correction of the wire remote temperature sensor may be required. Select the appropriate control setting according to the installed environment.

To change this setting, set Function 42 to Both "01".

Ensure that the Thermo Sensor icon is displayed on the remote controller screen.

Function number		Setting value	Setting description	Factory setting
35 (For cooling)	36 (For heating)	00	Standard setting	◆
		01	No correction 0.0°C	
		02	-0.5°C	More cooling Less heating
		03	-1.0°C	
		04	-1.5°C	
		05	-2.0°C	
		06	-2.5°C	
		07	-3.0°C	
		08	-3.5°C	
		09	-4.0°C	
		10	+0.5°C	Less cooling More heating
		11	+1.0°C	
		12	+1.5°C	
		13	+2.0°C	
		14	+2.5°C	
		15	+3.0°C	
		16	+3.5°C	
		17	+4.0°C	

8) Auto restart

Enables or disables automatic restart after a power interruption.

Function number	Setting value	Setting description	Factory setting
40	00	Enable	◆
	01	Disable	

NOTE: Auto restart is an emergency function such as for power outage etc. Do not attempt to use this function in normal operation. Be sure to operate the unit by remote controller or external device.

9) Room temperature sensor switching (for other than KN models in Wall-mounted type)

When using the wired remote controller temperature sensor, change the setting to "Both" (01).

Function number	Setting value	Setting description	Factory setting
42	00	Indoor unit	◆
	01	Both	

00: Sensor on the indoor unit is active.

01: Sensors on both indoor unit and wired remote controller are active.

NOTES:

- Remote controller sensor must be turned on by using the remote controller.
- When using the remote sensor unit, set to "00" or set to "01" and then select "indoor unit sensor" from wired remote controller.

10) Remote controller custom code

(Only for wireless remote controller)

The indoor unit custom code can be changed. Select the appropriate custom code.

Function number	Setting value	Setting description	Factory setting
44	00	A	◆
	01	B	
	02	C	
	03	D	

11) External input control

“Operation/Stop” mode or “Forced stop” mode can be selected.

Function number	Setting value	Setting description	Factory setting
46	00	Operation/Stop mode 1 (Remote controller enabled)	◆
	01	(Setting prohibited)	
	02	Forced stop mode	
	03	Operation/Stop mode 2 (Remote controller disabled)	

NOTE: If this function is necessary, the rotary switch on the External input and output PCB should be set to 1.

12) Room temperature sensor switching (Aux.) (for other than Floor type and KN models in Wall-mounted type)

To use the temperature sensor on the wired remote controller only, change the setting to “Wired remote controller” (01).

This function will only work if the function setting 42 is set at “Both” (01).

When the setting value is set to “Both” (00), more suitable control of the room temperature is possible by setting function setting 30 and 31 too.

Function number	Setting value	Setting description	Factory setting
48	00	Both	◆
	01	Wired remote controller	

13) Indoor unit fan control for energy saving for cooling (for other than Floor type)

Enables or disables the power-saving function by controlling the indoor unit fan rotation when the outdoor unit is stopped during cooling operation.

Function number	Setting value	Setting description	Factory setting
49	00	Disable	
	01	Enable	
	02	Remote controller	◆

00: When the outdoor unit is stopped, the indoor unit fan operates continuously following the setting on the remote controller.

01: When the outdoor unit is stopped, the indoor unit fan operates intermittently at a very low speed.

02: Enable or disable this function by remote controller setting.

NOTE: Set to “00” or “01” when connecting a remote controller that cannot set the Fan control for energy saving function or connecting a network converter. To confirm if the remote controller has this setting, refer to the operating manual of each remote controller.

14) Switching functions for external output terminal (For other than 18-24KMTB, KETA[-B], and KN models in Wall-mounted type)

Functions of the external output terminal can be switched. For details, refer to "External input and output".

Function number	Setting value	Setting description	Factory setting
60	00	Operation status	◆
	01—08	(Setting prohibited)	
	09	Error status	
	10	Indoor unit fan operation status	
	11	(Setting prohibited)	

15) Auto mode type (for Medium static pressure duct type)

Switches the setting method of the auto mode between single or dual (cooling and heating.)

Set the primary indoor unit using a wired remote controller for heat pump systems.

Function number	Setting value	Setting description	Factory setting
68	00	Single setpoint auto mode	◆
	01	Dual setpoint auto mode	

NOTE: The auto mode type setting is available only if a compatible operating device is connected.

16) Deadband value (for Medium static pressure duct type)

Sets the minimum temperature of the deadband in the dual setpoint auto mode (the setting value 01 of the function setting number 68: Auto mode type.)

Function number	Setting value	Setting description	Factory setting
69	00	0°C	◆
	01	0.5°C	
	02	1.0°C	
	03	1.5°C	
	04	2.0°C	
	05	2.5°C	
	06	3.0°C	
	07	3.5°C	
	08	4.0°C	
	09	4.5°C	


NOTE: The deadband setting is available only if a compatible operating device is connected.

15-7. Wired remote controller (UTY-RNNGM)

DIP switch 1	SW1	Prohibited
	SW2	Dual remote controller setting
	SW3	Prohibited
	SW4	°F/°C switch
	SW5	Prohibited
	SW6	Memory backup setting

* Do not use DIP switch 2.

■ Switch location

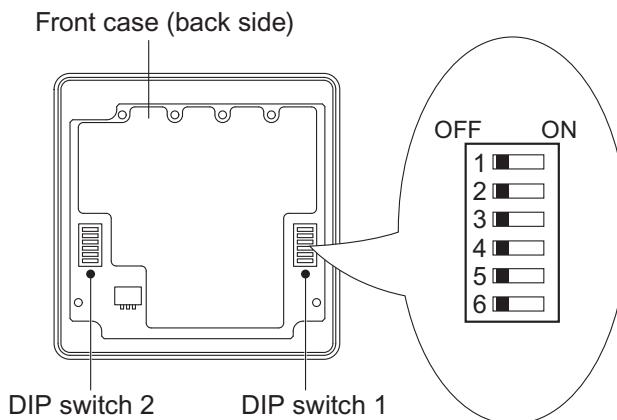


■ DIP switch 1 setting

● SW2: Dual remote controller setting

Set the remote controller SW2 according to the following table.

Number of remote controller	Primary unit	Secondary unit	Factory setting
	SW2	SW2	
1 (Normal)	OFF	—	♦
2 (Dual)	OFF	ON	

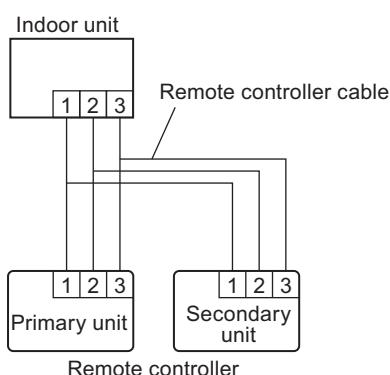

● SW4: Switching temperature unit °F / °C

Displayed temperature unit can be switched between Fahrenheit (°F) and Celsius (°C).

SW4	Fahrenheit (°F) / Celsius (°C)	Factory setting
OFF	°C	♦
ON	°F	

● SW6: Memory backup setting

Set to “ON” to use batteries for the memory backup.


When batteries are not used, all of settings stored in memory will be deleted if there is a power failure.

SW6	Memory backup	Factory setting
OFF	Disable	♦
ON	Enable	

15-8. Wired remote controller (UTY-RVNGM)

DIP switch 1	SW1	Memory backup setting
	SW2	Dual remote controller setting

■ Switch location

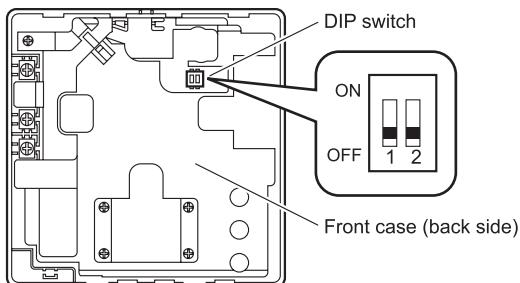

■ DIP switch setting

● SW1: Memory backup setting

Set to "ON" to use batteries for the memory backup.


When batteries are not used, all of settings stored in memory will be deleted if there is a power failure.

SW1	Memory backup	Factory setting
OFF	Disable	◆
ON	Enable	

● SW2: Dual remote controller setting

Set the remote controller SW2 according to the following table.


Number of remote controller	Primary unit	Secondary unit	Factory setting
	SW2	SW2	
1 (Normal)	OFF	—	◆
2 (Dual)	OFF	ON	

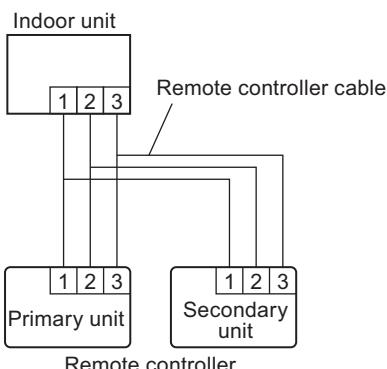

15-9. Wired remote controller (UTY-RLRG)

DIP switch	Memory backup setting
------------	-----------------------

■ Switch location

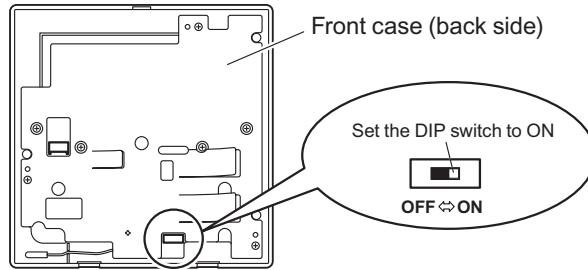

■ Dip switch setting

● SW1: Memory backup setting

Set to "ON" to use batteries for the memory backup.


When batteries are not used, all of settings stored in memory will be deleted if there is a power failure.

SW1	Memory backup	Factory setting
OFF	Disable	♦
ON	Enable	

15-10. Wired remote controller (UTY-RNRGZ*)

DIP switch	Memory backup setting
------------	-----------------------

■ Switch location

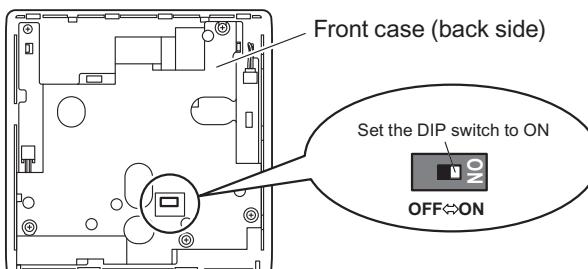

■ Dip switch setting

● SW1: Memory backup setting

Set to "ON" to use batteries for the memory backup.


When batteries are not used, all of settings stored in memory will be deleted if there is a power failure.

SW1	Memory backup	Factory setting
OFF	Disable	♦
ON	Enable	

15-11. Simple remote controller (UTY-RSNGM)

DIP switch	SW1	Prohibited
	SW2	Dual remote controller setting
	SW3	°F/°C switch
	SW4	Prohibited
	SW5	Prohibited
	SW6	Prohibited

■ Switch location

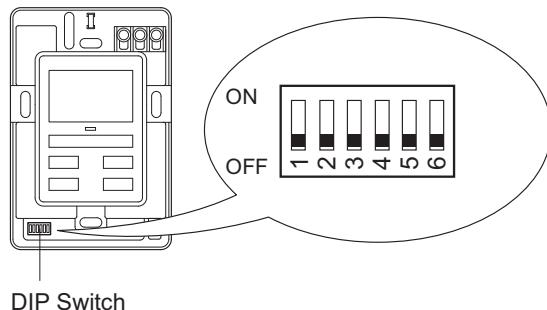


■ DIP switch setting

● SW2: Dual remote controller setting

Set the remote controller SW2 according to the following table.

Number of remote controller	Primary unit	Secondary unit	Factory setting
	SW2	SW2	
1 (Normal)	OFF	—	◆
2 (Dual)	OFF	ON	

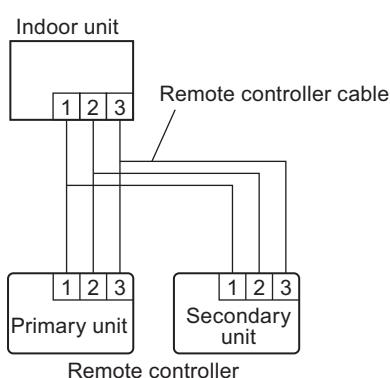

● SW3: Switching temperature unit °F / °C

Displayed temperature unit can be switched between Fahrenheit (°F) and Celsius (°C).

SW3	Fahrenheit (°F) / Celsius (°C)	Factory setting
OFF	°C	◆
ON	°F	

16. Accessories

16-1. Compact cassette type

■ Models: AUXG07-14KVLA

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Drain hose insulation		1
Operation manual (CD-ROM)		1	Hose band		1
Installation manual		1	Coupler heat insulation (large)		1
Template (Carton top)		1	Coupler heat insulation (small)		1
M10 nut A (with flange)		4	Cable tie		2
M10 nut B (with spring lock washer)		4	Wire crammer		1
Drain hose		1			





16-2. Mini duct type

■ Models: ARXG07-14KSLAP

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Drain hose		1
Operation manual (CD-ROM)		1	Hose band		1
Installation manual		1	Drain hose insulation B		1
Installation template (Carton top)		1	Washer		8
Cable tie (large)		4	Coupler heat insulation (large)		1
Cable tie (medium)		3	Coupler heat insulation (small)		1
Filter (small)		2	Insulation (For electrical wiring)		2






16-3. Slim duct type

■ Models: ARXG07-14KLLAP

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Filter (small)		2
Operation manual (CD-ROM)		1	Drain hose		1
Installation manual		1	Hose band		1
Installation template		1	Drain hose insulation B		1
Washer		8	Insulation (for electrical wiring)		2
Cable tie (large)		4	Coupler heat insulation (large)		1
Cable tie (medium)		3	Coupler heat insulation (small)		1

16-4. Medium static pressure duct type

■ Models: ARXH12-14KMTAP

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Cable tie (large)		4
Operation manual (CD-ROM)		1	Cable tie (medium)		1
Installation manual		1	Cable tie (small)		1
Washer		8	Drain hose insulation		1
Coupler heat insulation (large)		1	Drain hose		1
Coupler heat insulation (small)		1	Hose band		1

16-5. Wall mounted type

■ Models: ASHG07-14KMCE and ASHG07-14KMCF

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Cloth tape		1
Operation manual (CD-ROM)		1	Self-tapping screw (large)		5
Installation manual		1	Self-tapping screw (small)		2
Remote controller		1	Wall hook bracket		1
Battery		2	Filter holder		2
Remote controller holder		1	Air cleaning filters		1

■ Models: ASHH07-14KMCG, ASHH07-14KMCG-B, and ASHH07-14KGTG

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Cloth tape		1
Installation manual		1	Self-tapping screw (large)		5
Remote controller		1	Self-tapping screw (small)		2
Battery		2	Wall hook bracket		1
Remote controller holder		1	Filter holder		2
Installation spacer		1	Air cleaning filters		1
Operation manual (CD-ROM)		1			

■ Models:ASHH07-14KMCH, ASHH07-14KMCH-B, and ASHH07-14KGTH

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Cloth tape		1
Installation manual		1	Self-tapping screw (large)		5
Remote controller		1	Self-tapping screw (small)		2
Battery		2	Wall hook bracket		1
Remote controller holder		1	Filter holder		2
Installation spacer		1	Air cleaning filters		1

■ Models: ASHG07-14KETA, ASHG07-14KETA-B, ASHG07-14KETE, ASHG07-14KETE-B, ASHG07-14KETF, and ASHG07-14KETF-B

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Cloth tape		1
Operation manual (CD-ROM)		1	Self-tapping screw (large)		5
Installation manual		1	Self-tapping screw (small)		2
Remote controller		1	Wall hook bracket		1
Battery		2	Filter holder		2
Remote controller holder		1	Air cleaning filters		1
Template (for pipe cover cutting)		1			

■ Models: ASHG07-14KGTB, ASHG07-14KMTB, and ASHG07-14KMCC

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Cloth tape		1
Operation manual (CD-ROM)		1	Self-tapping screw (large)		5
Installation manual		1	Self-tapping screw (small)		2
Remote controller		1	Wall hook bracket		1
Battery		2	Filter holder		2
Remote controller holder		1	Air cleaning filters		1

■ Models: ASHG07-14KGTE and ASHG07-14KGTF

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Cloth tape		1
Operation manual (CD-ROM)		1	Self-tapping screw (large)		5
Installation manual		1	Self-tapping screw (small)		2
Remote controller		1	Wall hook bracket		1
Battery		2	Filter holder		2
Remote controller holder		1	Air cleaning filters		1

■ Models: ASHH05-12KNCA





Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Self-tapping screw (Large)		5
Installation manual		1	Self-tapping screw (Small)		2
Remote controller		1	Wall hook bracket		1
Battery		2	Remote controller holder		1
Installation spacer		1	Cloth tape		1
Operation manual (CD-ROM)		1			

■ Models: ASHH05-12KNCH

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Self-tapping screw (Large)		5
Installation manual		1	Self-tapping screw (Small)		2
Remote controller		1	Wall hook bracket		1
Battery		2	Remote controller holder		1
Installation spacer		1	Cloth tape		1

16-6. Floor type

■ Models: AGHG09–14KVCA

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Operation manual (CD-ROM)		1
Installation manual		1	Cloth tape		1
Wall hook bracket		1	Self-tapping screws (large)		9
Remote controller		1	Self-tapping screws (small)		2
Battery		2	Air cleaning filters		1
Remote controller holder		1			

17. Optional parts

17-1. Controllers

■ Lineup

Indoor unit type	Type			
	Wireless Remote Controller			
	AR-REM4E	AR-REM7E	AR-REB1E	AR-REW3E
Compact cassette	—	—	—	—
Mini duct	—	—	—	—
Slim duct	—	—	—	—
Medium static pressure duct	—	—	—	—
Floor	—	●	—	—
Wall mounted	KMCC	—	—	●
	KMCE	—	—	—
	KMCF	—	—	—
	KMCG(-B)	—	—	—
	KMCH(-B)	—	—	—
	KETA(-B)	—	—	—
	KETE(-B)	—	—	—
	KETF(-B)	—	—	—
	KGTB	●	—	—
	KGTE	—	—	●
	KGTF	—	—	●
	KGTG	—	—	●
	KGTH	—	—	●
	KNCA	—	—	—
	KNCH	—	—	—
	KMTB	—	—	●

Indoor unit type		Type			
		Wireless Remote Controller			
		AR-REW4E	AR-RMB1E(-B)	AR-RPF4E	UTY-LNTG
Compact cassette	—	—	—	—	○
Mini duct	—	—	—	—	—
Slim duct	—	—	—	—	—
Medium static pressure duct	—	—	—	—	—
Floor	—	—	—	—	—
Wall mounted	KMCC	—	—	—	—
	KMCE	—	●	—	—
	KMCF	—	●	—	—
	KMCG(-B)	—	●	—	—
	KMCH(-B)	—	●	—	—
	KETA(-B)	●	—	—	—
	KETE(-B)	●	—	—	—
	KETF(-B)	●	—	—	—
	KGTB	—	—	—	—
	KGTE	—	—	—	—
	KGTF	—	—	—	—
	KGTG	—	—	—	—
	KGTH	—	—	—	—
	KNCA	—	—	●	—
	KNCH	—	—	●	—
	KMTB	—	—	—	—

Indoor unit type		Type			
		Wired Remote Controller			
		UTY-RNNGM	UTY-RVNGM	UTY-RVRG	UTY-RLRG
Compact cassette	○	○	○	○	○
Mini duct	○	○	○	○	○
Slim duct	○	○	○	○	○
Medium static pressure duct	—	—	○	○	○
Floor	—	—	○*3	○*3	○*3
Wall mounted	KMCC	○*1	○*1	○*1	—
	KMCE	—	—	○*2	○*2
	KMCF	—	—	○*2	○*2
	KMCG(-B)	—	—	○*2	○*2
	KMCH(-B)	—	—	○*2	○*2
	KETA(-B)	—	—	○*2	○*2
	KETE(-B)	—	—	○*2	○*2
	KETF(-B)	—	—	○*2	○*2
	KGTB	—	—	○*2	○*2
	KGTE	—	—	○*2	○*2
	KGTF	—	—	○*2	○*2
	KGTG	—	—	○*2	○*2
	KGTH	—	—	○*2	○*2
	KNCA	—	—	—	—
	KNCH	—	—	—	—
	KMTB	○*1	○*1	○*1	—




Indoor unit type	Type		
	Wired Remote Controller		IR Receiver Kit with Wireless Remote Controller
	UTY-RNRGZ*	UTY-RCRGZ1	UTY-LBTGM
Compact cassette	○	○	—
Mini duct	○	○	○
Slim duct	○	○	○
Medium static pressure duct	○	○	○
Floor	○*2	○*2	—
Wall mounted	KMCC	○*2	○*2
	KMCE	○*2	○*2
	KMCF	○*2	○*2
	KMCG(-B)	○*2	○*2
	KMCH(-B)	○*2	○*2
	KETA(-B)	○*2	○*2
	KETE(-B)	○*2	○*2
	KETF(-B)	○*2	○*2
	KGTB	○	○
	KGTE	○*2	○*2
	KGTF	○*2	○*2
	KGTG	○*2	○*2
	KGTH	○*2	○*2
	KNCA	—	—
	KNCH	—	—
	KMTB	—	—

Indoor unit type	Type		
	Simple Remote Controller		
	UTY-RSNGM	UTY-RSRG	UTY-RHRG
Compact cassette	○	○	○
Mini duct	○	○	○
Slim duct	○	○	○
Medium static pressure duct	—	○	○
Floor	—	○*3	○*3
Wall mounted	KMCC	○*1	—
	KMCE	—	○*2
	KMCF	—	○*2
	KMCG(-B)	—	○*2
	KMCH(-B)	—	○*2
	KETA(-B)	—	○*2
	KETE(-B)	—	○*2
	KETF(-B)	—	○*2
	KGTB	—	○*2
	KGTE	—	○*2
	KGTF	—	○*2
	KGTG	—	○*2
	KGTH	—	○*2
	KNCA	—	—
	KNCH	—	—
	KMTB	○*1	—

●: Accessory, ○: Optional, —: Not applicable

- *1: Optional Communication Kit (UTY-TWBXF2) is necessary for the installation.
- *2: Optional Communication Kit (UTY-TWRXZ2) is necessary for the installation.
- *3: Optional Communication Kit (UTY-TWRXZ3) is necessary for the installation.

■ Parts

Exterior	Part name	Model name	Summary
	Wired Remote Controller (Touch Panel)	UTY-RVRG	Remote controller that provides the functions you need in a sleek design that uniquely transforms itself to blend with any interior. Wire type: Non-polar 2-wire
	Wired Remote Controller (Touch Panel)	UTY-RNRGZ*	Easy finger touch operation with LCD panel. Backlit LCD enables easy operation in a dark room. Wire type: Non-polar 2-wire
	Wired Remote Controller	UTY-RLRG	High visibility and easy operation. Room temperature can be accurately controlled using the thermo sensor. Wire type: Non-polar 2-wire
	Compact Wired Remote Controller	UTY-RCRGZ1	Compact body and easy operation. Room temperature can be accurately controlled using the thermo sensor. Wire type: Non-polar 2-wire
	Wired Remote Controller	UTY-RVNGM	Large and full-dot liquid crystal screen, wide and large keys easy to press, user-intuitive arrow key. Wire type: Polar 3-wire
	Wired Remote Controller	UTY-RNNGM	Room temperature can be controlled by detecting the temperature accurately with thermo sensor. Wire type: Polar 3-wire
	Simple Remote Controller	UTY-RSRG	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting, and operation mode. Wire type: Non-polar 2-wire

Exterior	Part name	Model name	Summary
	Simple Remote Controller	UTY-RHRG	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, and temperature setting. Wire type: Non-polar 2-wire
	Simple Remote Controller	UTY-RSNGM	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting, and operation mode. Wire type: Polar 3-wire
	IR Receiver Kit with Wireless Remote Controller	UTY-LBTGM	Unit control is performed by Wireless Remote Controller
	Wireless Remote Controller	UTY-LNTG	Unit control is performed by Wireless Remote Controller.

NOTES:


- Available functions may differ by the remote controller. For details, refer to the operation manual.
- When using the group controlling system of the Wired Remote Controller, using WLAN Adapter is prohibited.

17-2. Cassette grille

■ Lineup

Indoor unit type	Model
Compact cassette	UTG-UFGF-W

■ Part

Exterior	Part name	Model name	Summary
	Cassette Grille	UTG-UFGF-W	This cassette grille can be installed appropriately on the grid type ceiling common in the office.

17-3. Others

■ Lineup

Indoor unit type	Type			
	Air Outlet Shutter Plate	Insulation Kit for High Humidity	Fresh Air Intake Kit	Half Concealed Kit
	UTR-YDZB	UTZ-KXGC	UTZ-VXAA	UTR-STA
Compact cassette	○	○	○	—
Mini duct	—	—	—	—
Slim duct	—	—	—	—
Medium static pressure duct	—	—	—	—
Floor	—	—	—	○
Wall mounted	KMCC	—	—	—
	KMCE	—	—	—
	KMCF	—	—	—
	KMCG(-B)	—	—	—
	KMCH(-B)	—	—	—
	KETA(-B)	—	—	—
	KETE(-B)	—	—	—
	KETF(-B)	—	—	—
	KGTB	—	—	—
	KGTE	—	—	—
	KGTF	—	—	—
	KGTG	—	—	—
	KGTH	—	—	—
	KNCA	—	—	—
	KNCH	—	—	—
	KMTB	—	—	—

Indoor unit type	Type			
	Auto Louver Grille Kit	Remote Sensor Unit		External Switch Controller
	UTD-GXTA-W	UTY-XSZX	UTY-XSZXZ*	UTY-TERX
Compact cassette	—	—	—	○
Mini duct	○	○	○	○
Slim duct	○	○	○	○
Medium static pressure duct	—	○	○	○
Floor	—	—	—	○*3
Wall mounted	KMCC	—	—	○*1
	KMCE	—	—	○*2
	KMCF	—	—	○*2
	KMCG(-B)	—	—	○*2
	KMCH(-B)	—	—	○*2
	KETA(-B)	—	—	○*2
	KETE(-B)	—	—	○*2
	KETF(-B)	—	—	○*2
	KGTB	—	—	○*2
	KGTE	—	—	○*2
	KGTF	—	—	○*2
	KGTG	—	—	○*2
	KGTH	—	—	○*2
	KNCA	—	—	—
	KNCH	—	—	—
	KMTB	—	—	○*1

Indoor unit type	Type				
	External Connect Kit			External Input and Output PCB	
	UTY-XWZX	UTY-XWZXZ5	UTY-XWZXZG	UTY-XCSXZ2	UTY-XCSX
Compact cassette	—	—	○	—	○
Mini duct	—	—	○	—	—
Slim duct	—	—	○	—	—
Medium static pressure duct	—	—	○	—	○
Floor	—	○	—	—	—
Wall mounted	KMCC	—	○	—	—
	KMCE	○	○	—	○
	KMCF	○	○	—	○
	KMCG(-B)	○	○	—	○
	KMCH(-B)	○	○	—	○
	KETA(-B)	—	○	—	○
	KETE(-B)	○	○	—	○
	KETF(-B)	○	○	—	○
	KGTB	○	—	—	○
	KGTE	○	○	—	○
	KGTF	○	○	—	○
	KGTG	○	○	—	○
	KGTH	○	○	—	○
	KNCA	—	—	—	—
	KNCH	—	—	—	—
	KMTB	—	○	—	—

Indoor unit type	Type			
	KNX Convertor	Network Converter		Modbus Converter
	UTY-VKSX	UTY-VTGX	UTY-VTGXV	UTY-VMSX
Compact cassette	○	○	○	○
Mini duct	○	○	○	○
Slim duct	○	○	○	○
Medium static pressure duct	○	○	○	○
Floor	○	○*3	○*3	○
Wall mounted	KMCC	○	○*1	○*1
	KMCE	○	○*2	○*2
	KMCF	○	○*2	○*2
	KMCG(-B)	○	○*2	○*2
	KMCH(-B)	○	○*2	○*2
	KETA(-B)	○	○*2	○*2
	KETE(-B)	○	○*2	○*2
	KETF(-B)	○	○*2	○*2
	KGTB	○	○*2	○*2
	KGTE	○	○*2	○*2
	KGTF	○	○*2	○*2
	KGTG	○	○*2	○*2
	KGTH	○	○*2	○*2
	KNCA	—	—	—
	KNCH	—	—	—
	KMTB	○	○*1	○*1

Indoor unit type	Type		
	Communication Kit		
	UTY-TWBXF2	UTY-TWRXZ2	UTY-TWRXZ3
Compact cassette	—	—	—
Mini duct	—	—	—
Slim duct	—	—	—
Medium static pressure duct	—	—	—
Floor	—	—	○
Wall mounted	KMCC	○	—
	KMCE	—	○
	KMCF	—	○
	KMCG(-B)	—	○
	KMCH(-B)	—	○
	KETA(-B)	—	○
	KETE(-B)	—	○
	KETF(-B)	—	○
	KGTB	—	○
	KGTE	—	○
	KGTF	—	○
	KGTG	—	○
	KGTH	—	○
	KNCA	—	—
	KNCH	—	—
	KMTB	○	—

Indoor unit type	Type				
	WLAN Adapter*4				
	UTY-TFSXW1	UTY-TFSXF2	UTY-TFSXZ1	UTY-TFSXH3	UTY-TFSXJ3
Compact cassette	—	—	○	—	—
Mini duct	—	—	○	—	—
Slim duct	—	—	○	—	—
Medium static pressure duct	—	—	○	—	○
Floor	—	—	○	—	—
Wall mounted	KMCC	○	—	—	—
	KMCE	—	○	—	—
	KMCF	—	—	—	—
	KMCG(-B)	—	—	—	—
	KMCH(-B)	—	—	—	○
	KETA(-B)	—	○	—	—
	KETE(-B)	—	○	—	—
	KETF(-B)	—	—	—	—
	KGTB	○	—	—	—
	KGTE	—	○	—	—
	KGTF	—	—	—	—
	KGTG	—	—	—	—
	KGTH	—	—	—	○
	KNCA	—	—	—	—
	KNCH	—	—	—	○
	KMTB	○	—	—	—

Indoor unit type	Type	
	Air Cleaning Filter	
	UTR-FA16-5	UTD-HFNC
Compact cassette	—	—
Mini duct	—	—
Slim duct	—	—
Medium static pressure duct	—	○
Floor	—	—
Wall mounted	KMCC	○
	KMCE	○
	KMCF	○
	KMCG(-B)	○
	KMCH(-B)	○
	KETA(-B)	—
	KETE(-B)	—
	KETF(-B)	—
	KGTB	—
	KGTE	—
	KGTF	—
	KGTG	—
	KGTH	—
	KNCA	○
	KNCH	○
	KMTB	—





Indoor unit type	Type	
	Long-life Filter	External Input and Output PCB Box
	UTD-LFDC	UTZ-GXDA
Compact cassette	—	—
Mini duct	—	—
Slim duct	—	—
Medium static pressure duct	○	○
Floor	—	—
Wall mounted	KMCC	—
	KMCE	—
	KMCF	—
	KMCG(-B)	—
	KMCH(-B)	—
	KETA(-B)	—
	KETE(-B)	—
	KETF(-B)	—
	KGTB	—
	KGTE	—
	KGTF	—
	KGTG	—
	KGTH	—
	KNCA	—
	KNCH	—
	KMTB	—



●:Accessory, ○: Optional, —: Not applicable

- *1: Optional Communication Kit (UTY-TWBXF2) is necessary for the installation.
- *2: Optional Communication Kit (UTY-TWRXZ2) is necessary for the installation.
- *3: Optional Communication Kit (UTY-TWRXZ3) is necessary for the installation.
- *4: For details of wireless LAN control, refer to “Design & Technical manual” or “Setting manual” of WLAN control system.

NOTE: Combined use of Modbus Converter, KNX Convertor, and WLAN Adapter is not allowed.

■ Parts

Exterior	Part name	Model name	Summary
	Remote Sensor Unit	UTY-XSZX	Thermo-sensor for sensing the temperature of arbitrary place in the room.
	Remote Sensor Unit	UTY-XSZX*	Thermo-sensor for sensing the temperature of arbitrary place in the room.
	Auto Louver Grille Kit	UTD-GXTA-W	Width: 683 mm For 07, 09, 12, and 14 models
	Long-life Filter	UTD-LFDC	Long-life Filter can be mounted to the indoor unit.
	Air Cleaning Filter	UTR-FA16-5	Air Cleaning Filter can be mounted to the indoor unit. (For antibacterial)
	Air Cleaning Filter	UTD-HFNC	Air Cleaning Filter can be mounted to the indoor unit.
	External Connect Kit	UTY-XWZX	Use to connect with various peripheral devices and air conditioner PCB.
	External Connect Kit	UTY-XWZXZ5	Required when external device is connected.
	External Connect Kit	UTY-XWZXZG	Use to connect with various peripheral devices and air conditioner PCB. For control output port.
	Air Outlet Shutter Plate	UTR-YDZB	Installed at the air outlet when 3-directions mode is performed.
	Fresh Air Intake Kit	UTZ-VXAA	By attaching Fresh Air Intake Kit to the indoor unit, it can be taken in fresh air of up to 10% of "high" air volume of the indoor unit.
	Insulation Kit for High Humidity	UTZ-KXGC	Install when the under-roof condition is expected to be the humidity of over 80% and the temperature of over 30 °C.

Exterior	Part name	Model name	Summary
	Half Concealed Kit	UTR-STA	Used for the indoor unit installing of half concealed.
	Communication Kit	UTY-TWBXF2	Use to connect with optional devices and air conditioner PCB.
	External Input and Output PCB	UTY-XCSX	Use to connect with external devices and air conditioner PCB.
	External Input and Output PCB	UTY-XCSXZ2	Use to connect with external devices and air conditioner PCB. Optional External Connect Kit might be required to connect locally purchased devices via this PCB.
	External Input and Output PCB Box	UTZ-GXDA	For installing the External input and output PCB.
	Communication Kit	UTY-TWRXZ3	Use to connect Non-polar 2-core wired remote controller.
	Communication Kit	UTY-TWRXZ2	Use to connect Non-polar 2-core wired remote controller.
	WLAN Adapter	UTY-TFSXZ1 UTY-TFSXJ3	Remotely manage an air conditioning system using mobile devices such as smartphones and tablets. For connection indoor unit with UART interface. Appropriate application for each region is required to use this option. For details, contact FGL sales company.

Exterior	Part name	Model name	Summary
	WLAN Adapter	UTY-TFSXW1	Remotely manage an air conditioning system using mobile devices such as smartphones and tablets. Appropriate application for each region is required to use this option. For details, contact FGL sales company.
	WLAN Adapter	UTY-TFSXF2 UTY-TFSXH3	Remotely manage an air conditioning system using mobile devices such as smartphones and tablets. Appropriate application for each region is required to use this option. For details, contact FGL sales company.
	Modbus Converter	UTY-VMSX	For connection between indoor unit with UART interface and a Modbus open network.
	KNX Convertor	UTY-VKSX	For connection between indoor unit with UART interface and a KNX open network.
	Network Converter	UTY-VTGX	This converter is required when connecting single split system to VRF network system. Optional Communication Kit is necessary for installation.
	Network Converter (AC power supply)	UTY-VTGXV	This converter is required when connecting single split system to VRF network system. Optional Communication Kit is necessary for installation.
	External Switch Controller	UTY-TERX	Air conditioner switching can be controlled by connecting other external sensor switches. Optional Communication Kit is necessary for installation.

18. Indoor unit installation precautions

NOTE: The information listed below are general precautions.

Some models also include items that do not apply.

18-1. Places where prohibited for use



- Places where there is a danger of combustible gas leakage.
- Places where sulfur gas, chlorine gas, acid, alkali, or other matter which effects equipment is generated.
- Places where there is a lot of oil splash and steam such as kitchen or machinery room.
- Places where machinery which generates high frequencies is used.
- Ocean beaches and other areas where there is a lot of salt.
- Places where carbon fibers or any kind of powder suspended in the air.
- Inside of vehicles, ships, and other conveyances.
- Places where voltage fluctuations are large such as a factory.

18-2. Points to remember when installing

- The product shall be installed at a place which can withstand the weight and vibration of the indoor.
- To allow maintenance after refrigerant piping, drain piping, and the connection/installation of electric wiring, provide an maintenance space and an inspection port, as required.
Maintenance space is shown in "[Dimensions](#)" on page 29.
- Be careful when installing the unit at the following places.

Condition	Contents	Countermeasures (Reference)
When the ceiling is high.	If the indoor unit is installed where the installation height given in the installation manual is exceeded, the temperature difference between the floor and ceiling of the room will be large and the heating effect will be poor. Moreover, even if the indoor unit is installed within the installation height, a similar phenomena will occur when installed in a room in which the doors are opened and closed frequently and hot air circulation is obstructed by furniture such as desks or chairs.	<ol style="list-style-type: none"> Switch the setting to the high ceiling mode. Install a circulator. Arrange the furniture in the room so that it does not obstruct the hot air.
When lower level directly contacts the outside air.	When the lower level of the room is a semi-open space such as warehouse or parking lot the surface temperature of the flooring will become low and the radiation of cold from the floor will increase. In this case, even if the room temperature is suitable, you may feel the foot level is cold.	
When the airflow distribution is poor.	When an indoor unit is installed in a position where the outlet airflow will directly contact people, a draft may be felt. In addition, when there are obstructions in the path of the intake and outlet airflow, the air distribution may become extremely bad.	<ol style="list-style-type: none"> Adjust the louver fins or take other measures matched to the site. Change the indoor unit outlet.

Condition	Contents	Countermeasures (Reference)
When inside the ceiling is high temperature and high humidity.	When the indoor unit is installed where the inside of the ceiling is 30 °C RH80% or greater, the dew point temperature of the outer perimeter may become higher than the cabinet surface temperature and moisture will condense on the surface of the cabinet and water drops may fall inside the room. ("Figure 18-1 Moist air curve ") In addition, the humidity may vary considerably the same as when the inside of the ceiling is close to hermetically sealed and used as the outside air intake path.	<ol style="list-style-type: none"> 1. Add heat insulating material to the outside of the indoor unit cabinet. *Regarding the cassette type, use of optional High humidity correspondence kit is recommended. 2. Strengthen the heat insulating material of the refrigerant pipe and drain pipe too. ("Figure 18-2 Work method when reinforcing the heat insulation of on-site piping") 3. When the humidity inside the ceiling changes considerably, install a ventilation port.
When using an external duct.	When using an external duct to take in new fresh air, etc., condensation may form on the surface of the duct due to the effect of the outside air temperature and the humidity inside the ceiling.	Always perform heat insulation processing. (Heat insulating material: Glass wool 25 mm thick or more.)
When the remote controller installation site is bad.	If the cold or warm air blown out from the air conditioner directly contacts the thermostat section of the remote controller, the outlet temperature of the air conditioner may be sensed and room temperature control will be different from the room temperature, and "not cooled" or "not heated" or other trouble may occur. In addition, there is the possibility that the same kind of trouble may also occur when the remote controller is effected by direct sunlight.	<ol style="list-style-type: none"> 1. Install the remote controller where it will not be directly exposed to the cold or hot air. 2. Install the remote controller where it will not be directly exposed to sunlight or strong lighting.
When installation environment is quiet.	When the wall mounted type was installed in a bedroom, living room, or other quiet place, the sound of the refrigerant flow may be sensed as noise and must be taken into account.	<ol style="list-style-type: none"> 1. Plan installation of a model with external expansion valve. 2. Plan installation of a branch box farther from indoor unit. 3. Plan installation using another air conditioner.
When installing duct type in ceiling chamber system.	In the case of the ceiling chamber system (duct is not installed at indoor unit inlet side and room air is sucked into the indoor unit through the inside of the ceiling), the thermistor inside the indoor unit may not correctly detect the room temperature. <ul style="list-style-type: none"> • Heating operation: Room is not heated because the indoor unit is easily turned off by the thermostat. • Cooling operation: Room is too cold because the indoor unit is difficult to turn off by the thermostat. 	Replace the indoor unit thermistor with optional remote sensor unit, and install the sensor where the room temperature can be correctly detected.
When the outlet air is sucked in at duct type.	Cooling operation does not cool the room and heating operation does not heat the room because the short circuited indoor unit is not turned on by the thermostat.	<ol style="list-style-type: none"> 1. Reconsider the ventilation port construction. 2. Replace the indoor unit thermistor with optional Remote sensor unit, and install the sensor where the room temperature can be correctly detected.
When using the wireless remote controller.	Signals may not be received when using it in a room illuminated by an inverter fluorescent lamp.	Turn on the fluorescent lamp and check if the indoor unit receives the signals from the remote controller. If the indoor unit does not receive the signals, consult an authorized service personnel.
When installing the inverter type.	It may generate noise in TV sets, stereos and PCs.	The inverter type should be installed at a sufficient distance from these equipments.

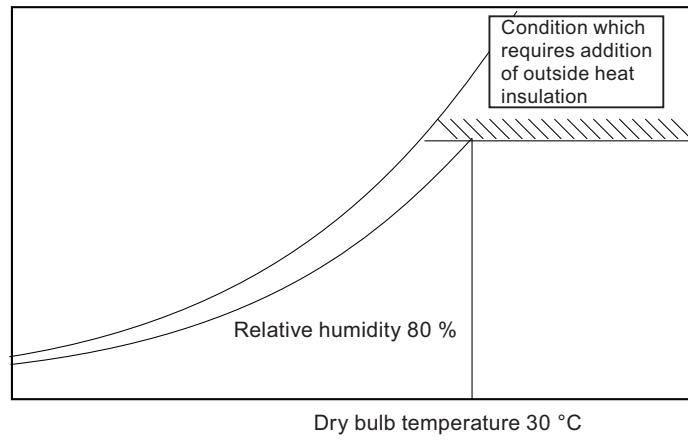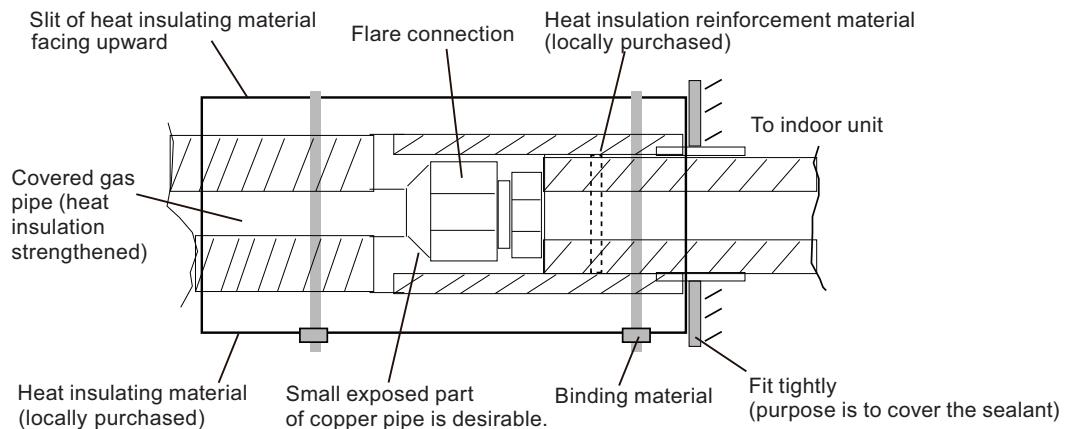Figure 18-1 **Moist air curve**Figure 18-2 **Work method when reinforcing the heat insulation of on-site piping**

Part 2. OUTDOOR UNIT (2 UNITS TYPE)

MULTI-SPLIT TYPE:

AOHG14KBTA2

AOHG18KBTA2


1. Specifications

Type	Inverter heat pump								
Model name	AOHG14KBTA2		AOHG18KBTA2						
Power source	230 V 50 Hz		198—264V						
Available voltage range									
Standard combination of indoor unit	Wall mounted ASHG07KGTB ×2		Wall mounted ASHG09KGTB ×2						
Capacity	Cooling	Rated	kW	4.0					
			Btu/h	13,600					
		Min.—Max.	kW	1.4—4.6					
			Btu/h	4,700—15,700					
	Heating	Rated	kW	4.4					
			Btu/h	15,000					
		Min.—Max.	kW	1.1—5.5					
			Btu/h	3,700—18,800					
Input power	Cooling	Rated	kW	0.97					
				1.24					
	Heating	Rated		1.20					
				1.55					
Current	Cooling	Rated	A	0.95					
				1.22					
EER	Cooling	Rated	kW/kW	1.65					
				1.80					
COP	Heating	Rated	A	4.7					
				5.6					
Starting current			A	4.7					
Maximum operating current *1			A	10.9					
Type × Q'ty			Propeller × 1						
Fan	Airflow rate	Cooling	m³/h	1,670					
		Heating		1,670					
	Motor output		W	23					
Sound pressure level *2	Cooling		dB (A)	47					
	Heating			49					
	Dimension (H × W × D)		mm	Main 1: 504 × 881 × 18.19					
Heat exchanger	Main 2: 504 × 851 × 18.19			Main 1: 588 × 881 × 18.19					
	Fin pitch			Main 2: 588 × 851 × 18.19					
	Rows × Stages			Main 1: 1 × 24					
	Pipe type (Material)			Main 2: 1 × 24					
	Fin type (Material)			Copper tube					
Compressor	Type × Quantity			Aluminum					
	Motor output		DC rotary × 1	DC twin rotary × 2					
Refrigerant	Type (Global warming potential)			900					
	Charge		R32 (675)	1,020					
Refrigerant oil	Type		RB68A	FW68S					
	Amount		cm³	340					
Enclosure	Material			350					
	Color			Steel sheet					
Dimensions (H × W × D)	Beige		(Approximate color of Munsell 10YR 7.5/1.0 NN)						
	Net		mm	542 × 799 × 290					
Weight	Gross			692 × 940 × 375					
	Net		kg	33					
Connection pipe	Gross			37					
	Size	Liquid	mm (in)	Ø6.35 (Ø1/4) × 2					
Operation range				Ø9.52 (Ø3/8) × 2					
Gas				Flare					
				NOTES:					
				<ul style="list-style-type: none"> • Specifications are based on the following conditions: <ul style="list-style-type: none"> — Power source of specifications: 230 V — Pipe length: 5 m, Height difference: 0 m [Outdoor unit—Indoor unit] — Cooling: Indoor temperature of 27.0 °CDB/19.0 °CWB, and outdoor temperature of 35 °CDB/24.0 °CWB. — Heating: Indoor temperature of 20.0 °CDB/15.0 °CWB, and outdoor temperature of 7.0 °CDB/6.0 °CWB. 					
				<ul style="list-style-type: none"> • *1: Maximum operating current is the total current of the indoor unit and the outdoor unit. • *2: Sound pressure level <ul style="list-style-type: none"> — Measured values in manufacturer's anechoic chamber. — Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here. • For other combination, refer to the combination table. • The protective function might work when using it outside the operation range. 					

Specifications for ErP Lot10			
Model name		AOHG14KBTA2	AOHG18KBTA2
Energy efficiency class		A+++ A++	
Pdesign		4.0 (35 °C) 3.5 (-10 °C)	5.0 (35 °C) 4.2 (-10 °C)
SEER		8.70	8.60
SCOP		4.70	
Annual energy consumption		209 1,296	263 1,434
Sound power level		60 62	
Cooling	kW		
Heating (Average)			
Cooling	kWh/kWh		
Heating (Average)			
QCE	kWh/a		
QHE (Average)			
Cooling	dB (A)		
Heating			
HIGH			







2. Dimensions

2-1. Model: AOHG14KBTA2

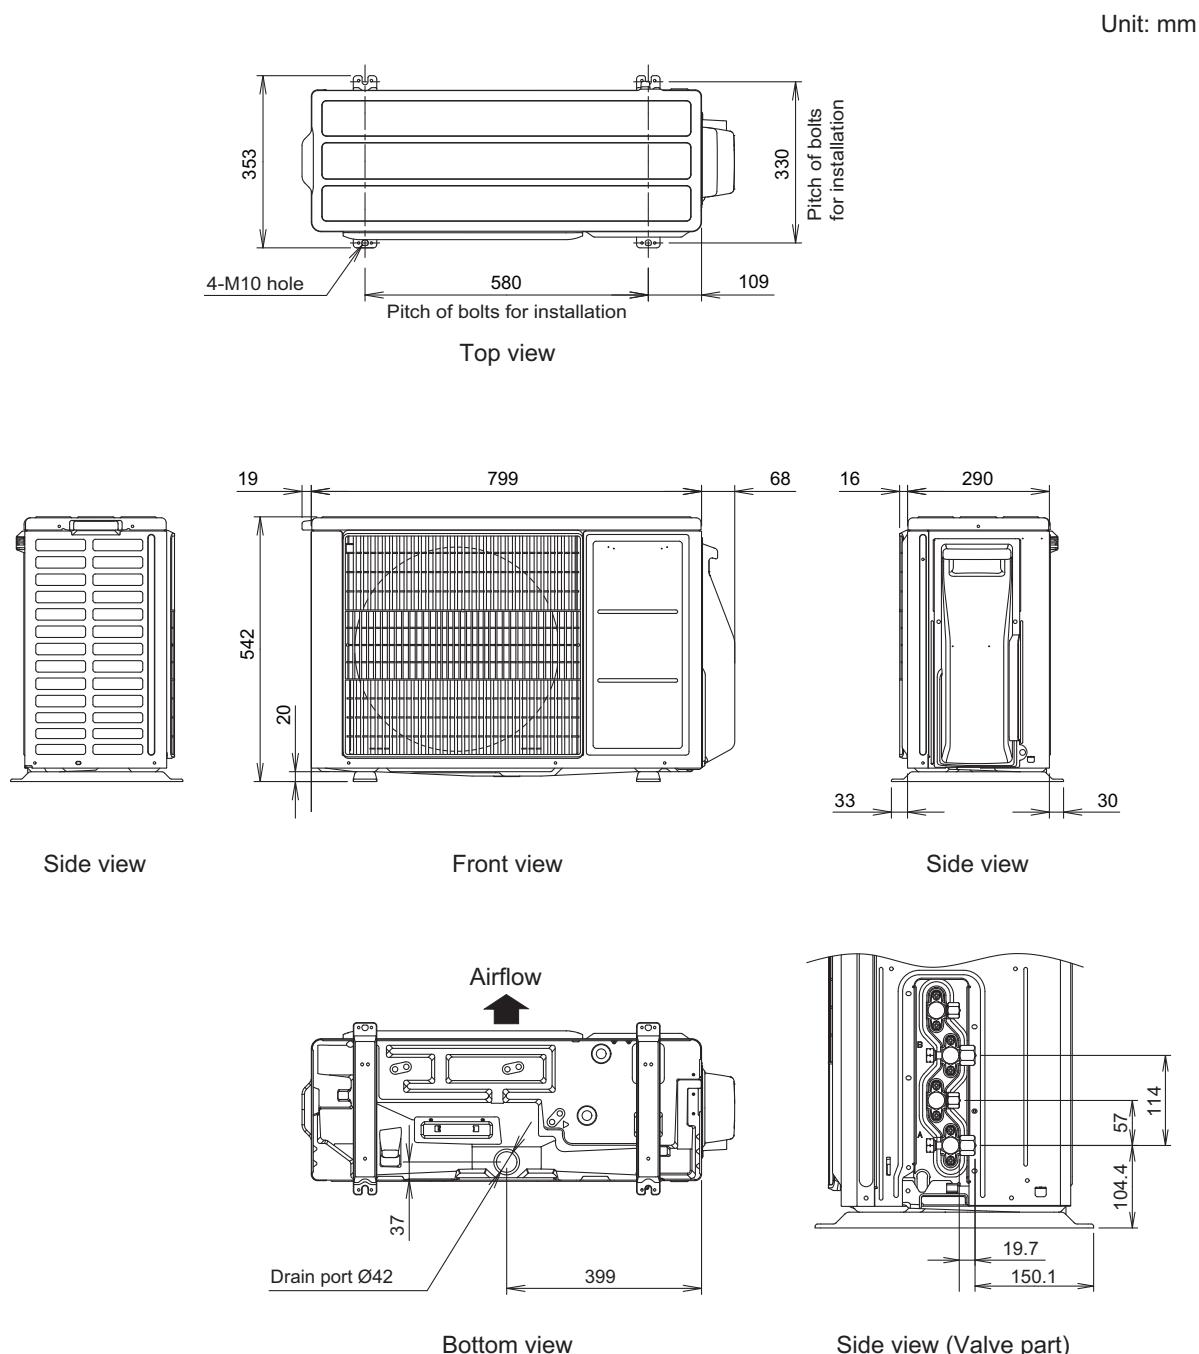

2-2. Model: AOHG18KBTA2

Unit: mm

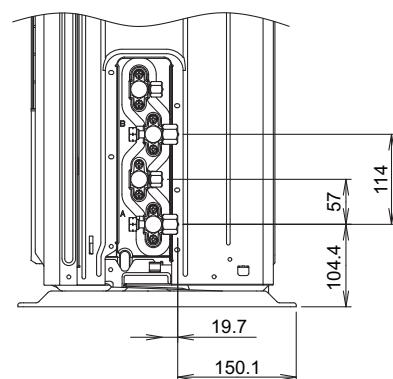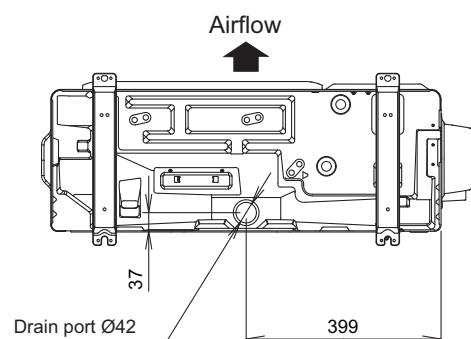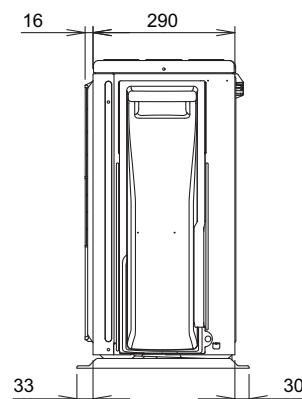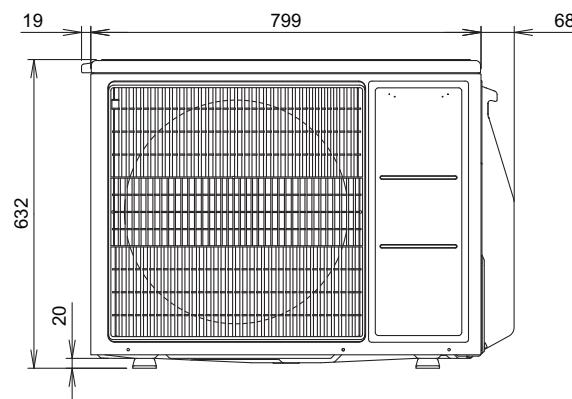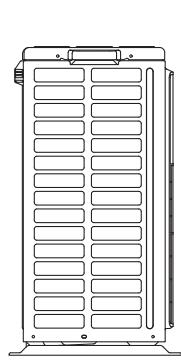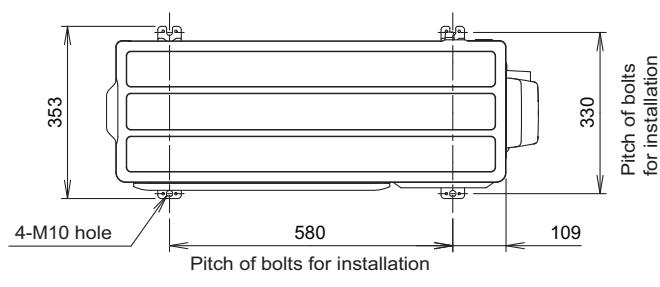OUTDOOR UNIT
AOHG14-18KBTA2OUTDOOR UNIT
AOHG14-18KBTA2

3. Installation space

3-1. Models: AOHG14KBTA2 and AOHG18KBTA2

■ Space requirement

Provide sufficient installation space for product safety.

⚠ CAUTION

Keep the space shown in the installation examples.


If the installation is not performed accordingly, it could cause a short circuit and result in a lack of operating performance.

● Single outdoor unit installation


- When the upper space is open:

Unit: mm


Obstacles at rear only

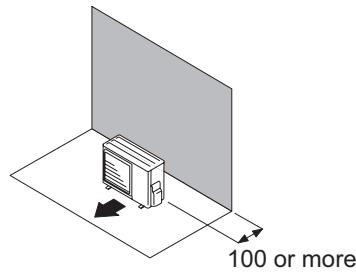


Obstacles at rear and sides

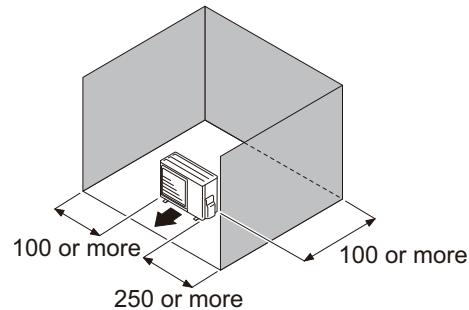

Obstacles at front

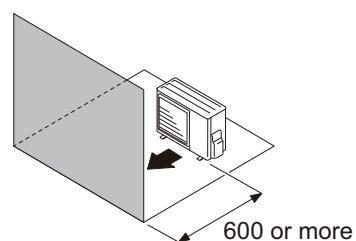


Obstacles at front and rear

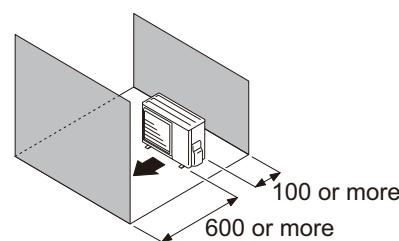


- When an obstruction in the upper space:

Unit: mm

Obstacles at rear and above

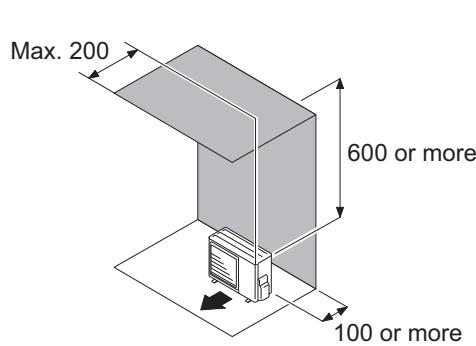

Obstacles at rear, sides, and above

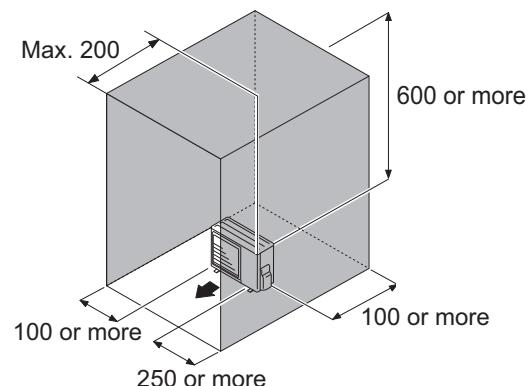


● Multiple outdoor unit installation

- Provide at least 250 mm of space between the outdoor units if multiple units are installed.
 - When routing the piping from the side of an outdoor unit, provide space for piping.
 - No more than 3 units must be installed side by side.
- When 4 units or more are arranged in a line, provide the space as shown in the following example **"When an obstruction in the upper space:"**.


- When the upper space is open:**

Unit: mm


Obstacles at rear only

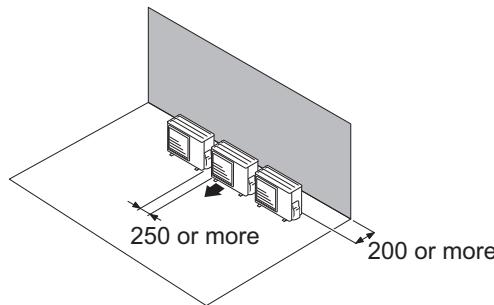

Obstacles at front only

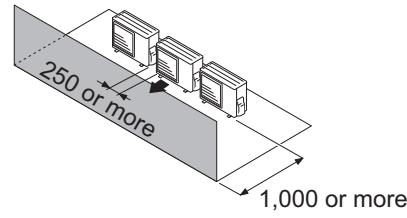


Obstacles at front and rear

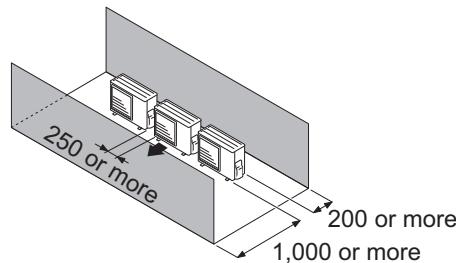

- When an obstruction in the upper space:**

Unit: mm


Obstacles at rear and above.

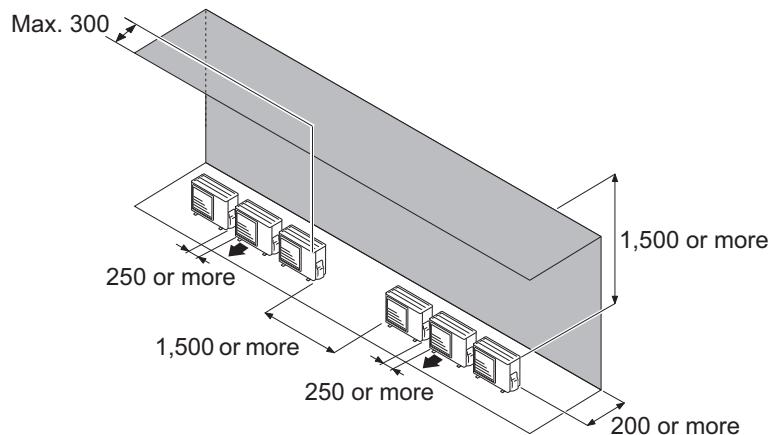



● Outdoor units installation in multi-row

Unit: mm

Single parallel unit arrangement

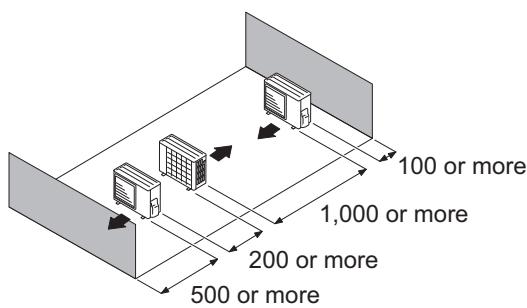


Multiple parallel unit arrangement

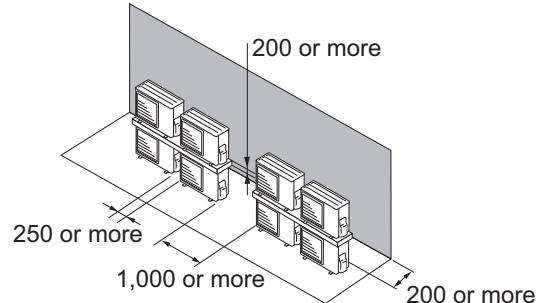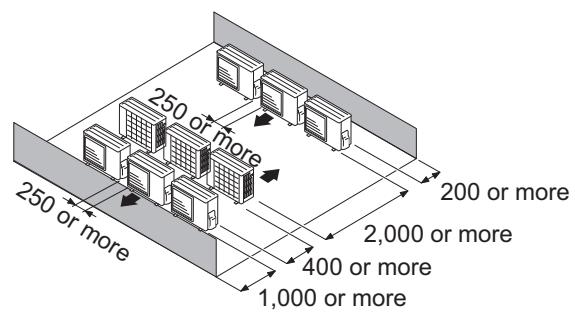**NOTES:**

- If the space is larger than stated above, the condition will be the same as when there is no obstacle.
- When installing the outdoor unit, be sure to open the front and left side to obtain better operation efficiency.

△ CAUTION

- Do not install the outdoor unit in two-stage where the drain water could freeze. Otherwise the drainage from the upper unit may form ice and cause a malfunction of the lower unit.
- When the outdoor temperature is 0 °C or less, do not use the accessory drain pipe and drain cap. If the drain pipe and drain cap are used, the drain water in the pipe may freeze in extremely cold climate. (For reverse cycle model only.)
- In area with heavy snowfall, if the inlet and outlet of the outdoor unit is blocked with snow, it might become difficult to get warm, and it is likely to cause product malfunction. Construct a canopy and a pedestal, or place the unit on a high stand that is locally installed.




4. Refrigerant circuit

4-1. Model: AOHG14KBTA2

OUTDOOR UNIT
AOHG14-18KBTA2


OUTDOOR UNIT
AOHG14-18KBTA2

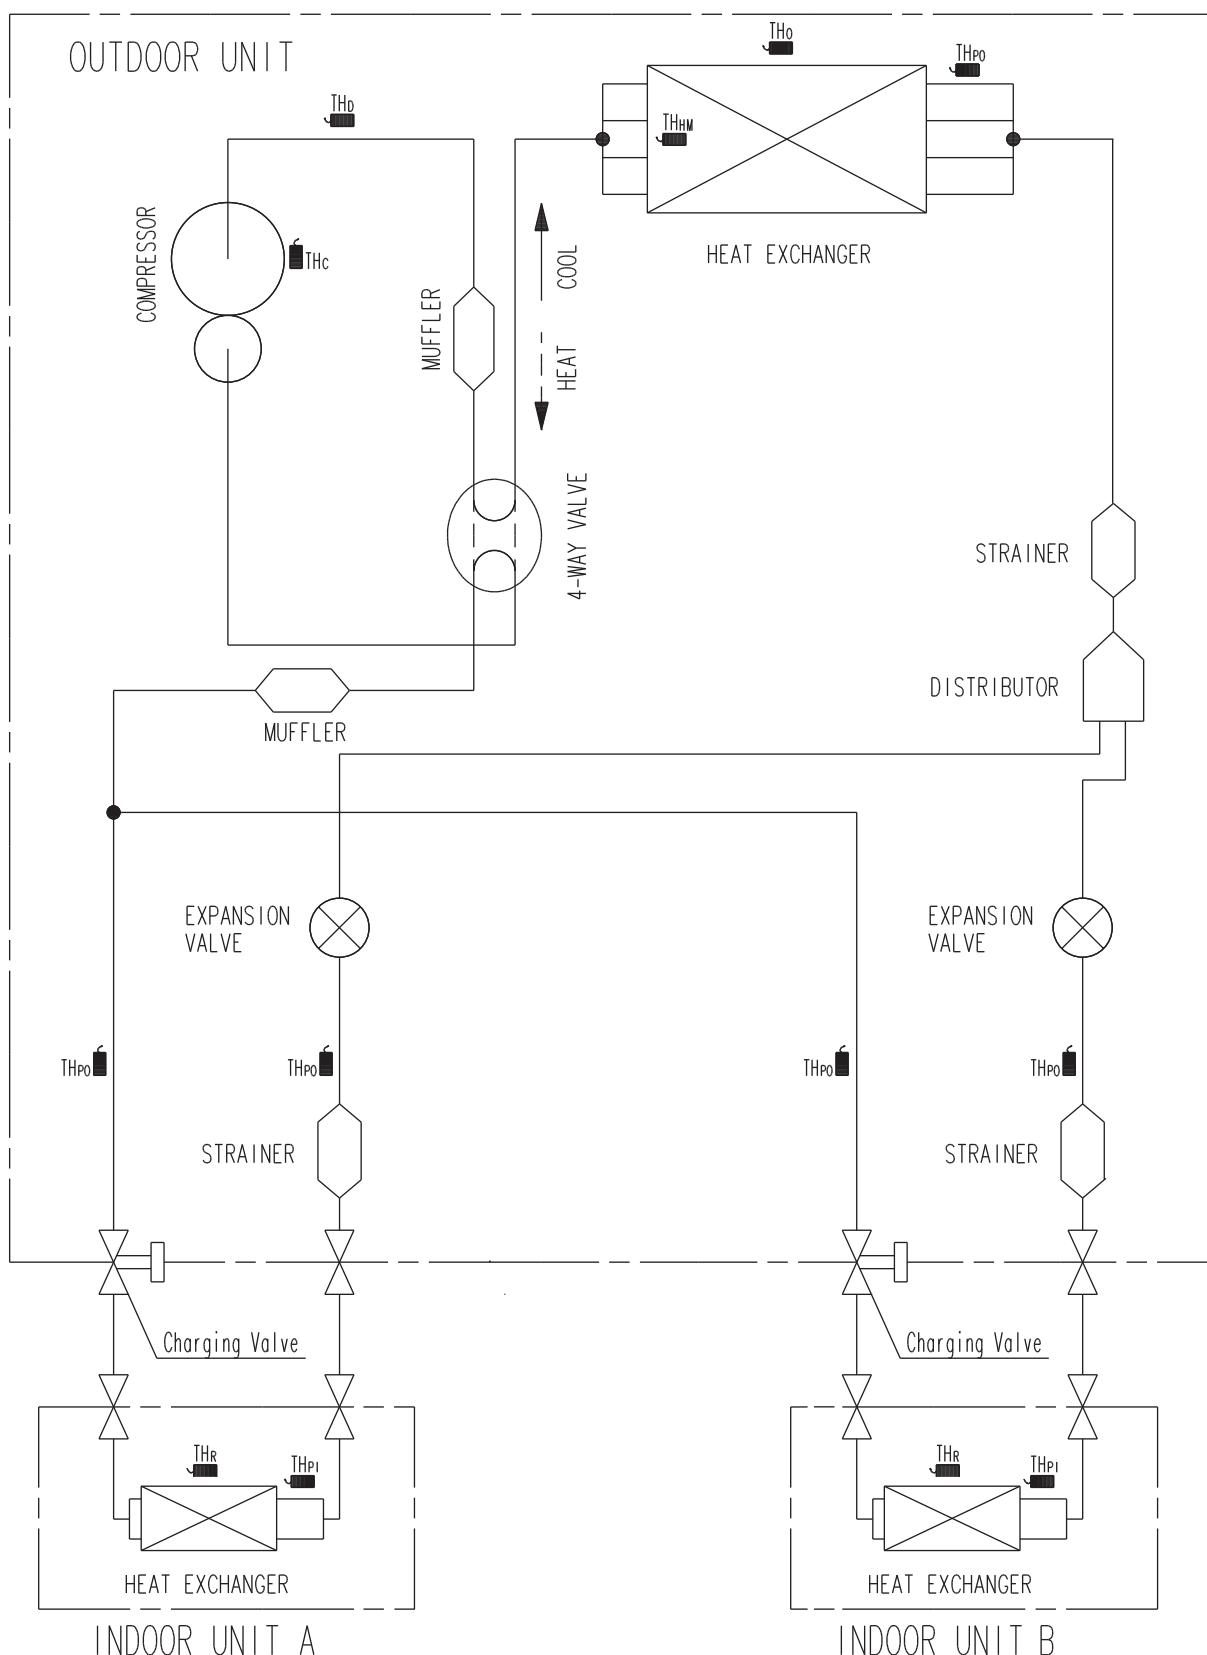

- TH_D: THERMISTOR(DISCHARGE TEMP.)
- TH_O: THERMISTOR(OUTDOOR TEMP.)
- TH_{P0}: THERMISTOR(PIPE TEMP.)
- TH_M: THERMISTOR(HEAT EXCHANGER MIDDLE TEMP.)
- TH_C: THERMISTOR(COMPRESSOR TEMP.)

- TH_R: THERMISTOR(ROOM TEMP.)
- TH_{P1}: THERMISTOR(PIPE TEMP.)

4-2. Model: AOHG18KBTA2

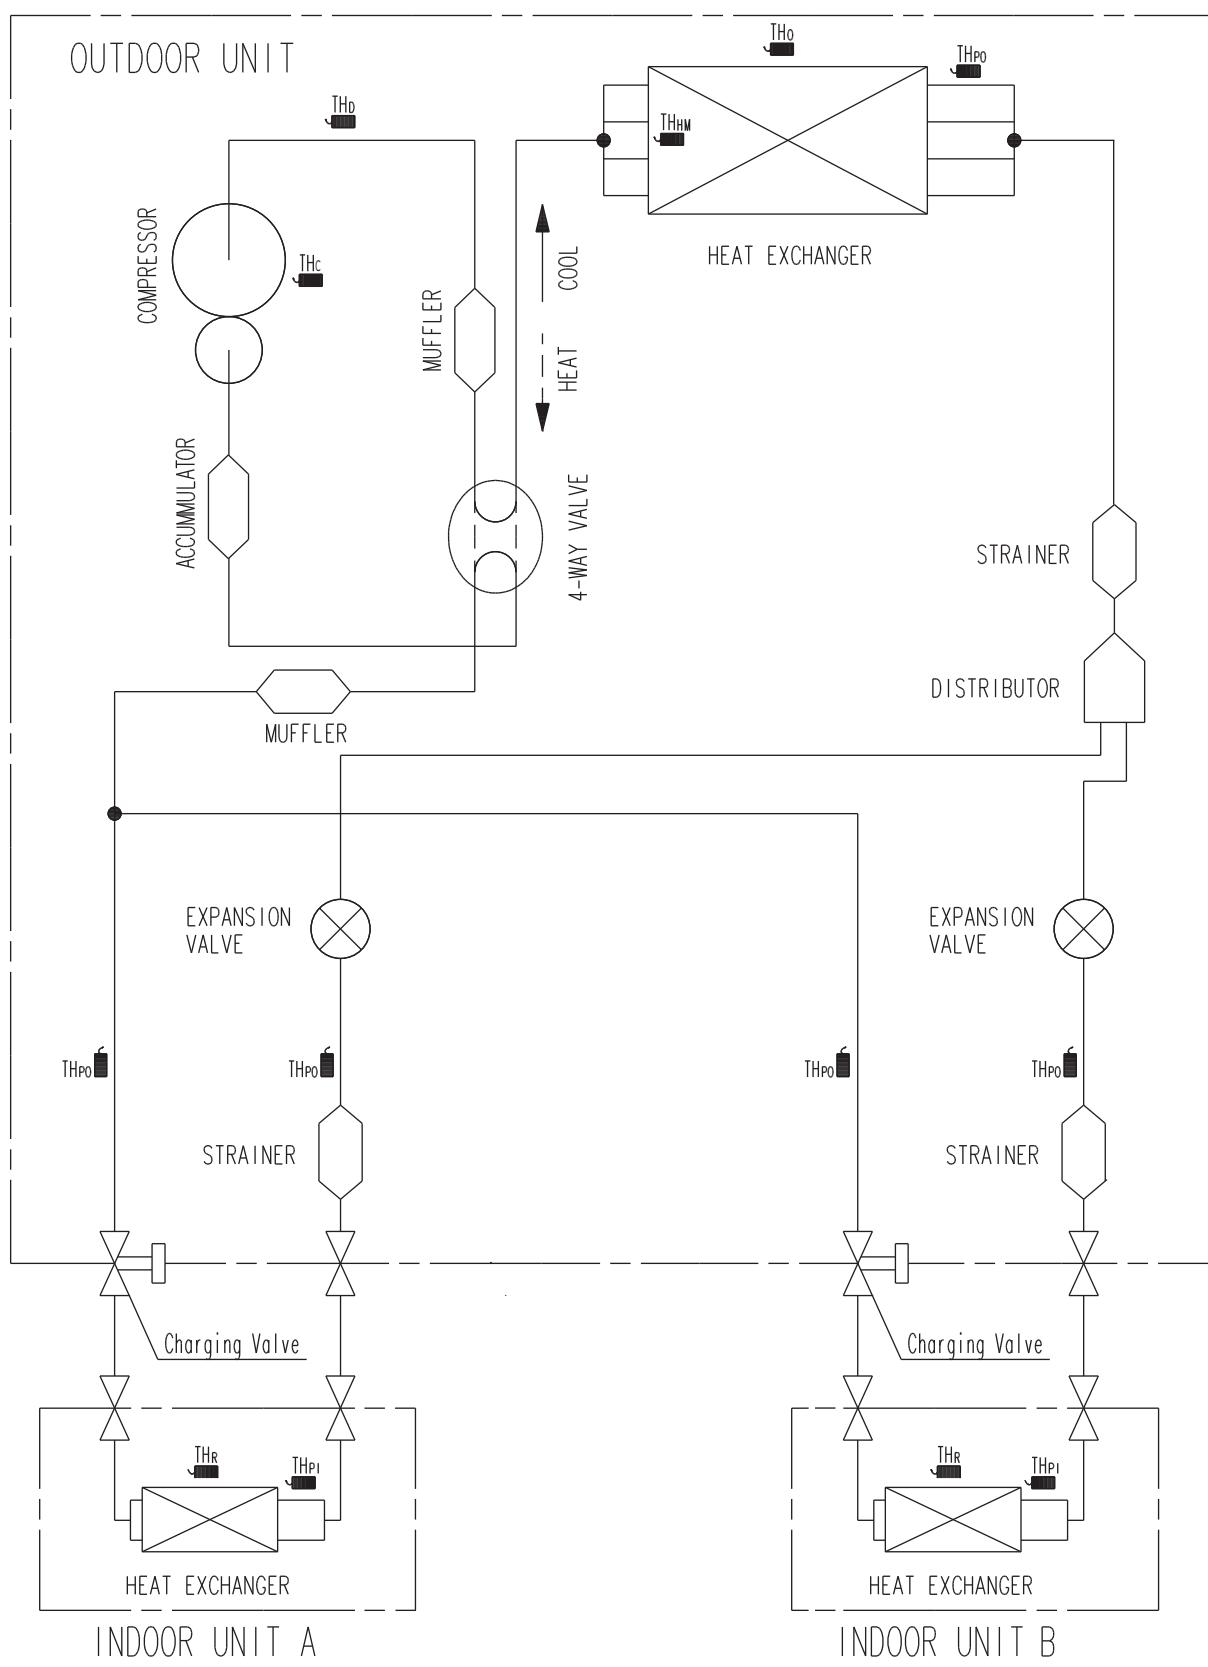OUTDOOR UNIT
AOHG14-18KBTA2OUTDOOR UNIT
AOHG14-18KBTA2

TH_o : THERMISTOR(DISCHARGE TEMP.)
 TH_{po} : THERMISTOR(OUTDOOR TEMP.)
 TH_{hp} : THERMISTOR(PIPE TEMP.)
 TH_c : THERMISTOR(COMPRESSOR TEMP.)
 TH_{hr} : THERMISTOR(ROOM TEMP.)
 TH_{pi} : THERMISTOR(Pipe TEMP.)


TH_{hr} : THERMISTOR(ROOM TEMP.)
 TH_{pi} : THERMISTOR(Pipe TEMP.)
 TH_c : THERMISTOR(COMPRESSOR TEMP.)

5. Wiring diagram


5-1. Model: AOHG14KBTA2

OUTDOOR UNIT
AOHG14-18KBTA2

OUTDOOR UNIT
AOHG14-18KBTA2

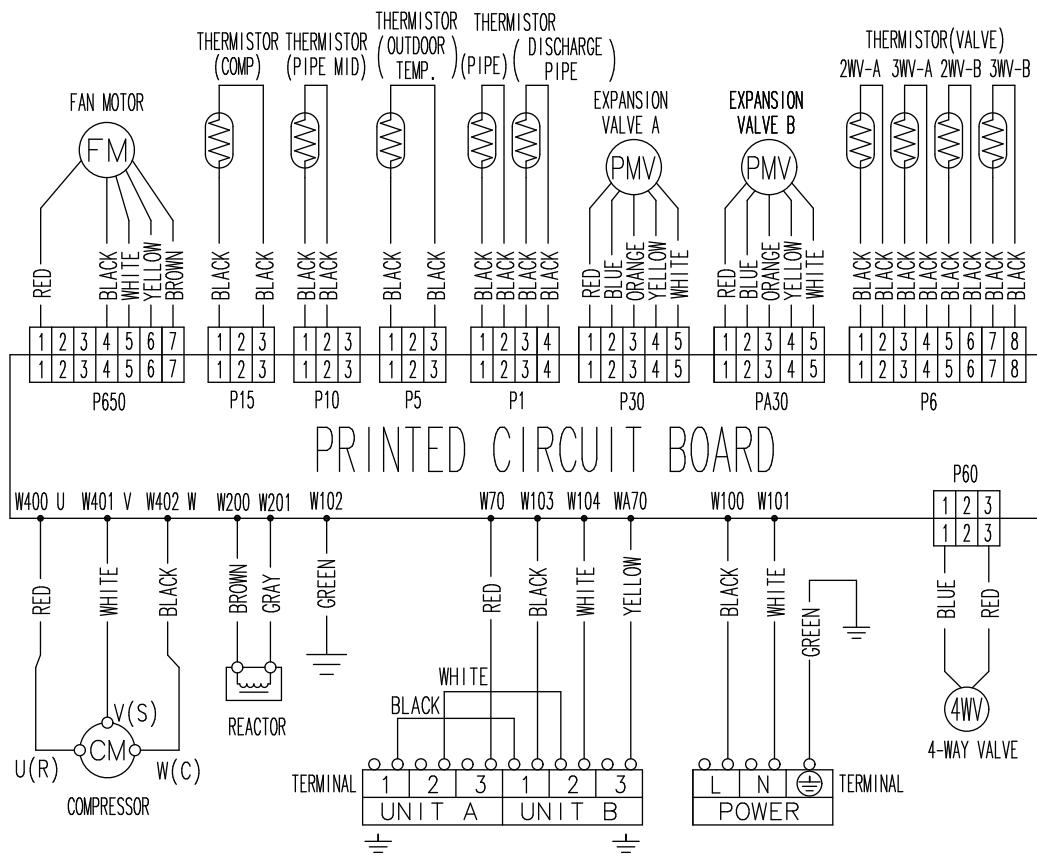

5-2. Model: AOHG18KBTA2

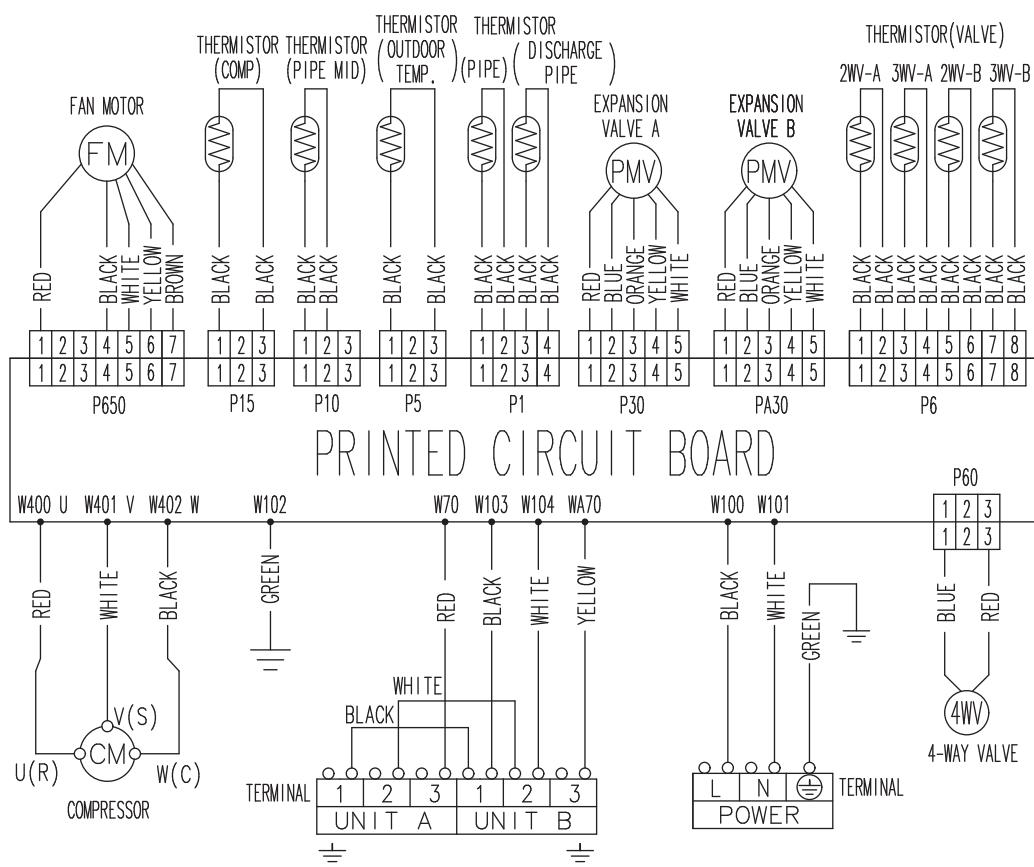OUTDOOR UNIT
AOHG14-18KBTA2OUTDOOR UNIT
AOHG14-18KBTA2

6. Capacity table

6-1. Combinations

■ Model: AOHG14KBTA2

● Cooling

Indoor unit combination (Wall-mounted KG/KM type only)

Combination of indoor unit			Rated capacity for each indoor unit (kW)			Total capacity (kW)			Input power (kW)			EER (W/W)	Seasonal data			
Unit		Total	Unit			Min.	Rated	Max.	Min.	Rated	Max.		Pdesign (kW)	SEER (kWh/kWh)	Energy efficiency class	
1	2		1	2												
7	7	14	2.00	2.00	1.4	4.00	4.60	0.25	0.97	1.20	4.12	4.0	8.7	A+++		
7	9	16	1.75	2.25	1.4	4.00	4.60	0.25	0.97	1.20	4.12	4.0	8.7	A+++		
7	12	19	1.47	2.53	1.4	4.00	4.60	0.25	0.97	1.20	4.12	4.0	8.7	A+++		
9	9	18	2.00	2.00	1.4	4.00	4.60	0.25	0.97	1.20	4.12	4.0	8.7	A+++		
9	12	21	1.71	2.29	1.4	4.00	4.60	0.25	0.97	1.20	4.12	4.0	8.7	A+++		

Indoor unit combination (All models other than wall-mounted type KG/KM models)

Combination of indoor unit			Rated capacity for each indoor unit (kW)			Total capacity (kW)			Input power (kW)			EER (W/W)	Seasonal data			
Unit		Total	Unit			Min.	Rated	Max.	Min.	Rated	Max.		Pdesign (kW)	SEER (kWh/kWh)	Energy efficiency class	
1	2		1	2												
5	5	10	1.50	1.50	1.4	3.00	3.60	0.25	0.74	0.95	4.03	3.0	6.8	A++		
5	7	12	1.50	2.00	1.4	3.50	4.30	0.25	0.84	1.10	4.15	3.5	6.8	A++		
5	9	14	1.50	2.50	1.4	4.00	4.39	0.25	1.07	1.25	3.75	4.0	6.8	A++		
5	12	17	1.18	2.82	1.4	4.00	4.61	0.25	1.02	1.25	3.92	4.0	6.8	A++		
7	7	14	2.00	2.00	1.4	4.00	4.60	0.25	1.02	1.25	3.92	4.0	6.8	A++		
7	9	16	1.75	2.25	1.4	4.00	4.60	0.25	1.02	1.25	3.92	4.0	6.8	A++		
7	12	19	1.47	2.53	1.4	4.00	4.60	0.25	1.02	1.25	3.92	4.0	6.8	A++		
9	9	18	2.00	2.00	1.4	4.00	4.60	0.25	1.02	1.25	3.92	4.0	6.8	A++		
9	12	21	1.71	2.29	1.4	4.00	4.60	0.25	1.02	1.25	3.92	4.0	6.8	A++		

NOTES:

- 5: 5,000 Btu/h, 7: 7,000 Btu/h, 9: 9,000 Btu/h, 12: 12,000 Btu/h
- The above is the value for connecting with KG models in wall mounted type.
- 2 or more indoor units should be connected.
- Cooling: Indoor temperature of 27 °CDB/19 °CWB and outdoor temperature of 35 °CDB.
- Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)
- The total ability of connected indoor unit is from 10,000 Btu/h up to 21,000 Btu/h.

● Heating

Indoor unit combination (Wall-mounted KG/KM type only)

Combination of indoor unit			Rated capacity for each indoor unit (kBtu/h)			Total capacity (kBtu/h)			Input power (kW)			COP (W/W)	Seasonal data			
Unit		Total	Unit			Min.	Rated	Max.	Min.	Rated	Max.		Pdesign (kW)	SCOP (kWh/kWh)	Energy efficiency class	
1	2		1	2												
7	7	14	2.20	2.20		1.1	4.40	5.5	0.25	0.95	1.65	4.63	3.5	4.7	A++	
7	9	16	1.92	2.48		1.1	4.40	5.5	0.25	0.95	1.65	4.63	3.5	4.7	A++	
7	12	19	1.62	2.78		1.1	4.40	5.5	0.25	0.95	1.65	4.63	3.5	4.7	A++	
9	9	18	2.20	2.20		1.1	4.40	5.5	0.25	0.95	1.65	4.63	3.5	4.7	A++	
9	12	21	1.89	2.51		1.1	4.40	5.5	0.25	0.95	1.65	4.63	3.5	4.7	A++	

Indoor unit combination (All models other than wall-mounted type KG/KM models)

Combination of indoor unit			Rated capacity for each indoor unit (kBtu/h)			Total capacity (kBtu/h)			Input power (kW)			COP (W/W)	Seasonal data			
Unit		Total	Unit			Min.	Rated	Max.	Min.	Rated	Max.		Pdesign (kW)	SCOP (kWh/kWh)	Energy efficiency class	
1	2		1	2												
5	5	10	1.80	1.80		1.1	3.60	4.2	0.25	0.80	1.25	4.52	2.9	4.08	A+	
5	7	12	1.67	2.33		1.1	4.00	4.8	0.25	0.92	1.50	4.36	3.4	4.10	A+	
5	9	14	1.57	2.83		1.1	4.40	5.1	0.25	1.06	1.70	4.16	3.5	4.10	A+	
5	12	17	1.29	3.11		1.1	4.40	5.4	0.25	1.01	1.70	4.34	3.5	4.10	A+	
7	7	14	2.20	2.20		1.1	4.40	5.5	0.25	1.00	1.70	4.40	3.5	4.10	A+	
7	9	16	1.92	2.48		1.1	4.40	5.5	0.25	1.00	1.70	4.40	3.5	4.10	A+	
7	12	19	1.62	2.78		1.1	4.40	5.5	0.25	1.00	1.70	4.40	3.5	4.10	A+	
9	9	18	2.20	2.20		1.1	4.40	5.5	0.25	1.00	1.70	4.40	3.5	4.1	A+	
9	12	21	1.89	2.51		1.1	4.40	5.5	0.25	1.00	1.70	4.40	3.5	4.1	A+	

NOTES:

- 5: 5,000 Btu/h, 7: 7,000 Btu/h, 9: 9,000 Btu/h, 12: 12,000 Btu/h
- The above is the value for connecting with KG models in wall mounted type.
- 2 or more indoor units should be connected.
- Heating: Indoor temperature of 20 °CDB, and outdoor temperature of 7 °CDB/6 °CWB.
- Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)
- The total ability of connected indoor unit is from 10,000 Btu/h up to 21,000 Btu/h.

■ Model: AOHG18KBTA2

● Cooling

Indoor unit combination (Wall-mounted KG/KM type only)

Combination of indoor unit			Rated capacity for each indoor unit (kW)		Total capacity (kW)			Input power (kW)			EER (W/W)	Seasonal data			
Unit		Total	Unit		Min.	Rated	Max.	Min.	Rated	Max.		Pdesign (kW)	SEER (kWh/kWh)	Energy efficiency class	
1	2		1	2											
7	7	14	2.00	2.00	1.7	4.00	5.0	0.25	0.92	1.23	4.35	4.0	8.8	A+++	
7	9	16	2.00	2.50	1.7	4.50	5.7	0.25	1.07	1.45	4.22	4.5	8.7	A+++	
7	12	19	1.84	3.16	1.7	5.00	5.8	0.25	1.24	1.55	4.03	5.0	8.6	A+++	
7	14	21	1.67	3.33	1.7	5.00	5.8	0.25	1.24	1.55	4.03	5.0	8.6	A+++	
9	9	18	2.50	2.50	1.7	5.00	5.8	0.25	1.24	1.55	4.03	5.0	8.6	A+++	
9	12	21	2.14	2.86	1.7	5.00	5.8	0.25	1.24	1.55	4.03	5.0	8.6	A+++	
9	14	23	1.96	3.04	1.7	5.00	5.8	0.25	1.24	1.55	4.03	5.0	8.6	A+++	
12	12	24	2.50	2.50	1.7	5.00	5.8	0.25	1.24	1.55	4.03	5.0	8.6	A+++	
12	14	26	2.31	2.69	1.7	5.00	5.8	0.25	1.24	1.55	4.03	5.0	8.6	A+++	

Indoor unit combination (All models other than wall-mounted type KG/KM models)

Combination of indoor unit			Rated capacity for each indoor unit (kW)		Total capacity (kW)			Input power (kW)			EER (W/W)	Seasonal data			
Unit		Total	Unit		Min.	Rated	Max.	Min.	Rated	Max.		Pdesign (kW)	SEER (kWh/kWh)	Energy efficiency class	
1	2		1	2											
5	5	10	1.50	1.50	1.7	3.00	3.60	0.25	0.53	0.94	5.65	3.0	6.9	A++	
5	7	12	1.50	2.00	1.7	3.50	4.30	0.25	0.75	1.12	4.65	3.5	6.9	A++	
5	9	14	1.50	2.50	1.7	4.00	5.00	0.25	0.97	1.29	4.10	4.0	6.9	A++	
5	12	17	1.41	3.39	1.7	4.80	5.70	0.25	1.20	1.58	4.00	5.0	6.7	A++	
5	14	19	1.32	3.68	1.7	5.00	5.80	0.25	1.32	1.63	3.78	5.0	6.7	A++	
7	7	14	2.00	2.00	1.7	4.00	5.00	0.25	0.97	1.29	4.10	4.0	6.9	A++	
7	9	16	2.00	2.50	1.7	4.50	5.70	0.25	1.20	1.58	3.75	4.5	6.8	A++	
7	12	19	1.84	3.16	1.7	5.00	5.80	0.25	1.32	1.63	3.79	5.0	6.7	A++	
7	14	21	1.67	3.33	1.7	5.00	5.80	0.25	1.32	1.63	3.79	5.0	6.7	A++	
9	9	18	2.50	2.50	1.7	5.00	5.80	0.25	1.32	1.63	3.79	5.0	6.7	A++	
9	12	21	2.14	2.86	1.7	5.00	5.80	0.25	1.32	1.63	3.79	5.0	6.7	A++	
9	14	23	1.96	3.04	1.7	5.00	5.80	0.25	1.32	1.63	3.79	5.0	6.7	A++	
12	12	24	2.50	2.50	1.7	5.00	5.80	0.25	1.32	1.63	3.79	5.0	6.7	A++	
12	14	26	2.31	2.69	1.7	5.00	5.8	0.25	1.32	1.63	3.79	5.0	6.7	A++	

NOTES:

- 5: 5,000 Btu/h, 7: 7,000 Btu/h, 9: 9,000 Btu/h, 12: 12,000 Btu/h, 14: 14,000 Btu/h
- The above is the value for connecting with KG models in wall mounted type.
- 2 or more indoor units should be connected.
- Cooling: Indoor temperature of 27 °CDB/19 °CWB and outdoor temperature of 35 °CDB.
- Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)
- The total ability of connected indoor units is from 10,000 Btu/h up to 26,000 Btu/h.

● Heating

Indoor unit combination (Wall-mounted KG/KM type only)

Combination of indoor unit			Rated capacity for each indoor unit (kW)			Total capacity (kW)			Input power (kW)			COP (W/W)	Seasonal data			
Unit		Total	Unit			Min.	Rated	Max.	Min.	Rated	Max.		Pdesign (kW)	SCOP (kWh/kWh)	Energy efficiency class	
1	2		1	2												
7	7	14	2.40	2.40		1.7	4.80	5.60	0.25	0.99	1.35	4.85	3.8	4.7	A++	
7	9	16	2.40	3.00		1.7	5.40	6.40	0.25	1.15	1.60	4.70	4.0	4.7	A++	
7	12	19	2.06	3.54		1.7	5.60	7.00	0.25	1.22	1.80	4.59	4.2	4.7	A++	
7	14	21	1.87	3.73		1.7	5.60	7.00	0.25	1.22	1.80	4.59	4.2	4.7	A++	
9	9	18	2.80	2.80		1.7	5.60	7.00	0.25	1.22	1.80	4.59	4.2	4.7	A++	
9	12	21	2.40	3.20		1.7	5.60	7.00	0.25	1.22	1.80	4.59	4.2	4.7	A++	
9	14	23	2.19	3.41		1.7	5.60	7.00	0.25	1.22	1.80	4.59	4.2	4.7	A++	
12	12	24	2.80	2.80		1.7	5.60	7.00	0.25	1.22	1.80	4.59	4.2	4.7	A++	
12	14	26	2.58	3.02		1.7	5.60	7.00	0.25	1.22	1.80	4.59	4.2	4.7	A++	

Indoor unit combination (All models other than wall-mounted type KG/KM models)

Combination of indoor unit			Rated capacity for each indoor unit (kW)			Total capacity (kW)			Input power (kW)			COP (W/W)	Seasonal data			
Unit		Total	Unit			Min.	Rated	Max.	Min.	Rated	Max.		Pdesign (kW)	SCOP (kWh/kWh)	Energy efficiency class	
1	2		1	2												
5	5	10	1.80	1.80		1.7	3.60	4.20	0.25	0.80	0.94	4.50	2.9	4.1	A+	
5	7	12	1.80	2.40		1.7	4.20	4.90	0.25	0.92	1.18	4.54	3.4	4.1	A+	
5	9	14	1.80	3.00		1.7	4.80	5.60	0.25	1.05	1.41	4.57	3.8	4.1	A+	
5	12	17	1.59	3.81		1.7	5.40	6.40	0.25	1.24	1.76	4.36	4.2	4.0	A+	
5	14	19	1.47	4.13		1.7	5.60	6.60	0.25	1.30	1.88	4.30	4.2	4.0	A+	
7	7	14	2.40	2.40		1.7	4.80	5.60	0.25	1.05	1.41	4.57	3.8	4.1	A+	
7	9	16	2.40	3.00		1.7	5.40	6.40	0.25	1.23	1.68	4.39	4.0	4.0	A+	
7	12	19	2.06	3.54		1.7	5.60	7.00	0.25	1.30	1.88	4.30	4.2	4.0	A+	
7	14	21	1.87	3.73		1.7	5.60	7.00	0.25	1.30	1.88	4.30	4.2	4.0	A+	
9	9	18	2.80	2.80		1.7	5.60	7.00	0.25	1.30	1.88	4.30	4.2	4.0	A+	
9	12	21	2.40	3.20		1.7	5.60	7.00	0.25	1.30	1.88	4.30	4.2	4.0	A+	
9	14	23	2.19	3.41		1.7	5.60	7.00	0.25	1.30	1.88	4.30	4.2	4.0	A+	
12	12	24	2.80	2.80		1.7	5.60	7.00	0.25	1.30	1.88	4.30	4.2	4.0	A+	
12	14	26	2.58	3.02		1.7	5.60	7.00	0.25	1.30	1.88	4.30	4.2	4.0	A+	

NOTES:

- 5: 5,000 Btu/h, 7: 7,000 Btu/h, 9: 9,000 Btu/h, 12: 12,000 Btu/h, 14: 14,000 Btu/h
- The above is the value for connecting with KG models in wall mounted type.
- 2 or more indoor units should be connected.
- Heating: Indoor temperature of 20 °CDB, and outdoor temperature of 7 °CDB/6 °CWB.
- Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)
- The total ability of connected indoor units is from 10,000 Btu/h up to 26,000 Btu/h.

6-2. Cooling capacity

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

■ Model: AOHG14KBTA2

Indoor unit connecting capacity	Outdoor temperature	Indoor temperature											
		18.0 °CDB		21.0 °CDB		23.0 °CDB		27.0 °CDB		29.0 °CDB		32.0 °CDB	
		12.0 °CWB		15.0 °CWB		16.0 °CWB		19.0 °CWB		21.0 °CWB		23.0 °CWB	
kBtu/h	°CDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
21	-10.0	3.60	0.63	4.10	0.64	4.30	0.64	4.60	0.65	4.90	0.66	5.10	0.66
	0.0	3.60	0.28	4.10	0.28	4.30	0.28	4.60	0.29	4.90	0.29	5.10	0.29
	5.0	3.60	0.45	4.10	0.46	4.30	0.46	4.60	0.47	4.90	0.47	5.10	0.47
	10.0	3.60	0.38	4.10	0.38	4.30	0.38	4.60	0.39	4.90	0.39	5.10	0.40
	15.0	3.60	0.50	4.10	0.51	4.30	0.51	4.60	0.52	4.90	0.52	5.10	0.53
	20.0	3.60	0.59	4.10	0.60	4.30	0.61	4.60	0.62	4.90	0.62	5.10	0.63
	25.0	3.60	0.76	4.10	0.78	4.30	0.78	4.60	0.79	4.90	0.80	5.10	0.81
	30.0	3.60	0.91	4.10	1.23	4.30	1.24	4.60	1.25	4.90	1.26	5.10	1.27
	35.0	3.60	1.21	4.10	1.23	4.30	1.24	4.60	1.25	4.90	1.26	5.10	1.27
	40.0	3.10	1.00	3.50	1.02	3.70	1.03	4.00	1.04	4.30	1.05	4.40	1.06
19	46.0	2.70	1.01	3.10	1.03	3.20	1.04	3.50	1.05	3.70	1.06	3.80	1.07
	-10.0	3.60	0.63	4.10	0.64	4.30	0.64	4.60	0.65	4.90	0.66	5.10	0.66
	0.0	3.60	0.28	4.10	0.28	4.30	0.28	4.60	0.29	4.90	0.29	5.10	0.29
	5.0	3.60	0.45	4.10	0.46	4.30	0.46	4.60	0.47	4.90	0.47	5.10	0.47
	10.0	3.60	0.38	4.10	0.38	4.30	0.38	4.60	0.39	4.90	0.39	5.10	0.40
	15.0	3.60	0.50	4.10	0.51	4.30	0.51	4.60	0.52	4.90	0.52	5.10	0.53
	20.0	3.60	0.59	4.10	0.60	4.30	0.61	4.60	0.62	4.90	0.62	5.10	0.63
	25.0	3.60	0.76	4.10	0.78	4.30	0.78	4.60	0.79	4.90	0.80	5.10	0.81
	30.0	3.60	0.91	4.10	0.93	4.30	0.94	4.60	0.95	4.90	0.96	5.10	0.96
	35.0	3.60	1.21	4.10	1.23	4.30	1.24	4.60	1.25	4.90	1.26	5.10	1.27
18	40.0	3.10	1.00	3.50	1.02	3.70	1.03	4.00	1.04	4.30	1.05	4.40	1.06
	46.0	2.70	1.01	3.10	1.03	3.20	1.04	3.50	1.05	3.70	1.06	3.80	1.07
	-10.0	3.60	0.63	4.10	0.64	4.30	0.64	4.60	0.65	4.90	0.66	5.10	0.66
	0.0	3.60	0.28	4.10	0.28	4.30	0.28	4.60	0.29	4.90	0.29	5.10	0.29
	5.0	3.60	0.45	4.10	0.46	4.30	0.46	4.60	0.47	4.90	0.47	5.10	0.47
	10.0	3.60	0.38	4.10	0.38	4.30	0.38	4.60	0.39	4.90	0.39	5.10	0.40
	15.0	3.60	0.50	4.10	0.51	4.30	0.51	4.60	0.52	4.90	0.52	5.10	0.53
	20.0	3.60	0.59	4.10	0.60	4.30	0.61	4.60	0.62	4.90	0.62	5.10	0.63
	25.0	3.60	0.76	4.10	0.78	4.30	0.78	4.60	0.79	4.90	0.80	5.10	0.81
	30.0	3.60	0.91	4.10	0.93	4.30	0.94	4.60	0.95	4.90	0.96	5.10	0.96
17	35.0	3.60	1.21	4.10	1.23	4.30	1.24	4.60	1.25	4.90	1.26	5.10	1.27
	40.0	3.13	1.00	3.54	1.02	3.73	1.03	3.99	1.04	4.27	1.05	4.40	1.06
	46.0	2.72	1.01	3.08	1.03	3.24	1.04	3.47	1.05	3.71	1.06	3.83	1.07
	-10.0	3.61	0.43	4.08	0.44	4.30	0.44	4.60	0.44	4.92	0.45	5.07	0.45
	0.0	3.61	0.28	4.08	0.28	4.30	0.28	4.60	0.29	4.92	0.29	5.07	0.29
	5.0	3.61	0.45	4.08	0.46	4.30	0.46	4.60	0.47	4.92	0.47	5.07	0.47
	10.0	3.61	0.38	4.08	0.38	4.30	0.38	4.60	0.39	4.92	0.39	5.07	0.40
	15.0	3.61	0.50	4.08	0.51	4.30	0.51	4.60	0.52	4.92	0.52	5.07	0.53
	20.0	3.61	0.59	4.08	0.60	4.30	0.61	4.60	0.62	4.90	0.62	5.07	0.63
	25.0	3.61	0.76	4.08	0.78	4.30	0.78	4.60	0.79	4.92	0.80	5.07	0.81
14	30.0	3.61	0.91	4.08	0.93	4.30	0.94	4.60	0.95	4.92	0.96	5.07	0.96
	35.0	3.61	1.21	4.08	1.23	4.30	1.24	4.60	1.25	4.92	1.26	5.07	1.27
	40.0	3.13	1.00	3.54	1.02	3.70	1.03	4.00	1.04	4.30	1.05	4.40	1.06
	46.0	2.70	1.01	3.10	1.03	3.20	1.04	3.50	1.05	3.70	1.06	3.80	1.07
	-10.0	3.60	0.63	4.10	0.64	4.30	0.64	4.60	0.65	4.90	0.66	5.10	0.66
	0.0	3.60	0.28	4.10	0.28	4.30	0.28	4.60	0.29	4.90	0.29	5.10	0.29
	5.0	3.60	0.45	4.10	0.46	4.30	0.46	4.60	0.47	4.90	0.47	5.10	0.47
	10.0	3.60	0.38	4.10	0.38	4.30	0.38	4.60	0.39	4.90	0.39	5.10	0.40
	15.0	3.60	0.50	4.10	0.51	4.30	0.51	4.60	0.52	4.90	0.52	5.10	0.53
	20.0	3.60	0.59	4.10	0.60	4.30	0.61	4.60	0.62	4.90	0.62	5.10	0.63
12	25.0	3.60	0.76	4.10	0.78	4.30	0.78	4.60	0.79	4.90	0.80	5.10	0.81
	30.0	3.60	0.91	4.10	0.93	4.30	0.94	4.60	0.95	4.90	0.96	5.10	0.96
	35.0	3.60	1.21	4.10	1.23	4.30	1.24	4.60	1.25	4.92	1.26	5.07	1.27
	40.0	3.13	1.00	3.54	1.02	3.73	1.03	3.99	1.04	4.27	1.05	4.40	1.06
	46.0	2.72	1.01	3.08	1.03	3.24	1.04	3.47	1.05	3.71	1.06	3.83	1.07
	-10.0	3.37	0.38	3.81	0.38	4.02	0.39	4.30	0.39	4.60	0.40	4.74	0.40
	0.0	3.37	0.24	3.81	0.25	4.02	0.25	4.30	0.25	4.60	0.26	4.74	0.26
	5.0	3.37	0.39	3.81	0.40	4.02	0.40	4.30	0.41	4.60	0.41	4.74	0.42
	10.0	3.37	0.33	3.81	0.34	4.02	0.34	4.30	0.34	4.60	0.35	4.74	0.35
	15.0	3.37	0.44	3.81	0.45	4.02	0.45	4.30	0.46	4.60	0.46	4.74	0.46
10	20.0	3.37	0.52	3.81	0.53	4.02	0.54	4.30	0.54	4.60	0.55	4.74	0.55
	25.0	3.37	0.67	3.81	0.68	4.02	0.69	4.30	0.70	4.60	0.71	4.74	0.71
	30.0	3.37	0.80	3.81	0.82	4.02	0.82	4.30	0.83	4.60	0.84	4.74	0.85
	35.0	3.37	1.06	3.81	1.08	4.02	1.09	4.30	1.10	4.60	1.11	4.74	1.12
	40.0	3.13	1.00	3.54	1.02	3.73	1.03	3.99	1.04	4.27	1.05	4.40	1.06
	46.0	2.72	1.01	3.08	1.03	3.24	1.04	3.47	1.05	3.71	1.06	3.83	1.07
	-10.0	2.82	0.33	3.19	0.33	3.36	0.33	3.60	0.34	3.85	0.34	3.97	0.34
	0.0	2.82	0.21	3.19	0.21	3.36	0.22	3.60	0.22	3.85	0.22	3.97	0.22
	5.0	2.82	0.34	3.19	0.35	3.36	0.35	3.60	0.35	3.85	0.36	3.97	0.36
	10.0	2.82	0.29	3.19	0.29	3.36	0.29	3.60	0.30	3.85	0.30	3.97	0.30
10	15.0	2.82	0.38	3.19	0.39	3.36	0.39	3.60	0.39	3.85	0.40	3.97	0.40
	20.0	2.82	0.45	3.19	0.46	3.36	0.46	3.60	0.47	3.85	0.47	3.97	0.48
	25.0	2.82	0.58	3.19	0.59	3.36	0.60	3.60	0.60	3.85	0.61	3.97	0.61
	30.0	2.82	0.69	3.19	0.70	3.36	0.71	3.60	0.72	3.85	0.73	3.97	0.73
	35.0	2.82	0.92	3.19	0.93	3.36	0.94	3.60	0.95	3.85	0.96	3.97	0.97
	40.0	3.13	1.00	3.54	1.02	3.73	1.03	3.99</					

NOTES:

- TC: Total Capacity (kW), IP: Input Power (kW)
- Values mentioned in the table are based on the following conditions:
 - Power source of specifications: 230 V
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)
- 2 or more indoor units should be connected.
- The total ability of connected indoor unit is from 10,000 Btu/h up to 21,000 Btu/h.
- Input in the table are calculated based on the maximum indoor unit input combinations.

● Compact cassette type

Model: AUXG07KVLA

Outdoor temperature (�b0;CDB)	Indoor temperature (�b0;CDB / �b0;CWB)</th><th data-kind="ghost"></th><th data-kind="ghost"></th></tr> <tr> <th data-kind="ghost"></th><th data-cs="2" data-kind="parent">18.0 / 12.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">21.0 / 15.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">23.0 / 16.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">27.0 / 19.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">29.0 / 21.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">32.0 / 23.0</th><th data-kind="ghost"></th></tr> <tr> <th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th></tr> </thead> <tbody> <tr><td>-10.0</td><td>1.80</td><td>1.22</td><td>2.04</td><td>1.39</td><td>2.15</td><td>1.60</td><td>2.30</td><td>1.79</td><td>2.46</td><td>1.96</td><td>2.53</td><td>2.25</td></tr> <tr><td>0.0</td><td>1.80</td><td>1.22</td><td>2.04</td><td>1.39</td><td>2.15</td><td>1.60</td><td>2.30</td><td>1.79</td><td>2.46</td><td>1.96</td><td>2.53</td><td>2.25</td></tr> <tr><td>5.0</td><td>1.80</td><td>1.22</td><td>2.04</td><td>1.39</td><td>2.15</td><td>1.60</td><td>2.30</td><td>1.79</td><td>2.46</td><td>1.96</td><td>2.53</td><td>2.25</td></tr> <tr><td>10.0</td><td>1.80</td><td>1.22</td><td>2.04</td><td>1.39</td><td>2.15</td><td>1.60</td><td>2.30</td><td>1.79</td><td>2.46</td><td>1.96</td><td>2.53</td><td>2.25</td></tr> <tr><td>15.0</td><td>1.80</td><td>1.22</td><td>2.04</td><td>1.39</td><td>2.15</td><td>1.60</td><td>2.30</td><td>1.79</td><td>2.46</td><td>1.96</td><td>2.53</td><td>2.25</td></tr> <tr><td>20.0</td><td>1.80</td><td>1.22</td><td>2.04</td><td>1.39</td><td>2.15</td><td>1.60</td><td>2.30</td><td>1.79</td><td>2.46</td><td>1.96</td><td>2.53</td><td>2.25</td></tr> <tr><td>25.0</td><td>1.80</td><td>1.22</td><td>2.04</td><td>1.39</td><td>2.15</td><td>1.60</td><td>2.30</td><td>1.79</td><td>2.46</td><td>1.96</td><td>2.53</td><td>2.25</td></tr> <tr><td>30.0</td><td>1.80</td><td>1.22</td><td>2.04</td><td>1.39</td><td>2.15</td><td>1.60</td><td>2.30</td><td>1.79</td><td>2.46</td><td>1.96</td><td>2.53</td><td>2.25</td></tr> <tr><td>35.0</td><td>1.80</td><td>1.22</td><td>2.04</td><td>1.39</td><td>2.15</td><td>1.60</td><td>2.30</td><td>1.79</td><td>2.46</td><td>1.96</td><td>2.53</td><td>2.25</td></tr> <tr><td>40.0</td><td>1.57</td><td>0.92</td><td>1.77</td><td>1.05</td><td>1.87</td><td>1.20</td><td>2.00</td><td>1.35</td><td>2.13</td><td>1.48</td><td>2.20</td><td>1.69</td></tr> <tr><td>46.0</td><td>1.36</td><td>0.69</td><td>1.54</td><td>0.79</td><td>1.62</td><td>0.91</td><td>1.74</td><td>1.02</td><td>1.86</td><td>1.12</td><td>1.91</td><td>1.28</td></tr> </tbody> </table> </div> <div data-bbox="101 242 296 258" data-label="Text"> <p>Model: AUXG09KVLA</p> </div> <div data-bbox="102 264 925 415" data-label="Table"> <table border="1"> <thead> <tr> <th data-kind="parent" data-rs="2">Outdoor temperature (�b0;CDB)</th><th data-cs="12" data-kind="parent">Indoor temperature (�b0;CDB / �b0;CWB)</th><th data-kind="ghost"></th><th data-kind="ghost"></th></tr> <tr> <th data-kind="ghost"></th><th data-cs="2" data-kind="parent">18.0 / 12.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">21.0 / 15.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">23.0 / 16.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">27.0 / 19.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">29.0 / 21.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">32.0 / 23.0</th><th data-kind="ghost"></th></tr> <tr> <th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th></tr> </thead> <tbody> <tr><td>-10.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>0.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>5.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>10.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>15.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>20.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>25.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>30.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>35.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>40.0</td><td>1.76</td><td>1.02</td><td>1.99</td><td>1.16</td><td>2.10</td><td>1.34</td><td>2.25</td><td>1.50</td><td>2.40</td><td>1.64</td><td>2.48</td><td>1.88</td></tr> <tr><td>46.0</td><td>1.53</td><td>0.77</td><td>1.73</td><td>0.88</td><td>1.83</td><td>1.01</td><td>1.96</td><td>1.14</td><td>2.09</td><td>1.24</td><td>2.16</td><td>1.43</td></tr> </tbody> </table> </div> <div data-bbox="101 425 296 441" data-label="Text"> <p>Model: AUXG12KVLA</p> </div> <div data-bbox="102 446 925 600" data-label="Table"> <table border="1"> <thead> <tr> <th data-kind="parent" data-rs="2">Outdoor temperature (�b0;CDB)</th><th data-cs="12" data-kind="parent">Indoor temperature (�b0;CDB / �b0;CWB)</th><th data-kind="ghost"></th><th data-kind="ghost"></th></tr> <tr> <th data-kind="ghost"></th><th data-cs="2" data-kind="parent">18.0 / 12.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">21.0 / 15.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">23.0 / 16.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">27.0 / 19.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">29.0 / 21.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">32.0 / 23.0</th><th data-kind="ghost"></th></tr> <tr> <th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th></tr> </thead> <tbody> <tr><td>-10.0</td><td>2.28</td><td>1.50</td><td>2.58</td><td>1.71</td><td>2.72</td><td>1.97</td><td>2.91</td><td>2.21</td><td>3.11</td><td>2.42</td><td>3.21</td><td>2.77</td></tr> <tr><td>0.0</td><td>2.28</td><td>1.50</td><td>2.58</td><td>1.71</td><td>2.72</td><td>1.97</td><td>2.91</td><td>2.21</td><td>3.11</td><td>2.42</td><td>3.21</td><td>2.77</td></tr> <tr><td>5.0</td><td>2.28</td><td>1.50</td><td>2.58</td><td>1.71</td><td>2.72</td><td>1.97</td><td>2.91</td><td>2.21</td><td>3.11</td><td>2.42</td><td>3.21</td><td>2.77</td></tr> <tr><td>10.0</td><td>2.28</td><td>1.50</td><td>2.58</td><td>1.71</td><td>2.72</td><td>1.97</td><td>2.91</td><td>2.21</td><td>3.11</td><td>2.42</td><td>3.21</td><td>2.77</td></tr> <tr><td>15.0</td><td>2.28</td><td>1.50</td><td>2.58</td><td>1.71</td><td>2.72</td><td>1.97</td><td>2.91</td><td>2.21</td><td>3.11</td><td>2.42</td><td>3.21</td><td>2.77</td></tr> <tr><td>20.0</td><td>2.28</td><td>1.50</td><td>2.58</td><td>1.71</td><td>2.72</td><td>1.97</td><td>2.91</td><td>2.21</td><td>3.11</td><td>2.42</td><td>3.21</td><td>2.77</td></tr> <tr><td>25.0</td><td>2.28</td><td>1.50</td><td>2.58</td><td>1.71</td><td>2.72</td><td>1.97</td><td>2.91</td><td>2.21</td><td>3.11</td><td>2.42</td><td>3.21</td><td>2.77</td></tr> <tr><td>30.0</td><td>2.28</td><td>1.50</td><td>2.58</td><td>1.71</td><td>2.72</td><td>1.97</td><td>2.91</td><td>2.21</td><td>3.11</td><td>2.42</td><td>3.21</td><td>2.77</td></tr> <tr><td>35.0</td><td>2.28</td><td>1.50</td><td>2.58</td><td>1.71</td><td>2.72</td><td>1.97</td><td>2.91</td><td>2.21</td><td>3.11</td><td>2.42</td><td>3.21</td><td>2.77</td></tr> <tr><td>40.0</td><td>1.98</td><td>1.13</td><td>2.24</td><td>1.29</td><td>2.36</td><td>1.48</td><td>2.53</td><td>1.67</td><td>2.70</td><td>1.82</td><td>2.78</td><td>2.09</td></tr> <tr><td>46.0</td><td>1.72</td><td>0.86</td><td>1.95</td><td>0.97</td><td>2.05</td><td>1.12</td><td>2.20</td><td>1.26</td><td>2.35</td><td>1.38</td><td>2.42</td><td>1.58</td></tr> </tbody> </table> </div> <div data-bbox="101 607 176 623" data-label="Section-Header"> <h3>NOTES:</h3> </div> <div data-bbox="109 625 704 678" data-label="List-Group"> • TC: Total Capacity (kW), SHC: Sensible Heat Capacity (kW) • Values mentioned in the table are based on the following conditions: – Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit) </div> <div data-bbox="0 125 38 210" data-label="Page-Header"> <p>OUTDOOR UNIT AOHG14-18KBTA2</p> </div> <div data-bbox="960 125 1000 210" data-label="Page-Header"> <p>OUTDOOR UNIT AOHG14-18KBTA2</p> </div> <div data-bbox="66 965 167 978" data-label="Page-Footer">6-2. Cooling capacity</div> <div data-bbox="477 962 521 976" data-label="Page-Footer">- 383 -</div> <div data-bbox="849 965 933 978" data-label="Page-Footer">6. Capacity table</div>
-------------------------------------	--

● Mini duct type

Model: ARXG07KSLAP

Outdoor temperature (�b0;CDB)	Indoor temperature (�b0;CDB / �b0;CWB)</th><th data-kind="ghost"></th><th data-kind="ghost"></th></tr> <tr> <th data-kind="ghost"></th><th data-cs="2" data-kind="parent">18.0 / 12.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">21.0 / 15.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">23.0 / 16.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">27.0 / 19.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">29.0 / 21.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">32.0 / 23.0</th><th data-kind="ghost"></th></tr> <tr> <th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th></tr> </thead> <tbody> <tr> <td>-10.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr> <td>0.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr> <td>5.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr> <td>10.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr> <td>15.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr> <td>20.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr> <td>25.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr> <td>30.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr> <td>35.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr> <td>40.0</td><td>1.57</td><td>0.94</td><td>1.77</td><td>1.07</td><td>1.87</td><td>1.23</td><td>2.00</td><td>1.39</td><td>2.13</td><td>1.52</td><td>2.20</td><td>1.74</td></tr> <tr> <td>46.0</td><td>1.36</td><td>0.71</td><td>1.54</td><td>0.81</td><td>1.62</td><td>0.93</td><td>1.74</td><td>1.05</td><td>1.86</td><td>1.15</td><td>1.91</td><td>1.31</td></tr> </tbody> </table> </div> <div data-bbox="101 242 307 258" data-label="Text"> <p>Model: ARXG09KSLAP</p> </div> <div data-bbox="102 264 925 415" data-label="Table"> <table border="1"> <thead> <tr> <th data-kind="parent" data-rs="2">Outdoor temperature (�b0;CDB)</th><th data-cs="12" data-kind="parent">Indoor temperature (�b0;CDB / �b0;CWB)</th><th data-kind="ghost"></th><th data-kind="ghost"></th></tr> <tr> <th data-kind="ghost"></th><th data-cs="2" data-kind="parent">18.0 / 12.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">21.0 / 15.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">23.0 / 16.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">27.0 / 19.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">29.0 / 21.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">32.0 / 23.0</th><th data-kind="ghost"></th></tr> <tr> <th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th></tr> </thead> <tbody> <tr> <td>-10.0</td><td>2.03</td><td>1.30</td><td>2.29</td><td>1.48</td><td>2.42</td><td>1.71</td><td>2.59</td><td>1.92</td><td>2.77</td><td>2.10</td><td>2.85</td><td>2.40</td></tr> <tr> <td>0.0</td><td>2.03</td><td>1.30</td><td>2.29</td><td>1.48</td><td>2.42</td><td>1.71</td><td>2.59</td><td>1.92</td><td>2.77</td><td>2.10</td><td>2.85</td><td>2.40</td></tr> <tr> <td>5.0</td><td>2.03</td><td>1.30</td><td>2.29</td><td>1.48</td><td>2.42</td><td>1.71</td><td>2.59</td><td>1.92</td><td>2.77</td><td>2.10</td><td>2.85</td><td>2.40</td></tr> <tr> <td>10.0</td><td>2.03</td><td>1.30</td><td>2.29</td><td>1.48</td><td>2.42</td><td>1.71</td><td>2.59</td><td>1.92</td><td>2.77</td><td>2.10</td><td>2.85</td><td>2.40</td></tr> <tr> <td>15.0</td><td>2.03</td><td>1.30</td><td>2.29</td><td>1.48</td><td>2.42</td><td>1.71</td><td>2.59</td><td>1.92</td><td>2.77</td><td>2.10</td><td>2.85</td><td>2.40</td></tr> <tr> <td>20.0</td><td>2.03</td><td>1.30</td><td>2.29</td><td>1.48</td><td>2.42</td><td>1.71</td><td>2.59</td><td>1.92</td><td>2.77</td><td>2.10</td><td>2.85</td><td>2.40</td></tr> <tr> <td>25.0</td><td>2.03</td><td>1.30</td><td>2.29</td><td>1.48</td><td>2.42</td><td>1.71</td><td>2.59</td><td>1.92</td><td>2.77</td><td>2.10</td><td>2.85</td><td>2.40</td></tr> <tr> <td>30.0</td><td>2.03</td><td>1.30</td><td>2.29</td><td>1.48</td><td>2.42</td><td>1.71</td><td>2.59</td><td>1.92</td><td>2.77</td><td>2.10</td><td>2.85</td><td>2.40</td></tr> <tr> <td>35.0</td><td>2.03</td><td>1.30</td><td>2.29</td><td>1.48</td><td>2.42</td><td>1.71</td><td>2.59</td><td>1.92</td><td>2.77</td><td>2.10</td><td>2.85</td><td>2.40</td></tr> <tr> <td>40.0</td><td>1.76</td><td>0.98</td><td>1.99</td><td>1.12</td><td>2.10</td><td>1.29</td><td>2.25</td><td>1.44</td><td>2.40</td><td>1.58</td><td>2.48</td><td>1.81</td></tr> <tr> <td>46.0</td><td>1.53</td><td>0.74</td><td>1.73</td><td>0.84</td><td>1.83</td><td>0.97</td><td>1.96</td><td>1.09</td><td>2.09</td><td>1.20</td><td>2.16</td><td>1.37</td></tr> </tbody> </table> </div> <div data-bbox="101 425 307 441" data-label="Text"> <p>Model: ARXG12KSLAP</p> </div> <div data-bbox="102 446 925 600" data-label="Table"> <table border="1"> <thead> <tr> <th data-kind="parent" data-rs="2">Outdoor temperature (�b0;CDB)</th><th data-cs="12" data-kind="parent">Indoor temperature (�b0;CDB / �b0;CWB)</th><th data-kind="ghost"></th><th data-kind="ghost"></th></tr> <tr> <th data-kind="ghost"></th><th data-cs="2" data-kind="parent">18.0 / 12.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">21.0 / 15.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">23.0 / 16.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">27.0 / 19.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">29.0 / 21.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">32.0 / 23.0</th><th data-kind="ghost"></th></tr> <tr> <th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th></tr> </thead> <tbody> <tr> <td>-10.0</td><td>2.28</td><td>1.46</td><td>2.58</td><td>1.66</td><td>2.72</td><td>1.92</td><td>2.91</td><td>2.15</td><td>3.11</td><td>2.36</td><td>3.21</td><td>2.70</td></tr> <tr> <td>0.0</td><td>2.28</td><td>1.46</td><td>2.58</td><td>1.66</td><td>2.72</td><td>1.92</td><td>2.91</td><td>2.15</td><td>3.11</td><td>2.36</td><td>3.21</td><td>2.70</td></tr> <tr> <td>5.0</td><td>2.28</td><td>1.46</td><td>2.58</td><td>1.66</td><td>2.72</td><td>1.92</td><td>2.91</td><td>2.15</td><td>3.11</td><td>2.36</td><td>3.21</td><td>2.70</td></tr> <tr> <td>10.0</td><td>2.28</td><td>1.46</td><td>2.58</td><td>1.66</td><td>2.72</td><td>1.92</td><td>2.91</td><td>2.15</td><td>3.11</td><td>2.36</td><td>3.21</td><td>2.70</td></tr> <tr> <td>15.0</td><td>2.28</td><td>1.46</td><td>2.58</td><td>1.66</td><td>2.72</td><td>1.92</td><td>2.91</td><td>2.15</td><td>3.11</td><td>2.36</td><td>3.21</td><td>2.70</td></tr> <tr> <td>20.0</td><td>2.28</td><td>1.46</td><td>2.58</td><td>1.66</td><td>2.72</td><td>1.92</td><td>2.91</td><td>2.15</td><td>3.11</td><td>2.36</td><td>3.21</td><td>2.70</td></tr> <tr> <td>25.0</td><td>2.28</td><td>1.46</td><td>2.58</td><td>1.66</td><td>2.72</td><td>1.92</td><td>2.91</td><td>2.15</td><td>3.11</td><td>2.36</td><td>3.21</td><td>2.70</td></tr> <tr> <td>30.0</td><td>2.28</td><td>1.46</td><td>2.58</td><td>1.66</td><td>2.72</td><td>1.92</td><td>2.91</td><td>2.15</td><td>3.11</td><td>2.36</td><td>3.21</td><td>2.70</td></tr> <tr> <td>35.0</td><td>2.28</td><td>1.46</td><td>2.58</td><td>1.66</td><td>2.72</td><td>1.92</td><td>2.91</td><td>2.15</td><td>3.11</td><td>2.36</td><td>3.21</td><td>2.70</td></tr> <tr> <td>40.0</td><td>1.98</td><td>1.10</td><td>2.24</td><td>1.25</td><td>2.36</td><td>1.44</td><td>2.53</td><td>1.62</td><td>2.70</td><td>1.78</td><td>2.78</td><td>2.03</td></tr> <tr> <td>46.0</td><td>1.72</td><td>0.83</td><td>1.95</td><td>0.95</td><td>2.05</td><td>1.09</td><td>2.20</td><td>1.23</td><td>2.35</td><td>1.34</td><td>2.42</td><td>1.54</td></tr> </tbody> </table> </div> <div data-bbox="101 607 176 623" data-label="Section-Header"> <h3>NOTES:</h3> </div> <div data-bbox="109 625 700 678" data-label="List-Group"> • TC: Total Capacity (kW), SHC: Sensible Heat Capacity (kW) • Values mentioned in the table are based on the following conditions: – Pipe length: 5 m, Height difference: 0 m [Outdoor unit—Indoor unit] </div> <div data-bbox="0 125 37 212" data-label="Page-Header"> <p>OUTDOOR UNIT AOHG14-18KBTA2</p> </div> <div data-bbox="960 125 1000 212" data-label="Page-Header"> <p>OUTDOOR UNIT AOHG14-18KBTA2</p> </div> <div data-bbox="66 965 167 978" data-label="Page-Footer"> <p>6-2. Cooling capacity</p> </div> <div data-bbox="477 962 521 976" data-label="Page-Footer"> <p>- 384 -</p> </div> <div data-bbox="847 965 933 978" data-label="Page-Footer"> <p>6. Capacity table</p> </div>
-------------------------------------	--

● Slim duct type

Model: ARXG07KLLAP

Outdoor temperature (�b0;CDB)	Indoor temperature (�b0;CDB / �b0;CWB)</th><th data-kind="ghost"></th><th data-kind="ghost"></th></tr> <tr> <th data-kind="ghost"></th><th data-cs="2" data-kind="parent">18.0 / 12.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">21.0 / 15.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">23.0 / 16.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">27.0 / 19.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">29.0 / 21.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">32.0 / 23.0</th><th data-kind="ghost"></th></tr> <tr> <th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th></tr> </thead> <tbody> <tr><td>-10.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr><td>0.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr><td>5.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr><td>10.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr><td>15.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr><td>20.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr><td>25.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr><td>30.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr><td>35.0</td><td>1.80</td><td>1.25</td><td>2.04</td><td>1.42</td><td>2.15</td><td>1.64</td><td>2.30</td><td>1.84</td><td>2.46</td><td>2.01</td><td>2.53</td><td>2.31</td></tr> <tr><td>40.0</td><td>1.57</td><td>0.94</td><td>1.77</td><td>1.07</td><td>1.87</td><td>1.23</td><td>2.00</td><td>1.39</td><td>2.13</td><td>1.52</td><td>2.20</td><td>1.74</td></tr> <tr><td>46.0</td><td>1.36</td><td>0.71</td><td>1.54</td><td>0.81</td><td>1.62</td><td>0.93</td><td>1.74</td><td>1.05</td><td>1.86</td><td>1.15</td><td>1.91</td><td>1.31</td></tr> </tbody> </table> </div> <div data-bbox="101 242 306 258" data-label="Text"> <p>Model: ARXG09KLLAP</p> </div> <div data-bbox="102 264 925 415" data-label="Table"> <table border="1"> <thead> <tr> <th data-kind="parent" data-rs="2">Outdoor temperature (�b0;CDB)</th><th data-cs="12" data-kind="parent">Indoor temperature (�b0;CDB / �b0;CWB)</th><th data-kind="ghost"></th><th data-kind="ghost"></th></tr> <tr> <th data-kind="ghost"></th><th data-cs="2" data-kind="parent">18.0 / 12.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">21.0 / 15.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">23.0 / 16.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">27.0 / 19.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">29.0 / 21.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">32.0 / 23.0</th><th data-kind="ghost"></th></tr> <tr> <th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th></tr> </thead> <tbody> <tr><td>-10.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>0.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>5.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>10.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>15.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>20.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>25.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>30.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>35.0</td><td>2.03</td><td>1.35</td><td>2.29</td><td>1.54</td><td>2.42</td><td>1.78</td><td>2.59</td><td>1.99</td><td>2.77</td><td>2.18</td><td>2.85</td><td>2.50</td></tr> <tr><td>40.0</td><td>1.76</td><td>1.02</td><td>1.99</td><td>1.16</td><td>2.10</td><td>1.34</td><td>2.25</td><td>1.50</td><td>2.40</td><td>1.64</td><td>2.48</td><td>1.88</td></tr> <tr><td>46.0</td><td>1.53</td><td>0.77</td><td>1.73</td><td>0.88</td><td>1.83</td><td>1.01</td><td>1.96</td><td>1.14</td><td>2.09</td><td>1.24</td><td>2.16</td><td>1.43</td></tr> </tbody> </table> </div> <div data-bbox="101 425 306 441" data-label="Text"> <p>Model: ARXG12KLLAP</p> </div> <div data-bbox="102 446 925 600" data-label="Table"> <table border="1"> <thead> <tr> <th data-kind="parent" data-rs="2">Outdoor temperature (�b0;CDB)</th><th data-cs="12" data-kind="parent">Indoor temperature (�b0;CDB / �b0;CWB)</th><th data-kind="ghost"></th><th data-kind="ghost"></th></tr> <tr> <th data-kind="ghost"></th><th data-cs="2" data-kind="parent">18.0 / 12.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">21.0 / 15.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">23.0 / 16.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">27.0 / 19.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">29.0 / 21.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">32.0 / 23.0</th><th data-kind="ghost"></th></tr> <tr> <th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th></tr> </thead> <tbody> <tr><td>-10.0</td><td>2.28</td><td>1.54</td><td>2.58</td><td>1.75</td><td>2.72</td><td>2.02</td><td>2.91</td><td>2.27</td><td>3.11</td><td>2.48</td><td>3.21</td><td>2.84</td></tr> <tr><td>0.0</td><td>2.28</td><td>1.54</td><td>2.58</td><td>1.75</td><td>2.72</td><td>2.02</td><td>2.91</td><td>2.27</td><td>3.11</td><td>2.48</td><td>3.21</td><td>2.84</td></tr> <tr><td>5.0</td><td>2.28</td><td>1.54</td><td>2.58</td><td>1.75</td><td>2.72</td><td>2.02</td><td>2.91</td><td>2.27</td><td>3.11</td><td>2.48</td><td>3.21</td><td>2.84</td></tr> <tr><td>10.0</td><td>2.28</td><td>1.54</td><td>2.58</td><td>1.75</td><td>2.72</td><td>2.02</td><td>2.91</td><td>2.27</td><td>3.11</td><td>2.48</td><td>3.21</td><td>2.84</td></tr> <tr><td>15.0</td><td>2.28</td><td>1.54</td><td>2.58</td><td>1.75</td><td>2.72</td><td>2.02</td><td>2.91</td><td>2.27</td><td>3.11</td><td>2.48</td><td>3.21</td><td>2.84</td></tr> <tr><td>20.0</td><td>2.28</td><td>1.54</td><td>2.58</td><td>1.75</td><td>2.72</td><td>2.02</td><td>2.91</td><td>2.27</td><td>3.11</td><td>2.48</td><td>3.21</td><td>2.84</td></tr> <tr><td>25.0</td><td>2.28</td><td>1.54</td><td>2.58</td><td>1.75</td><td>2.72</td><td>2.02</td><td>2.91</td><td>2.27</td><td>3.11</td><td>2.48</td><td>3.21</td><td>2.84</td></tr> <tr><td>30.0</td><td>2.28</td><td>1.54</td><td>2.58</td><td>1.75</td><td>2.72</td><td>2.02</td><td>2.91</td><td>2.27</td><td>3.11</td><td>2.48</td><td>3.21</td><td>2.84</td></tr> <tr><td>35.0</td><td>2.28</td><td>1.54</td><td>2.58</td><td>1.75</td><td>2.72</td><td>2.02</td><td>2.91</td><td>2.27</td><td>3.11</td><td>2.48</td><td>3.21</td><td>2.84</td></tr> <tr><td>40.0</td><td>1.98</td><td>1.16</td><td>2.24</td><td>1.32</td><td>2.36</td><td>1.52</td><td>2.53</td><td>1.71</td><td>2.70</td><td>1.87</td><td>2.78</td><td>2.14</td></tr> <tr><td>46.0</td><td>1.72</td><td>0.88</td><td>1.95</td><td>1.00</td><td>2.05</td><td>1.15</td><td>2.20</td><td>1.29</td><td>2.35</td><td>1.42</td><td>2.42</td><td>1.62</td></tr> </tbody> </table> </div> <div data-bbox="101 607 177 623" data-label="Section-Header"> <h3>NOTES:</h3> </div> <div data-bbox="109 625 704 678" data-label="List-Group"> • TC: Total Capacity (kW), SHC: Sensible Heat Capacity (kW) • Values mentioned in the table are based on the following conditions: – Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit) </div> <div data-bbox="0 125 37 212" data-label="Page-Header"> <p>OUTDOOR UNIT AOHG14-18KBTA2</p> </div> <div data-bbox="958 125 1000 212" data-label="Page-Header"> <p>OUTDOOR UNIT AOHG14-18KBTA2</p> </div> <div data-bbox="66 965 167 978" data-label="Page-Footer">6-2. Cooling capacity</div> <div data-bbox="477 962 521 976" data-label="Page-Footer">- 385 -</div> <div data-bbox="847 965 933 978" data-label="Page-Footer">6. Capacity table</div>
-------------------------------------	--

● Medium static pressure duct type

Model: ARXH12KMTAP

OUTDOOR UNIT
AOHG14-18KBTA2

OUTDOOR UNIT
AOHG14-18KBTA2

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	2.28	1.54	2.58	1.75	2.72	2.02	2.91	2.27	3.11	2.48	3.21	2.84
0.0	2.28	1.54	2.58	1.75	2.72	2.02	2.91	2.27	3.11	2.48	3.21	2.84
5.0	2.28	1.54	2.58	1.75	2.72	2.02	2.91	2.27	3.11	2.48	3.21	2.84
10.0	2.28	1.54	2.58	1.75	2.72	2.02	2.91	2.27	3.11	2.48	3.21	2.84
15.0	2.28	1.54	2.58	1.75	2.72	2.02	2.91	2.27	3.11	2.48	3.21	2.84
20.0	2.28	1.54	2.58	1.75	2.72	2.02	2.91	2.27	3.11	2.48	3.21	2.84
25.0	2.28	1.54	2.58	1.75	2.72	2.02	2.91	2.27	3.11	2.48	3.21	2.84
30.0	2.28	1.54	2.58	1.75	2.72	2.02	2.91	2.27	3.11	2.48	3.21	2.84
35.0	2.28	1.54	2.58	1.75	2.72	2.02	2.91	2.27	3.11	2.48	3.21	2.84
40.0	1.98	1.16	2.24	1.32	2.36	1.52	2.53	1.71	2.70	1.87	2.78	2.14
46.0	1.72	0.88	1.95	1.00	2.05	1.15	2.20	1.29	2.35	1.42	2.42	1.62

NOTES:

- TC: Total Capacity (kW), SHC: Sensible Heat Capacity (kW).
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Wall mounted type

Models: ASHG07KMTB, ASHG07KMCC, ASHG07KMCE, ASHG07KMCF, ASHH07KMCG, ASH-H07KMCG-B, ASHH07KMCH, and ASHH07KMCH-B

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
0.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
5.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
10.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
15.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
20.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
25.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
30.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
35.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
40.0	1.57	0.76	1.77	0.87	1.87	1.00	2.00	1.13	2.13	1.23	2.20	1.41
46.0	1.36	0.58	1.54	0.66	1.62	0.76	1.74	0.85	1.86	0.93	1.91	1.07

Models: ASHG09KMTB, ASHG09KMCC, ASHG09KMCE, ASHG09KMCF, ASHH09KMCG, ASH-H09KMCG-B, ASHH09KMCH, and ASHH09KMCH-B

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
0.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
5.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
10.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
15.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
20.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
25.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
30.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
35.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
40.0	1.76	0.86	1.99	0.98	2.10	1.13	2.25	1.27	2.40	1.39	2.48	1.59
46.0	1.53	0.65	1.73	0.74	1.83	0.85	1.96	0.96	2.09	1.05	2.16	1.20

Models: ASHG12KMTB, ASHG12KMCC, ASHG12KMCE, ASHG12KMCF, ASHH12KMCG, ASH-H12KMCG-B, ASHH12KMCH, and ASHH12KMCH-B

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
0.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
5.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
10.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
15.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
20.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
25.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
30.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
35.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
40.0	1.98	0.97	2.24	1.10	2.36	1.27	2.53	1.43	2.70	1.56	2.78	1.79
46.0	1.72	0.73	1.95	0.83	2.05	0.96	2.20	1.08	2.35	1.18	2.42	1.35

Models: ASHG07KETA, ASHG07KETA-B, ASHG07KETE, ASHG07KETE-B, ASHG07KETF, and ASHG07KETF-B

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
0.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
5.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
10.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
15.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
20.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
25.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
30.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
35.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
40.0	1.57	0.76	1.77	0.87	1.87	1.00	2.00	1.13	2.13	1.23	2.20	1.41
46.0	1.36	0.58	1.54	0.66	1.62	0.76	1.74	0.85	1.86	0.93	1.91	1.07

Models: ASHG09KETA, ASHG09KETA-B, ASHG09KETE, ASHG09KETE-B, ASHG09KETF, and ASHG09KETF-B

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
0.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
5.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
10.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
15.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
20.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
25.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
30.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
35.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
40.0	1.76	0.86	1.99	0.98	2.10	1.13	2.25	1.27	2.40	1.39	2.48	1.59
46.0	1.53	0.65	1.73	0.74	1.83	0.85	1.96	0.96	2.09	1.05	2.16	1.20

Models: ASHG12KETA, ASHG12KETA-B, ASHG12KETE, ASHG12KETE-B, ASHG12KETF, and ASHG12KETF-B

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
0.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
5.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
10.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
15.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
20.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
25.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
30.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
35.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
40.0	1.98	0.97	2.24	1.10	2.36	1.27	2.53	1.43	2.70	1.56	2.78	1.79
46.0	1.72	0.73	1.95	0.83	2.05	0.96	2.20	1.08	2.35	1.18	2.42	1.35

Models: ASHG07KGTB, ASHG07KGTE, ASHG07KGTF, ASHH07KG TG, and ASHH07KGTH

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
0.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
5.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
10.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
15.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
20.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
25.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
30.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
35.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
40.0	1.57	0.76	1.77	0.87	1.87	1.00	2.00	1.13	2.13	1.23	2.20	1.41
46.0	1.36	0.58	1.54	0.66	1.62	0.76	1.74	0.85	1.86	0.93	1.91	1.07

Models: ASHG09KGTB, ASHG09KGTE, ASHG09KGTF, ASHH09KG TG, and ASHH09KGTH

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
0.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
5.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
10.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
15.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
20.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
25.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
30.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
35.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
40.0	1.76	0.86	1.99	0.98	2.10	1.13	2.25	1.27	2.40	1.39	2.48	1.59
46.0	1.53	0.65	1.73	0.74	1.83	0.85	1.96	0.96	2.09	1.05	2.16	1.20

Models: ASHG12KG TB, ASHG12KG TE, ASHG12KG TF, ASHH12KG TG, and ASHH12KG TH

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
0.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
5.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
10.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
15.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
20.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
25.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
30.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
35.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
40.0	1.98	0.97	2.24	1.10	2.36	1.27	2.53	1.43	2.70	1.56	2.78	1.79
46.0	1.72	0.73	1.95	0.83	2.05	0.96	2.20	1.08	2.35	1.18	2.42	1.35

Models: ASHH05KNCA and ASHH05KNCH

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
-5.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
0.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
5.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
10.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
15.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
20.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
25.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
30.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
35.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
40.0	1.23	0.60	1.38	0.68	1.46	0.78	1.56	0.88	1.67	0.96	1.72	1.11
46.0	1.07	0.45	1.20	0.52	1.27	0.59	1.36	0.67	1.45	0.73	1.50	0.84

Models: ASHH07KNCA and ASHH07KNCH

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
-5.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
0.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
5.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
10.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
15.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
20.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
25.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
30.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
35.0	1.80	1.01	2.04	1.16	2.15	1.33	2.30	1.50	2.46	1.64	2.53	1.87
40.0	1.57	0.76	1.77	0.87	1.87	1.00	2.00	1.13	2.13	1.23	2.20	1.41
46.0	1.36	0.58	1.54	0.66	1.62	0.76	1.74	0.85	1.86	0.93	1.91	1.07

Models: ASHH09KNCA and ASHH09KNCH

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
-5.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
0.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
5.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
10.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
15.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
20.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
25.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
30.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
35.0	2.03	1.14	2.29	1.30	2.42	1.50	2.59	1.68	2.77	1.84	2.85	2.11
40.0	1.76	0.86	1.99	0.98	2.10	1.13	2.25	1.27	2.40	1.39	2.48	1.59
46.0	1.53	0.65	1.73	0.74	1.83	0.85	1.96	0.96	2.09	1.05	2.16	1.20

Models: ASHH12KNCA and ASHH12KNCH

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
-5.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
0.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
5.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
10.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
15.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
20.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
25.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
30.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
35.0	2.28	1.28	2.58	1.46	2.72	1.68	2.91	1.89	3.11	2.07	3.21	2.37
40.0	1.98	0.97	2.24	1.10	2.36	1.27	2.53	1.43	2.70	1.56	2.78	1.79
46.0	1.72	0.73	1.95	0.83	2.05	0.96	2.20	1.08	2.35	1.18	2.42	1.35

NOTES:

- TC: Total Capacity (kW), SHC: Sensible Heat Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Floor type

Model: AGHG09KVCA

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	2.03	1.39	2.29	1.58	2.42	1.82	2.59	2.05	2.77	2.24	2.85	2.56
-5.0	2.03	1.39	2.29	1.58	2.42	1.82	2.59	2.05	2.77	2.24	2.85	2.56
0.0	2.03	1.39	2.29	1.58	2.42	1.82	2.59	2.05	2.77	2.24	2.85	2.56
5.0	2.03	1.39	2.29	1.58	2.42	1.82	2.59	2.05	2.77	2.24	2.85	2.56
10.0	2.03	1.39	2.29	1.58	2.42	1.82	2.59	2.05	2.77	2.24	2.85	2.56
15.0	2.03	1.39	2.29	1.58	2.42	1.82	2.59	2.05	2.77	2.24	2.85	2.56
20.0	2.03	1.39	2.29	1.58	2.42	1.82	2.59	2.05	2.77	2.24	2.85	2.56
25.0	2.03	1.39	2.29	1.58	2.42	1.82	2.59	2.05	2.77	2.24	2.85	2.56
30.0	2.03	1.39	2.29	1.58	2.42	1.82	2.59	2.05	2.77	2.24	2.85	2.56
35.0	2.03	1.39	2.29	1.58	2.42	1.82	2.59	2.05	2.77	2.24	2.85	2.56
40.0	1.76	1.05	1.99	1.19	2.10	1.37	2.25	1.54	2.40	1.69	2.48	1.93
46.0	1.53	0.79	1.73	0.90	1.83	1.04	1.96	1.17	2.09	1.28	2.16	1.46

Model: AGHG12KVCA

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	2.28	1.46	2.58	1.66	2.72	1.92	2.91	2.15	3.11	2.36	3.21	2.70
-5.0	2.28	1.46	2.58	1.66	2.72	1.92	2.91	2.15	3.11	2.36	3.21	2.70
0.0	2.28	1.46	2.58	1.66	2.72	1.92	2.91	2.15	3.11	2.36	3.21	2.70
5.0	2.28	1.46	2.58	1.66	2.72	1.92	2.91	2.15	3.11	2.36	3.21	2.70
10.0	2.28	1.46	2.58	1.66	2.72	1.92	2.91	2.15	3.11	2.36	3.21	2.70
15.0	2.28	1.46	2.58	1.66	2.72	1.92	2.91	2.15	3.11	2.36	3.21	2.70
20.0	2.28	1.46	2.58	1.66	2.72	1.92	2.91	2.15	3.11	2.36	3.21	2.70
25.0	2.28	1.46	2.58	1.66	2.72	1.92	2.91	2.15	3.11	2.36	3.21	2.70
30.0	2.28	1.46	2.58	1.66	2.72	1.92	2.91	2.15	3.11	2.36	3.21	2.70
35.0	2.28	1.46	2.58	1.66	2.72	1.92	2.91	2.15	3.11	2.36	3.21	2.70
40.0	1.98	1.10	2.24	1.25	2.36	1.44	2.53	1.62	2.70	1.78	2.78	2.03
46.0	1.72	0.83	1.95	0.95	2.05	1.09	2.20	1.23	2.35	1.34	2.42	1.54

NOTES:

- TC: Total Capacity (kW), SHC: Sensible Heat Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

■ Model: AOHG18KBTA2

OUTDOOR UNIT
AOHG14-18KBTA2OUTDOOR UNIT
AOHG14-18KBTA2

Indoor unit connect-ing capacity	Outdoor temperature	Indoor temperature											
		18.0 °CDB		21.0 °CDB		23.0 °CDB		27.0 °CDB		29.0 °CDB		32.0 °CDB	
		12.0 °CWB		15.0 °CWB		16.0 °CWB		19.0 °CWB		21.0 °CWB		23.0 °CWB	
kBtu/h	°CDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
26	-10.0	4.50	0.80	5.10	0.81	5.40	0.82	5.80	0.83	6.20	0.84	6.40	0.84
	0.0	4.50	1.04	5.10	1.05	5.40	1.06	5.80	1.07	6.20	1.09	6.40	1.09
	5.0	4.50	0.88	5.10	0.90	5.40	0.90	5.80	0.91	6.20	0.92	6.40	0.93
	10.0	4.50	0.48	5.10	0.49	5.40	0.50	5.80	0.50	6.20	0.51	6.40	0.51
	15.0	4.50	0.64	5.10	0.65	5.40	0.66	5.80	0.67	6.20	0.67	6.40	0.68
	20.0	4.50	0.85	5.10	0.86	5.40	0.87	5.80	0.88	6.20	0.89	6.40	0.89
	25.0	4.50	1.05	5.10	1.07	5.40	1.08	5.80	1.09	6.20	1.10	6.40	1.11
	30.0	4.50	1.22	5.10	1.24	5.40	1.25	5.80	1.27	6.20	1.28	6.40	1.29
	35.0	4.50	1.57	5.10	1.60	5.40	1.61	5.80	1.63	6.20	1.65	6.40	1.66
	40.0	3.60	1.28	4.00	1.30	4.30	1.31	4.60	1.32	4.90	1.34	5.00	1.35
24	46.0	2.60	0.99	2.90	1.00	3.10	1.01	3.30	1.02	3.60	1.03	3.70	1.04
	-10.0	4.50	0.80	5.10	0.81	5.40	0.82	5.80	0.83	6.20	0.84	6.40	0.84
	0.0	4.50	1.04	5.10	1.05	5.40	1.06	5.80	1.07	6.20	1.09	6.40	1.09
	5.0	4.50	0.88	5.10	0.90	5.40	0.90	5.80	0.91	6.20	0.92	6.40	0.93
	10.0	4.50	0.48	5.10	0.49	5.40	0.50	5.80	0.50	6.20	0.51	6.40	0.51
	15.0	4.50	0.64	5.10	0.65	5.40	0.66	5.80	0.67	6.20	0.67	6.40	0.68
	20.0	4.50	0.85	5.10	0.86	5.40	0.87	5.80	0.88	6.20	0.89	6.40	0.89
	25.0	4.50	1.05	5.10	1.07	5.40	1.08	5.80	1.09	6.20	1.10	6.40	1.11
	30.0	4.50	1.22	5.10	1.24	5.40	1.25	5.80	1.27	6.20	1.28	6.40	1.29
	35.0	4.50	1.57	5.10	1.60	5.40	1.61	5.80	1.63	6.20	1.65	6.40	1.66
23	40.0	3.60	1.28	4.00	1.30	4.30	1.31	4.60	1.32	4.90	1.34	5.00	1.35
	46.0	2.60	0.99	2.90	1.00	3.10	1.01	3.30	1.02	3.60	1.03	3.70	1.04
	-10.0	4.50	0.80	5.10	0.81	5.40	0.82	5.80	0.83	6.20	0.84	6.40	0.84
	0.0	4.50	1.04	5.10	1.05	5.40	1.06	5.80	1.07	6.20	1.09	6.40	1.09
	5.0	4.50	0.88	5.10	0.90	5.40	0.90	5.80	0.91	6.20	0.92	6.40	0.93
	10.0	4.50	0.48	5.10	0.49	5.40	0.50	5.80	0.50	6.20	0.51	6.40	0.51
	15.0	4.50	0.64	5.10	0.65	5.40	0.66	5.80	0.67	6.20	0.67	6.40	0.68
	20.0	4.50	0.85	5.10	0.86	5.40	0.87	5.80	0.88	6.20	0.89	6.40	0.89
	25.0	4.50	1.05	5.10	1.07	5.40	1.08	5.80	1.09	6.20	1.10	6.40	1.11
	30.0	4.50	1.22	5.10	1.24	5.40	1.25	5.80	1.27	6.20	1.28	6.40	1.29
21	35.0	4.50	1.57	5.10	1.60	5.40	1.61	5.80	1.63	6.20	1.65	6.40	1.66
	40.0	3.60	1.28	4.00	1.30	4.30	1.31	4.60	1.32	4.90	1.34	5.00	1.35
	46.0	2.60	0.99	2.90	1.00	3.10	1.01	3.30	1.02	3.60	1.03	3.70	1.04
	-10.0	4.50	0.80	5.10	0.81	5.40	0.82	5.80	0.83	6.20	0.84	6.40	0.84
	0.0	4.50	1.04	5.10	1.05	5.40	1.06	5.80	1.07	6.20	1.09	6.40	1.09
	5.0	4.50	0.88	5.10	0.90	5.40	0.90	5.80	0.91	6.20	0.92	6.40	0.93
	10.0	4.50	0.48	5.10	0.49	5.40	0.50	5.80	0.50	6.20	0.51	6.40	0.51
	15.0	4.50	0.64	5.10	0.65	5.40	0.66	5.80	0.67	6.20	0.67	6.40	0.68
	20.0	4.50	0.85	5.10	0.86	5.40	0.87	5.80	0.88	6.20	0.89	6.40	0.89
	25.0	4.50	1.05	5.10	1.07	5.40	1.08	5.80	1.09	6.20	1.10	6.40	1.11
19	30.0	4.50	1.22	5.10	1.24	5.40	1.25	5.80	1.27	6.20	1.28	6.40	1.29
	35.0	4.50	1.57	5.10	1.60	5.40	1.61	5.80	1.63	6.20	1.65	6.40	1.66
	40.0	3.60	1.28	4.00	1.30	4.30	1.31	4.60	1.32	4.90	1.34	5.00	1.35
	46.0	2.60	0.99	2.90	1.00	3.10	1.01	3.30	1.02	3.60	1.03	3.70	1.04
	-10.0	4.50	0.80	5.10	0.81	5.40	0.82	5.80	0.83	6.20	0.84	6.40	0.84
	0.0	4.50	1.04	5.10	1.05	5.40	1.06	5.80	1.07	6.20	1.09	6.40	1.09
	5.0	4.50	0.88	5.10	0.90	5.40	0.90	5.80	0.91	6.20	0.92	6.40	0.93
	10.0	4.50	0.48	5.10	0.49	5.40	0.50	5.80	0.50	6.20	0.51	6.40	0.51
	15.0	4.50	0.64	5.10	0.65	5.40	0.66	5.80	0.67	6.20	0.67	6.40	0.68
	20.0	4.50	0.85	5.10	0.86	5.40	0.87	5.80	0.88	6.20	0.89	6.40	0.89
18	25.0	4.50	1.05	5.10	1.07	5.40	1.08	5.80	1.09	6.20	1.10	6.40	1.11
	30.0	4.50	1.22	5.10	1.24	5.40	1.25	5.80	1.27	6.20	1.28	6.40	1.29
	35.0	4.50	1.57	5.10	1.60	5.40	1.61	5.80	1.63	6.20	1.65	6.40	1.66
	40.0	3.60	1.28	4.00	1.30	4.30	1.31	4.60	1.32	4.90	1.34	5.00	1.35
	46.0	2.60	0.99	2.90	1.00	3.10	1.01	3.30	1.02	3.60	1.03	3.70	1.04
	-10.0	4.50	0.80	5.10	0.81	5.40	0.82	5.80	0.83	6.20	0.84	6.40	0.84
	0.0	4.50	1.04	5.10	1.05	5.40	1.06	5.80	1.07	6.20	1.09	6.40	1.09
	5.0	4.50	0.88	5.10	0.90	5.40	0.90	5.80	0.91	6.20	0.92	6.40	0.93
	10.0	4.50	0.48	5.10	0.49	5.40	0.50	5.80	0.50	6.20	0.51	6.40	0.51
	15.0	4.50	0.64	5.10	0.65	5.40	0.66	5.80	0.67	6.20	0.67	6.40	0.68
17	20.0	4.50	0.85	5.10	0.86	5.40	0.87	5.80	0.88	6.20	0.89	6.40	0.89
	25.0	4.50	1.05	5.10	1.07	5.40	1.08	5.80	1.09	6.20	1.10	6.40	1.11
	30.0	4.50	1.22	5.10	1.24	5.40	1.25	5.80	1.27	6.20	1.28	6.40	1.29
	35.0	4.50	1.57	5.10	1.60	5.40	1.61	5.80	1.63	6.20	1.65	6.40	1.66
	40.0	3.60	1.28	4.00	1.30	4.30	1.31	4.60	1.32	4.90	1.34	5.00	1.35
	46.0	2.60	0.99	2.90	1.00	3.10	1.01	3.30	1.02	3.60	1.03	3.70	1.04
	-10.0	4.47	0.54	5.05	0.55	5.32	0.56	5.70	0.56	6.09	0.57	6.28	0.57
	0.0	4.47	1.01	5.05	1.02	5.32	1.03	5.70	1.04	6.09	1.06	6.28	1.06
	5.0	4.47	0.86	5.05	0.87	5.32	0.88	5.70	0.89	6.09	0.90	6.28	0.90
	10.0	4.47	0.47	5.05	0.48	5.32	0.48	5.70	0.49	6.09	0.49	6.28	0.50
17	15.0	4.47	0.62	5.05	0.63	5.32	0.64	5.70	0.65	6.09	0.65	6.28	0.66
	20.0	4.47	0.82	5.05	0.84	5.32	0.84	5.70	0.85	6.09	0.86	6.28	0.87
	25.0	4.47	1.02	5.05	1.04	5.32	1.05	5.70	1.06	6.09	1.07	6.28	1.08
	30.0	4.47	1.19	5.05	1.21	5.32	1.22	5.70	1.23	6.09	1.25	6.28	1.25
	35.0	4.47	1.52	5.05	1.55	5.32	1.56	5.70	1.58	6.09	1.60	6.28	1.61
	40.0	3.52	1.24	3.97	1.26	4.19	1.27	4.49	1.29	4.80	1.30	4.94	1.31
	46.0	3.52	0.96	3.97	0.97</								

Indoor unit connect-ing capacity	Outdoor temperature	Indoor temperature											
		18.0 °CDB		21.0 °CDB		23.0 °CDB		27.0 °CDB		29.0 °CDB		32.0 °CDB	
		12.0 °CWB		15.0 °CWB		16.0 °CWB		19.0 °CWB		21.0 °CWB		23.0 °CWB	
kBtu/h	°CDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
16	-10.0	4.50	0.78	5.10	0.79	5.30	0.80	5.70	0.80	6.10	0.81	6.30	0.82
	0.0	4.50	1.01	5.10	1.02	5.30	1.03	5.70	1.04	6.10	1.06	6.30	1.06
	5.0	4.50	0.86	5.10	0.87	5.30	0.88	5.70	0.89	6.10	0.90	6.30	0.90
	10.0	4.50	0.47	5.10	0.48	5.30	0.48	5.70	0.49	6.10	0.49	6.30	0.50
	15.0	4.50	0.62	5.10	0.63	5.30	0.64	5.70	0.65	6.10	0.65	6.30	0.66
	20.0	4.50	0.82	5.10	0.84	5.30	0.84	5.70	0.85	6.10	0.86	6.30	0.87
	25.0	4.50	1.02	5.10	1.04	5.30	1.05	5.70	1.06	6.10	1.07	6.30	1.08
	30.0	4.50	1.19	5.10	1.21	5.30	1.22	5.70	1.23	6.10	1.25	6.30	1.25
	35.0	4.50	1.52	5.10	1.55	5.30	1.56	5.70	1.58	6.10	1.60	6.30	1.61
	40.0	3.50	1.24	4.00	1.26	4.20	1.27	4.50	1.29	4.80	1.30	4.90	1.31
14	46.0	3.50	0.96	4.00	0.97	4.20	0.98	4.50	0.99	4.80	1.00	4.90	1.01
	-10.0	3.90	0.63	4.40	0.64	4.70	0.65	5.00	0.65	5.30	0.66	5.50	0.67
	0.0	3.90	0.82	4.40	0.83	4.70	0.84	5.00	0.85	5.30	0.86	5.50	0.86
	5.0	3.90	0.70	4.40	0.71	4.70	0.71	5.00	0.72	5.30	0.73	5.50	0.73
	10.0	3.90	0.38	4.40	0.39	4.70	0.39	5.00	0.40	5.30	0.40	5.50	0.40
	15.0	3.90	0.51	4.40	0.52	4.70	0.52	5.00	0.53	5.30	0.53	5.50	0.54
	20.0	3.90	0.67	4.40	0.68	4.70	0.69	5.00	0.69	5.30	0.70	5.50	0.71
	25.0	3.90	0.83	4.40	0.84	4.70	0.85	5.00	0.86	5.30	0.87	5.50	0.87
	30.0	3.90	0.97	4.40	0.98	4.70	0.99	5.00	1.00	5.30	1.01	5.50	1.02
	35.0	3.90	1.24	4.40	1.26	4.70	1.27	5.00	1.29	5.30	1.30	5.50	1.31
12	40.0	3.10	1.01	3.50	1.03	3.70	1.04	3.90	1.05	4.20	1.06	4.30	1.06
	46.0	3.10	0.78	3.50	0.79	3.70	0.80	3.90	0.81	4.20	0.82	4.30	0.82
	-10.0	3.37	0.38	3.81	0.39	4.02	0.39	4.30	0.40	4.60	0.40	4.74	0.40
	0.0	3.37	0.71	3.81	0.72	4.02	0.73	4.30	0.74	4.60	0.75	4.74	0.75
	5.0	3.37	0.61	3.81	0.62	4.02	0.62	4.30	0.63	4.60	0.64	4.74	0.64
	10.0	3.37	0.33	3.81	0.34	4.02	0.34	4.30	0.35	4.60	0.35	4.74	0.35
	15.0	3.37	0.44	3.81	0.45	4.02	0.45	4.30	0.46	4.60	0.46	4.74	0.47
	20.0	3.37	0.58	3.81	0.59	4.02	0.60	4.30	0.60	4.60	0.61	4.74	0.61
	25.0	3.37	0.72	3.81	0.73	4.02	0.74	4.30	0.75	4.60	0.76	4.74	0.76
	30.0	3.37	0.84	3.81	0.86	4.02	0.86	4.30	0.87	4.60	0.88	4.74	0.89
10	35.0	3.37	1.08	3.81	1.10	4.02	1.11	4.30	1.12	4.60	1.13	4.74	1.14
	40.0	2.65	0.88	3.00	0.89	3.16	0.90	3.38	0.91	3.62	0.92	3.73	0.93
	46.0	2.65	0.68	3.00	0.69	3.16	0.70	3.38	0.70	3.62	0.71	3.73	0.72
	-10.0	2.82	0.32	3.19	0.33	3.36	0.33	3.60	0.33	3.85	0.34	3.97	0.34
	0.0	2.82	0.60	3.19	0.61	3.36	0.61	3.60	0.62	3.85	0.63	3.97	0.63
	5.0	2.82	0.51	3.19	0.52	3.36	0.52	3.60	0.53	3.85	0.53	3.97	0.54
	10.0	2.82	0.28	3.19	0.29	3.36	0.29	3.60	0.29	3.85	0.29	3.97	0.30
	15.0	2.82	0.37	3.19	0.38	3.36	0.38	3.60	0.38	3.85	0.39	3.97	0.39
	20.0	2.82	0.49	3.19	0.50	3.36	0.50	3.60	0.51	3.85	0.51	3.97	0.52
	25.0	2.82	0.61	3.19	0.62	3.36	0.62	3.60	0.63	3.85	0.64	3.97	0.64
6. Capacity table	30.0	2.82	0.71	3.19	0.72	3.36	0.72	3.60	0.73	3.85	0.74	3.97	0.74
	35.0	2.82	0.91	3.19	0.92	3.36	0.93	3.60	0.94	3.85	0.95	3.97	0.96
	40.0	2.22	0.74	2.51	0.75	2.65	0.76	2.83	0.77	3.03	0.77	3.12	0.78
	46.0	2.22	0.57	2.51	0.58	2.65	0.58	2.83	0.59	3.03	0.60	3.12	0.60

NOTES:

- TC: Total Capacity (kW), IP: Input Power (kW)
- Values mentioned in the table are based on the following conditions:
 - Power source of specifications: 230 V
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)
- 2 or more indoor units should be connected.
- The total ability of connected indoor unit is from 10,000 Btu/h up to 26,000 Btu/h.
- Input in the table are calculated based on the maximum indoor unit input combinations.

● Compact cassette type

Model: AUXG07KVLA

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	1.96	1.32	2.22	1.51	2.34	1.74	2.50	1.95	2.67	2.13	2.76	2.44
0.0	1.96	1.32	2.22	1.51	2.34	1.74	2.50	1.95	2.67	2.13	2.76	2.44
5.0	1.96	1.32	2.22	1.51	2.34	1.74	2.50	1.95	2.67	2.13	2.76	2.44
10.0	1.96	1.32	2.22	1.51	2.34	1.74	2.50	1.95	2.67	2.13	2.76	2.44
15.0	1.96	1.32	2.22	1.51	2.34	1.74	2.50	1.95	2.67	2.13	2.76	2.44
20.0	1.96	1.32	2.22	1.51	2.34	1.74	2.50	1.95	2.67	2.13	2.76	2.44
25.0	1.96	1.32	2.22	1.51	2.34	1.74	2.50	1.95	2.67	2.13	2.76	2.44
30.0	1.96	1.32	2.22	1.51	2.34	1.74	2.50	1.95	2.67	2.13	2.76	2.44
35.0	1.96	1.32	2.22	1.51	2.34	1.74	2.50	1.95	2.67	2.13	2.76	2.44
40.0	1.85	1.18	2.10	1.35	2.21	1.55	2.37	1.75	2.53	1.91	2.61	2.19
46.0	1.75	1.05	1.98	1.20	2.08	1.38	2.23	1.55	2.38	1.70	2.46	1.95

Model: AUXG09KVLA

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
0.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
5.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
10.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
15.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
20.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
25.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
30.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
35.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
40.0	2.37	1.50	2.68	1.71	2.83	1.96	3.03	2.21	3.24	2.41	3.34	2.76
46.0	2.24	1.33	2.53	1.52	2.67	1.75	2.86	1.96	3.05	2.15	3.15	2.46

Model: AUXG12KVLA

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	2.87	1.89	3.24	2.15	3.42	2.48	3.66	2.78	3.91	3.04	4.03	3.49
0.0	2.87	1.89	3.24	2.15	3.42	2.48	3.66	2.78	3.91	3.04	4.03	3.49
5.0	2.87	1.89	3.24	2.15	3.42	2.48	3.66	2.78	3.91	3.04	4.03	3.49
10.0	2.87	1.89	3.24	2.15	3.42	2.48	3.66	2.78	3.91	3.04	4.03	3.49
15.0	2.87	1.89	3.24	2.15	3.42	2.48	3.66	2.78	3.91	3.04	4.03	3.49
20.0	2.87	1.89	3.24	2.15	3.42	2.48	3.66	2.78	3.91	3.04	4.03	3.49
25.0	2.87	1.89	3.24	2.15	3.42	2.48	3.66	2.78	3.91	3.04	4.03	3.49
30.0	2.87	1.89	3.24	2.15	3.42	2.48	3.66	2.78	3.91	3.04	4.03	3.49
35.0	2.87	1.89	3.24	2.15	3.42	2.48	3.66	2.78	3.91	3.04	4.03	3.49
40.0	2.72	1.69	3.07	1.93	3.23	2.22	3.46	2.49	3.70	2.72	3.82	3.12
46.0	2.56	1.50	2.89	1.71	3.05	1.97	3.27	2.22	3.49	2.42	3.60	2.78

Model: AUXG14KVLA

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
0.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
5.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
10.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
15.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
20.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
25.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
30.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
35.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
40.0	2.87	1.69	3.24	1.93	3.42	2.22	3.66	2.49	3.91	2.73	4.04	3.13
46.0	2.71	1.50	3.06	1.72	3.23	1.97	3.45	2.22	3.69	2.43	3.81	2.78

NOTES:

- TC: Total Capacity (kW), SHC: Sensible Heat Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Mini duct type

Model: ARXG07KSLAP

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
0.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
5.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
10.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
15.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
20.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
25.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
30.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
35.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
40.0	1.54	0.84	1.74	0.96	1.84	1.10	1.97	1.24	2.10	1.35	2.17	1.55
46.0	1.12	0.45	1.27	0.51	1.34	0.59	1.43	0.66	1.53	0.72	1.58	0.83

Model: ARXG09KSLAP

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	2.51	1.61	2.84	1.83	2.99	2.11	3.20	2.37	3.42	2.59	3.53	2.97
0.0	2.51	1.61	2.84	1.83	2.99	2.11	3.20	2.37	3.42	2.59	3.53	2.97
5.0	2.51	1.61	2.84	1.83	2.99	2.11	3.20	2.37	3.42	2.59	3.53	2.97
10.0	2.51	1.61	2.84	1.83	2.99	2.11	3.20	2.37	3.42	2.59	3.53	2.97
15.0	2.51	1.61	2.84	1.83	2.99	2.11	3.20	2.37	3.42	2.59	3.53	2.97
20.0	2.51	1.61	2.84	1.83	2.99	2.11	3.20	2.37	3.42	2.59	3.53	2.97
25.0	2.51	1.61	2.84	1.83	2.99	2.11	3.20	2.37	3.42	2.59	3.53	2.97
30.0	2.51	1.61	2.84	1.83	2.99	2.11	3.20	2.37	3.42	2.59	3.53	2.97
35.0	2.51	1.61	2.84	1.83	2.99	2.11	3.20	2.37	3.42	2.59	3.53	2.97
40.0	1.97	0.99	2.23	1.13	2.35	1.31	2.52	1.47	2.69	1.60	2.78	1.84
46.0	1.44	0.53	1.63	0.60	1.72	0.69	1.84	0.78	1.96	0.85	2.02	0.98

Model: ARXG12KSLAP

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
0.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
5.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
10.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
15.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
20.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
25.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
30.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
35.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
40.0	2.26	1.14	2.55	1.30	2.69	1.49	2.88	1.68	3.08	1.83	3.17	2.10
46.0	1.65	0.60	1.86	0.69	1.96	0.79	2.10	0.89	2.25	0.98	2.31	1.13

Model: ARXG14KSLAP

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	3.03	1.86	3.43	2.12	3.61	2.45	3.87	2.75	4.14	3.01	4.26	3.44
0.0	3.03	1.86	3.43	2.12	3.61	2.45	3.87	2.75	4.14	3.01	4.26	3.44
5.0	3.03	1.86	3.43	2.12	3.61	2.45	3.87	2.75	4.14	3.01	4.26	3.44
10.0	3.03	1.86	3.43	2.12	3.61	2.45	3.87	2.75	4.14	3.01	4.26	3.44
15.0	3.03	1.86	3.43	2.12	3.61	2.45	3.87	2.75	4.14	3.01	4.26	3.44
20.0	3.03	1.86	3.43	2.12	3.61	2.45	3.87	2.75	4.14	3.01	4.26	3.44
25.0	3.03	1.86	3.43	2.12	3.61	2.45	3.87	2.75	4.14	3.01	4.26	3.44
30.0	3.03	1.86	3.43	2.12	3.61	2.45	3.87	2.75	4.14	3.01	4.26	3.44
35.0	3.03	1.86	3.43	2.12	3.61	2.45	3.87	2.75	4.14	3.01	4.26	3.44
40.0	2.39	1.15	2.70	1.32	2.84	1.51	3.05	1.70	3.26	1.86	3.36	2.13
46.0	1.74	0.61	1.97	0.70	2.07	0.81	2.22	0.91	2.37	0.99	2.45	1.13

NOTES:

- TC: Total Capacity (kW), SHC: Sensible Heat Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m [Outdoor unit—Indoor unit]

● Slim duct type

Model: ARXG07KLLAP

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
0.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
5.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
10.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
15.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
20.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
25.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
30.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
35.0	1.96	1.36	2.22	1.55	2.34	1.78	2.50	2.00	2.67	2.19	2.76	2.51
40.0	1.54	0.84	1.74	0.96	1.84	1.10	1.97	1.24	2.10	1.35	2.17	1.55
46.0	1.12	0.45	1.27	0.51	1.34	0.59	1.43	0.66	1.53	0.72	1.58	0.83

Model: ARXG09KLLAP

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
0.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
5.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
10.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
15.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
20.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
25.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
30.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
35.0	2.51	1.67	2.84	1.90	2.99	2.19	3.20	2.46	3.42	2.69	3.53	3.09
40.0	1.97	1.03	2.23	1.18	2.35	1.36	2.52	1.53	2.69	1.67	2.78	1.91
46.0	1.44	0.55	1.63	0.63	1.72	0.72	1.84	0.81	1.96	0.89	2.02	1.02

Model: ARXG12KLLAP

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
0.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
5.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
10.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
15.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
20.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
25.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
30.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
35.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
40.0	2.26	1.20	2.55	1.37	2.69	1.57	2.88	1.77	3.08	1.93	3.17	2.22
46.0	1.65	0.64	1.86	0.73	1.96	0.84	2.10	0.94	2.25	1.03	2.31	1.18

Model: ARXG14KLLAP

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	3.03	1.94	3.43	2.21	3.61	2.55	3.87	2.86	4.14	3.13	4.26	3.59
0.0	3.03	1.94	3.43	2.21	3.61	2.55	3.87	2.86	4.14	3.13	4.26	3.59
5.0	3.03	1.94	3.43	2.21	3.61	2.55	3.87	2.86	4.14	3.13	4.26	3.59
10.0	3.03	1.94	3.43	2.21	3.61	2.55	3.87	2.86	4.14	3.13	4.26	3.59
15.0	3.03	1.94	3.43	2.21	3.61	2.55	3.87	2.86	4.14	3.13	4.26	3.59
20.0	3.03	1.94	3.43	2.21	3.61	2.55	3.87	2.86	4.14	3.13	4.26	3.59
25.0	3.03	1.94	3.43	2.21	3.61	2.55	3.87	2.86	4.14	3.13	4.26	3.59
30.0	3.03	1.94	3.43	2.21	3.61	2.55	3.87	2.86	4.14	3.13	4.26	3.59
35.0	3.03	1.94	3.43	2.21	3.61	2.55	3.87	2.86	4.14	3.13	4.26	3.59
40.0	2.39	1.20	2.70	1.37	2.84	1.58	3.05	1.77	3.26	1.94	3.36	2.22
46.0	1.74	0.64	1.97	0.73	2.07	0.84	2.22	0.94	2.37	1.03	2.45	1.18

NOTES:

- TC: Total Capacity (kW), SHC: Sensible Heat Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Medium static pressure duct type

Model: ARXH12KMTAP

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
0.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
5.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
10.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
15.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
20.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
25.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
30.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
35.0	2.87	1.94	3.24	2.21	3.42	2.54	3.66	2.85	3.91	3.12	4.03	3.58
40.0	2.26	1.20	2.55	1.37	2.69	1.57	2.88	1.77	3.08	1.93	3.17	2.22
46.0	1.65	0.64	1.86	0.73	1.96	0.84	2.10	0.94	2.25	1.03	2.31	1.18

Model: ARXH14KMTAP

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	3.03	2.03	3.43	2.31	3.61	2.67	3.87	2.99	4.14	3.28	4.26	3.76
0.0	3.03	2.03	3.43	2.31	3.61	2.67	3.87	2.99	4.14	3.28	4.26	3.76
5.0	3.03	2.03	3.43	2.31	3.61	2.67	3.87	2.99	4.14	3.28	4.26	3.76
10.0	3.03	2.03	3.43	2.31	3.61	2.67	3.87	2.99	4.14	3.28	4.26	3.76
15.0	3.03	2.03	3.43	2.31	3.61	2.67	3.87	2.99	4.14	3.28	4.26	3.76
20.0	3.03	2.03	3.43	2.31	3.61	2.67	3.87	2.99	4.14	3.28	4.26	3.76
25.0	3.03	2.03	3.43	2.31	3.61	2.67	3.87	2.99	4.14	3.28	4.26	3.76
30.0	3.03	2.03	3.43	2.31	3.61	2.67	3.87	2.99	4.14	3.28	4.26	3.76
35.0	3.03	2.03	3.43	2.31	3.61	2.67	3.87	2.99	4.14	3.28	4.26	3.76
40.0	2.39	1.26	2.70	1.43	2.84	1.65	3.05	1.85	3.26	2.03	3.36	2.32
46.0	1.74	0.67	1.97	0.76	2.07	0.88	2.22	0.98	2.37	1.08	2.45	1.24

NOTES:

- TC: Total Capacity (kW), SHC: Sensible Heat Capacity (kW).
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Wall mounted type

Models: ASHG07KMTB, ASHG07KMCC, ASHG07KMCE, ASHG07KMCF, ASHH07KMCG, ASH-H07KMCG-B, ASHH07KMCH, and ASHH07KMCH-B

Outdoor temperature (�b0;CDB)	Indoor temperature (�b0;CDB / �b0;CWB)</th><th data-kind="ghost"></th><th data-kind="ghost"></th></tr> <tr> <th data-kind="ghost"></th><th data-cs="2" data-kind="parent">18.0 / 12.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">21.0 / 15.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">23.0 / 16.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">27.0 / 19.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">29.0 / 21.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">32.0 / 23.0</th><th data-kind="ghost"></th></tr> <tr> <th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th></tr> </thead> <tbody> <tr><td>-10.0</td><td>1.96</td><td>1.10</td><td>2.22</td><td>1.26</td><td>2.34</td><td>1.45</td><td>2.50</td><td>1.63</td><td>2.67</td><td>1.78</td><td>2.76</td><td>2.04</td></tr> <tr><td>0.0</td><td>1.96</td><td>1.10</td><td>2.22</td><td>1.26</td><td>2.34</td><td>1.45</td><td>2.50</td><td>1.63</td><td>2.67</td><td>1.78</td><td>2.76</td><td>2.04</td></tr> <tr><td>5.0</td><td>1.96</td><td>1.10</td><td>2.22</td><td>1.26</td><td>2.34</td><td>1.45</td><td>2.50</td><td>1.63</td><td>2.67</td><td>1.78</td><td>2.76</td><td>2.04</td></tr> <tr><td>10.0</td><td>1.96</td><td>1.10</td><td>2.22</td><td>1.26</td><td>2.34</td><td>1.45</td><td>2.50</td><td>1.63</td><td>2.67</td><td>1.78</td><td>2.76</td><td>2.04</td></tr> <tr><td>15.0</td><td>1.96</td><td>1.10</td><td>2.22</td><td>1.26</td><td>2.34</td><td>1.45</td><td>2.50</td><td>1.63</td><td>2.67</td><td>1.78</td><td>2.76</td><td>2.04</td></tr> <tr><td>20.0</td><td>1.96</td><td>1.10</td><td>2.22</td><td>1.26</td><td>2.34</td><td>1.45</td><td>2.50</td><td>1.63</td><td>2.67</td><td>1.78</td><td>2.76</td><td>2.04</td></tr> <tr><td>25.0</td><td>1.96</td><td>1.10</td><td>2.22</td><td>1.26</td><td>2.34</td><td>1.45</td><td>2.50</td><td>1.63</td><td>2.67</td><td>1.78</td><td>2.76</td><td>2.04</td></tr> <tr><td>30.0</td><td>1.96</td><td>1.10</td><td>2.22</td><td>1.26</td><td>2.34</td><td>1.45</td><td>2.50</td><td>1.63</td><td>2.67</td><td>1.78</td><td>2.76</td><td>2.04</td></tr> <tr><td>35.0</td><td>1.96</td><td>1.10</td><td>2.22</td><td>1.26</td><td>2.34</td><td>1.45</td><td>2.50</td><td>1.63</td><td>2.67</td><td>1.78</td><td>2.76</td><td>2.04</td></tr> <tr><td>40.0</td><td>1.54</td><td>0.68</td><td>1.74</td><td>0.78</td><td>1.84</td><td>0.90</td><td>1.97</td><td>1.01</td><td>2.10</td><td>1.10</td><td>2.17</td><td>1.26</td></tr> <tr><td>46.0</td><td>1.12</td><td>0.36</td><td>1.27</td><td>0.41</td><td>1.34</td><td>0.48</td><td>1.43</td><td>0.54</td><td>1.53</td><td>0.59</td><td>1.58</td><td>0.67</td></tr> </tbody> </table> </div> <div data-bbox="100 258 920 288" data-label="Text"> <p>Models: ASHG09KMTB, ASHG09KMCC, ASHG09KMCE, ASHG09KMCF, ASHH09KMCG, ASH-H09KMCG-B, ASHH09KMCH, and ASHH09KMCH-B</p> </div> <div data-bbox="102 295 925 446" data-label="Table"> <table border="1"> <thead> <tr> <th data-kind="parent" data-rs="2">Outdoor temperature (�b0;CDB)</th><th data-cs="12" data-kind="parent">Indoor temperature (�b0;CDB / �b0;CWB)</th><th data-kind="ghost"></th><th data-kind="ghost"></th></tr> <tr> <th data-kind="ghost"></th><th data-cs="2" data-kind="parent">18.0 / 12.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">21.0 / 15.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">23.0 / 16.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">27.0 / 19.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">29.0 / 21.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">32.0 / 23.0</th><th data-kind="ghost"></th></tr> <tr> <th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th></tr> </thead> <tbody> <tr><td>-10.0</td><td>2.51</td><td>1.41</td><td>2.84</td><td>1.61</td><td>2.99</td><td>1.85</td><td>3.20</td><td>2.08</td><td>3.42</td><td>2.27</td><td>3.53</td><td>2.61</td></tr> <tr><td>0.0</td><td>2.51</td><td>1.41</td><td>2.84</td><td>1.61</td><td>2.99</td><td>1.85</td><td>3.20</td><td>2.08</td><td>3.42</td><td>2.27</td><td>3.53</td><td>2.61</td></tr> <tr><td>5.0</td><td>2.51</td><td>1.41</td><td>2.84</td><td>1.61</td><td>2.99</td><td>1.85</td><td>3.20</td><td>2.08</td><td>3.42</td><td>2.27</td><td>3.53</td><td>2.61</td></tr> <tr><td>10.0</td><td>2.51</td><td>1.41</td><td>2.84</td><td>1.61</td><td>2.99</td><td>1.85</td><td>3.20</td><td>2.08</td><td>3.42</td><td>2.27</td><td>3.53</td><td>2.61</td></tr> <tr><td>15.0</td><td>2.51</td><td>1.41</td><td>2.84</td><td>1.61</td><td>2.99</td><td>1.85</td><td>3.20</td><td>2.08</td><td>3.42</td><td>2.27</td><td>3.53</td><td>2.61</td></tr> <tr><td>20.0</td><td>2.51</td><td>1.41</td><td>2.84</td><td>1.61</td><td>2.99</td><td>1.85</td><td>3.20</td><td>2.08</td><td>3.42</td><td>2.27</td><td>3.53</td><td>2.61</td></tr> <tr><td>25.0</td><td>2.51</td><td>1.41</td><td>2.84</td><td>1.61</td><td>2.99</td><td>1.85</td><td>3.20</td><td>2.08</td><td>3.42</td><td>2.27</td><td>3.53</td><td>2.61</td></tr> <tr><td>30.0</td><td>2.51</td><td>1.41</td><td>2.84</td><td>1.61</td><td>2.99</td><td>1.85</td><td>3.20</td><td>2.08</td><td>3.42</td><td>2.27</td><td>3.53</td><td>2.61</td></tr> <tr><td>35.0</td><td>2.51</td><td>1.41</td><td>2.84</td><td>1.61</td><td>2.99</td><td>1.85</td><td>3.20</td><td>2.08</td><td>3.42</td><td>2.27</td><td>3.53</td><td>2.61</td></tr> <tr><td>40.0</td><td>1.97</td><td>0.87</td><td>2.23</td><td>1.00</td><td>2.35</td><td>1.15</td><td>2.52</td><td>1.29</td><td>2.69</td><td>1.41</td><td>2.78</td><td>1.61</td></tr> <tr><td>46.0</td><td>1.44</td><td>0.46</td><td>1.63</td><td>0.53</td><td>1.72</td><td>0.61</td><td>1.84</td><td>0.69</td><td>1.96</td><td>0.75</td><td>2.02</td><td>0.86</td></tr> </tbody> </table> </div> <div data-bbox="100 457 920 488" data-label="Text"> <p>Models: ASHG12KMTB, ASHG12KMCC, ASHG12KMCE, ASHG12KMCF, ASHH12KMCG, ASH-H12KMCG-B, ASHH12KMCH, and ASHH12KMCH-B</p> </div> <div data-bbox="102 494 925 645" data-label="Table"> <table border="1"> <thead> <tr> <th data-kind="parent" data-rs="2">Outdoor temperature (�b0;CDB)</th><th data-cs="12" data-kind="parent">Indoor temperature (�b0;CDB / �b0;CWB)</th><th data-kind="ghost"></th><th data-kind="ghost"></th></tr> <tr> <th data-kind="ghost"></th><th data-cs="2" data-kind="parent">18.0 / 12.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">21.0 / 15.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">23.0 / 16.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">27.0 / 19.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">29.0 / 21.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">32.0 / 23.0</th><th data-kind="ghost"></th></tr> <tr> <th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th></tr> </thead> <tbody> <tr><td>-10.0</td><td>2.87</td><td>1.61</td><td>3.24</td><td>1.84</td><td>3.42</td><td>2.12</td><td>3.66</td><td>2.38</td><td>3.91</td><td>2.60</td><td>4.03</td><td>2.98</td></tr> <tr><td>0.0</td><td>2.87</td><td>1.61</td><td>3.24</td><td>1.84</td><td>3.42</td><td>2.12</td><td>3.66</td><td>2.38</td><td>3.91</td><td>2.60</td><td>4.03</td><td>2.98</td></tr> <tr><td>5.0</td><td>2.87</td><td>1.61</td><td>3.24</td><td>1.84</td><td>3.42</td><td>2.12</td><td>3.66</td><td>2.38</td><td>3.91</td><td>2.60</td><td>4.03</td><td>2.98</td></tr> <tr><td>10.0</td><td>2.87</td><td>1.61</td><td>3.24</td><td>1.84</td><td>3.42</td><td>2.12</td><td>3.66</td><td>2.38</td><td>3.91</td><td>2.60</td><td>4.03</td><td>2.98</td></tr> <tr><td>15.0</td><td>2.87</td><td>1.61</td><td>3.24</td><td>1.84</td><td>3.42</td><td>2.12</td><td>3.66</td><td>2.38</td><td>3.91</td><td>2.60</td><td>4.03</td><td>2.98</td></tr> <tr><td>20.0</td><td>2.87</td><td>1.61</td><td>3.24</td><td>1.84</td><td>3.42</td><td>2.12</td><td>3.66</td><td>2.38</td><td>3.91</td><td>2.60</td><td>4.03</td><td>2.98</td></tr> <tr><td>25.0</td><td>2.87</td><td>1.61</td><td>3.24</td><td>1.84</td><td>3.42</td><td>2.12</td><td>3.66</td><td>2.38</td><td>3.91</td><td>2.60</td><td>4.03</td><td>2.98</td></tr> <tr><td>30.0</td><td>2.87</td><td>1.61</td><td>3.24</td><td>1.84</td><td>3.42</td><td>2.12</td><td>3.66</td><td>2.38</td><td>3.91</td><td>2.60</td><td>4.03</td><td>2.98</td></tr> <tr><td>35.0</td><td>2.87</td><td>1.61</td><td>3.24</td><td>1.84</td><td>3.42</td><td>2.12</td><td>3.66</td><td>2.38</td><td>3.91</td><td>2.60</td><td>4.03</td><td>2.98</td></tr> <tr><td>40.0</td><td>2.26</td><td>1.00</td><td>2.55</td><td>1.14</td><td>2.69</td><td>1.31</td><td>2.88</td><td>1.47</td><td>3.08</td><td>1.61</td><td>3.17</td><td>1.85</td></tr> <tr><td>46.0</td><td>1.65</td><td>0.53</td><td>1.86</td><td>0.61</td><td>1.96</td><td>0.70</td><td>2.10</td><td>0.78</td><td>2.25</td><td>0.86</td><td>2.31</td><td>0.98</td></tr> </tbody> </table> </div> <div data-bbox="100 654 920 685" data-label="Text"> <p>Models: ASHG14KMTB, ASHG14KMCC, ASHG14KMCE, ASHG14KMCF, ASHH14KMCG, ASH-H14KMCG-B, ASHH14KMCH, and ASHH14KMCH-B</p> </div> <div data-bbox="102 691 925 842" data-label="Table"> <table border="1"> <thead> <tr> <th data-kind="parent" data-rs="2">Outdoor temperature (�b0;CDB)</th><th data-cs="12" data-kind="parent">Indoor temperature (�b0;CDB / �b0;CWB)</th><th data-kind="ghost"></th><th data-kind="ghost"></th></tr> <tr> <th data-kind="ghost"></th><th data-cs="2" data-kind="parent">18.0 / 12.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">21.0 / 15.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">23.0 / 16.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">27.0 / 19.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">29.0 / 21.0</th><th data-kind="ghost"></th><th data-cs="2" data-kind="parent">32.0 / 23.0</th><th data-kind="ghost"></th></tr> <tr> <th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th><th>TC</th><th>SHC</th></tr> </thead> <tbody> <tr><td>-10.0</td><td>3.03</td><td>1.71</td><td>3.43</td><td>1.94</td><td>3.61</td><td>2.24</td><td>3.87</td><td>2.52</td><td>4.14</td><td>2.75</td><td>4.26</td><td>3.15</td></tr> <tr><td>0.0</td><td>3.03</td><td>1.71</td><td>3.43</td><td>1.94</td><td>3.61</td><td>2.24</td><td>3.87</td><td>2.52</td><td>4.14</td><td>2.75</td><td>4.26</td><td>3.15</td></tr> <tr><td>5.0</td><td>3.03</td><td>1.71</td><td>3.43</td><td>1.94</td><td>3.61</td><td>2.24</td><td>3.87</td><td>2.52</td><td>4.14</td><td>2.75</td><td>4.26</td><td>3.15</td></tr> <tr><td>10.0</td><td>3.03</td><td>1.71</td><td>3.43</td><td>1.94</td><td>3.61</td><td>2.24</td><td>3.87</td><td>2.52</td><td>4.14</td><td>2.75</td><td>4.26</td><td>3.15</td></tr> <tr><td>15.0</td><td>3.03</td><td>1.71</td><td>3.43</td><td>1.94</td><td>3.61</td><td>2.24</td><td>3.87</td><td>2.52</td><td>4.14</td><td>2.75</td><td>4.26</td><td>3.15</td></tr> <tr><td>20.0</td><td>3.03</td><td>1.71</td><td>3.43</td><td>1.94</td><td>3.61</td><td>2.24</td><td>3.87</td><td>2.52</td><td>4.14</td><td>2.75</td><td>4.26</td><td>3.15</td></tr> <tr><td>25.0</td><td>3.03</td><td>1.71</td><td>3.43</td><td>1.94</td><td>3.61</td><td>2.24</td><td>3.87</td><td>2.52</td><td>4.14</td><td>2.75</td><td>4.26</td><td>3.15</td></tr> <tr><td>30.0</td><td>3.03</td><td>1.71</td><td>3.43</td><td>1.94</td><td>3.61</td><td>2.24</td><td>3.87</td><td>2.52</td><td>4.14</td><td>2.75</td><td>4.26</td><td>3.15</td></tr> <tr><td>35.0</td><td>3.03</td><td>1.71</td><td>3.43</td><td>1.94</td><td>3.61</td><td>2.24</td><td>3.87</td><td>2.52</td><td>4.14</td><td>2.75</td><td>4.26</td><td>3.15</td></tr> <tr><td>40.0</td><td>2.39</td><td>1.06</td><td>2.70</td><td>1.20</td><td>2.84</td><td>1.39</td><td>3.05</td><td>1.56</td><td>3.26</td><td>1.70</td><td>3.36</td><td>1.95</td></tr> <tr><td>46.0</td><td>1.74</td><td>0.56</td><td>1.97</td><td>0.64</td><td>2.07</td><td>0.74</td><td>2.22</td><td>0.83</td><td>2.37</td><td>0.91</td><td>2.45</td><td>1.04</td></tr> </tbody> </table> </div> <div data-bbox="67 967 167 979" data-label="Page-Footer">6-2. Cooling capacity</div> <div data-bbox="476 960 520 973" data-label="Page-Footer">- 398 -</div> <div data-bbox="847 967 933 979" data-label="Page-Footer">6. Capacity table</div> <div data-bbox="0 125 35 215" data-label="Page-Footer">OUTDOOR UNIT AOHG14-18KBTA2</div> <div data-bbox="960 125 1000 215" data-label="Page-Footer">OUTDOOR UNIT AOHG14-18KBTA2</div>
-------------------------------------	--

Models: ASHG07KETA, ASHG07KETA-B, ASHG07KETE, ASHG07KETE-B, ASHG07KETF, and ASHG07KETF-B

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
0.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
5.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
10.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
15.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
20.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
25.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
30.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
35.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
40.0	1.54	0.68	1.74	0.78	1.84	0.90	1.97	1.01	2.10	1.10	2.17	1.26
46.0	1.12	0.36	1.27	0.41	1.34	0.48	1.43	0.54	1.53	0.59	1.58	0.67

Models: ASHG09KETA, ASHG09KETA-B, ASHG09KETE, ASHG09KETE-B, ASHG09KETF, and ASHG09KETF-B

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
0.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
5.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
10.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
15.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
20.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
25.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
30.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
35.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
40.0	1.97	0.87	2.23	1.00	2.35	1.15	2.52	1.29	2.69	1.41	2.78	1.61
46.0	1.44	0.46	1.63	0.53	1.72	0.61	1.84	0.69	1.96	0.75	2.02	0.86

Models: ASHG12KETA, ASHG12KETA-B, ASHG12KETE, ASHG12KETE-B, ASHG12KETF, and ASHG12KETF-B

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
0.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
5.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
10.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
15.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
20.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
25.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
30.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
35.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
40.0	2.26	1.00	2.55	1.14	2.69	1.31	2.88	1.47	3.08	1.61	3.17	1.85
46.0	1.65	0.53	1.86	0.61	1.96	0.70	2.10	0.78	2.25	0.86	2.31	0.98

Models: ASHG14KETA, ASHG14KETA-B, ASHG14KETE, ASHG14KETE-B, ASHG14KETF, and ASHG14KETF-B

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
0.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
5.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
10.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
15.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
20.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
25.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
30.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
35.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
40.0	2.39	1.06	2.70	1.20	2.84	1.39	3.05	1.56	3.26	1.70	3.36	1.95
46.0	1.74	0.56	1.97	0.64	2.07	0.74	2.22	0.83	2.37	0.91	2.45	1.04

Models: ASHG07KGTB, ASHG07KGTE, ASHG07KGTF, ASHH07KG TG, and ASHH07KGTH

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
0.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
5.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
10.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
15.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
20.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
25.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
30.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
35.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
40.0	1.54	0.68	1.74	0.78	1.84	0.90	1.97	1.01	2.10	1.10	2.17	1.26
46.0	1.12	0.36	1.27	0.41	1.34	0.48	1.43	0.54	1.53	0.59	1.58	0.67

Models: ASHG09KG TB, ASHG09KG TE, ASHG09KG TF, ASHH09KG TG, and ASHH09KG TH

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
0.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
5.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
10.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
15.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
20.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
25.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
30.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
35.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
40.0	1.97	0.87	2.23	1.00	2.35	1.15	2.52	1.29	2.69	1.41	2.78	1.61
46.0	1.44	0.46	1.63	0.53	1.72	0.61	1.84	0.69	1.96	0.75	2.02	0.86

Models: ASHG12KG TB, ASHG12KG TE, ASHG12KG TF, ASHH12KG TG, and ASHH12KG TH

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
0.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
5.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
10.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
15.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
20.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
25.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
30.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
35.0	2.87	1.61	3.24	1.84	3.42	2.12	3.66	2.38	3.91	2.60	4.03	2.98
40.0	2.26	1.00	2.55	1.14	2.69	1.31	2.88	1.47	3.08	1.61	3.17	1.85
46.0	1.65	0.53	1.86	0.61	1.96	0.70	2.10	0.78	2.25	0.86	2.31	1.08

Models: ASHG14KG TB, ASHG14KG TE, ASHG14KG TF, ASHH14KG TG, and ASHH14KG TH

Outdoor temperature (°CDB)	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
0.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
5.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
10.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
15.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
20.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
25.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
30.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
35.0	3.03	1.71	3.43	1.94	3.61	2.24	3.87	2.52	4.14	2.75	4.26	3.15
40.0	2.39	1.06	2.70	1.20	2.84	1.39	3.05	1.56	3.26	1.70	3.36	1.95
46.0	1.74	0.56	1.97	0.64	2.07	0.74	2.22	0.83	2.37	0.91	2.45	1.04

Models: ASHH05KNCA and ASHH05KNCH

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
-5.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
0.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
5.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
10.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
15.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
20.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
25.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
30.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
35.0	1.41	0.79	1.59	0.90	1.68	1.04	1.80	1.17	1.92	1.28	1.98	1.47
40.0	1.11	0.49	1.26	0.56	1.32	0.64	1.42	0.72	1.51	0.79	1.56	0.91
46.0	0.81	0.26	0.92	0.30	0.96	0.34	1.03	0.39	1.10	0.42	1.14	0.48

Models: ASHH07KNCA and ASHH07KNCH

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
-5.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
0.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
5.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
10.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
15.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
20.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
25.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
30.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
35.0	1.96	1.10	2.22	1.26	2.34	1.45	2.50	1.63	2.67	1.78	2.76	2.04
40.0	1.54	0.68	1.74	0.78	1.84	0.90	1.97	1.01	2.10	1.10	2.17	1.26
46.0	1.12	0.36	1.27	0.41	1.34	0.48	1.43	0.54	1.53	0.59	1.58	0.67

Models: ASHH09KNCA and ASHH09KNCH

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
-5.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
0.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
5.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
10.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
15.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
20.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
25.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
30.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
35.0	2.51	1.41	2.84	1.61	2.99	1.85	3.20	2.08	3.42	2.27	3.53	2.61
40.0	1.97	0.87	2.23	1.00	2.35	1.15	2.52	1.29	2.69	1.41	2.78	1.61
46.0	1.44	0.46	1.63	0.53	1.72	0.61	1.84	0.69	1.96	0.75	2.02	0.86

Models: ASHH12KNCA and ASHH12KNCH

Outdoor temperature	Indoor temperature (°CDB / °CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
(°CDB)	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
-10.0	2.82	1.59	3.19	1.81	3.36	2.08	3.60	2.34	3.85	2.56	3.97	2.93
-5.0	2.82	1.59	3.19	1.81	3.36	2.08	3.60	2.34	3.85	2.56	3.97	2.93
0.0	2.82	1.59	3.19	1.81	3.36	2.08	3.60	2.34	3.85	2.56	3.97	2.93
5.0	2.82	1.59	3.19	1.81	3.36	2.08	3.60	2.34	3.85	2.56	3.97	2.93
10.0	2.82	1.59	3.19	1.81	3.36	2.08	3.60	2.34	3.85	2.56	3.97	2.93
15.0	2.82	1.59	3.19	1.81	3.36	2.08	3.60	2.34	3.85	2.56	3.97	2.93
20.0	2.82	1.59	3.19	1.81	3.36	2.08	3.60	2.34	3.85	2.56	3.97	2.93
25.0	2.82	1.59	3.19	1.81	3.36	2.08	3.60	2.34	3.85	2.56	3.97	2.93
30.0	2.82	1.59	3.19	1.81	3.36	2.08	3.60	2.34	3.85	2.56	3.97	2.93
35.0	2.82	1.59	3.19	1.81	3.36	2.08	3.60	2.34	3.85	2.56	3.97	2.93
40.0	2.22	0.98	2.51	1.12	2.65	1.29	2.83	1.45	3.03	1.59	3.12	1.82
46.0	1.62	0.52	1.83	0.60	1.93	0.69	2.07	0.77	2.21	0.84	2.28	0.97

NOTES:

- TC: Total Capacity (kW), SHC: Sensible Heat Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Floor type

Model: AGHG09KVCA

Outdoor temperature (℃CDB)	Indoor temperature (℃CDB / ℃CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	2.51	1.71	2.84	1.95	2.99	2.25	3.20	2.53	3.42	2.76	3.53	3.17
-5.0	2.51	1.71	2.84	1.95	2.99	2.25	3.20	2.53	3.42	2.76	3.53	3.17
0.0	2.51	1.71	2.84	1.95	2.99	2.25	3.20	2.53	3.42	2.76	3.53	3.17
5.0	2.51	1.71	2.84	1.95	2.99	2.25	3.20	2.53	3.42	2.76	3.53	3.17
10.0	2.51	1.71	2.84	1.95	2.99	2.25	3.20	2.53	3.42	2.76	3.53	3.17
15.0	2.51	1.71	2.84	1.95	2.99	2.25	3.20	2.53	3.42	2.76	3.53	3.17
20.0	2.51	1.71	2.84	1.95	2.99	2.25	3.20	2.53	3.42	2.76	3.53	3.17
25.0	2.51	1.71	2.84	1.95	2.99	2.25	3.20	2.53	3.42	2.76	3.53	3.17
30.0	2.51	1.71	2.84	1.95	2.99	2.25	3.20	2.53	3.42	2.76	3.53	3.17
35.0	2.51	1.71	2.84	1.95	2.99	2.25	3.20	2.53	3.42	2.76	3.53	3.17
40.0	2.37	1.53	2.68	1.75	2.83	2.01	3.03	2.26	3.24	2.48	3.34	2.84
46.0	2.24	1.37	2.53	1.56	2.67	1.79	2.86	2.01	3.05	2.20	3.15	2.52

Model: AGHG12KVCA

Outdoor temperature (℃CDB)	Indoor temperature (℃CDB / ℃CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
-5.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
0.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
5.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
10.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
15.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
20.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
25.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
30.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
35.0	2.87	1.84	3.24	2.09	3.42	2.41	3.66	2.71	3.91	2.96	4.03	3.39
40.0	2.72	1.64	3.07	1.87	3.23	2.16	3.46	2.42	3.70	2.65	3.82	3.04
46.0	2.56	1.46	2.89	1.67	3.05	1.92	3.27	2.16	3.49	2.36	3.60	2.70

Model: AGHG14KVCA

Outdoor temperature (℃CDB)	Indoor temperature (℃CDB / ℃CWB)											
	18.0 / 12.0		21.0 / 15.0		23.0 / 16.0		27.0 / 19.0		29.0 / 21.0		32.0 / 23.0	
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
-10.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
-5.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
0.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
5.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
10.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
15.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
20.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
25.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
30.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
35.0	3.03	1.89	3.43	2.15	3.61	2.48	3.87	2.79	4.14	3.05	4.26	3.49
40.0	2.87	1.69	3.24	1.93	3.42	2.22	3.66	2.49	3.91	2.73	4.04	3.13
46.0	2.71	1.50	3.06	1.72	3.23	1.97	3.45	2.22	3.69	2.43	3.81	2.78

NOTES:

- TC: Total Capacity (kW), SHC: Sensible Heat Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

6-3. Heating capacity

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

■ Model: AOHG14KBTA2

Indoor unit connecting capacity	Outdoor temperature	Indoor temperature										
		16.0 °CDB		18.0 °CDB		20.0 °CDB		22.0 °CDB		24.0 °CDB		
kBtu/h	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
21	-15.0	-16.0	3.30	1.34	3.30	1.37	3.20	1.40	3.10	1.43	3.00	1.46
	-10.0	-11.0	3.80	1.39	3.70	1.42	3.60	1.45	3.50	1.48	3.40	1.51
	-5.0	-7.0	4.20	1.44	4.10	1.47	4.00	1.50	3.90	1.53	3.80	1.56
	0.0	-2.0	5.30	1.46	5.20	1.49	5.10	1.52	4.90	1.55	4.80	1.58
	5.0	3.0	5.70	1.47	5.60	1.50	5.50	1.53	5.30	1.56	5.20	1.59
	7.0	6.0	5.80	1.63	5.60	1.67	5.50	1.70	5.40	1.73	5.20	1.77
	10.0	8.0	5.80	1.32	5.60	1.34	5.50	1.37	5.40	1.40	5.20	1.43
	15.0	10.0	5.80	1.20	5.60	1.23	5.50	1.25	5.40	1.28	5.20	1.30
	20.0	15.0	5.80	0.94	5.60	0.96	5.50	0.98	5.40	1.00	5.20	1.02
	24.0	18.0	5.80	0.84	5.60	0.86	5.50	0.88	5.40	0.89	5.20	0.91
19	-15.0	-16.0	3.30	1.34	3.30	1.37	3.20	1.40	3.10	1.43	3.00	1.46
	-10.0	-11.0	3.80	1.39	3.70	1.42	3.60	1.45	3.50	1.48	3.40	1.51
	-5.0	-7.0	4.20	1.44	4.10	1.47	4.00	1.50	3.90	1.53	3.80	1.56
	0.0	-2.0	5.30	1.46	5.20	1.49	5.10	1.52	4.90	1.55	4.80	1.58
	5.0	3.0	5.70	1.47	5.60	1.50	5.50	1.53	5.30	1.56	5.20	1.59
	7.0	6.0	5.80	1.63	5.60	1.67	5.50	1.70	5.40	1.73	5.20	1.77
	10.0	8.0	5.80	1.32	5.60	1.34	5.50	1.37	5.40	1.40	5.20	1.43
	15.0	10.0	5.80	1.20	5.60	1.23	5.50	1.25	5.40	1.28	5.20	1.30
	20.0	15.0	5.80	0.94	5.60	0.96	5.50	0.98	5.40	1.00	5.20	1.02
	24.0	18.0	5.80	0.84	5.60	0.86	5.50	0.88	5.40	0.89	5.20	0.91
18	-15.0	-16.0	3.30	1.34	3.30	1.37	3.20	1.40	3.10	1.43	3.00	1.46
	-10.0	-11.0	3.80	1.39	3.70	1.42	3.60	1.45	3.50	1.48	3.40	1.51
	-5.0	-7.0	4.20	1.44	4.10	1.47	4.00	1.50	3.90	1.53	3.80	1.56
	0.0	-2.0	5.30	1.46	5.20	1.49	5.10	1.52	4.90	1.55	4.80	1.58
	5.0	3.0	5.70	1.47	5.60	1.50	5.50	1.53	5.30	1.56	5.20	1.59
	7.0	6.0	5.80	1.63	5.60	1.67	5.50	1.70	5.40	1.73	5.20	1.77
	10.0	8.0	5.80	1.32	5.60	1.34	5.50	1.37	5.40	1.40	5.20	1.43
	15.0	10.0	5.80	1.20	5.60	1.23	5.50	1.25	5.40	1.28	5.20	1.30
	20.0	15.0	5.80	0.94	5.60	0.96	5.50	0.98	5.40	1.00	5.20	1.02
	24.0	18.0	5.80	0.84	5.60	0.86	5.50	0.88	5.40	0.89	5.20	0.91
17	-15.0	-16.0	3.34	1.34	3.26	1.37	3.18	1.40	3.10	1.43	3.02	1.46
	-10.0	-11.0	3.77	1.39	3.68	1.42	3.59	1.45	3.50	1.48	3.41	1.51
	-5.0	-7.0	4.19	1.44	4.09	1.47	4.00	1.50	3.90	1.53	3.80	1.56
	0.0	-2.0	5.32	1.46	5.20	1.49	5.07	1.52	4.94	1.55	4.82	1.58
	5.0	3.0	5.74	1.47	5.60	1.50	5.47	1.53	5.33	1.56	5.19	1.59
	7.0	6.0	5.78	1.63	5.64	1.67	5.50	1.70	5.36	1.73	5.23	1.77
	10.0	8.0	5.78	1.32	5.64	1.34	5.50	1.37	5.36	1.40	5.23	1.43
	15.0	10.0	5.78	1.20	5.64	1.23	5.50	1.25	5.36	1.28	5.23	1.30
	20.0	15.0	5.78	0.94	5.64	0.96	5.50	0.98	5.36	1.00	5.23	1.02
	24.0	18.0	5.78	0.84	5.64	0.86	5.50	0.88	5.36	0.89	5.23	0.91
16	-15.0	-16.0	3.30	1.34	3.30	1.37	3.20	1.40	3.10	1.43	3.00	1.46
	-10.0	-11.0	3.80	1.39	3.70	1.42	3.60	1.45	3.50	1.48	3.40	1.51
	-5.0	-7.0	4.20	1.44	4.10	1.47	4.00	1.50	3.90	1.53	3.80	1.56
	0.0	-2.0	5.30	1.46	5.20	1.49	5.10	1.52	4.90	1.55	4.80	1.58
	5.0	3.0	5.70	1.47	5.60	1.50	5.50	1.53	5.30	1.56	5.20	1.59
	7.0	6.0	5.80	1.63	5.60	1.67	5.50	1.70	5.40	1.73	5.20	1.77
	10.0	8.0	5.80	1.32	5.60	1.34	5.50	1.37	5.40	1.40	5.20	1.43
	15.0	10.0	5.80	1.20	5.60	1.23	5.50	1.25	5.40	1.28	5.20	1.30
	20.0	15.0	5.80	0.94	5.60	0.96	5.50	0.98	5.40	1.00	5.20	1.02
	24.0	18.0	5.80	0.84	5.60	0.86	5.50	0.88	5.40	0.89	5.20	0.91
14	-15.0	-16.0	3.30	1.34	3.30	1.36	3.20	1.39	3.10	1.42	3.00	1.45
	-10.0	-11.0	3.80	1.39	3.70	1.42	3.60	1.45	3.50	1.47	3.40	1.50
	-5.0	-7.0	4.20	1.44	4.10	1.47	4.00	1.50	3.90	1.53	3.80	1.56
	0.0	-2.0	5.30	1.45	5.20	1.48	5.10	1.51	4.90	1.54	4.80	1.57
	5.0	3.0	5.70	1.46	5.60	1.49	5.50	1.52	5.30	1.55	5.20	1.58
	7.0	6.0	5.80	1.63	5.60	1.67	5.50	1.70	5.40	1.73	5.20	1.77
	10.0	8.0	5.80	1.32	5.60	1.34	5.50	1.37	5.40	1.40	5.20	1.43
	15.0	10.0	5.80	1.20	5.60	1.23	5.50	1.25	5.40	1.28	5.20	1.30
	20.0	15.0	5.80	0.94	5.60	0.96	5.50	0.98	5.40	1.00	5.20	1.02
	24.0	18.0	5.80	0.84	5.60	0.86	5.50	0.88	5.40	0.89	5.20	0.91
12	-15.0	-16.0	3.34	1.18	3.26	1.20	3.18	1.23	3.10	1.25	3.02	1.28
	-10.0	-11.0	3.77	1.22	3.68	1.25	3.59	1.28	3.50	1.30	3.41	1.33
	-5.0	-7.0	4.19	1.27	4.09	1.30	4.00	1.32	3.90	1.35	3.80	1.38
	0.0	-2.0	5.32	1.28	5.20	1.31	5.07	1.33	4.94	1.36	4.82	1.39
	5.0	3.0	5.74	1.29	5.60	1.32	5.47	1.34	5.33	1.37	5.19	1.40
	7.0	6.0	5.15	1.44	5.02	1.47	4.90	1.50	4.78	1.53	4.66	1.56
	10.0	8.0	5.78	1.16	5.64	1.19	5.50	1.21	5.36	1.23	5.23	1.26
	15.0	10.0	5.78	1.06	5.64	1.08	5.50	1.10	5.36	1.13	5.23	1.15
	20.0	15.0	5.78	0.83	5.64	0.85	5.50	0.86	5.36	0.88	5.23	0.90
	24.0	18.0	5.78	0.74	5.64	0.76	5.50	0.77	5.36	0.79	5.23	0.80
10	-15.0	-16.0	3.34	0.98	3.26	1.00	3.18	1.02	3.10	1.04	3.02	1.07
	-10.0	-11.0	3.77	1.02	3.68	1.04	3.59	1.06	3.50	1.08	3.41	1.11
	-5.0	-7.0	4.19	1.06	4.09	1.08	4.00	1.10	3.90	1.12	3.80	1.15
	0.0	-2.0	5.32	1.07	5.20	1.09	5.07	1.11	4.94	1.13	4.82	1.16
	5.0	3.0	5.74	1.08	5.60	1.10	5.47	1.12	5.33	1.14	5.19	1.16
	7.0	6.0	4.41	1.20	4.31	1.23	4.20	1.25	4.10	1.28	3.99	1.30
	10.0	8.0	5.78	0.97	5.64	0.99	5.50	1.01	5.36	1.03	5.23	1.05
	15.0	10.0	5.78	0.88	5.64	0.90	5.50	0.92	5.36	0.94	5.23	0.96
	20.0	15.0	5.78	0.69	5.64	0.70	5.50	0.72	5.36	0.73	5.23	0.75
	24.0	18.0	5.78	0.62	5.64	0.63	5.50	0.64	5.36	0.66	5.23	0.67

NOTES:

- TC: Total Capacity (kW), IP: Input Power (kW)
- Values mentioned in the table are based on the following conditions:
 - Power source of specifications: 230 V
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)
- 2 or more indoor units should be connected.
- The total ability of connected a indoor unit is from 10,000 Btu/h up to 21,000 Btu/h.
- Input in the table are calculated based on the maximum indoor unit input combinations.

● Compact cassette type

Model: AUXG07KVLA

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.67	1.63	1.59	1.55	1.51
-10.0	-11.0	1.88	1.84	1.79	1.75	1.70
-5.0	-7.0	2.10	2.05	2.00	1.95	1.90
0.0	-2.0	2.66	2.60	2.54	2.47	2.41
5.0	3.0	2.87	2.80	2.73	2.67	2.60
7.0	6.0	2.89	2.82	2.75	2.68	2.61
10.0	8.0	2.89	2.82	2.75	2.68	2.61
15.0	10.0	2.89	2.82	2.75	2.68	2.61
20.0	15.0	2.89	2.82	2.75	2.68	2.61
24.0	18.0	2.89	2.82	2.75	2.68	2.61

Model: AUXG09KVLA

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.87	1.83	1.79	1.74	1.70
-10.0	-11.0	2.12	2.07	2.02	1.96	1.91
-5.0	-7.0	2.36	2.30	2.24	2.19	2.13
0.0	-2.0	2.99	2.92	2.85	2.78	2.71
5.0	3.0	3.23	3.15	3.07	3.00	2.92
7.0	6.0	3.24	3.17	3.09	3.01	2.94
10.0	8.0	3.24	3.17	3.09	3.01	2.94
15.0	10.0	3.24	3.17	3.09	3.01	2.94
20.0	15.0	3.24	3.17	3.09	3.01	2.94
24.0	18.0	3.24	3.17	3.09	3.01	2.94

Model: AUXG12KVLA

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.11	2.06	2.01	1.95	1.90
-10.0	-11.0	2.38	2.32	2.26	2.21	2.15
-5.0	-7.0	2.65	2.58	2.52	2.46	2.39
0.0	-2.0	3.36	3.28	3.20	3.12	3.04
5.0	3.0	3.62	3.54	3.45	3.36	3.28
7.0	6.0	3.64	3.56	3.47	3.38	3.30
10.0	8.0	3.64	3.56	3.47	3.38	3.30
15.0	10.0	3.64	3.56	3.47	3.38	3.30
20.0	15.0	3.64	3.56	3.47	3.38	3.30
24.0	18.0	3.64	3.56	3.47	3.38	3.30

NOTES:

- TC: Total Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Mini duct type

Model: ARXG07KSLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.67	1.63	1.59	1.55	1.51
-10.0	-11.0	1.88	1.84	1.79	1.75	1.70
-5.0	-7.0	2.10	2.05	2.00	1.95	1.90
0.0	-2.0	2.66	2.60	2.54	2.47	2.41
5.0	3.0	2.87	2.80	2.73	2.67	2.60
7.0	6.0	2.89	2.82	2.75	2.68	2.61
10.0	8.0	2.89	2.82	2.75	2.68	2.61
15.0	10.0	2.89	2.82	2.75	2.68	2.61
20.0	15.0	2.89	2.82	2.75	2.68	2.61
24.0	18.0	2.89	2.82	2.75	2.68	2.61

Model: ARXG09KSLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.87	1.83	1.79	1.74	1.70
-10.0	-11.0	2.12	2.07	2.02	1.96	1.91
-5.0	-7.0	2.36	2.30	2.24	2.19	2.13
0.0	-2.0	2.99	2.92	2.85	2.78	2.71
5.0	3.0	3.23	3.15	3.07	3.00	2.92
7.0	6.0	3.24	3.17	3.09	3.01	2.94
10.0	8.0	3.24	3.17	3.09	3.01	2.94
15.0	10.0	3.24	3.17	3.09	3.01	2.94
20.0	15.0	3.24	3.17	3.09	3.01	2.94
24.0	18.0	3.24	3.17	3.09	3.01	2.94

Model: ARXG12KSLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.11	2.06	2.01	1.95	1.90
-10.0	-11.0	2.38	2.32	2.26	2.21	2.15
-5.0	-7.0	2.65	2.58	2.52	2.46	2.39
0.0	-2.0	3.36	3.28	3.20	3.12	3.04
5.0	3.0	3.62	3.54	3.45	3.36	3.28
7.0	6.0	3.64	3.56	3.47	3.38	3.30
10.0	8.0	3.64	3.56	3.47	3.38	3.30
15.0	10.0	3.64	3.56	3.47	3.38	3.30
20.0	15.0	3.64	3.56	3.47	3.38	3.30
24.0	18.0	3.64	3.56	3.47	3.38	3.30

NOTES:

- TC: Total Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m [Outdoor unit—Indoor unit]

● Slim duct type

Model: ARXG07KLLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.67	1.63	1.59	1.55	1.51
-10.0	-11.0	1.88	1.84	1.79	1.75	1.70
-5.0	-7.0	2.10	2.05	2.00	1.95	1.90
0.0	-2.0	2.66	2.60	2.54	2.47	2.41
5.0	3.0	2.87	2.80	2.73	2.67	2.60
7.0	6.0	2.89	2.82	2.75	2.68	2.61
10.0	8.0	2.89	2.82	2.75	2.68	2.61
15.0	10.0	2.89	2.82	2.75	2.68	2.61
20.0	15.0	2.89	2.82	2.75	2.68	2.61
24.0	18.0	2.89	2.82	2.75	2.68	2.61

Model: ARXG09KLLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.87	1.83	1.79	1.74	1.70
-10.0	-11.0	2.12	2.07	2.02	1.96	1.91
-5.0	-7.0	2.36	2.30	2.24	2.19	2.13
0.0	-2.0	2.99	2.92	2.85	2.78	2.71
5.0	3.0	3.23	3.15	3.07	3.00	2.92
7.0	6.0	3.24	3.17	3.09	3.01	2.94
10.0	8.0	3.24	3.17	3.09	3.01	2.94
15.0	10.0	3.24	3.17	3.09	3.01	2.94
20.0	15.0	3.24	3.17	3.09	3.01	2.94
24.0	18.0	3.24	3.17	3.09	3.01	2.94

Model: ARXG12KLLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.11	2.06	2.01	1.95	1.90
-10.0	-11.0	2.38	2.32	2.26	2.21	2.15
-5.0	-7.0	2.65	2.58	2.52	2.46	2.39
0.0	-2.0	3.36	3.28	3.20	3.12	3.04
5.0	3.0	3.62	3.54	3.45	3.36	3.28
7.0	6.0	3.64	3.56	3.47	3.38	3.30
10.0	8.0	3.64	3.56	3.47	3.38	3.30
15.0	10.0	3.64	3.56	3.47	3.38	3.30
20.0	15.0	3.64	3.56	3.47	3.38	3.30
24.0	18.0	3.64	3.56	3.47	3.38	3.30

NOTES:

- TC: Total Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Medium static pressure duct type

Model: ARXH12KMTAP

OUTDOOR UNIT
AOHG14-18KBTA2

OUTDOOR UNIT
AOHG14-18KBTA2

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.11	2.06	2.01	1.95	1.90
-10.0	-11.0	2.38	2.32	2.26	2.21	2.15
-5.0	-7.0	2.65	2.58	2.52	2.46	2.39
0.0	-2.0	3.36	3.28	3.20	3.12	3.04
5.0	3.0	3.62	3.54	3.45	3.36	3.28
7.0	6.0	3.64	3.56	3.47	3.38	3.30
10.0	8.0	3.64	3.56	3.47	3.38	3.30
15.0	10.0	3.64	3.56	3.47	3.38	3.30
20.0	15.0	3.64	3.56	3.47	3.38	3.30
24.0	18.0	3.64	3.56	3.47	3.38	3.30

NOTES:

- TC: Total Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Wall mounted type

Models: ASHG07KMTB, ASHG07KMCC, ASHG07KMCE, ASHG07KMCF, ASHH07KMCG, ASH-H07KMCG-B, ASHH07KMCH, and ASHH07KMCH-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.67	1.63	1.59	1.55	1.51
-10.0	-11.0	1.88	1.84	1.79	1.75	1.70
-5.0	-7.0	2.10	2.05	2.00	1.95	1.90
0.0	-2.0	2.66	2.60	2.54	2.47	2.41
5.0	3.0	2.87	2.80	2.73	2.67	2.60
7.0	6.0	2.89	2.82	2.75	2.68	2.61
10.0	8.0	2.89	2.82	2.75	2.68	2.61
15.0	10.0	2.89	2.82	2.75	2.68	2.61
20.0	15.0	2.89	2.82	2.75	2.68	2.61
24.0	18.0	2.89	2.82	2.75	2.68	2.61

Models: ASHG09KMTB, ASHG09KMCC, ASHG09KMCE, ASHG09KMCF, ASHH09KMCG, ASH-H09KMCG-B, ASHH09KMCH, and ASHH09KMCH-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.87	1.83	1.79	1.74	1.70
-10.0	-11.0	2.12	2.07	2.02	1.96	1.91
-5.0	-7.0	2.36	2.30	2.24	2.19	2.13
0.0	-2.0	2.99	2.92	2.85	2.78	2.71
5.0	3.0	3.23	3.15	3.07	3.00	2.92
7.0	6.0	3.24	3.17	3.09	3.01	2.94
10.0	8.0	3.24	3.17	3.09	3.01	2.94
15.0	10.0	3.24	3.17	3.09	3.01	2.94
20.0	15.0	3.24	3.17	3.09	3.01	2.94
24.0	18.0	3.24	3.17	3.09	3.01	2.94

Models: ASHG12KMTB, ASHG12KMCC, ASHG12KMCE, ASHG12KMCF, ASHH12KMCG, ASH-H12KMCG-B, ASHH12KMCH, and ASHH12KMCH-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.11	2.06	2.01	1.95	1.90
-10.0	-11.0	2.38	2.32	2.26	2.21	2.15
-5.0	-7.0	2.65	2.58	2.52	2.46	2.39
0.0	-2.0	3.36	3.28	3.20	3.12	3.04
5.0	3.0	3.62	3.54	3.45	3.36	3.28
7.0	6.0	3.64	3.56	3.47	3.38	3.30
10.0	8.0	3.64	3.56	3.47	3.38	3.30
15.0	10.0	3.64	3.56	3.47	3.38	3.30
20.0	15.0	3.64	3.56	3.47	3.38	3.30
24.0	18.0	3.64	3.56	3.47	3.38	3.30

Models: ASHG07KETA, ASHG07KETA-B, ASHG07KETE, ASHG07KETE-B, ASHG07KETF, and ASHG07KETF-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.67	1.63	1.59	1.55	1.51
-10.0	-11.0	1.88	1.84	1.79	1.75	1.70
-5.0	-7.0	2.10	2.05	2.00	1.95	1.90
0.0	-2.0	2.66	2.60	2.54	2.47	2.41
5.0	3.0	2.87	2.80	2.73	2.67	2.60
7.0	6.0	2.89	2.82	2.75	2.68	2.61
10.0	8.0	2.89	2.82	2.75	2.68	2.61
15.0	10.0	2.89	2.82	2.75	2.68	2.61
20.0	15.0	2.89	2.82	2.75	2.68	2.61
24.0	18.0	2.89	2.82	2.75	2.68	2.61

Models: ASHG09KETA, ASHG09KETA-B, ASHG09KETE, ASHG09KETE-B, ASHG09KETF, and ASHG09KETF-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.87	1.83	1.79	1.74	1.70
-10.0	-11.0	2.12	2.07	2.02	1.96	1.91
-5.0	-7.0	2.36	2.30	2.24	2.19	2.13
0.0	-2.0	2.99	2.92	2.85	2.78	2.71
5.0	3.0	3.23	3.15	3.07	3.00	2.92
7.0	6.0	3.24	3.17	3.09	3.01	2.94
10.0	8.0	3.24	3.17	3.09	3.01	2.94
15.0	10.0	3.24	3.17	3.09	3.01	2.94
20.0	15.0	3.24	3.17	3.09	3.01	2.94
24.0	18.0	3.24	3.17	3.09	3.01	2.94

Models: ASHG12KETA, ASHG12KETA-B, ASHG12KETE, ASHG12KETE-B, ASHG12KETF, and ASHG12KETF-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.11	2.06	2.01	1.95	1.90
-10.0	-11.0	2.38	2.32	2.26	2.21	2.15
-5.0	-7.0	2.65	2.58	2.52	2.46	2.39
0.0	-2.0	3.36	3.28	3.20	3.12	3.04
5.0	3.0	3.62	3.54	3.45	3.36	3.28
7.0	6.0	3.64	3.56	3.47	3.38	3.30
10.0	8.0	3.64	3.56	3.47	3.38	3.30
15.0	10.0	3.64	3.56	3.47	3.38	3.30
20.0	15.0	3.64	3.56	3.47	3.38	3.30
24.0	18.0	3.64	3.56	3.47	3.38	3.30

Models: ASHG07KGTB, ASHG07KGTE, ASHG07KGTF, ASHH07KG TG, and ASHH07KGTH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.67	1.63	1.59	1.55	1.51
-10.0	-11.0	1.88	1.84	1.79	1.75	1.70
-5.0	-7.0	2.10	2.05	2.00	1.95	1.90
0.0	-2.0	2.66	2.60	2.54	2.47	2.41
5.0	3.0	2.87	2.80	2.73	2.67	2.60
7.0	6.0	2.89	2.82	2.75	2.68	2.61
10.0	8.0	2.89	2.82	2.75	2.68	2.61
15.0	10.0	2.89	2.82	2.75	2.68	2.61
20.0	15.0	2.89	2.82	2.75	2.68	2.61
24.0	18.0	2.89	2.82	2.75	2.68	2.61

Models: ASHG09KGTB, ASHG09KGTE, ASHG09KGTF, ASHH09KG TG, and ASHH09KGTH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.87	1.83	1.79	1.74	1.70
-10.0	-11.0	2.12	2.07	2.02	1.96	1.91
-5.0	-7.0	2.36	2.30	2.24	2.19	2.13
0.0	-2.0	2.99	2.92	2.85	2.78	2.71
5.0	3.0	3.23	3.15	3.07	3.00	2.92
7.0	6.0	3.24	3.17	3.09	3.01	2.94
10.0	8.0	3.24	3.17	3.09	3.01	2.94
15.0	10.0	3.24	3.17	3.09	3.01	2.94
20.0	15.0	3.24	3.17	3.09	3.01	2.94
24.0	18.0	3.24	3.17	3.09	3.01	2.94

Models: ASHG12KG TB, ASHG12KGTE, ASHG12KGTF, ASHH12KG TG, and ASHH12KGTH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.11	2.06	2.01	1.95	1.90
-10.0	-11.0	2.38	2.32	2.26	2.21	2.15
-5.0	-7.0	2.65	2.58	2.52	2.46	2.39
0.0	-2.0	3.36	3.28	3.20	3.12	3.04
5.0	3.0	3.62	3.54	3.45	3.36	3.28
7.0	6.0	3.64	3.56	3.47	3.38	3.30
10.0	8.0	3.64	3.56	3.47	3.38	3.30
15.0	10.0	3.64	3.56	3.47	3.38	3.30
20.0	15.0	3.64	3.56	3.47	3.38	3.30
24.0	18.0	3.64	3.56	3.47	3.38	3.30

Models: ASHH05KNCA and ASHH05KNCH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.27	1.24	1.21	1.18	1.15
-10.0	-11.0	1.44	1.40	1.37	1.34	1.30
-5.0	-7.0	1.60	1.56	1.53	1.49	1.45
0.0	-2.0	2.03	1.98	1.94	1.89	1.84
5.0	3.0	2.19	2.14	2.09	2.04	1.98
7.0	6.0	2.21	2.15	2.10	2.05	2.00
10.0	8.0	2.21	2.15	2.10	2.05	2.00
15.0	10.0	2.21	2.15	2.10	2.05	2.00
20.0	15.0	2.21	2.15	2.10	2.05	2.00
24.0	18.0	2.21	2.15	2.10	2.05	2.00

Models: ASHH07KNCA and ASHH07KNCH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.67	1.63	1.59	1.55	1.51
-10.0	-11.0	1.88	1.84	1.79	1.75	1.70
-5.0	-7.0	2.10	2.05	2.00	1.95	1.90
0.0	-2.0	2.66	2.60	2.54	2.47	2.41
5.0	3.0	2.87	2.80	2.73	2.67	2.60
7.0	6.0	2.89	2.82	2.75	2.68	2.61
10.0	8.0	2.89	2.82	2.75	2.68	2.61
15.0	10.0	2.89	2.82	2.75	2.68	2.61
20.0	15.0	2.89	2.82	2.75	2.68	2.61
24.0	18.0	2.89	2.82	2.75	2.68	2.61

Models: ASHH09KNCA and ASHH09KNCH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.87	1.83	1.79	1.74	1.70
-10.0	-11.0	2.12	2.07	2.02	1.96	1.91
-5.0	-7.0	2.36	2.30	2.24	2.19	2.13
0.0	-2.0	2.99	2.92	2.85	2.78	2.71
5.0	3.0	3.23	3.15	3.07	3.00	2.92
7.0	6.0	3.24	3.17	3.09	3.01	2.94
10.0	8.0	3.24	3.17	3.09	3.01	2.94
15.0	10.0	3.24	3.17	3.09	3.01	2.94
20.0	15.0	3.24	3.17	3.09	3.01	2.94
24.0	18.0	3.24	3.17	3.09	3.01	2.94

Models: ASHH12KNCA and ASHH12KNCH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.11	2.06	2.01	1.95	1.90
-10.0	-11.0	2.38	2.32	2.26	2.21	2.15
-5.0	-7.0	2.65	2.58	2.52	2.46	2.39
0.0	-2.0	3.36	3.28	3.20	3.12	3.04
5.0	3.0	3.62	3.54	3.45	3.36	3.28
7.0	6.0	3.64	3.56	3.47	3.38	3.30
10.0	8.0	3.64	3.56	3.47	3.38	3.30
15.0	10.0	3.64	3.56	3.47	3.38	3.30
20.0	15.0	3.64	3.56	3.47	3.38	3.30
24.0	18.0	3.64	3.56	3.47	3.38	3.30

NOTES:

- TC: Total Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Floor type

Model: AGHG09KVCA

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.87	1.83	1.79	1.74	1.70
-10.0	-11.0	2.12	2.07	2.02	1.96	1.91
-5.0	-7.0	2.36	2.30	2.24	2.19	2.13
0.0	-2.0	2.99	2.92	2.85	2.78	2.71
5.0	3.0	3.23	3.15	3.07	3.00	2.92
7.0	6.0	3.24	3.17	3.09	3.01	2.94
10.0	8.0	3.24	3.17	3.09	3.01	2.94
15.0	10.0	3.24	3.17	3.09	3.01	2.94
20.0	15.0	3.24	3.17	3.09	3.01	2.94
24.0	18.0	3.24	3.17	3.09	3.01	2.94

Model: AGHG12KVCA

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.11	2.06	2.01	1.95	1.90
-10.0	-11.0	2.38	2.32	2.26	2.21	2.15
-5.0	-7.0	2.65	2.58	2.52	2.46	2.39
0.0	-2.0	3.36	3.28	3.20	3.12	3.04
5.0	3.0	3.62	3.54	3.45	3.36	3.28
7.0	6.0	3.64	3.56	3.47	3.38	3.30
10.0	8.0	3.64	3.56	3.47	3.38	3.30
15.0	10.0	3.64	3.56	3.47	3.38	3.30
20.0	15.0	3.64	3.56	3.47	3.38	3.30
24.0	18.0	3.64	3.56	3.47	3.38	3.30

NOTES:

- TC: Total Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

■ Model: AOHG18KBTA2

OUTDOOR UNIT
AOHG14-18KBTA2OUTDOOR UNIT
AOHG14-18KBTA2

Indoor unit connecting capacity	Outdoor temperature		Indoor temperature									
			16.0 °CDB		18.0 °CDB		20.0 °CDB		22.0 °CDB		24.0 °CDB	
	kBtu/h	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC
26	-15.0	-16.0	4.00	1.63	3.90	1.67	3.80	1.70	3.70	1.73	3.60	1.77
	-10.0	-11.0	4.60	1.68	4.40	1.72	4.30	1.75	4.20	1.79	4.10	1.82
	-5.0	-7.0	5.20	1.73	5.00	1.76	4.90	1.80	4.80	1.84	4.70	1.87
	0.0	-2.0	6.60	1.90	6.40	1.94	6.30	1.98	6.10	2.02	5.90	2.06
	5.0	3.0	7.40	1.90	7.20	1.94	7.00	1.98	6.80	2.02	6.70	2.06
	7.0	6.0	7.40	1.80	7.20	1.84	7.00	1.88	6.80	1.92	6.70	1.96
	10.0	8.0	7.40	1.69	7.20	1.73	7.00	1.77	6.80	1.80	6.70	1.84
	15.0	10.0	7.40	1.55	7.20	1.59	7.00	1.62	6.80	1.65	6.70	1.68
	20.0	15.0	7.40	1.31	7.20	1.34	7.00	1.37	6.80	1.40	6.70	1.42
24	24.0	18.0	7.40	1.15	7.20	1.18	7.00	1.20	6.80	1.23	6.70	1.25
	-15.0	-16.0	4.00	1.63	3.90	1.67	3.80	1.70	3.70	1.73	3.60	1.77
	-10.0	-11.0	4.60	1.68	4.40	1.72	4.30	1.75	4.20	1.79	4.10	1.82
	-5.0	-7.0	5.20	1.73	5.00	1.76	4.90	1.80	4.80	1.84	4.70	1.87
	0.0	-2.0	6.60	1.90	6.40	1.94	6.30	1.98	6.10	2.02	5.90	2.06
	5.0	3.0	7.40	1.90	7.20	1.94	7.00	1.98	6.80	2.02	6.70	2.06
	7.0	6.0	7.40	1.80	7.20	1.84	7.00	1.88	6.80	1.92	6.70	1.96
	10.0	8.0	7.40	1.69	7.20	1.73	7.00	1.77	6.80	1.80	6.70	1.84
	15.0	10.0	7.40	1.55	7.20	1.59	7.00	1.62	6.80	1.65	6.70	1.68
23	20.0	15.0	7.40	1.31	7.20	1.34	7.00	1.37	6.80	1.40	6.70	1.42
	24.0	18.0	7.40	1.15	7.20	1.18	7.00	1.20	6.80	1.23	6.70	1.25
	-15.0	-16.0	4.00	1.63	3.90	1.67	3.80	1.70	3.70	1.73	3.60	1.77
	-10.0	-11.0	4.60	1.68	4.40	1.72	4.30	1.75	4.20	1.79	4.10	1.82
	-5.0	-7.0	5.20	1.73	5.00	1.76	4.90	1.80	4.80	1.84	4.70	1.87
	0.0	-2.0	6.60	1.90	6.40	1.94	6.30	1.98	6.10	2.02	5.90	2.06
	5.0	3.0	7.40	1.90	7.20	1.94	7.00	1.98	6.80	2.02	6.70	2.06
	7.0	6.0	7.40	1.80	7.20	1.84	7.00	1.88	6.80	1.92	6.70	1.96
	10.0	8.0	7.40	1.69	7.20	1.73	7.00	1.77	6.80	1.80	6.70	1.84
21	15.0	10.0	7.40	1.55	7.20	1.59	7.00	1.62	6.80	1.65	6.70	1.68
	20.0	15.0	7.40	1.31	7.20	1.34	7.00	1.37	6.80	1.40	6.70	1.42
	24.0	18.0	7.40	1.15	7.20	1.18	7.00	1.20	6.80	1.23	6.70	1.25
	-15.0	-16.0	4.00	1.63	3.90	1.67	3.80	1.70	3.70	1.73	3.60	1.77
	-10.0	-11.0	4.60	1.68	4.40	1.72	4.30	1.75	4.20	1.79	4.10	1.82
	-5.0	-7.0	5.20	1.73	5.00	1.76	4.90	1.80	4.80	1.84	4.70	1.87
	0.0	-2.0	6.60	1.90	6.40	1.94	6.30	1.98	6.10	2.02	5.90	2.06
	5.0	3.0	7.40	1.90	7.20	1.94	7.00	1.98	6.80	2.02	6.70	2.06
	7.0	6.0	7.40	1.80	7.20	1.84	7.00	1.88	6.80	1.92	6.70	1.96
19	10.0	8.0	7.40	1.69	7.20	1.73	7.00	1.77	6.80	1.80	6.70	1.84
	15.0	10.0	7.40	1.55	7.20	1.59	7.00	1.62	6.80	1.65	6.70	1.68
	20.0	15.0	7.40	1.31	7.20	1.34	7.00	1.37	6.80	1.40	6.70	1.42
	24.0	18.0	7.40	1.15	7.20	1.18	7.00	1.20	6.80	1.23	6.70	1.25
	-15.0	-16.0	4.00	1.63	3.90	1.67	3.80	1.70	3.70	1.73	3.60	1.77
	-10.0	-11.0	4.60	1.68	4.40	1.72	4.30	1.75	4.20	1.79	4.10	1.82
	-5.0	-7.0	5.20	1.73	5.00	1.76	4.90	1.80	4.80	1.84	4.70	1.87
	0.0	-2.0	6.60	1.90	6.40	1.94	6.30	1.98	6.10	2.02	5.90	2.06
	5.0	3.0	7.40	1.90	7.20	1.94	7.00	1.98	6.80	2.02	6.70	2.06
18	7.0	6.0	7.40	1.80	7.20	1.84	7.00	1.88	6.80	1.92	6.70	1.96
	10.0	8.0	7.40	1.69	7.20	1.73	7.00	1.77	6.80	1.80	6.70	1.84
	15.0	10.0	7.40	1.55	7.20	1.59	7.00	1.62	6.80	1.65	6.70	1.68
	20.0	15.0	7.40	1.31	7.20	1.34	7.00	1.37	6.80	1.40	6.70	1.42
	24.0	18.0	7.40	1.15	7.20	1.18	7.00	1.20	6.80	1.23	6.70	1.25
	-15.0	-16.0	4.00	1.63	3.90	1.66	3.80	1.69	3.70	1.73	3.60	1.76
	-10.0	-11.0	4.60	1.68	4.40	1.72	4.30	1.75	4.20	1.78	4.10	1.81
	-5.0	-7.0	5.20	1.72	5.00	1.76	4.90	1.79	4.80	1.83	4.70	1.87
	0.0	-2.0	6.60	1.90	6.40	1.94	6.30	1.98	6.10	2.02	5.90	2.06
17	5.0	3.0	7.40	1.90	7.20	1.94	7.00	1.98	6.80	2.02	6.70	2.06
	7.0	6.0	7.40	1.80	7.20	1.84	7.00	1.88	6.80	1.92	6.70	1.96
	10.0	8.0	7.40	1.69	7.20	1.73	7.00	1.77	6.80	1.80	6.70	1.84
	15.0	10.0	7.40	1.55	7.20	1.59	7.00	1.62	6.80	1.65	6.70	1.68
	20.0	15.0	7.40	1.31	7.20	1.34	7.00	1.37	6.80	1.40	6.70	1.42
	24.0	18.0	7.40	1.15	7.20	1.18	7.00	1.20	6.80	1.23	6.70	1.25
	-15.0	-16.0	3.62	1.53	3.53	1.56	3.45	1.59	3.36	1.62	3.27	1.65
	-10.0	-11.0	4.16	1.57	4.07	1.61	3.97	1.64	3.87	1.67	3.77	1.71
	-5.0	-7.0	4.71	1.61	4.60	1.65	4.49	1.68	4.37	1.71	4.26	1.75
16	0.0	-2.0	6.01	1.79	5.86	1.82	5.72	1.86	5.58	1.90	5.43	1.93
	5.0	3.0	6.72	1.79	6.56	1.82	6.40	1.86	6.24	1.90	6.08	1.93
	7.0	6.0	6.72	1.69	6.56	1.72	6.40	1.76	6.24	1.80	6.08	1.83
	10.0	8.0	6.72	1.59	6.56	1.62	6.40	1.65	6.24	1.69	6.08	1.72
	15.0	10.0	6.72	1.45	6.56	1.49	6.40	1.52	6.24	1.55	6.08	1.58
	20.0	15.0	6.72	1.23	6.56	1.26	6.40	1.28	6.24	1.31	6.08	1.33
	24.0	18.0	6.72	1.08	6.56	1.10	6.40	1.12	6.24	1.15	6.08	1.17
	-15.0	-16.0	3.60	1.46	3.50	1.49	3.40	1.52	3.40	1.55	3.30	1.58
	-10.0	-11.0	4.20	1.50	4.10	1.53	4.00	1.56	3.90	1.59	3.80	1.62
15	-5.0	-7.0	4.70	1.55	4.60	1.58	4.50	1.61	4.40	1.64	4.30	1.67
	0.0	-2.0	6.00	1.70	5.90	1.73	5.70	1.77	5.60	1.81	5.40	1.84
	5.0	3.0	6.70	1.70	6.60	1.73	6.40	1.77	6.20	1.81	6.10	1.84
	7.0	6.0	6.70	1.61	6.60	1.65	6.40	1.68	6.20	1.71	6.10	1.75
	10.0	8.0	6.70	1.51	6.60	1.55	6.40	1.58	6.20	1.61	6.10	1.64
	15.0	10.0	6.70	1.39	6.60	1.42	6.40	1.45	6.20	1.48	6.10	1.50
	20.0	15.0	6.70	1.17	6.60	1.20	6.40	1.22	6.20	1.25	6.10	1.27
	24.0	18.0	6.70	1.03	6.60	1.05	6.40	1.07	6.20	1.09	6.10	1.12

Indoor unit connecting capacity	Outdoor temperature	Indoor temperature										
		16.0 °CDB		18.0 °CDB		20.0 °CDB		22.0 °CDB		24.0 °CDB		
kBtu/h	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
14	-15.0	-16.0	3.20	1.22	3.10	1.24	3.00	1.27	2.90	1.30	2.90	1.32
	-10.0	-11.0	3.60	1.26	3.60	1.28	3.50	1.31	3.40	1.34	3.30	1.36
	-5.0	-7.0	4.10	1.30	4.00	1.32	3.90	1.35	3.80	1.38	3.70	1.40
	0.0	-2.0	5.30	1.43	5.10	1.46	5.00	1.49	4.90	1.52	4.80	1.55
	5.0	3.0	5.90	1.43	5.70	1.46	5.60	1.49	5.50	1.52	5.30	1.55
	7.0	6.0	5.90	1.35	5.70	1.38	5.60	1.41	5.50	1.44	5.30	1.47
	10.0	8.0	5.90	1.27	5.70	1.30	5.60	1.32	5.50	1.35	5.30	1.38
	15.0	10.0	5.90	1.17	5.70	1.19	5.60	1.21	5.50	1.24	5.30	1.26
	20.0	15.0	5.90	0.99	5.70	1.01	5.60	1.03	5.50	1.05	5.30	1.07
	24.0	18.0	5.90	0.86	5.70	0.88	5.60	0.90	5.50	0.92	5.30	0.94
12	-15.0	-16.0	2.77	1.03	2.70	1.05	2.64	1.07	2.57	1.09	2.51	1.11
	-10.0	-11.0	3.19	1.06	3.11	1.08	3.04	1.10	2.96	1.12	2.88	1.14
	-5.0	-7.0	3.61	1.08	3.52	1.11	3.43	1.13	3.35	1.15	3.26	1.18
	0.0	-2.0	4.60	1.20	4.49	1.23	4.38	1.25	4.27	1.28	4.16	1.30
	5.0	3.0	5.15	1.20	5.02	1.23	4.90	1.25	4.78	1.28	4.66	1.30
	7.0	6.0	5.15	1.13	5.02	1.16	4.90	1.18	4.78	1.20	4.66	1.23
	10.0	8.0	5.15	1.06	5.02	1.09	4.90	1.11	4.78	1.13	4.66	1.15
	15.0	10.0	5.15	0.98	5.02	1.00	4.90	1.02	4.78	1.04	4.66	1.06
	20.0	15.0	5.15	0.82	5.02	0.84	4.90	0.86	4.78	0.88	4.66	0.89
	24.0	18.0	5.15	0.72	5.02	0.74	4.90	0.75	4.78	0.77	4.66	0.78
10	-15.0	-16.0	2.37	0.82	2.32	0.83	2.26	0.85	2.20	0.87	2.15	0.88
	-10.0	-11.0	2.73	0.84	2.67	0.86	2.60	0.88	2.54	0.90	2.47	0.92
	-5.0	-7.0	3.09	0.86	3.02	0.88	2.94	0.90	2.87	0.92	2.80	0.94
	0.0	-2.0	3.94	0.95	3.85	0.97	3.75	0.99	3.66	1.01	3.57	1.03
	5.0	3.0	4.41	0.95	4.31	0.97	4.20	0.99	4.10	1.01	3.99	1.03
	7.0	6.0	4.41	0.90	4.31	0.92	4.20	0.94	4.10	0.96	3.99	0.98
	10.0	8.0	4.41	0.85	4.31	0.86	4.20	0.88	4.10	0.90	3.99	0.92
	15.0	10.0	4.41	0.78	4.31	0.79	4.20	0.81	4.10	0.83	3.99	0.84
	20.0	15.0	4.41	0.66	4.31	0.67	4.20	0.68	4.10	0.70	3.99	0.71
	24.0	18.0	4.41	0.58	4.31	0.59	4.20	0.60	4.10	0.61	3.99	0.62

NOTES:

- TC: Total Capacity (kW), IP: Input Power (kW)
- Values mentioned in the table are based on the following conditions:
 - Power source of specifications: 230 V
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)
- 2 or more indoor units should be connected.
- The total ability of connected a indoor unit is from 10,000 Btu/h up to 26,000 Btu/h.
- Input in the table are calculated based on the maximum indoor unit input combinations.

● Compact cassette type

Model: AUXG07KVLA

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.58	1.55	1.51	1.47	1.43
-10.0	-11.0	1.82	1.78	1.74	1.69	1.65
-5.0	-7.0	2.06	2.01	1.96	1.91	1.86
0.0	-2.0	2.63	2.56	2.50	2.44	2.38
5.0	3.0	2.94	2.87	2.80	2.73	2.66
7.0	6.0	2.94	2.87	2.80	2.73	2.66
10.0	8.0	2.94	2.87	2.80	2.73	2.66
15.0	10.0	2.94	2.87	2.80	2.73	2.66
20.0	15.0	2.94	2.87	2.80	2.73	2.66
24.0	18.0	2.94	2.87	2.80	2.73	2.66

Model: AUXG09KVLA

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.04	1.99	1.94	1.89	1.84
-10.0	-11.0	2.34	2.29	2.23	2.18	2.12
-5.0	-7.0	2.65	2.59	2.52	2.46	2.40
0.0	-2.0	3.38	3.30	3.22	3.14	3.06
5.0	3.0	3.78	3.69	3.60	3.51	3.42
7.0	6.0	3.78	3.69	3.60	3.51	3.42
10.0	8.0	3.78	3.69	3.60	3.51	3.42
15.0	10.0	3.78	3.69	3.60	3.51	3.42
20.0	15.0	3.78	3.69	3.60	3.51	3.42
24.0	18.0	3.78	3.69	3.60	3.51	3.42

Model: AUXG12KVLA

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.50	2.44	2.38	2.32	2.26
-10.0	-11.0	2.88	2.81	2.74	2.67	2.60
-5.0	-7.0	3.25	3.18	3.10	3.02	2.94
0.0	-2.0	4.15	4.05	3.95	3.85	3.75
5.0	3.0	4.64	4.53	4.42	4.31	4.20
7.0	6.0	4.64	4.53	4.42	4.31	4.20
10.0	8.0	4.64	4.53	4.42	4.31	4.20
15.0	10.0	4.64	4.53	4.42	4.31	4.20
20.0	15.0	4.64	4.53	4.42	4.31	4.20
24.0	18.0	4.64	4.53	4.42	4.31	4.20

Model: AUXG14KVLA

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.64	2.58	2.51	2.45	2.39
-10.0	-11.0	3.04	2.97	2.89	2.82	2.75
-5.0	-7.0	3.44	3.36	3.27	3.19	3.11
0.0	-2.0	4.38	4.28	4.17	4.07	3.96
5.0	3.0	4.90	4.79	4.67	4.55	4.44
7.0	6.0	4.90	4.79	4.67	4.55	4.44
10.0	8.0	4.90	4.79	4.67	4.55	4.44
15.0	10.0	4.90	4.79	4.67	4.55	4.44
20.0	15.0	4.90	4.79	4.67	4.55	4.44
24.0	18.0	4.90	4.79	4.67	4.55	4.44

NOTES:

- TC: Total Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Mini duct type

Model: ARXG07KSLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.58	1.55	1.51	1.47	1.43
-10.0	-11.0	1.82	1.78	1.74	1.69	1.65
-5.0	-7.0	2.06	2.01	1.96	1.91	1.86
0.0	-2.0	2.63	2.56	2.50	2.44	2.38
5.0	3.0	2.94	2.87	2.80	2.73	2.66
7.0	6.0	2.94	2.87	2.80	2.73	2.66
10.0	8.0	2.94	2.87	2.80	2.73	2.66
15.0	10.0	2.94	2.87	2.80	2.73	2.66
20.0	15.0	2.94	2.87	2.80	2.73	2.66
24.0	18.0	2.94	2.87	2.80	2.73	2.66

Model: ARXG09KSLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.04	1.99	1.94	1.89	1.84
-10.0	-11.0	2.34	2.29	2.23	2.18	2.12
-5.0	-7.0	2.65	2.59	2.52	2.46	2.40
0.0	-2.0	3.38	3.30	3.22	3.14	3.06
5.0	3.0	3.78	3.69	3.60	3.51	3.42
7.0	6.0	3.78	3.69	3.60	3.51	3.42
10.0	8.0	3.78	3.69	3.60	3.51	3.42
15.0	10.0	3.78	3.69	3.60	3.51	3.42
20.0	15.0	3.78	3.69	3.60	3.51	3.42
24.0	18.0	3.78	3.69	3.60	3.51	3.42

Model: ARXG12KSLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.50	2.44	2.38	2.32	2.26
-10.0	-11.0	2.88	2.81	2.74	2.67	2.60
-5.0	-7.0	3.25	3.18	3.10	3.02	2.94
0.0	-2.0	4.15	4.05	3.95	3.85	3.75
5.0	3.0	4.64	4.53	4.42	4.31	4.20
7.0	6.0	4.64	4.53	4.42	4.31	4.20
10.0	8.0	4.64	4.53	4.42	4.31	4.20
15.0	10.0	4.64	4.53	4.42	4.31	4.20
20.0	15.0	4.64	4.53	4.42	4.31	4.20
24.0	18.0	4.64	4.53	4.42	4.31	4.20

Model: ARXG14KSLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.64	2.58	2.51	2.45	2.39
-10.0	-11.0	3.04	2.97	2.89	2.82	2.75
-5.0	-7.0	3.44	3.36	3.27	3.19	3.11
0.0	-2.0	4.38	4.28	4.17	4.07	3.96
5.0	3.0	4.90	4.79	4.67	4.55	4.44
7.0	6.0	4.90	4.79	4.67	4.55	4.44
10.0	8.0	4.90	4.79	4.67	4.55	4.44
15.0	10.0	4.90	4.79	4.67	4.55	4.44
20.0	15.0	4.90	4.79	4.67	4.55	4.44
24.0	18.0	4.90	4.79	4.67	4.55	4.44

NOTES:

- TC: Total Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m [Outdoor unit—Indoor unit]

● Slim duct type

Model: ARXG07KLLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.58	1.55	1.51	1.47	1.43
-10.0	-11.0	1.82	1.78	1.74	1.69	1.65
-5.0	-7.0	2.06	2.01	1.96	1.91	1.86
0.0	-2.0	2.63	2.56	2.50	2.44	2.38
5.0	3.0	2.94	2.87	2.80	2.73	2.66
7.0	6.0	2.94	2.87	2.80	2.73	2.66
10.0	8.0	2.94	2.87	2.80	2.73	2.66
15.0	10.0	2.94	2.87	2.80	2.73	2.66
20.0	15.0	2.94	2.87	2.80	2.73	2.66
24.0	18.0	2.94	2.87	2.80	2.73	2.66

Model: ARXG09KLLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.04	1.99	1.94	1.89	1.84
-10.0	-11.0	2.34	2.29	2.23	2.18	2.12
-5.0	-7.0	2.65	2.59	2.52	2.46	2.40
0.0	-2.0	3.38	3.30	3.22	3.14	3.06
5.0	3.0	3.78	3.69	3.60	3.51	3.42
7.0	6.0	3.78	3.69	3.60	3.51	3.42
10.0	8.0	3.78	3.69	3.60	3.51	3.42
15.0	10.0	3.78	3.69	3.60	3.51	3.42
20.0	15.0	3.78	3.69	3.60	3.51	3.42
24.0	18.0	3.78	3.69	3.60	3.51	3.42

Model: ARXG12KLLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.50	2.44	2.38	2.32	2.26
-10.0	-11.0	2.88	2.81	2.74	2.67	2.60
-5.0	-7.0	3.25	3.18	3.10	3.02	2.94
0.0	-2.0	4.15	4.05	3.95	3.85	3.75
5.0	3.0	4.64	4.53	4.42	4.31	4.20
7.0	6.0	4.64	4.53	4.42	4.31	4.20
10.0	8.0	4.64	4.53	4.42	4.31	4.20
15.0	10.0	4.64	4.53	4.42	4.31	4.20
20.0	15.0	4.64	4.53	4.42	4.31	4.20
24.0	18.0	4.64	4.53	4.42	4.31	4.20

Model: ARXG14KLLAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.64	2.58	2.51	2.45	2.39
-10.0	-11.0	3.04	2.97	2.89	2.82	2.75
-5.0	-7.0	3.44	3.36	3.27	3.19	3.11
0.0	-2.0	4.38	4.28	4.17	4.07	3.96
5.0	3.0	4.90	4.79	4.67	4.55	4.44
7.0	6.0	4.90	4.79	4.67	4.55	4.44
10.0	8.0	4.90	4.79	4.67	4.55	4.44
15.0	10.0	4.90	4.79	4.67	4.55	4.44
20.0	15.0	4.90	4.79	4.67	4.55	4.44
24.0	18.0	4.90	4.79	4.67	4.55	4.44

NOTES:

- TC: Total Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Medium static pressure duct type

Model: ARXH12KMTAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.50	2.44	2.38	2.32	2.26
-10.0	-11.0	2.88	2.81	2.74	2.67	2.60
-5.0	-7.0	3.25	3.18	3.10	3.02	2.94
0.0	-2.0	4.15	4.05	3.95	3.85	3.75
5.0	3.0	4.64	4.53	4.42	4.31	4.20
7.0	6.0	4.64	4.53	4.42	4.31	4.20
10.0	8.0	4.64	4.53	4.42	4.31	4.20
15.0	10.0	4.64	4.53	4.42	4.31	4.20
20.0	15.0	4.64	4.53	4.42	4.31	4.20
24.0	18.0	4.64	4.53	4.42	4.31	4.20

Model: ARXH14KMTAP

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.64	2.58	2.51	2.45	2.39
-10.0	-11.0	3.04	2.97	2.89	2.82	2.75
-5.0	-7.0	3.44	3.36	3.27	3.19	3.11
0.0	-2.0	4.38	4.28	4.17	4.07	3.96
5.0	3.0	4.90	4.79	4.67	4.55	4.44
7.0	6.0	4.90	4.79	4.67	4.55	4.44
10.0	8.0	4.90	4.79	4.67	4.55	4.44
15.0	10.0	4.90	4.79	4.67	4.55	4.44
20.0	15.0	4.90	4.79	4.67	4.55	4.44
24.0	18.0	4.90	4.79	4.67	4.55	4.44

NOTES:

- TC: Total Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Wall mounted type

Models: ASHG07KMTB, ASHG07KMCC, ASHG07KMCE, ASHG07KMCF, ASHH07KMCG, ASH-H07KMCG-B, ASHH07KMCH, and ASHH07KMCH-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.58	1.55	1.51	1.47	1.43
-10.0	-11.0	1.82	1.78	1.74	1.69	1.65
-5.0	-7.0	2.06	2.01	1.96	1.91	1.86
0.0	-2.0	2.63	2.56	2.50	2.44	2.38
5.0	3.0	2.94	2.87	2.80	2.73	2.66
7.0	6.0	2.94	2.87	2.80	2.73	2.66
10.0	8.0	2.94	2.87	2.80	2.73	2.66
15.0	10.0	2.94	2.87	2.80	2.73	2.66
20.0	15.0	2.94	2.87	2.80	2.73	2.66
24.0	18.0	2.94	2.87	2.80	2.73	2.66

Models: ASHG09KMTB, ASHG09KMCC, ASHG09KMCE, ASHG09KMCF, ASHH09KMCG, ASH-H09KMCG-B, ASHH09KMCH, and ASHH09KMCH-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.04	1.99	1.94	1.89	1.84
-10.0	-11.0	2.34	2.29	2.23	2.18	2.12
-5.0	-7.0	2.65	2.59	2.52	2.46	2.40
0.0	-2.0	3.38	3.30	3.22	3.14	3.06
5.0	3.0	3.78	3.69	3.60	3.51	3.42
7.0	6.0	3.78	3.69	3.60	3.51	3.42
10.0	8.0	3.78	3.69	3.60	3.51	3.42
15.0	10.0	3.78	3.69	3.60	3.51	3.42
20.0	15.0	3.78	3.69	3.60	3.51	3.42
24.0	18.0	3.78	3.69	3.60	3.51	3.42

Models: ASHG12KMTB, ASHG12KMCC, ASHG12KMCE, ASHG12KMCF, ASHH12KMCG, ASH-H12KMCG-B, ASHH12KMCH, and ASHH12KMCH-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.50	2.44	2.38	2.32	2.26
-10.0	-11.0	2.88	2.81	2.74	2.67	2.60
-5.0	-7.0	3.25	3.18	3.10	3.02	2.94
0.0	-2.0	4.15	4.05	3.95	3.85	3.75
5.0	3.0	4.64	4.53	4.42	4.31	4.20
7.0	6.0	4.64	4.53	4.42	4.31	4.20
10.0	8.0	4.64	4.53	4.42	4.31	4.20
15.0	10.0	4.64	4.53	4.42	4.31	4.20
20.0	15.0	4.64	4.53	4.42	4.31	4.20
24.0	18.0	4.64	4.53	4.42	4.31	4.20

Models: ASHG14KMTB, ASHG14KMCC, ASHG14KMCE, ASHG14KMCF, ASHH14KMCG, ASH-H14KMCG-B, ASHH14KMCH, and ASHH14KMCH-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.64	2.58	2.51	2.45	2.39
-10.0	-11.0	3.04	2.97	2.89	2.82	2.75
-5.0	-7.0	3.44	3.36	3.27	3.19	3.11
0.0	-2.0	4.38	4.28	4.17	4.07	3.96
5.0	3.0	4.90	4.79	4.67	4.55	4.44
7.0	6.0	4.90	4.79	4.67	4.55	4.44
10.0	8.0	4.90	4.79	4.67	4.55	4.44
15.0	10.0	4.90	4.79	4.67	4.55	4.44
20.0	15.0	4.90	4.79	4.67	4.55	4.44
24.0	18.0	4.90	4.79	4.67	4.55	4.44

Models: ASHG07KETA, ASHG07KETA-B, ASHG07KETE, ASHG07KETE-B, ASHG07KETF, and ASHG07KETF-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.58	1.55	1.51	1.47	1.43
-10.0	-11.0	1.82	1.78	1.74	1.69	1.65
-5.0	-7.0	2.06	2.01	1.96	1.91	1.86
0.0	-2.0	2.63	2.56	2.50	2.44	2.38
5.0	3.0	2.94	2.87	2.80	2.73	2.66
7.0	6.0	2.94	2.87	2.80	2.73	2.66
10.0	8.0	2.94	2.87	2.80	2.73	2.66
15.0	10.0	2.94	2.87	2.80	2.73	2.66
20.0	15.0	2.94	2.87	2.80	2.73	2.66
24.0	18.0	2.94	2.87	2.80	2.73	2.66

Models: ASHG09KETA, ASHG09KETA-B, ASHG09KETE, ASHG09KETE-B, ASHG09KETF, and ASHG09KETF-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.04	1.99	1.94	1.89	1.84
-10.0	-11.0	2.34	2.29	2.23	2.18	2.12
-5.0	-7.0	2.65	2.59	2.52	2.46	2.40
0.0	-2.0	3.38	3.30	3.22	3.14	3.06
5.0	3.0	3.78	3.69	3.60	3.51	3.42
7.0	6.0	3.78	3.69	3.60	3.51	3.42
10.0	8.0	3.78	3.69	3.60	3.51	3.42
15.0	10.0	3.78	3.69	3.60	3.51	3.42
20.0	15.0	3.78	3.69	3.60	3.51	3.42
24.0	18.0	3.78	3.69	3.60	3.51	3.42

Models: ASHG12KETA, ASHG12KETA-B, ASHG12KETE, ASHG12KETE-B, ASHG12KETF, and ASHG12KETF-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.50	2.44	2.38	2.32	2.26
-10.0	-11.0	2.88	2.81	2.74	2.67	2.60
-5.0	-7.0	3.25	3.18	3.10	3.02	2.94
0.0	-2.0	4.15	4.05	3.95	3.85	3.75
5.0	3.0	4.64	4.53	4.42	4.31	4.20
7.0	6.0	4.64	4.53	4.42	4.31	4.20
10.0	8.0	4.64	4.53	4.42	4.31	4.20
15.0	10.0	4.64	4.53	4.42	4.31	4.20
20.0	15.0	4.64	4.53	4.42	4.31	4.20
24.0	18.0	4.64	4.53	4.42	4.31	4.20

Models: ASHG14KETA, ASHG14KETA-B, ASHG14KETE, ASHG14KETE-B, ASHG14KETF, and ASHG14KETF-B

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.64	2.58	2.51	2.45	2.39
-10.0	-11.0	3.04	2.97	2.89	2.82	2.75
-5.0	-7.0	3.44	3.36	3.27	3.19	3.11
0.0	-2.0	4.38	4.28	4.17	4.07	3.96
5.0	3.0	4.90	4.79	4.67	4.55	4.44
7.0	6.0	4.90	4.79	4.67	4.55	4.44
10.0	8.0	4.90	4.79	4.67	4.55	4.44
15.0	10.0	4.90	4.79	4.67	4.55	4.44
20.0	15.0	4.90	4.79	4.67	4.55	4.44
24.0	18.0	4.90	4.79	4.67	4.55	4.44

Models: ASHG07KGTB, ASHG07KGTE, ASHG07KGTF, ASHH07KG TG, and ASHH07KGTH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.58	1.55	1.51	1.47	1.43
-10.0	-11.0	1.82	1.78	1.74	1.69	1.65
-5.0	-7.0	2.06	2.01	1.96	1.91	1.86
0.0	-2.0	2.63	2.56	2.50	2.44	2.38
5.0	3.0	2.94	2.87	2.80	2.73	2.66
7.0	6.0	2.94	2.87	2.80	2.73	2.66
10.0	8.0	2.94	2.87	2.80	2.73	2.66
15.0	10.0	2.94	2.87	2.80	2.73	2.66
20.0	15.0	2.94	2.87	2.80	2.73	2.66
24.0	18.0	2.94	2.87	2.80	2.73	2.66

Models: ASHG09KGTB, ASHG09KGTE, ASHG09KGTF, ASHH09KG TG, and ASHH09KGTH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.04	1.99	1.94	1.89	1.84
-10.0	-11.0	2.34	2.29	2.23	2.18	2.12
-5.0	-7.0	2.65	2.59	2.52	2.46	2.40
0.0	-2.0	3.38	3.30	3.22	3.14	3.06
5.0	3.0	3.78	3.69	3.60	3.51	3.42
7.0	6.0	3.78	3.69	3.60	3.51	3.42
10.0	8.0	3.78	3.69	3.60	3.51	3.42
15.0	10.0	3.78	3.69	3.60	3.51	3.42
20.0	15.0	3.78	3.69	3.60	3.51	3.42
24.0	18.0	3.78	3.69	3.60	3.51	3.42

Models: ASHG12KG TB, ASHG12KGTE, ASHG12KGTF, ASHH12KG TG, and ASHH12KGTH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.50	2.44	2.38	2.32	2.26
-10.0	-11.0	2.88	2.81	2.74	2.67	2.60
-5.0	-7.0	3.25	3.18	3.10	3.02	2.94
0.0	-2.0	4.15	4.05	3.95	3.85	3.75
5.0	3.0	4.64	4.53	4.42	4.31	4.20
7.0	6.0	4.64	4.53	4.42	4.31	4.20
10.0	8.0	4.64	4.53	4.42	4.31	4.20
15.0	10.0	4.64	4.53	4.42	4.31	4.20
20.0	15.0	4.64	4.53	4.42	4.31	4.20
24.0	18.0	4.64	4.53	4.42	4.31	4.20

Models: ASHG14KG TB, ASHG14KGTE, ASHG14KGTF, ASHH14KG TG, and ASHH14KGTH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.64	2.58	2.51	2.45	2.39
-10.0	-11.0	3.04	2.97	2.89	2.82	2.75
-5.0	-7.0	3.44	3.36	3.27	3.19	3.11
0.0	-2.0	4.38	4.28	4.17	4.07	3.96
5.0	3.0	4.90	4.79	4.67	4.55	4.44
7.0	6.0	4.90	4.79	4.67	4.55	4.44
10.0	8.0	4.90	4.79	4.67	4.55	4.44
15.0	10.0	4.90	4.79	4.67	4.55	4.44
20.0	15.0	4.90	4.79	4.67	4.55	4.44
24.0	18.0	4.90	4.79	4.67	4.55	4.44

Models: ASHH05KNCA and ASHH05KNCH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.19	1.16	1.13	1.10	1.07
-10.0	-11.0	1.37	1.33	1.30	1.27	1.24
-5.0	-7.0	1.55	1.51	1.47	1.44	1.40
0.0	-2.0	1.97	1.92	1.88	1.83	1.78
5.0	3.0	2.21	2.15	2.10	2.05	2.00
7.0	6.0	2.21	2.15	2.10	2.05	2.00
10.0	8.0	2.21	2.15	2.10	2.05	2.00
15.0	10.0	2.21	2.15	2.10	2.05	2.00
20.0	15.0	2.21	2.15	2.10	2.05	2.00
24.0	18.0	2.21	2.15	2.10	2.05	2.00

Models: ASHH07KNCA and ASHH07KNCH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	1.58	1.55	1.51	1.47	1.43
-10.0	-11.0	1.82	1.78	1.74	1.69	1.65
-5.0	-7.0	2.06	2.01	1.96	1.91	1.86
0.0	-2.0	2.63	2.56	2.50	2.44	2.38
5.0	3.0	2.94	2.87	2.80	2.73	2.66
7.0	6.0	2.94	2.87	2.80	2.73	2.66
10.0	8.0	2.94	2.87	2.80	2.73	2.66
15.0	10.0	2.94	2.87	2.80	2.73	2.66
20.0	15.0	2.94	2.87	2.80	2.73	2.66
24.0	18.0	2.94	2.87	2.80	2.73	2.66

Models: ASHH09KNCA and ASHH09KNCH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.04	1.99	1.94	1.89	1.84
-10.0	-11.0	2.34	2.29	2.23	2.18	2.12
-5.0	-7.0	2.65	2.59	2.52	2.46	2.40
0.0	-2.0	3.38	3.30	3.22	3.14	3.06
5.0	3.0	3.78	3.69	3.60	3.51	3.42
7.0	6.0	3.78	3.69	3.60	3.51	3.42
10.0	8.0	3.78	3.69	3.60	3.51	3.42
15.0	10.0	3.78	3.69	3.60	3.51	3.42
20.0	15.0	3.78	3.69	3.60	3.51	3.42
24.0	18.0	3.78	3.69	3.60	3.51	3.42

Models: ASHH12KNCA and ASHH12KNCH

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.50	2.44	2.38	2.32	2.26
-10.0	-11.0	2.88	2.81	2.74	2.67	2.60
-5.0	-7.0	3.25	3.18	3.10	3.02	2.94
0.0	-2.0	4.15	4.05	3.95	3.85	3.75
5.0	3.0	4.64	4.53	4.42	4.31	4.20
7.0	6.0	4.64	4.53	4.42	4.31	4.20
10.0	8.0	4.64	4.53	4.42	4.31	4.20
15.0	10.0	4.64	4.53	4.42	4.31	4.20
20.0	15.0	4.64	4.53	4.42	4.31	4.20
24.0	18.0	4.64	4.53	4.42	4.31	4.20

NOTES:

- TC: Total Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

● Floor type

Model: AGHG09KVCA

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.04	1.99	1.94	1.89	1.84
-10.0	-11.0	2.34	2.29	2.23	2.18	2.12
-5.0	-7.0	2.65	2.59	2.52	2.46	2.40
0.0	-2.0	3.38	3.30	3.22	3.14	3.06
5.0	3.0	3.78	3.69	3.60	3.51	3.42
7.0	6.0	3.78	3.69	3.60	3.51	3.42
10.0	8.0	3.78	3.69	3.60	3.51	3.42
15.0	10.0	3.78	3.69	3.60	3.51	3.42
20.0	15.0	3.78	3.69	3.60	3.51	3.42
24.0	18.0	3.78	3.69	3.60	3.51	3.42

Model: AGHG12KVCA

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.50	2.44	2.38	2.32	2.26
-10.0	-11.0	2.88	2.81	2.74	2.67	2.60
-5.0	-7.0	3.25	3.18	3.10	3.02	2.94
0.0	-2.0	4.15	4.05	3.95	3.85	3.75
5.0	3.0	4.64	4.53	4.42	4.31	4.20
7.0	6.0	4.64	4.53	4.42	4.31	4.20
10.0	8.0	4.64	4.53	4.42	4.31	4.20
15.0	10.0	4.64	4.53	4.42	4.31	4.20
20.0	15.0	4.64	4.53	4.42	4.31	4.20
24.0	18.0	4.64	4.53	4.42	4.31	4.20


Model: AGHG14KVCA

Outdoor temperature		Indoor temperature (°CDB)				
		16.0	18.0	20.0	22.0	24.0
(°CDB)	(°CWB)	TC	TC	TC	TC	TC
-15.0	-16.0	2.64	2.58	2.51	2.45	2.39
-10.0	-11.0	3.04	2.97	2.89	2.82	2.75
-5.0	-7.0	3.44	3.36	3.27	3.19	3.11
0.0	-2.0	4.38	4.28	4.17	4.07	3.96
5.0	3.0	4.90	4.79	4.67	4.55	4.44
7.0	6.0	4.90	4.79	4.67	4.55	4.44
10.0	8.0	4.90	4.79	4.67	4.55	4.44
15.0	10.0	4.90	4.79	4.67	4.55	4.44
20.0	15.0	4.90	4.79	4.67	4.55	4.44
24.0	18.0	4.90	4.79	4.67	4.55	4.44

NOTES:

- TC: Total Capacity (kW)
- Values mentioned in the table are based on the following conditions:
 - Pipe length: 5 m, Height difference: 0 m (Outdoor unit—Indoor unit)

7. Capacity compensation rate for pipe length and height difference

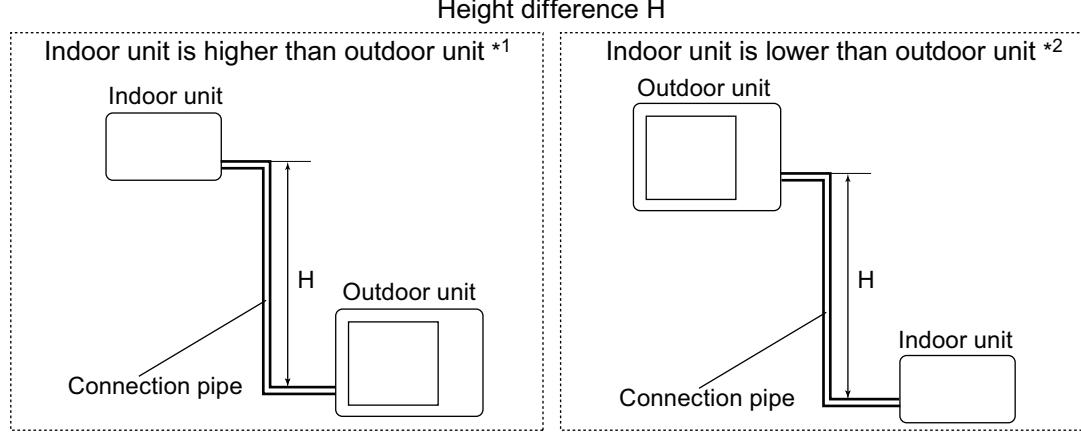

7-1. Model: AOHG14KBTA2

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

■ Indoor unit: 5,000 Btu/h and 7,000 Btu/h

Cooling		Pipe length					
		m	2.5	5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit * ¹	15	—	—	—	0.936	0.908
		10	—	—	0.969	0.943	0.915
		5	—	0.991	0.976	0.950	0.921
		2.5	0.993	0.993	0.978	0.952	0.923
		0	1.000	1.000	0.985	0.959	0.930
	Indoor unit is lower than outdoor unit * ²	-2.5	1.000	1.000	0.985	0.959	0.930
		-5	—	1.000	0.985	0.959	0.930
		-10	—	—	0.985	0.959	0.930
		-15	—	—	—	0.959	0.930

Heating		Pipe length					
		m	2.5	5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit * ¹	15	—	—	—	0.937	0.915
		10	—	—	0.956	0.937	0.915
		5	—	1.000	0.956	0.937	0.915
		2.5	0.990	1.000	0.956	0.937	0.915
		0	0.990	1.000	0.956	0.937	0.915
	Indoor unit is lower than outdoor unit * ²	-2.5	0.986	0.996	0.952	0.933	0.911
		-5	—	0.994	0.950	0.931	0.909
		-10	—	—	0.946	0.928	0.906
		-15	—	—	—	0.923	0.901

■ Indoor unit: 9,000 Btu/h

OUTDOOR UNIT
AOHG14-18KBTA2OUTDOOR UNIT
AOHG14-18KBTA2

Cooling		Pipe length					
		m	2.5	5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	—	—	—	0.924	0.891
		10	—	—	0.962	0.931	0.899
		5	—	0.991	0.968	0.938	0.905
		2.5	0.993	0.993	0.970	0.940	0.907
		0	1.000	1.000	0.977	0.946	0.913
Height difference H (m)	Indoor unit is lower than outdoor unit *2	-2.5	1.000	1.000	0.977	0.946	0.913
		-5	—	1.000	0.977	0.946	0.913
		-10	—	—	0.977	0.946	0.913
		-15	—	—	—	0.946	0.913

Heating		Pipe length					
		m	2.5	5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	—	—	—	0.937	0.914
		10	—	—	0.956	0.937	0.914
		5	—	1.000	0.956	0.937	0.914
		2.5	0.990	1.000	0.956	0.937	0.914
		0	0.990	1.000	0.956	0.937	0.914
Height difference H (m)	Indoor unit is lower than outdoor unit *2	-2.5	0.986	0.996	0.952	0.933	0.910
		-5	—	0.994	0.950	0.931	0.908
		-10	—	—	0.946	0.927	0.905
		-15	—	—	—	0.923	0.900

■ Indoor unit: 12,000 Btu/h

Cooling		Pipe length					
		m	2.5	5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	—	—	—	0.914	0.877
		10	—	—	0.959	0.921	0.884
		5	—	0.991	0.965	0.928	0.890
		2.5	0.993	0.993	0.967	0.930	0.893
		0	1.000	1.000	0.974	0.936	0.899
Height difference H (m)	Indoor unit is lower than outdoor unit *2	-2.5	1.000	1.000	0.974	0.936	0.899
		-5	—	1.000	0.974	0.936	0.899
		-10	—	—	0.974	0.936	0.899
		-15	—	—	—	0.936	0.899

Heating		Pipe length					
		m	2.5	5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	—	—	—	0.936	0.914
		10	—	—	0.955	0.936	0.914
		5	—	1.000	0.955	0.936	0.914
		2.5	0.992	1.000	0.955	0.936	0.914
		0	0.992	1.000	0.955	0.936	0.914
Height difference H (m)	Indoor unit is lower than outdoor unit *2	-2.5	0.988	0.996	0.951	0.932	0.910
		-5	—	0.994	0.949	0.930	0.908
		-10	—	—	0.945	0.927	0.905
		-15	—	—	—	0.922	0.900

7-2. Model: AOHG18KBTA2

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

■ Indoor unit: 5,000 Btu/h and 7,000 Btu/h

Cooling		Pipe length					
		m	2.5	5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	—	—	—	0.940	0.914
		10	—	—	0.973	0.948	0.921
		5	—	0.991	0.980	0.955	0.928
		2.5	0.993	0.993	0.982	0.957	0.930
	Indoor unit is lower than outdoor unit *2	0	1.000	1.000	0.989	0.963	0.936
		-2.5	1.000	1.000	0.989	0.963	0.936
		-5	—	1.000	0.989	0.963	0.936
		-10	—	—	0.989	0.963	0.936
		-15	—	—	—	0.963	0.936

Heating		Pipe length					
		m	2.5	5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	—	—	—	0.942	0.925
		10	—	—	0.959	0.942	0.925
		5	—	1.000	0.959	0.942	0.925
		2.5	0.990	1.000	0.959	0.942	0.925
	Indoor unit is lower than outdoor unit *2	0	0.990	1.000	0.959	0.942	0.925
		-2.5	0.986	0.996	0.955	0.938	0.921
		-5	—	0.994	0.953	0.936	0.919
		-10	—	—	0.949	0.933	0.916
		-15	—	—	—	0.928	0.911

■ Indoor unit: 9,000 Btu/h

Cooling		Pipe length					
		m	2.5	5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	—	—	—	0.928	0.898
		10	—	—	0.966	0.936	0.905
		5	—	0.991	0.972	0.942	0.911
		2.5	0.993	0.993	0.974	0.944	0.913
	Indoor unit is lower than outdoor unit *2	0	1.000	1.000	0.981	0.951	0.920
		-2.5	1.000	1.000	0.981	0.951	0.920
		-5	—	1.000	0.981	0.951	0.920
		-10	—	—	0.981	0.951	0.920
		-15	—	—	—	0.951	0.920

Heating		Pipe length					
		m	2.5	5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	—	—	—	0.942	0.924
		10	—	—	0.959	0.942	0.924
		5	—	1.000	0.959	0.942	0.924
		2.5	0.990	1.000	0.959	0.942	0.924
	Indoor unit is lower than outdoor unit *2	0	0.990	1.000	0.959	0.942	0.924
		-2.5	0.986	0.996	0.955	0.938	0.920
		-5	—	0.994	0.953	0.936	0.918
		-10	—	—	0.949	0.932	0.915
		-15	—	—	—	0.928	0.910

■ Indoor unit: 12,000 Btu/h

Cooing		Pipe length					
		m	2.5	5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	—	—	—	0.919	0.883
		10	—	—	0.962	0.926	0.891
		5	—	0.991	0.969	0.933	0.897
		2.5	0.993	0.993	0.971	0.935	0.899
		0	1.000	1.000	0.978	0.941	0.905
Height difference H (m)	Indoor unit is lower than outdoor unit *2	-2.5	1.000	1.000	0.978	0.941	0.905
		-5	—	1.000	0.978	0.941	0.905
		-10	—	—	0.978	0.941	0.905
		-15	—	—	—	0.941	0.905

Heating		Pipe length					
		m	2.5	5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	—	—	—	0.941	0.924
		10	—	—	0.958	0.941	0.924
		5	—	1.000	0.958	0.941	0.924
		2.5	0.992	1.000	0.958	0.941	0.924
		0	0.992	1.000	0.958	0.941	0.924
Height difference H (m)	Indoor unit is lower than outdoor unit *2	-2.5	0.988	0.996	0.954	0.937	0.920
		-5	—	0.994	0.952	0.935	0.918
		-10	—	—	0.948	0.932	0.915
		-15	—	—	—	0.927	0.910

■ Indoor unit: 14,000 Btu/h

Cooing		Pipe length					
		m	2.5	5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	—	—	—	0.913	0.873
		10	—	—	0.959	0.919	0.882
		5	—	0.991	0.967	0.927	0.888
		2.5	0.993	0.993	0.969	0.929	0.890
		0	1.000	1.000	0.976	0.934	0.895
Height difference H (m)	Indoor unit is lower than outdoor unit *2	-2.5	1.000	1.000	0.976	0.934	0.895
		-5	—	1.000	0.976	0.934	0.895
		-10	—	—	0.976	0.934	0.895
		-15	—	—	—	0.934	0.895

Heating		Pipe length					
		m	3	7.5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	—	—	—	0.940	0.924
		10	—	—	0.957	0.940	0.924
		5	—	1.000	0.957	0.940	0.924
		2.5	0.993	1.000	0.957	0.940	0.924
		0	0.993	1.000	0.957	0.940	0.924
Height difference H (m)	Indoor unit is lower than outdoor unit *2	-2.5	0.989	0.996	0.953	0.936	0.920
		-5	—	0.994	0.951	0.934	0.918
		-10	—	—	0.947	0.932	0.915
		-15	—	—	—	0.926	0.910

8. Additional charge calculation

8-1. Model: AOHG14KBTA2

Refrigerant type	R32
Refrigerant amount	900

■ Refrigerant charge

Total pipe length	m	20 or less	30 (Max.)	20 g/m
Additional charge	g	0	200	

8-2. Model: AOHG18KBTA2

Refrigerant type	R32
Refrigerant amount	1,020

■ Refrigerant charge

Total pipe length	m	20 or less	30 (Max.)	20 g/m
Additional charge	g	0	200	

9. Airflow

9-1. Model: AOHG14KBTA2

● Cooling

m ³ /h	1,670
l/s	464
CFM	983

● Heating

m ³ /h	1,670
l/s	464
CFM	983

9-2. Model: AOHG18KBTA2

● Cooling

m ³ /h	1,960
l/s	544
CFM	1,154

● Heating


m ³ /h	2,020
l/s	561
CFM	1,189

10. Operation noise (sound pressure)


10-1. Noise level curve

■ Model: AOHG14KBTA2

● Cooling

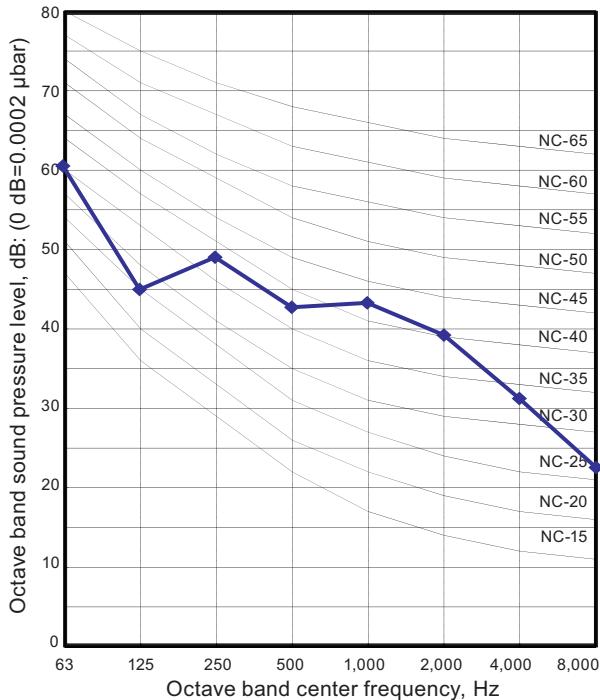


● Heating

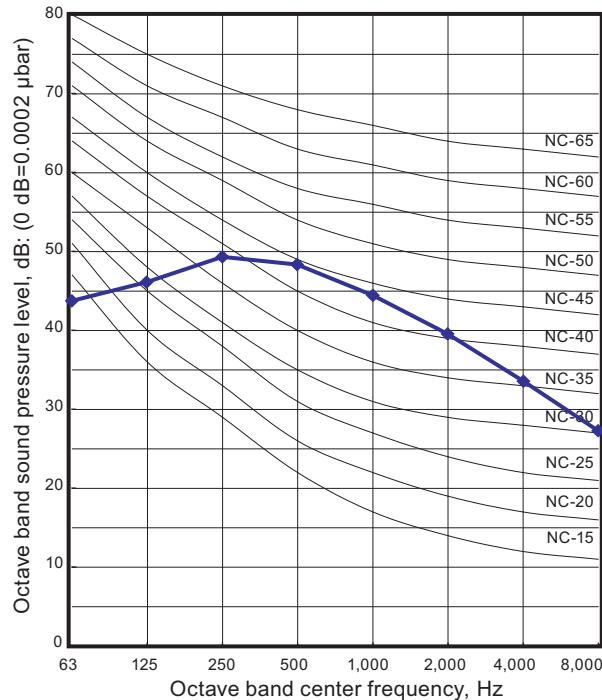


■ Model: AOHG18KBTA2


● Cooling

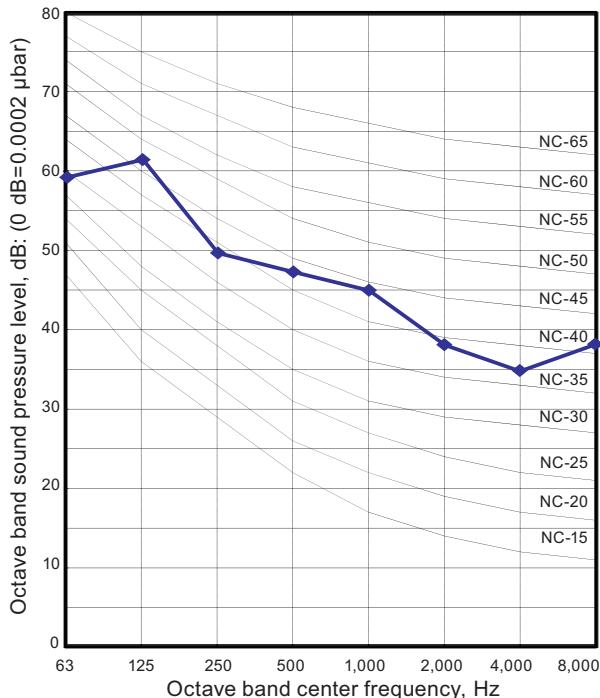

● Heating

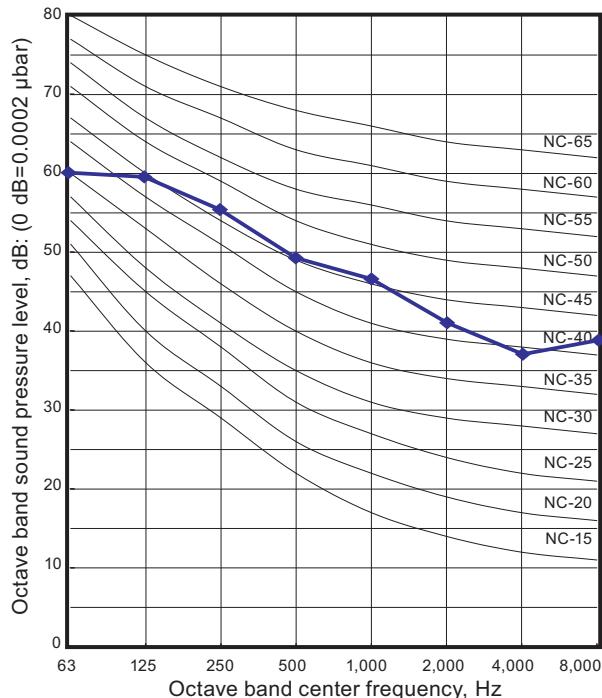

10-2. Sound level check point

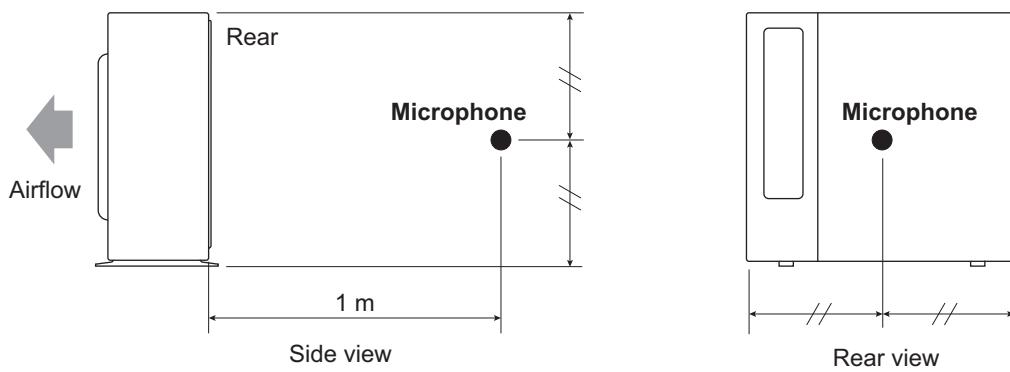

NOTE: Detailed shape of the actual outdoor unit might be slightly different from the one illustrated above.

11. Electrical characteristics

Model name			AOHG14KBTA2	AOHG18KBTA2
Power supply	Voltage	V	230 ~	
	Frequency	Hz	50	
Maximum operating current *1			A	10.9 11.6
Starting current			A	4.7 5.6
Wiring spec. *2	Main fuse (Circuit breaker) current	A	15	
	Power cable	mm ²	1.5	
	Connection cable *3	Cross-sectional area		1.5
		Limited wiring length	m	21

*1: Maximum operating current is the total current of the indoor unit and the outdoor unit.

*2: Selected sample based on Japan Electrotechnical Standards and Codes Committee E0005. As the regulations of wire size and circuit breaker differ in each country or region, select appropriate devices complied to the regional standard.

*3: This is the wiring length in case voltage descent is less than 2%. When the wiring length becomes longer, select the wiring of a more larger diameter.

12. Safety devices

Type of protection	Protection form	Model	
		AOHG14KBTA2	AOHG18KBTA2
Circuit protection	Current fuse (Main PCB)	250 V, 5 A 250 V, 20 A 250 V, 3.15 A	250 V, 5 A 250 V, 25 A 250 V, 3.15 A
Fan motor protection	Thermal protector	Activate	127 ±5 °C Fan motor stop
		Reset	95 °C or less Fan motor restart
Compressor protection	Temperature thermistor (Discharge temp.)	Activate	110 °C Compressor stop
		Reset	After 7 minutes Compressor restart
	Temperature thermistor (Compressor bottom temp.)	Activate	— 108 °C Compressor stop
		Reset	— After 3 minutes, and 80 °C or less Compressor restart
	Thermal protection program (Outdoor temp.) (Only in COOL or DRY mode)	Activate	-20 °C Compressor stop
		Reset	-15 °C Compressor restart

13. Accessories

13-1. Models: AOHG14KBTA2 and AOHG18KBTA2

Part name	Exterior	Qty	Part name	Exterior	Qty
Installation manual		1	Drain pipe		1

14. Outdoor unit installation precautions

NOTE: The information listed below are general precautions.

Some models also include items that do not apply.

14-1. Places where prohibited for use

- Places where there is a danger of combustible gas leakage.
- Places where sulfur gas, chlorine gas, acid, alkali, or other matter which effects equipment is generated.
- Places affected by heat radiation from other heat sources.
- Places where the air is stagnant.
- Places where machinery which generates high frequencies is used.
- Ocean beaches and other areas where there is a lot of salt.
- Inside of vehicles, ships, and other conveyances.
- Places where voltage fluctuations are large such as a factory.

14-2. Points to remember when installing

- The product shall be installed at a place which can withstand the weight and vibration of the outdoor unit.
- To allow maintenance after refrigerant piping, drain piping, and the connection/installation of electric wiring, provide an maintenance space.
Maintenance space is shown in "[Installation space](#)" on page 370.
- Be careful when installing the set at the following places.

Condition	Contents	Countermeasures (Reference)
When installed near adjacent houses.	Perform installation work so that operating sound does not disturb the neighbors.	<ol style="list-style-type: none"> Install a soundproof barrier. Change the installation site.
When there is the possibility of strong wind.	<ul style="list-style-type: none"> If the outdoor unit is exposed to strong wind, capacity may drop, frost may form during heating, and operation may be stopped by high pressure rise. In addition, when a very strong wind blows, the fan may be damaged. When a very strong wind blows, there is the possibility of the outdoor unit being toppled over if held only by foundation bolts. 	<ol style="list-style-type: none"> Install the outdoor unit with keeping a sufficient distance between the outlet side of the unit and a facing wall or fence. Make the outlet direction and wind direction perpendicular. Fasten the outdoor unit using toppling prevention hardware (purchased locally).
When snow accumulates.	If the outdoor unit is covered by accumulated snow, it may not be able to operate.	<ol style="list-style-type: none"> Make the foundation as high as possible. Perform snow prevention work.
When installing the inverter type.	It may generate noise in TV sets, stereos and PCs.	The inverter type should be installed at a sufficient distance from these equipments.